

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918154

Luminaire Tested: DFN2DIP-TR3F0-080D090US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918154
REPORT IS A COMBINATION OF REPORTS P900365 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-080D090US930-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12951.0 lumens
Efficiency: N/A
Efficacy: 85.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 151.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918154

CATALOG NUMBER: DFN2DIP-TR3F0-080D090US930-FLLFLL

Luminous Intensity Polar Plot

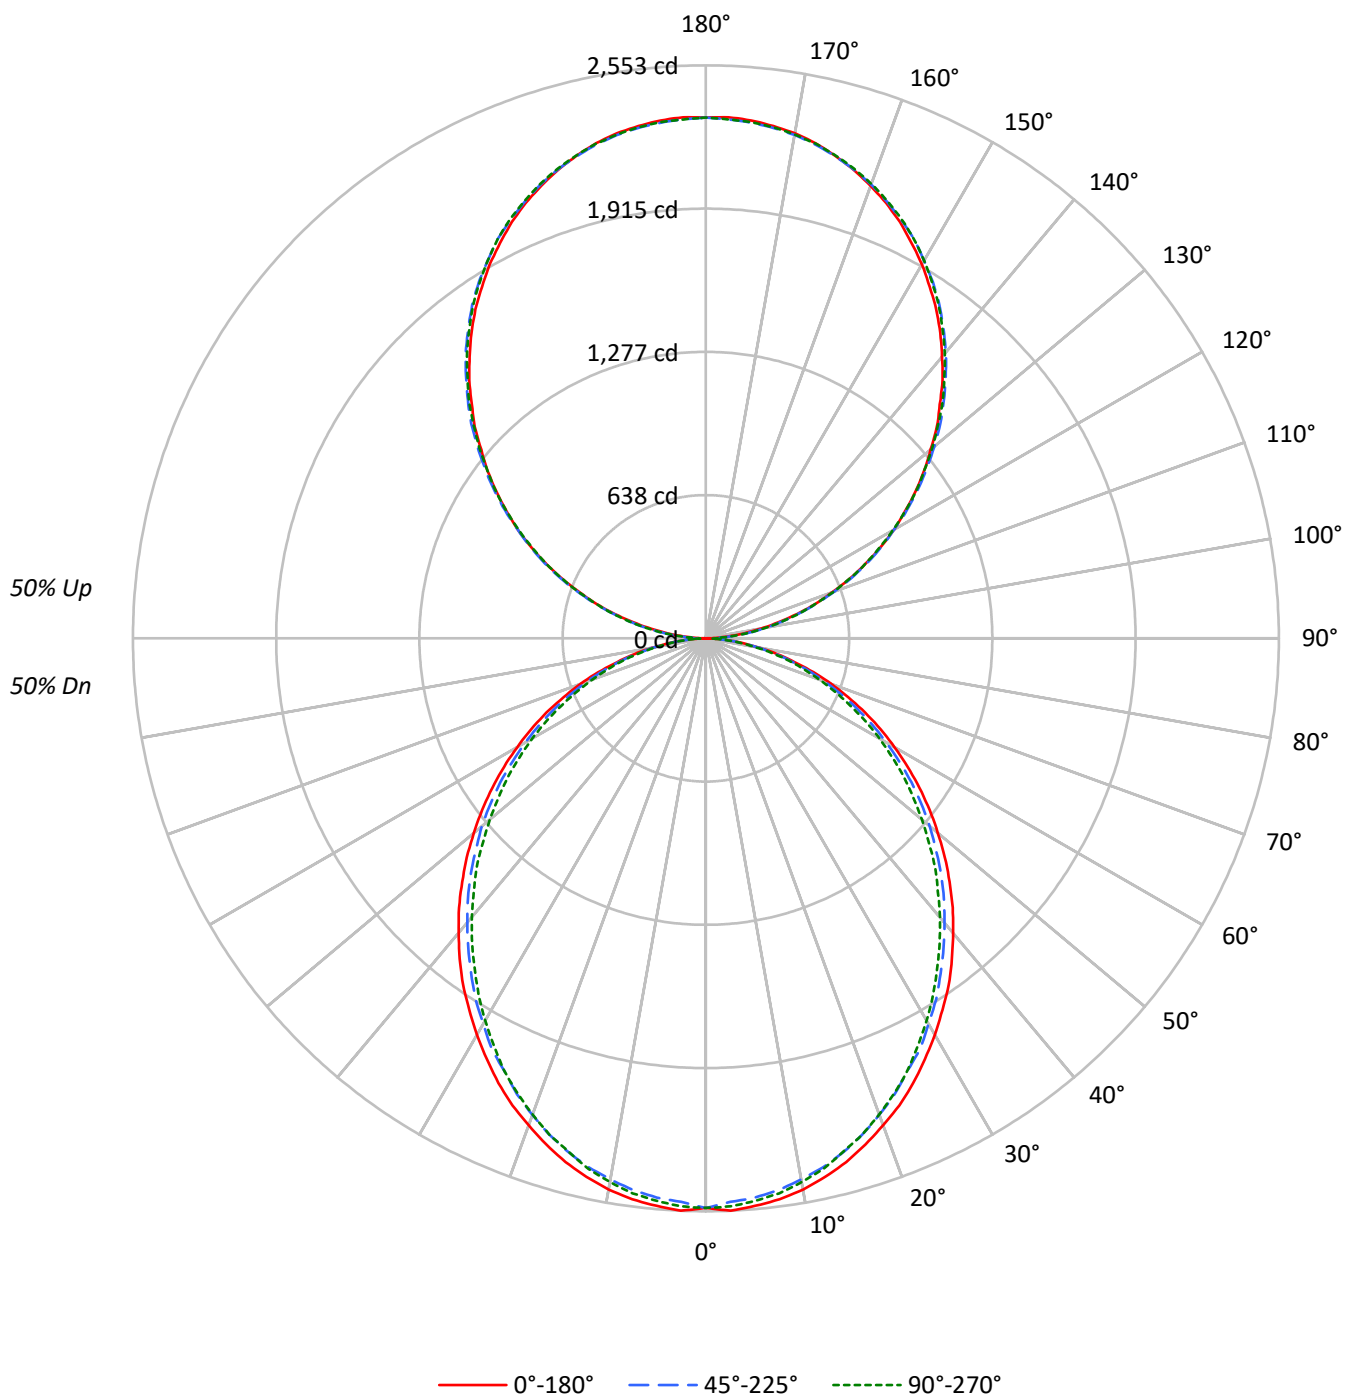

TEST NUMBER: P918154

CATALOG NUMBER: DFN2DIP-TR3F0-080D090US930-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	75	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	63	56	50	68	59	52	46	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	25
6	63	51	43	37	58	47	40	35	40	35	31	34	30	26	28	25	22
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	22	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3162	3162	3162
5°	3166	3116	3137
10°	3138	3071	3093
15°	3091	3018	3024
20°	3026	2945	2954
25°	2963	2858	2874
30°	2883	2778	2772
35°	2807	2683	2664
40°	2715	2587	2561
45°	2622	2490	2456
50°	2521	2389	2335
55°	2415	2272	2222
60°	2295	2133	2093
65°	2163	1989	1942
70°	1996	1813	1778
75°	1765	1603	1623
80°	1486	1334	1334
85°	1050	878	861

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2622 cd/sqm

TEST NUMBER: P918154

CATALOG NUMBER: DFN2DIP-TR3F0-080D090US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	238.9	1.8
10°-20°	672.1	5.2
20°-30°	987.7	7.6
30°-40°	1147.1	8.9
40°-50°	1145.7	8.8
50°-60°	999.0	7.7
60°-70°	738.5	5.7
70°-80°	417.8	3.2
80°-90°	116.9	0.9
90°-100°	143.6	1.1
100°-110°	456.3	3.5
110°-120°	780.8	6.0
120°-130°	1026.9	7.9
130°-140°	1152.6	8.9
140°-150°	1130.3	8.7
150°-160°	948.2	7.3
160°-170°	628.8	4.9
170°-180°	219.8	1.7
0°-30°	1898.6	14.7
0°-40°	3045.8	23.5
0°-60°	5190.5	40.1
0°-90°	6463.8	49.9
90°-120°	1380.7	10.7
90°-150°	4690.5	36.2
90°-180°	6487.0	50.1
0°-180°	12951.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2538	2538	2538	2538	2538	
5°	2538	2528	2501	2521	2516	241
15°	2416	2402	2370	2379	2367	680
25°	2186	2167	2126	2130	2126	1006
35°	1886	1862	1823	1808	1796	1178
45°	1535	1518	1481	1455	1445	1185
55°	1162	1147	1118	1088	1076	1039
65°	784	769	744	722	710	775
75°	410	405	393	378	383	438
85°	100	98	95	88	85	112
90°	2	25	69	64	66	13
95°	102	122	125	125	122	114
105°	421	427	431	434	434	444
115°	784	795	791	789	784	775
125°	1140	1157	1152	1145	1143	1018
135°	1474	1496	1500	1498	1492	1139
145°	1790	1804	1815	1817	1809	1118
155°	2046	2052	2058	2068	2062	942
165°	2226	2224	2224	2238	2228	628
175°	2316	2311	2307	2321	2309	220
180°	2321	2321	2321	2321	2321	

TEST NUMBER: P918154

CATALOG NUMBER: DFN2DIP-TR3F0-080D090US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2537.9	2537.9	2537.9	2537.9	2537.9
2.5°	2552.6	2540.5	2513.6	2537.9	2533.2
5°	2537.9	2528.3	2501.4	2520.8	2516.2
7.5°	2520.8	2506.3	2479.4	2499.1	2494.2
10°	2494.2	2477.0	2447.8	2467.2	2460.0
12.5°	2457.4	2442.9	2413.6	2425.8	2420.9
15°	2416.0	2401.5	2369.6	2379.4	2367.3
17.5°	2364.7	2350.2	2318.3	2330.5	2318.3
20°	2308.5	2294.0	2259.8	2267.1	2257.5
22.5°	2252.6	2230.6	2198.7	2198.7	2193.8
25°	2186.5	2167.1	2125.7	2130.4	2125.7
27.5°	2113.3	2096.2	2064.6	2057.3	2045.2
30°	2040.3	2020.6	1984.1	1976.9	1967.0
32.5°	1962.1	1947.6	1908.5	1893.7	1883.9
35°	1886.4	1862.1	1823.0	1808.2	1796.1
37.5°	1801.0	1779.0	1739.9	1722.8	1710.7
40°	1713.3	1693.5	1654.5	1632.7	1622.9
42.5°	1627.8	1608.1	1569.3	1544.7	1530.2
45°	1535.1	1518.0	1481.2	1454.6	1444.8
47.5°	1444.8	1427.7	1388.5	1361.6	1347.1
50°	1349.5	1337.3	1303.1	1268.9	1256.8
52.5°	1256.8	1239.7	1208.1	1181.2	1164.1
55°	1161.7	1147.0	1117.8	1088.5	1076.3
57.5°	1066.5	1054.3	1022.5	993.2	983.3
60°	971.2	961.6	927.4	900.5	893.2
62.5°	878.5	861.4	837.1	812.8	802.9
65°	783.5	768.7	744.4	722.4	710.2
67.5°	685.8	673.4	651.7	634.6	624.8
70°	595.5	585.6	563.7	546.6	537.0
72.5°	502.8	493.0	480.8	463.7	456.5
75°	409.9	405.2	392.8	378.3	383.2
77.5°	327.0	317.2	312.3	305.0	297.7
80°	244.2	241.6	236.7	229.4	224.5
82.5°	166.0	166.0	163.6	153.8	153.8
85°	100.0	97.6	95.3	87.8	85.4
87.5°	44.0	39.1	34.2	26.9	24.4
90°	2.1	25.2	68.6	64.3	66.4
92.5°	43.4	58.8	60.9	62.9	62.9
95°	102.2	121.7	125.2	125.2	121.7
97.5°	170.0	188.2	195.9	195.9	195.9
100°	248.3	264.5	270.0	270.0	268.0
102.5°	330.9	342.8	350.5	352.6	350.5
105°	421.2	426.7	431.0	434.5	434.5
107.5°	510.7	519.1	519.1	520.5	510.7
110°	597.5	608.7	608.7	608.7	603.1

TEST NUMBER: P918154

CATALOG NUMBER: DFN2DIP-TR3F0-080D090US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	691.2	703.1	701.0	695.4	691.2
115°	783.6	794.8	791.2	789.2	783.6
117.5°	875.2	890.6	880.8	875.2	869.6
120°	967.6	982.9	967.6	967.6	961.2
122.5°	1051.5	1071.1	1061.4	1055.7	1051.5
125°	1139.7	1157.2	1151.6	1145.2	1143.2
127.5°	1225.7	1247.4	1239.7	1231.3	1225.7
130°	1306.2	1331.4	1327.9	1323.6	1316.0
132.5°	1396.4	1416.0	1417.4	1407.6	1402.1
135°	1474.1	1495.7	1500.0	1497.9	1492.3
137.5°	1560.8	1578.3	1581.8	1580.5	1572.1
140°	1637.1	1654.6	1664.3	1664.3	1656.7
142.5°	1715.5	1732.9	1738.5	1740.7	1732.9
145°	1789.7	1803.6	1814.8	1816.9	1809.2
147.5°	1856.1	1873.6	1882.0	1885.5	1877.8
150°	1924.7	1936.6	1944.2	1950.5	1944.2
152.5°	1985.5	1997.4	2007.2	2014.9	2007.2
155°	2046.4	2051.9	2058.3	2068.1	2061.8
157.5°	2098.8	2103.1	2106.6	2120.5	2110.7
160°	2145.7	2149.9	2152.1	2163.9	2155.5
162.5°	2189.1	2189.1	2191.2	2204.5	2194.7
165°	2226.2	2224.1	2224.1	2238.1	2228.3
167.5°	2259.8	2253.5	2253.5	2267.4	2257.6
170°	2285.0	2279.3	2277.3	2291.2	2279.3
172.5°	2302.4	2296.9	2294.7	2308.8	2296.9
175°	2316.4	2310.8	2306.6	2320.7	2308.8
177.5°	2324.1	2318.5	2314.3	2326.2	2314.3
180°	2320.7	2320.7	2320.7	2320.7	2320.7

TEST NUMBER: P918154

CATALOG NUMBER: DFN2DIP-TR3F0-080D090US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.21	12.07	12.17	13.04	14.32	10.78	11.64	11.74	12.62	13.89
	3H	12.86	13.63	13.83	14.62	15.91	12.39	13.17	13.36	14.15	15.44
	4H	13.44	14.17	14.43	15.16	16.46	12.98	13.71	13.96	14.69	16.00
	6H	13.84	14.51	14.83	15.50	16.82	13.37	14.04	14.36	15.03	16.35
	8H	13.94	14.58	14.94	15.59	16.90	13.47	14.11	14.47	15.12	16.43
	12H	13.98	14.59	14.99	15.59	16.93	13.51	14.12	14.51	15.12	16.46
4H	2H	11.67	12.40	12.66	13.39	14.69	11.33	12.06	12.31	13.04	14.35
	3H	13.52	14.13	14.52	15.15	16.47	13.13	13.74	14.13	14.76	16.08
	4H	14.23	14.79	15.24	15.80	17.14	13.83	14.39	14.84	15.40	16.74
	6H	14.74	15.22	15.75	16.25	17.59	14.33	14.81	15.35	15.84	17.18
	8H	14.88	15.33	15.90	16.36	17.71	14.48	14.92	15.49	15.95	17.30
	12H	14.95	15.36	15.99	16.40	17.75	14.54	14.94	15.57	15.98	17.34
8H	4H	14.42	14.87	15.44	15.90	17.25	14.07	14.52	15.09	15.54	16.89
	6H	15.04	15.41	16.09	16.48	17.83	14.69	15.06	15.73	16.12	17.47
	8H	15.26	15.58	16.31	16.64	18.01	14.89	15.22	15.95	16.27	17.64
	12H	15.38	15.67	16.44	16.72	18.13	15.00	15.29	16.06	16.34	17.75
12H	4H	14.41	14.81	15.45	15.85	17.21	14.06	14.46	15.10	15.50	16.86
	6H	15.07	15.40	16.12	16.45	17.82	14.72	15.05	15.77	16.10	17.47
	8H	15.31	15.59	16.36	16.64	18.05	14.95	15.24	16.01	16.29	17.70