

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918157

Luminaire Tested: DFN2DIP-TR3F0-090D030US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918157
REPORT IS A COMBINATION OF REPORTS P901803 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-090D030US930-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9685.8 lumens
Efficiency: N/A
Efficacy: 82.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 117.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918157

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US930-FLLONL

Luminous Intensity Polar Plot

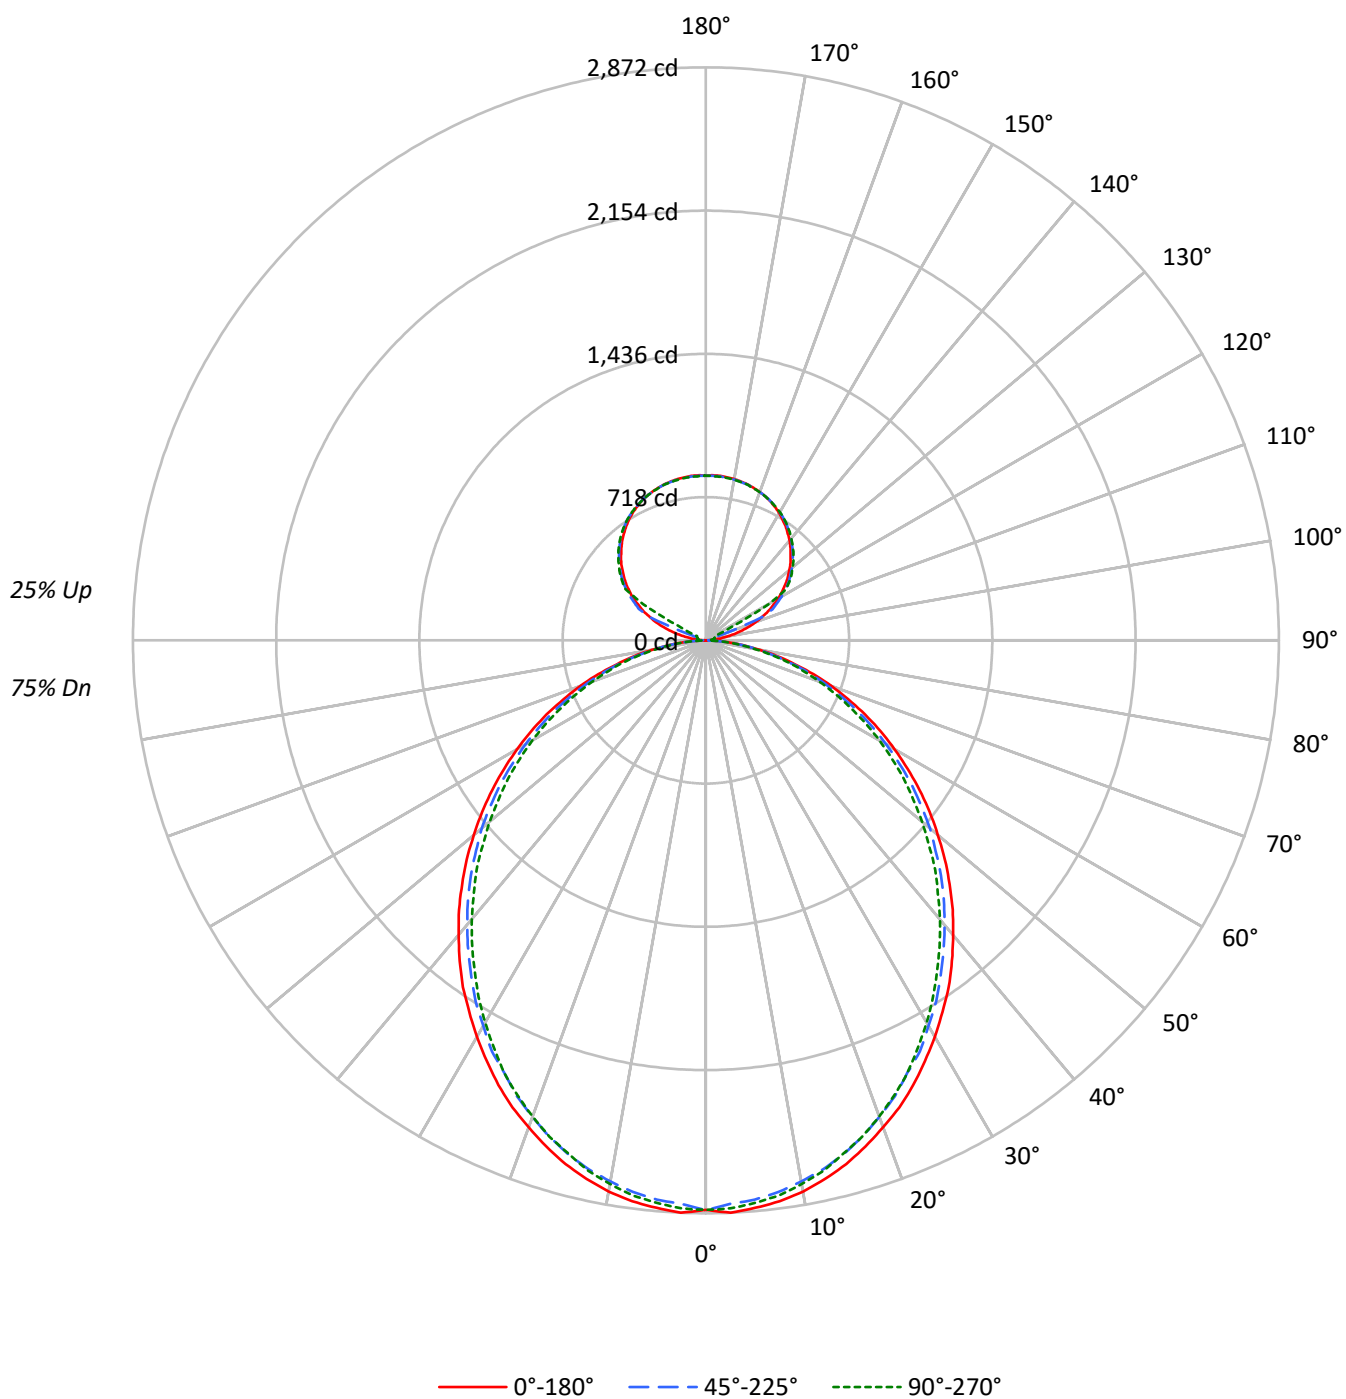

TEST NUMBER: P918157

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US930-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	108	108	108	108	97	97	97	88	88	88	79	79	79
1	103	99	95	91	98	94	91	87	85	83	80	77	75	73	70	68	67
2	94	86	80	75	89	82	77	72	75	70	66	68	64	61	62	59	56
3	86	76	68	62	81	73	66	60	66	61	56	60	56	52	55	51	48
4	79	67	59	53	75	64	57	51	59	53	48	54	49	45	49	45	41
5	72	60	52	46	69	58	50	44	53	46	41	48	43	39	44	40	36
6	67	54	46	40	63	52	44	39	48	41	36	44	38	34	40	35	32
7	62	49	41	35	59	47	39	34	43	37	32	40	34	30	37	32	28
8	58	45	37	31	55	43	36	30	40	33	29	37	31	27	34	29	25
9	54	41	33	28	51	39	32	27	37	30	26	34	28	24	31	26	23
10	50	38	30	25	48	36	29	25	34	28	23	31	26	22	29	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3558	3558	3558
5°	3561	3505	3529
10°	3531	3455	3479
15°	3477	3395	3402
20°	3405	3313	3324
25°	3333	3216	3233
30°	3243	3125	3118
35°	3158	3018	2997
40°	3054	2910	2882
45°	2950	2801	2763
50°	2836	2687	2627
55°	2717	2556	2500
60°	2581	2400	2355
65°	2434	2238	2185
70°	2245	2040	2000
75°	1985	1803	1826
80°	1671	1500	1501
85°	1180	988	969

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2950 cd/sqm

TEST NUMBER: P918157

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	268.7	2.8
10°-20°	756.1	7.8
20°-30°	1111.2	11.5
30°-40°	1290.5	13.3
40°-50°	1288.9	13.3
50°-60°	1123.9	11.6
60°-70°	830.8	8.6
70°-80°	470.1	4.9
80°-90°	125.5	1.3
90°-100°	27.2	0.3
100°-110°	101.5	1.0
110°-120°	269.1	2.8
120°-130°	446.3	4.6
130°-140°	474.1	4.9
140°-150°	440.6	4.5
150°-160°	354.3	3.7
160°-170°	228.3	2.4
170°-180°	78.6	0.8
0°-30°	2136.0	22.1
0°-40°	3426.5	35.4
0°-60°	5839.4	60.3
0°-90°	7265.8	75.0
90°-120°	397.8	4.1
90°-150°	1758.9	18.2
90°-180°	2420.0	25.0
0°-180°	9685.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2855	2855	2855	2855	2855	
5°	2855	2844	2814	2836	2831	271
15°	2718	2702	2666	2677	2663	765
25°	2460	2438	2391	2397	2391	1132
35°	2122	2095	2051	2034	2021	1325
45°	1727	1708	1666	1636	1625	1333
55°	1307	1290	1257	1225	1211	1169
65°	881	865	837	813	799	871
75°	461	456	442	426	431	492
85°	112	110	107	99	96	125
90°	1	7	12	15	16	9
95°	39	19	23	26	26	46
105°	182	200	36	43	45	194
115°	343	354	368	92	49	338
125°	486	493	505	509	511	433
135°	601	610	616	622	621	464
145°	697	696	707	711	708	436
155°	768	762	769	773	768	354
165°	809	805	807	811	807	228
175°	827	823	824	828	822	79
180°	826	826	826	826	826	

TEST NUMBER: P918157

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US930-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2855.1	2855.1	2855.1	2855.1	2855.1
2.5°	2871.7	2858.0	2827.8	2855.1	2849.9
5°	2855.1	2844.3	2814.1	2835.9	2830.6
7.5°	2835.9	2819.6	2789.3	2811.5	2805.9
10°	2805.9	2786.7	2753.8	2775.6	2767.4
12.5°	2764.5	2748.2	2715.4	2729.0	2723.5
15°	2718.0	2701.7	2665.8	2676.9	2663.2
17.5°	2660.2	2643.9	2608.1	2621.8	2608.1
20°	2597.1	2580.7	2542.3	2550.4	2539.7
22.5°	2534.1	2509.4	2473.5	2473.5	2468.0
25°	2459.8	2438.0	2391.4	2396.7	2391.4
27.5°	2377.4	2358.2	2322.7	2314.6	2300.9
30°	2295.3	2273.1	2232.0	2223.9	2212.9
32.5°	2207.3	2191.0	2147.0	2130.5	2119.4
35°	2122.3	2094.9	2050.9	2034.3	2020.6
37.5°	2026.2	2001.4	1957.4	1938.2	1924.5
40°	1927.4	1905.3	1861.2	1836.8	1825.8
42.5°	1831.2	1809.1	1765.4	1737.8	1721.5
45°	1727.0	1707.8	1666.4	1636.4	1625.4
47.5°	1625.4	1606.1	1562.1	1531.9	1515.6
50°	1518.2	1504.5	1466.0	1427.6	1413.9
52.5°	1413.9	1394.6	1359.1	1328.9	1309.6
55°	1307.0	1290.4	1257.4	1224.6	1210.9
57.5°	1199.8	1186.1	1150.3	1117.4	1106.3
60°	1092.6	1081.8	1043.3	1013.1	1004.9
62.5°	988.3	969.1	941.7	914.4	903.3
65°	881.4	864.8	837.4	812.7	799.0
67.5°	771.6	757.7	733.1	714.0	702.9
70°	669.9	658.8	634.1	614.9	604.1
72.5°	565.7	554.6	540.9	521.7	513.6
75°	461.1	455.8	441.9	425.6	431.1
77.5°	367.9	356.9	351.3	343.2	335.0
80°	274.7	271.7	266.2	258.0	252.6
82.5°	186.7	186.7	184.1	173.0	173.0
85°	112.4	109.8	107.2	98.7	96.1
87.5°	49.5	43.9	38.5	30.3	27.4
90°	0.6	7.2	11.9	15.0	16.1
92.5°	15.0	12.6	14.3	15.6	16.1
95°	38.8	19.1	23.2	26.3	25.7
97.5°	69.9	21.0	30.4	32.3	32.9
100°	105.7	23.9	34.1	38.8	40.0
102.5°	145.1	144.0	35.2	41.7	43.6
105°	181.6	199.5	36.4	43.0	45.4
107.5°	224.0	238.9	37.7	44.2	46.6
110°	264.6	277.1	104.5	44.8	47.2

TEST NUMBER: P918157

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	302.9	313.6	303.5	46.0	47.8
115°	343.4	353.6	368.5	92.0	49.0
117.5°	378.7	390.6	400.8	315.4	158.9
120°	418.1	427.1	437.8	445.0	364.4
122.5°	451.5	461.1	473.1	476.6	477.3
125°	485.6	493.3	504.8	508.9	510.7
127.5°	516.7	525.0	534.0	540.0	540.5
130°	545.9	555.5	562.1	568.6	568.1
132.5°	575.8	583.6	590.1	595.5	594.9
135°	600.9	610.5	615.8	621.8	620.6
137.5°	627.1	634.3	640.3	646.3	644.5
140°	652.8	657.6	664.1	669.5	666.6
142.5°	674.4	678.6	686.3	691.0	688.1
145°	697.1	696.4	706.6	710.8	707.8
147.5°	716.7	714.9	725.1	728.1	725.7
150°	735.9	731.7	741.3	744.8	741.8
152.5°	751.9	747.2	756.2	759.8	755.6
155°	767.5	762.2	769.3	772.9	768.2
157.5°	780.1	775.3	780.7	784.9	780.1
160°	790.8	787.3	790.8	794.4	790.2
162.5°	800.4	796.8	799.8	804.0	798.6
165°	808.7	805.2	807.0	811.1	807.0
167.5°	815.3	811.7	813.5	817.7	812.4
170°	820.7	817.1	818.3	822.5	817.1
172.5°	824.3	820.7	821.9	826.1	820.7
175°	827.2	823.0	824.3	828.4	822.5
177.5°	828.4	824.3	824.9	829.1	823.7
180°	825.5	825.5	825.5	825.5	825.5

TEST NUMBER: P918157

CATALOG NUMBER: DFN2DIP-TR3F0-090D030US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.68	14.82	14.38	15.55	16.41	13.25	14.39	13.96	15.12	15.98
	3H	15.35	16.38	16.07	17.11	18.01	14.88	15.91	15.60	16.64	17.54
	4H	15.94	16.91	16.68	17.66	18.57	15.47	16.44	16.21	17.19	18.10
	6H	16.35	17.24	17.10	18.00	18.92	15.88	16.77	16.63	17.53	18.45
	8H	16.46	17.31	17.22	18.09	19.01	15.99	16.84	16.75	17.62	18.54
	12H	16.51	17.33	17.28	18.10	19.05	16.04	16.85	16.81	17.62	18.57
4H	2H	14.17	15.14	14.91	15.88	16.79	13.83	14.79	14.57	15.54	16.45
	3H	16.05	16.86	16.80	17.64	18.57	15.66	16.47	16.42	17.25	18.18
	4H	16.77	17.50	17.54	18.29	19.24	16.37	17.10	17.14	17.89	18.84
	6H	17.29	17.93	18.08	18.74	19.70	16.88	17.52	17.67	18.33	19.29
	8H	17.44	18.04	18.23	18.84	19.81	17.03	17.63	17.83	18.44	19.41
	12H	17.52	18.06	18.34	18.89	19.86	17.11	17.64	17.92	18.47	19.45
8H	4H	16.98	17.58	17.77	18.38	19.35	16.62	17.22	17.42	18.03	19.00
	6H	17.61	18.11	18.44	18.95	19.93	17.25	17.75	18.08	18.60	19.57
	8H	17.83	18.27	18.66	19.11	20.10	17.47	17.91	18.30	18.75	19.74
	12H	17.97	18.36	18.80	19.19	20.24	17.59	17.98	18.43	18.81	19.86
12H	4H	16.98	17.52	17.79	18.34	19.32	16.63	17.17	17.44	17.99	18.97
	6H	17.64	18.08	18.48	18.93	19.92	17.30	17.74	18.13	18.58	19.57
	8H	17.89	18.28	18.73	19.11	20.16	17.54	17.93	18.38	18.76	19.81