

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P918161

Luminaire Tested: DFN2DIP-TR3F0-090D040US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P918161
REPORT IS A COMBINATION OF REPORTS P901817 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-090D040US930-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10492.9 lumens
Efficiency: N/A
Efficacy: 84.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 124.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P918161

CATALOG NUMBER: DFN2DIP-TR3F0-090D040US930-FLLONL

Luminous Intensity Polar Plot

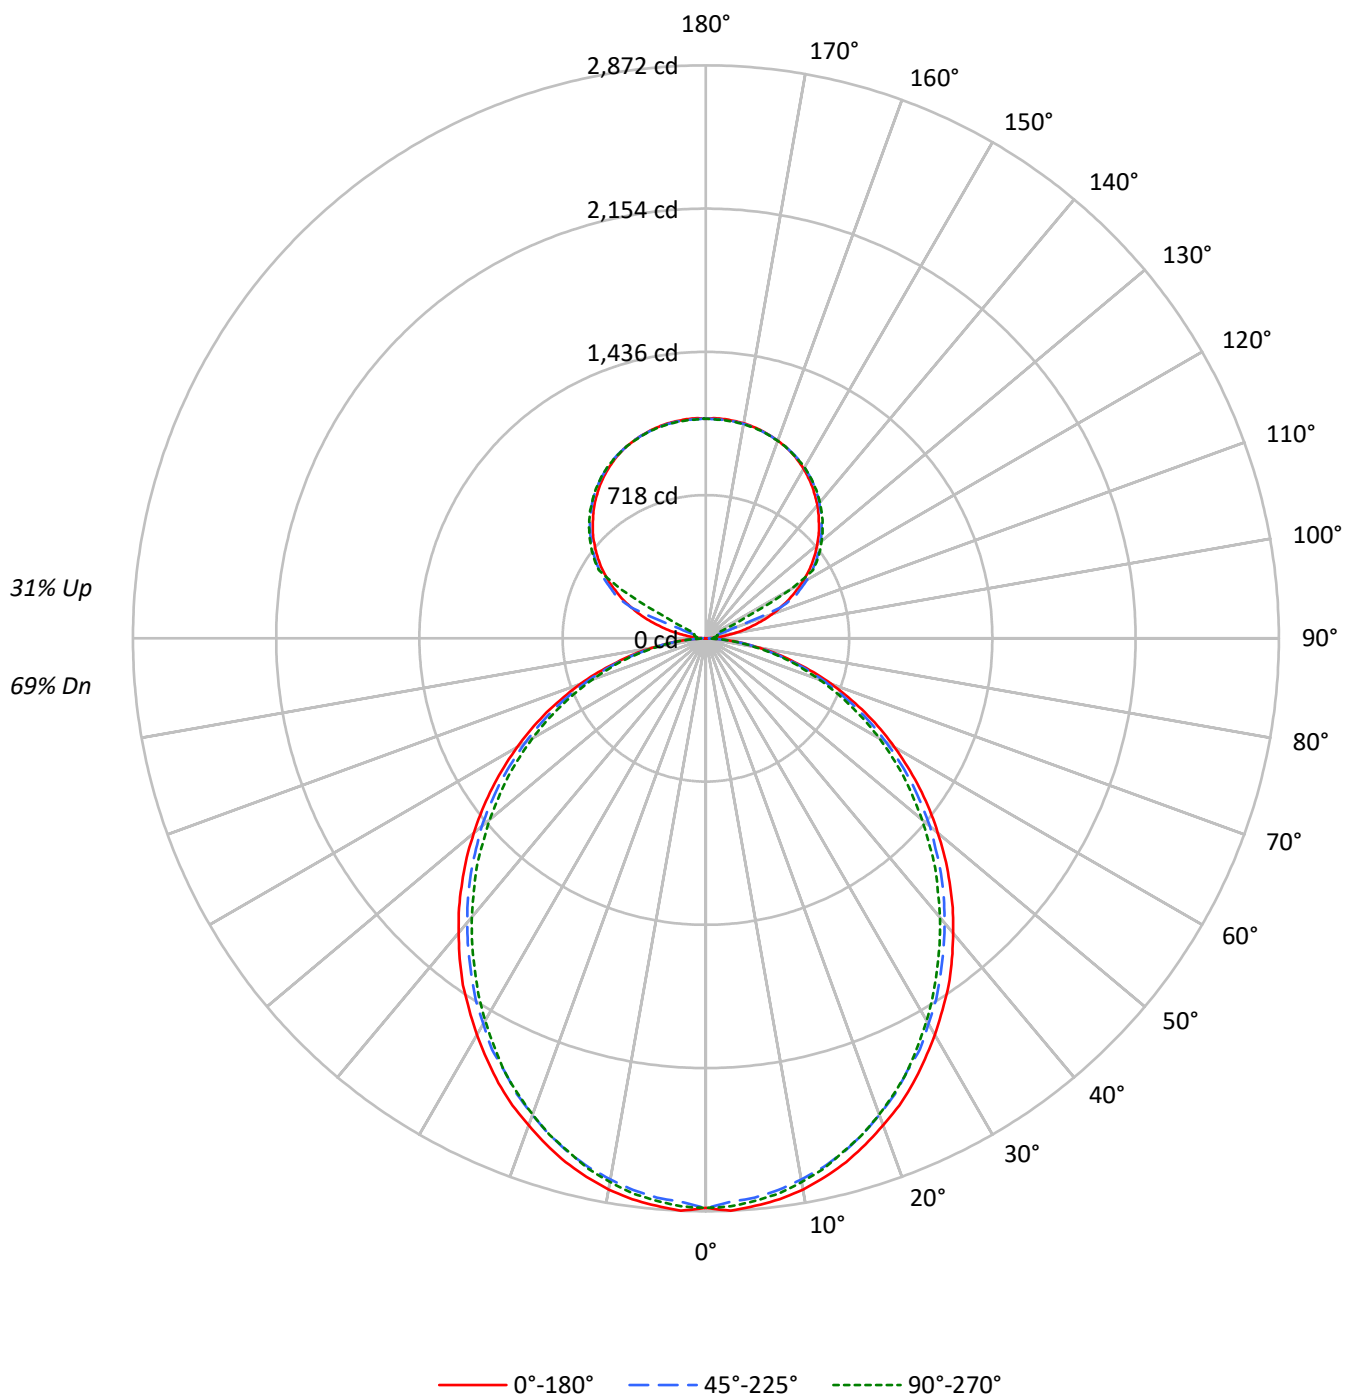

TEST NUMBER: P918161

CATALOG NUMBER: DFN2DIP-TR3F0-090D040US930-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	83	83	83	74	74	74
1	102	98	94	90	96	92	89	86	83	80	77	74	72	70	65	64	62
2	93	85	79	74	88	81	75	70	72	68	64	65	61	58	57	55	53
3	85	75	67	61	80	71	64	59	64	59	54	57	53	49	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	46	42	46	42	39
5	71	59	51	45	67	57	49	43	51	45	40	46	41	37	41	37	34
6	66	53	45	39	62	51	43	38	46	40	35	42	36	32	37	33	30
7	61	48	40	34	58	46	39	33	42	36	31	38	33	29	34	30	26
8	57	44	36	31	54	42	35	30	38	32	28	35	29	26	31	27	24
9	53	40	33	27	50	39	31	27	35	29	25	32	27	23	29	25	21
10	50	37	30	25	47	36	29	24	32	27	22	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3558	3558	3558
5°	3561	3505	3529
10°	3531	3455	3479
15°	3477	3395	3402
20°	3405	3313	3324
25°	3333	3216	3233
30°	3243	3125	3118
35°	3158	3018	2997
40°	3054	2910	2882
45°	2950	2801	2763
50°	2836	2687	2627
55°	2717	2556	2500
60°	2581	2400	2355
65°	2434	2238	2185
70°	2245	2040	2000
75°	1985	1803	1826
80°	1671	1500	1501
85°	1180	988	969

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2950 cd/sqm

TEST NUMBER: P918161

CATALOG NUMBER: DFN2DIP-TR3F0-090D040US930-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	268.7	2.6
10°-20°	756.1	7.2
20°-30°	1111.2	10.6
30°-40°	1290.5	12.3
40°-50°	1288.9	12.3
50°-60°	1123.9	10.7
60°-70°	830.8	7.9
70°-80°	470.1	4.5
80°-90°	126.0	1.2
90°-100°	36.3	0.3
100°-110°	135.3	1.3
110°-120°	358.8	3.4
120°-130°	595.1	5.7
130°-140°	632.1	6.0
140°-150°	587.5	5.6
150°-160°	472.3	4.5
160°-170°	304.4	2.9
170°-180°	104.8	1.0
0°-30°	2136.0	20.4
0°-40°	3426.5	32.7
0°-60°	5839.4	55.7
0°-90°	7266.3	69.2
90°-120°	530.4	5.1
90°-150°	2345.2	22.3
90°-180°	3227.0	30.8
0°-180°	10492.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2855	2855	2855	2855	2855	
5°	2855	2844	2814	2836	2831	271
15°	2718	2702	2666	2677	2663	765
25°	2460	2438	2391	2397	2391	1132
35°	2122	2095	2051	2034	2021	1325
45°	1727	1708	1666	1636	1625	1333
55°	1307	1290	1257	1225	1211	1169
65°	881	865	837	813	799	871
75°	461	456	442	426	431	492
85°	112	110	107	99	96	125
90°	1	10	16	20	21	10
95°	52	25	31	35	34	61
105°	242	266	49	57	60	259
115°	458	471	491	123	65	451
125°	647	658	673	679	681	577
135°	801	814	821	829	828	619
145°	929	929	942	948	944	581
155°	1023	1016	1026	1030	1024	472
165°	1078	1074	1076	1082	1076	305
175°	1103	1097	1099	1105	1097	105
180°	1101	1101	1101	1101	1101	

TEST NUMBER: P918161

CATALOG NUMBER: DFN2DIP-TR3F0-090D040US930-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2855.1	2855.1	2855.1	2855.1	2855.1
2.5°	2871.7	2858.0	2827.8	2855.1	2849.9
5°	2855.1	2844.3	2814.1	2835.9	2830.6
7.5°	2835.9	2819.6	2789.3	2811.5	2805.9
10°	2805.9	2786.7	2753.8	2775.6	2767.4
12.5°	2764.5	2748.2	2715.4	2729.0	2723.5
15°	2718.0	2701.7	2665.8	2676.9	2663.2
17.5°	2660.2	2643.9	2608.1	2621.8	2608.1
20°	2597.1	2580.7	2542.3	2550.4	2539.7
22.5°	2534.1	2509.4	2473.5	2473.5	2468.0
25°	2459.8	2438.0	2391.4	2396.7	2391.4
27.5°	2377.4	2358.2	2322.7	2314.6	2300.9
30°	2295.3	2273.1	2232.0	2223.9	2212.9
32.5°	2207.3	2191.0	2147.0	2130.5	2119.4
35°	2122.3	2094.9	2050.9	2034.3	2020.6
37.5°	2026.2	2001.4	1957.4	1938.2	1924.5
40°	1927.4	1905.3	1861.2	1836.8	1825.8
42.5°	1831.2	1809.1	1765.4	1737.8	1721.5
45°	1727.0	1707.8	1666.4	1636.4	1625.4
47.5°	1625.4	1606.1	1562.1	1531.9	1515.6
50°	1518.2	1504.5	1466.0	1427.6	1413.9
52.5°	1413.9	1394.6	1359.1	1328.9	1309.6
55°	1307.0	1290.4	1257.4	1224.6	1210.9
57.5°	1199.8	1186.1	1150.3	1117.4	1106.3
60°	1092.6	1081.8	1043.3	1013.1	1004.9
62.5°	988.3	969.1	941.7	914.4	903.3
65°	881.4	864.8	837.4	812.7	799.0
67.5°	771.6	757.7	733.1	714.0	702.9
70°	669.9	658.8	634.1	614.9	604.1
72.5°	565.7	554.6	540.9	521.7	513.6
75°	461.1	455.8	441.9	425.6	431.1
77.5°	367.9	356.9	351.3	343.2	335.0
80°	274.7	271.7	266.2	258.0	252.6
82.5°	186.7	186.7	184.1	173.0	173.0
85°	112.4	109.8	107.2	98.7	96.1
87.5°	49.5	43.9	38.5	30.3	27.4
90°	0.7	9.5	15.9	20.0	21.4
92.5°	20.0	16.7	19.1	20.7	21.4
95°	51.7	25.4	31.0	35.1	34.2
97.5°	93.2	27.9	40.6	43.0	43.8
100°	141.0	31.9	45.4	51.7	53.3
102.5°	193.5	192.0	47.0	55.7	58.1
105°	242.1	266.0	48.6	57.3	60.5
107.5°	298.6	318.5	50.2	58.9	62.1
110°	352.9	369.5	139.4	59.8	62.9

TEST NUMBER: P918161

CATALOG NUMBER: DFN2DIP-TR3F0-090D040US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	403.8	418.1	404.6	61.3	63.8
115°	457.9	471.4	491.4	122.6	65.4
117.5°	504.9	520.8	534.4	420.4	211.8
120°	557.5	569.4	583.8	593.4	485.8
122.5°	602.0	614.8	630.8	635.5	636.3
125°	647.4	657.9	672.9	678.6	680.9
127.5°	688.8	700.0	712.0	720.0	720.7
130°	727.9	740.7	749.3	758.1	757.4
132.5°	767.7	778.1	786.8	794.0	793.3
135°	801.2	814.0	821.1	829.1	827.5
137.5°	836.2	845.7	853.8	861.7	859.3
140°	870.4	876.9	885.6	892.8	888.8
142.5°	899.2	904.7	915.1	921.4	917.5
145°	929.4	928.6	942.1	947.7	943.7
147.5°	955.6	953.2	966.8	970.8	967.7
150°	981.1	975.6	988.4	993.1	989.1
152.5°	1002.7	996.3	1008.2	1013.0	1007.5
155°	1023.4	1016.3	1025.8	1030.5	1024.2
157.5°	1040.1	1033.7	1041.0	1046.5	1040.1
160°	1054.4	1049.6	1054.4	1059.2	1053.6
162.5°	1067.1	1062.4	1066.4	1072.0	1064.8
165°	1078.3	1073.6	1075.9	1081.5	1075.9
167.5°	1087.1	1082.2	1084.8	1090.3	1083.1
170°	1094.3	1089.5	1091.0	1096.7	1089.5
172.5°	1099.0	1094.3	1095.9	1101.5	1094.3
175°	1102.9	1097.4	1099.0	1104.6	1096.7
177.5°	1104.6	1099.0	1099.8	1105.5	1098.3
180°	1100.7	1100.7	1100.7	1100.7	1100.7

TEST NUMBER: P918161

CATALOG NUMBER: DFN2DIP-TR3F0-090D040US930-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.24	14.31	14.01	15.10	16.07	12.81	13.88	13.59	14.67	15.64
	3H	14.91	15.86	15.69	16.67	17.67	14.44	15.40	15.22	16.20	17.20
	4H	15.50	16.40	16.30	17.21	18.22	15.03	15.93	15.83	16.75	17.76
	6H	15.90	16.74	16.72	17.56	18.58	15.43	16.27	16.25	17.09	18.11
	8H	16.01	16.80	16.83	17.64	18.67	15.54	16.33	16.36	17.17	18.20
	12H	16.06	16.82	16.89	17.65	18.70	15.59	16.34	16.42	17.18	18.23
4H	2H	13.72	14.63	14.53	15.44	16.45	13.38	14.29	14.19	15.10	16.11
	3H	15.60	16.35	16.42	17.20	18.22	15.21	15.96	16.03	16.81	17.83
	4H	16.31	17.00	17.15	17.84	18.90	15.91	16.60	16.74	17.44	18.50
	6H	16.83	17.43	17.68	18.29	19.35	16.43	17.02	17.28	17.89	18.95
	8H	16.98	17.54	17.83	18.40	19.47	16.57	17.13	17.43	17.99	19.06
	12H	17.06	17.56	17.93	18.44	19.52	16.64	17.14	17.52	18.03	19.10
8H	4H	16.52	17.08	17.37	17.94	19.01	16.16	16.72	17.02	17.59	18.65
	6H	17.15	17.61	18.03	18.52	19.59	16.79	17.25	17.67	18.16	19.23
	8H	17.37	17.78	18.26	18.68	19.76	17.00	17.41	17.89	18.31	19.40
	12H	17.50	17.86	18.40	18.75	19.89	17.12	17.48	18.02	18.38	19.52
12H	4H	16.52	17.02	17.39	17.90	18.98	16.17	16.67	17.04	17.55	18.63
	6H	17.18	17.59	18.07	18.49	19.58	16.83	17.24	17.72	18.14	19.23
	8H	17.42	17.78	18.32	18.68	19.82	17.07	17.43	17.97	18.32	19.46

END OF REPORT