

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920814

Luminaire Tested: DFN2DIP-TR3F0-060D050US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920814
REPORT IS A COMBINATION OF REPORTS P900305 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D050US935-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8924.2 lumens
Efficiency: N/A
Efficacy: 94.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 94.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920814

CATALOG NUMBER: DFN2DIP-TR3F0-060D050US935-FLLFLL

Luminous Intensity Polar Plot

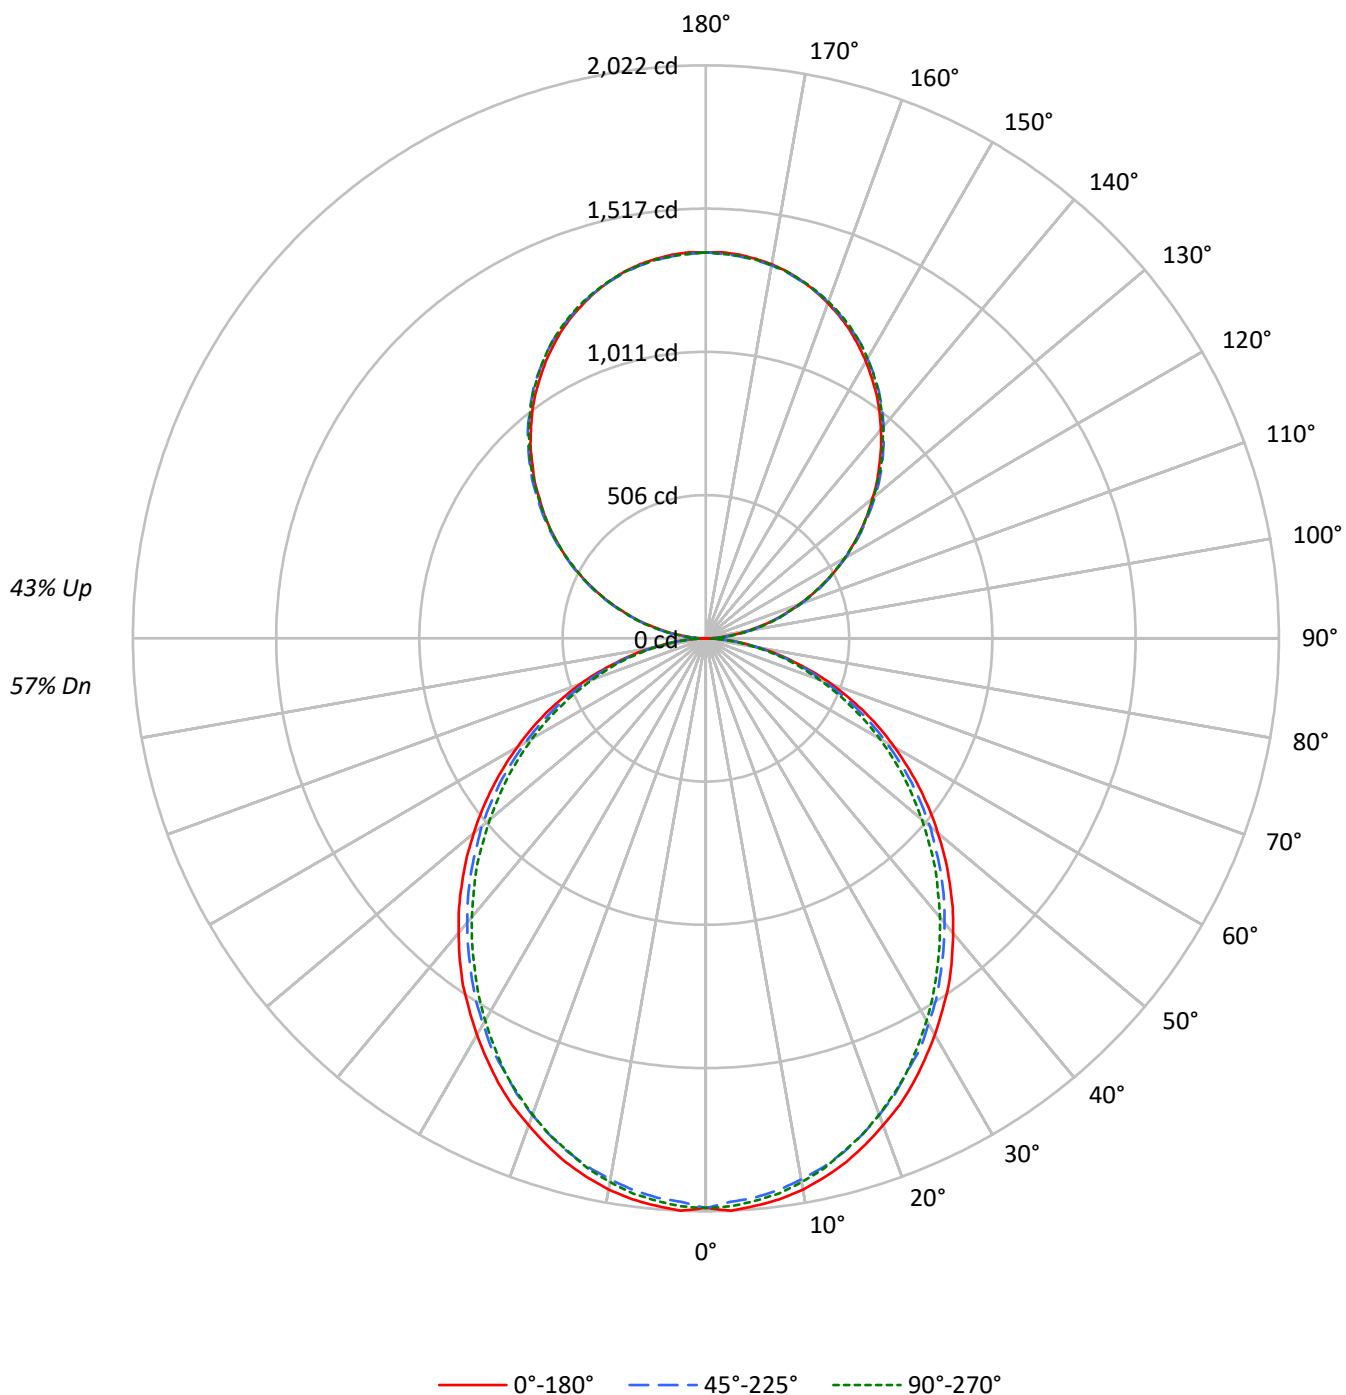

TEST NUMBER: P920814

CATALOG NUMBER: DFN2DIP-TR3F0-060D050US935-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	75	75	75	63	63	63
1	99	95	91	88	92	89	85	82	77	74	72	66	64	62	56	54	53
2	91	83	77	72	84	78	72	67	67	63	60	58	55	52	49	47	45
3	83	73	66	60	77	68	62	56	59	54	50	51	47	44	43	41	38
4	76	65	57	51	70	61	53	48	53	47	43	46	41	38	39	36	33
5	69	58	49	43	64	54	47	41	47	41	37	41	36	33	35	31	29
6	64	52	44	38	59	49	41	36	43	37	32	37	32	29	32	28	25
7	59	47	39	33	55	44	37	32	39	33	28	34	29	25	29	25	22
8	55	43	35	29	51	40	33	28	35	29	25	31	26	23	27	23	20
9	51	39	31	26	48	37	30	25	32	27	23	28	24	20	25	21	18
10	48	36	28	24	45	34	27	23	30	24	21	26	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2505	2505	2505
5°	2507	2468	2485
10°	2486	2432	2450
15°	2448	2390	2395
20°	2397	2332	2340
25°	2346	2264	2276
30°	2283	2200	2195
35°	2224	2125	2110
40°	2150	2049	2029
45°	2077	1972	1945
50°	1997	1892	1849
55°	1912	1799	1760
60°	1817	1690	1658
65°	1713	1575	1538
70°	1581	1436	1408
75°	1398	1269	1286
80°	1177	1056	1057
85°	830	695	683

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2077 cd/sqm

TEST NUMBER: P920814

CATALOG NUMBER: DFN2DIP-TR3F0-060D050US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	2.1
10°-20°	532.3	6.0
20°-30°	782.3	8.8
30°-40°	908.6	10.2
40°-50°	907.5	10.2
50°-60°	791.3	8.9
60°-70°	584.9	6.6
70°-80°	330.9	3.7
80°-90°	91.2	1.0
90°-100°	84.2	0.9
100°-110°	267.7	3.0
110°-120°	458.1	5.1
120°-130°	602.5	6.8
130°-140°	676.3	7.6
140°-150°	663.1	7.4
150°-160°	556.3	6.2
160°-170°	368.9	4.1
170°-180°	128.9	1.4
0°-30°	1503.8	16.9
0°-40°	2412.4	27.0
0°-60°	4111.1	46.1
0°-90°	5118.2	57.4
90°-120°	810.0	9.1
90°-150°	2751.9	30.8
90°-180°	3806.0	42.6
0°-180°	8924.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	1	15	40	38	39	9
95°	60	72	73	73	72	67
105°	247	250	253	255	255	261
115°	460	466	464	463	460	455
125°	669	679	676	672	671	598
135°	865	878	880	879	876	669
145°	1050	1058	1065	1066	1061	656
155°	1201	1204	1208	1213	1210	553
165°	1306	1305	1305	1313	1307	368
175°	1359	1356	1353	1362	1354	129
180°	1362	1362	1362	1362	1362	

TEST NUMBER: P920814

CATALOG NUMBER: DFN2DIP-TR3F0-060D050US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.3	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.3	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.7	1099.8	1078.5	1066.9
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.1	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	1.2	14.8	40.2	37.8	39.0
92.5°	25.5	34.4	35.7	36.9	36.9
95°	59.9	71.5	73.4	73.4	71.5
97.5°	99.7	110.4	114.9	114.9	114.9
100°	145.7	155.2	158.4	158.4	157.2
102.5°	194.2	201.1	205.6	206.9	205.6
105°	247.1	250.4	252.9	254.9	254.9
107.5°	299.6	304.5	304.5	305.4	299.6
110°	350.5	357.1	357.1	357.1	353.8

TEST NUMBER: P920814

CATALOG NUMBER: DFN2DIP-TR3F0-060D050US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	405.5	412.5	411.3	408.0	405.5
115°	459.7	466.3	464.3	463.0	459.7
117.5°	513.5	522.5	516.8	513.5	510.2
120°	567.7	576.7	567.7	567.7	564.0
122.5°	616.9	628.4	622.7	619.4	616.9
125°	668.7	678.9	675.6	671.9	670.7
127.5°	719.1	731.8	727.4	722.4	719.1
130°	766.4	781.1	779.0	776.6	772.1
132.5°	819.3	830.8	831.6	825.9	822.6
135°	864.9	877.5	880.0	878.8	875.5
137.5°	915.8	926.0	928.1	927.2	922.3
140°	960.4	970.8	976.5	976.5	972.0
142.5°	1006.4	1016.8	1020.0	1021.2	1016.8
145°	1050.0	1058.2	1064.7	1066.0	1061.4
147.5°	1089.0	1099.2	1104.1	1106.2	1101.6
150°	1129.2	1136.2	1140.6	1144.4	1140.6
152.5°	1164.9	1171.9	1177.6	1182.2	1177.6
155°	1200.6	1203.8	1207.5	1213.3	1209.6
157.5°	1231.4	1233.8	1235.9	1244.1	1238.4
160°	1258.9	1261.4	1262.6	1269.5	1264.6
162.5°	1284.4	1284.4	1285.6	1293.4	1287.6
165°	1306.1	1304.8	1304.8	1313.1	1307.3
167.5°	1325.8	1322.1	1322.1	1330.3	1324.6
170°	1340.6	1337.3	1336.1	1344.3	1337.3
172.5°	1350.8	1347.5	1346.3	1354.5	1347.5
175°	1359.1	1355.7	1353.3	1361.5	1354.5
177.5°	1363.6	1360.3	1357.8	1364.8	1357.8
180°	1361.5	1361.5	1361.5	1361.5	1361.5

TEST NUMBER: P920814

CATALOG NUMBER: DFN2DIP-TR3F0-060D050US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.06	11.99	11.95	12.91	14.07	10.63	11.57	11.52	12.48	13.64
	3H	12.72	13.55	13.62	14.48	15.66	12.25	13.09	13.15	14.01	15.19
	4H	13.30	14.09	14.22	15.02	16.22	12.83	13.63	13.75	14.55	15.75
	6H	13.70	14.43	14.63	15.36	16.57	13.23	13.96	14.16	14.89	16.10
	8H	13.80	14.50	14.74	15.45	16.65	13.33	14.03	14.27	14.98	16.19
	12H	13.85	14.51	14.79	15.45	16.69	13.38	14.04	14.32	14.98	16.21
4H	2H	11.53	12.32	12.45	13.25	14.44	11.19	11.98	12.11	12.90	14.10
	3H	13.39	14.05	14.32	15.01	16.22	13.00	13.66	13.94	14.62	15.83
	4H	14.10	14.70	15.04	15.65	16.89	13.70	14.30	14.64	15.25	16.49
	6H	14.61	15.13	15.57	16.11	17.34	14.21	14.73	15.16	15.70	16.94
	8H	14.76	15.24	15.72	16.21	17.46	14.35	14.84	15.31	15.81	17.06
	12H	14.83	15.27	15.81	16.25	17.51	14.41	14.85	15.39	15.84	17.09
8H	4H	14.30	14.78	15.26	15.75	17.00	13.94	14.43	14.90	15.40	16.65
	6H	14.92	15.32	15.91	16.33	17.58	14.56	14.96	15.55	15.98	17.22
	8H	15.14	15.49	16.13	16.49	17.76	14.77	15.13	15.77	16.13	17.39
	12H	15.26	15.58	16.26	16.57	17.88	14.89	15.20	15.88	16.19	17.51
12H	4H	14.29	14.72	15.27	15.71	16.97	13.94	14.38	14.92	15.36	16.62
	6H	14.95	15.31	15.94	16.30	17.57	14.60	14.96	15.60	15.96	17.22
	8H	15.19	15.50	16.19	16.49	17.81	14.84	15.15	15.83	16.14	17.45

END OF REPORT