

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920823

Luminaire Tested: DFN2DIP-TR3F0-060D070US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920823
REPORT IS A COMBINATION OF REPORTS P901853 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D070US935-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11081.1 lumens
Efficiency: N/A
Efficacy: 100.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 110.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920823

CATALOG NUMBER: DFN2DIP-TR3F0-060D070US935-FLLONL

Luminous Intensity Polar Plot

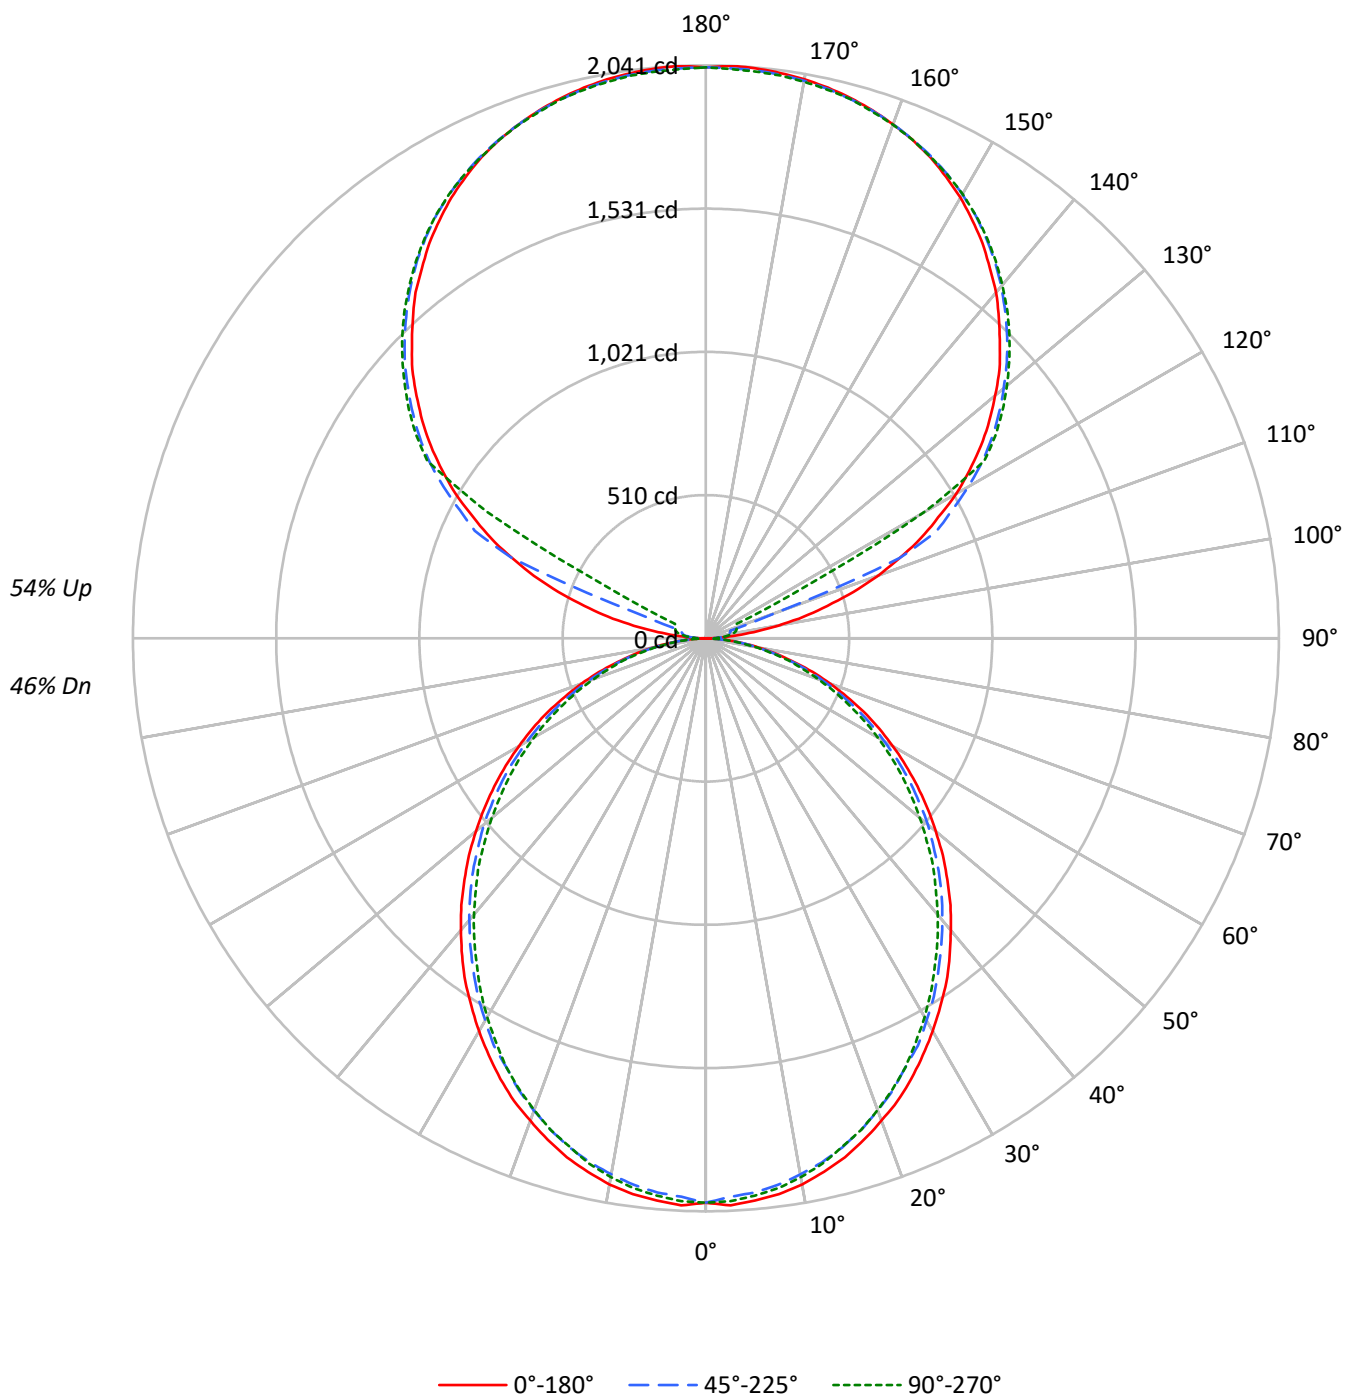

TEST NUMBER: P920823

CATALOG NUMBER: DFN2DIP-TR3F0-060D070US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	89	85	89	85	82	79	71	69	67	58	57	55	46	45	44
2	88	81	75	70	81	74	69	65	62	59	55	51	48	46	41	39	37
3	81	71	64	58	74	66	59	54	55	50	46	45	42	39	36	34	32
4	74	63	55	49	67	58	51	46	49	44	40	40	37	33	32	30	27
5	68	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	33	29	25	26	23	21
7	58	45	37	32	53	42	35	30	36	30	26	30	26	22	24	21	19
8	53	41	33	28	49	38	31	26	33	27	23	27	23	20	22	19	17
9	50	38	30	25	46	35	28	24	30	24	21	25	21	18	21	17	15
10	46	34	27	22	43	32	26	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2505	2505	2505
5°	2507	2468	2485
10°	2486	2432	2450
15°	2448	2390	2395
20°	2397	2332	2340
25°	2346	2264	2276
30°	2283	2200	2195
35°	2224	2125	2110
40°	2150	2049	2029
45°	2077	1972	1945
50°	1997	1892	1849
55°	1912	1799	1760
60°	1817	1690	1658
65°	1713	1575	1538
70°	1581	1436	1408
75°	1398	1269	1286
80°	1177	1056	1057
85°	830	695	683

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2077 cd/sqm

TEST NUMBER: P920823

CATALOG NUMBER: DFN2DIP-TR3F0-060D070US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	1.7
10°-20°	532.3	4.8
20°-30°	782.3	7.1
30°-40°	908.6	8.2
40°-50°	907.5	8.2
50°-60°	791.3	7.1
60°-70°	584.9	5.3
70°-80°	330.9	3.0
80°-90°	90.9	0.8
90°-100°	67.1	0.6
100°-110°	250.0	2.3
110°-120°	663.1	6.0
120°-130°	1099.8	9.9
130°-140°	1168.3	10.5
140°-150°	1085.8	9.8
150°-160°	872.9	7.9
160°-170°	562.5	5.1
170°-180°	193.6	1.7
0°-30°	1503.8	13.6
0°-40°	2412.4	21.8
0°-60°	4111.1	37.1
0°-90°	5117.9	46.2
90°-120°	980.2	8.8
90°-150°	4334.1	39.1
90°-180°	5963.0	53.8
0°-180°	11081.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	1	18	29	37	40	10
95°	96	47	57	65	63	113
105°	448	492	90	106	112	478
115°	846	871	908	227	121	833
125°	1196	1216	1244	1254	1258	1067
135°	1481	1504	1517	1532	1529	1144
145°	1718	1716	1741	1751	1744	1074
155°	1891	1878	1896	1904	1893	872
165°	1993	1984	1988	1999	1988	563
175°	2038	2028	2031	2041	2027	194
180°	2034	2034	2034	2034	2034	

TEST NUMBER: P920823

CATALOG NUMBER: DFN2DIP-TR3F0-060D070US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.3	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.3	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.7	1099.8	1078.5	1066.9
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.1	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	1.4	17.7	29.4	36.9	39.7
92.5°	36.9	30.9	35.3	38.3	39.7
95°	95.6	47.0	57.3	64.8	63.3
97.5°	172.1	51.6	75.0	79.6	80.9
100°	260.6	58.9	83.9	95.6	98.6
102.5°	357.6	354.8	86.9	103.0	107.5
105°	447.5	491.6	89.8	105.9	111.8
107.5°	551.9	588.7	92.8	108.9	114.9
110°	652.1	682.9	257.6	110.5	116.2



TEST NUMBER: P920823

CATALOG NUMBER: DFN2DIP-TR3F0-060D070US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.3	772.7	747.7	113.2	117.8
115°	846.3	871.2	908.1	226.7	120.8
117.5°	933.1	962.5	987.7	777.1	391.5
120°	1030.3	1052.3	1078.9	1096.6	897.8
122.5°	1112.6	1136.2	1165.8	1174.5	1176.0
125°	1196.5	1215.7	1243.7	1254.0	1258.3
127.5°	1273.1	1293.6	1315.9	1330.6	1332.0
130°	1345.2	1368.8	1384.9	1401.2	1399.8
132.5°	1418.8	1438.0	1454.1	1467.4	1466.0
135°	1480.7	1504.2	1517.4	1532.2	1529.3
137.5°	1545.3	1563.1	1577.9	1592.6	1588.2
140°	1608.6	1620.5	1636.6	1649.8	1642.5
142.5°	1661.7	1672.1	1691.1	1702.8	1695.5
145°	1717.7	1716.1	1741.1	1751.4	1744.1
147.5°	1766.1	1761.8	1786.7	1794.1	1788.3
150°	1813.3	1803.0	1826.6	1835.3	1828.0
152.5°	1853.0	1841.2	1863.3	1872.2	1861.9
155°	1891.3	1878.1	1895.7	1904.5	1892.8
157.5°	1922.2	1910.5	1923.7	1934.1	1922.2
160°	1948.8	1939.8	1948.8	1957.5	1947.1
162.5°	1972.2	1963.4	1970.7	1981.1	1967.8
165°	1992.8	1984.1	1988.4	1998.7	1988.4
167.5°	2009.1	2000.1	2004.7	2015.0	2001.7
170°	2022.3	2013.4	2016.4	2026.7	2013.4
172.5°	2031.1	2022.3	2025.3	2035.6	2022.3
175°	2038.4	2028.1	2031.1	2041.3	2026.7
177.5°	2041.3	2031.1	2032.6	2043.0	2029.6
180°	2034.0	2034.0	2034.0	2034.0	2034.0

TEST NUMBER: P920823

CATALOG NUMBER: DFN2DIP-TR3F0-060D070US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.05	10.88	11.04	11.88	13.20	9.62	10.45	10.61	11.45	12.77
	3H	11.70	12.44	12.70	13.45	14.79	11.23	11.97	12.23	12.98	14.33
	4H	12.28	12.98	13.29	13.99	15.35	11.81	12.51	12.82	13.52	14.88
	6H	12.67	13.31	13.69	14.33	15.70	12.20	12.84	13.22	13.86	15.23
	8H	12.77	13.38	13.80	14.42	15.78	12.30	12.91	13.33	13.95	15.31
	12H	12.81	13.40	13.84	14.42	15.81	12.34	12.92	13.37	13.95	15.34
4H	2H	10.50	11.20	11.52	12.22	13.57	10.16	10.86	11.18	11.88	13.23
	3H	12.35	12.94	13.38	13.98	15.35	11.96	12.55	12.99	13.59	14.96
	4H	13.06	13.60	14.09	14.63	16.02	12.66	13.20	13.69	14.23	15.62
	6H	13.56	14.03	14.61	15.08	16.47	13.16	13.62	14.20	14.68	16.06
	8H	13.71	14.14	14.75	15.19	16.59	13.30	13.73	14.35	14.78	16.18
	12H	13.77	14.17	14.84	15.23	16.64	13.36	13.75	14.42	14.81	16.22
8H	4H	13.25	13.68	14.30	14.73	16.13	12.89	13.32	13.94	14.37	15.77
	6H	13.87	14.22	14.94	15.32	16.71	13.51	13.87	14.58	14.96	16.36
	8H	14.08	14.40	15.16	15.47	16.89	13.72	14.03	14.80	15.11	16.53
	12H	14.21	14.48	15.29	15.55	17.01	13.83	14.10	14.91	15.17	16.63
12H	4H	13.23	13.62	14.30	14.69	16.09	12.88	13.27	13.95	14.34	15.74
	6H	13.90	14.21	14.97	15.29	16.70	13.55	13.86	14.62	14.94	16.36
	8H	14.13	14.41	15.21	15.48	16.93	13.78	14.05	14.86	15.12	16.58