

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920839

Luminaire Tested: DFN2DIP-TR3F0-070D040US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920839
REPORT IS A COMBINATION OF REPORTS P901814 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-070D040US935-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8532.4 lumens
Efficiency: N/A
Efficacy: 85.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 99.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920839

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US935-RLLONL

Luminous Intensity Polar Plot

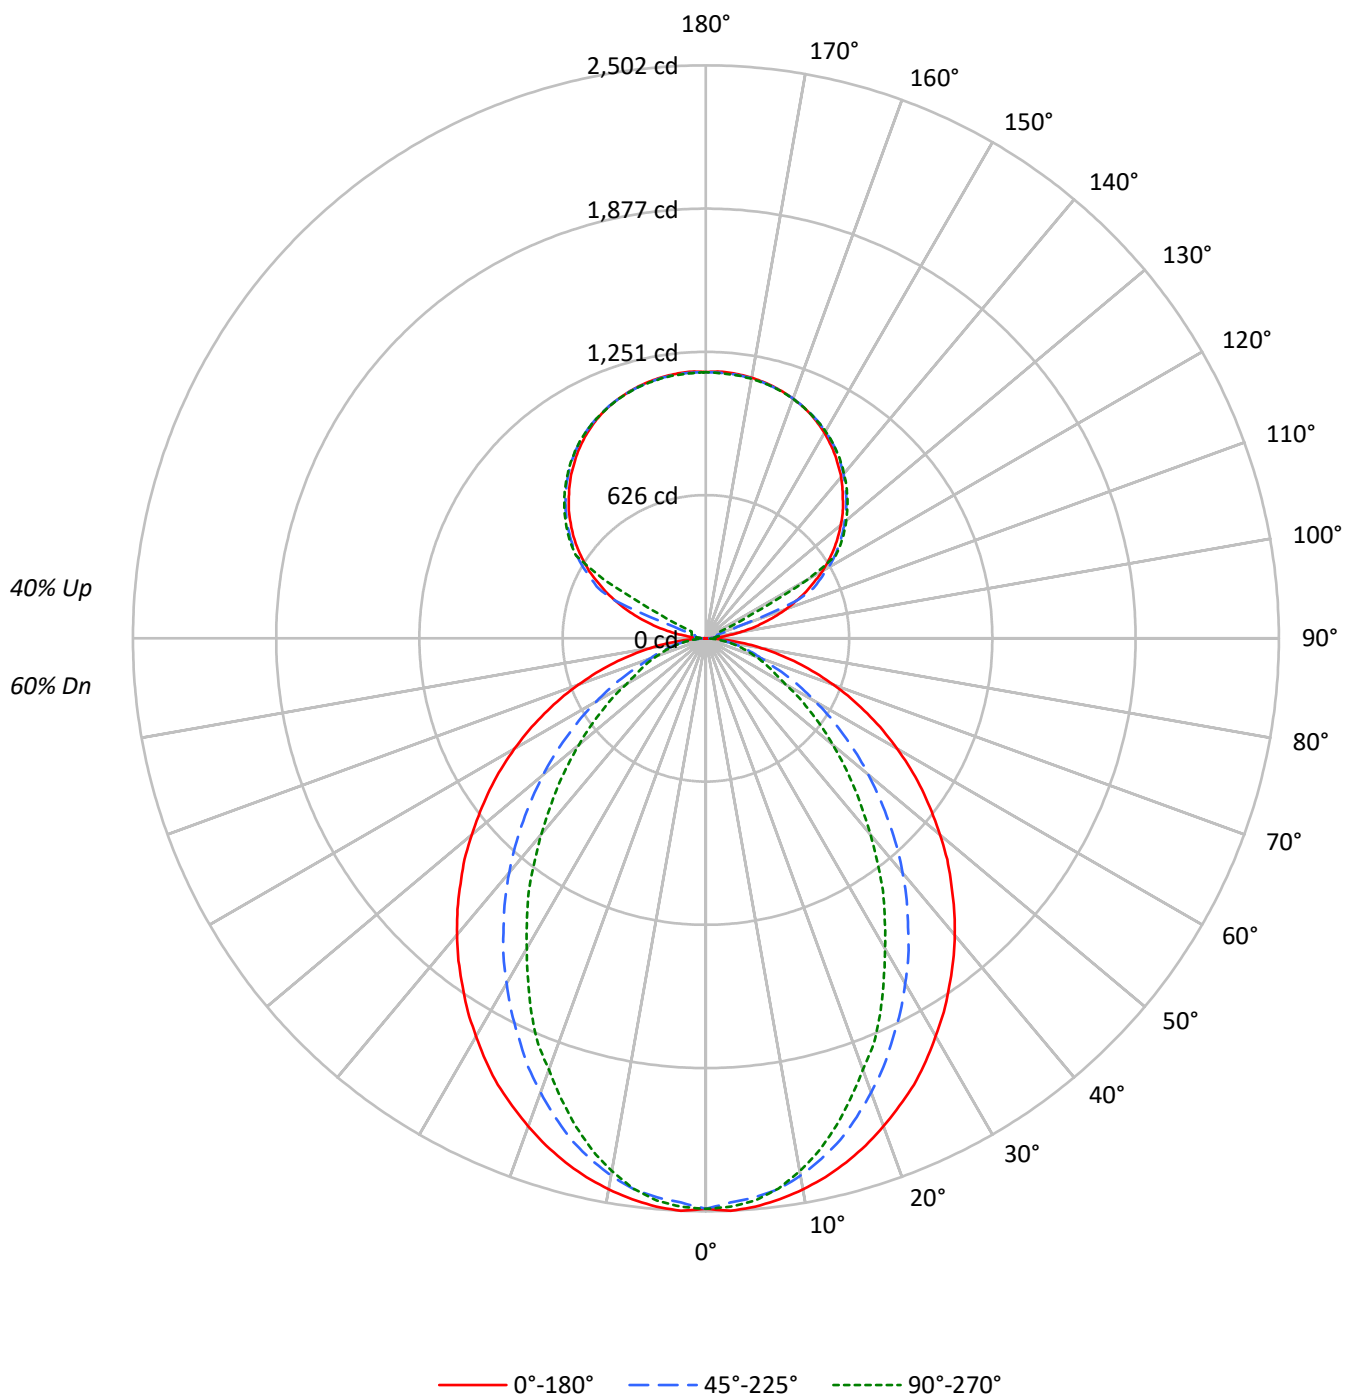

TEST NUMBER: P920839

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	101	96	93	89	94	90	87	84	79	77	74	68	67	65	59	57	56
2	92	85	79	74	86	80	74	70	70	66	62	61	58	55	52	50	48
3	84	75	68	62	79	71	64	59	62	57	53	54	51	47	47	44	42
4	78	67	59	53	72	63	56	51	56	50	46	49	45	41	42	39	37
5	71	60	52	46	67	57	49	44	50	44	40	44	40	36	38	35	32
6	66	54	46	40	62	51	44	39	45	40	35	40	35	32	35	32	29
7	61	49	41	36	57	46	39	34	41	36	31	37	32	29	32	29	26
8	57	45	37	32	53	42	35	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	29	25	31	27	23	28	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3104	3104	3104
5°	3107	3052	3072
10°	3075	2990	2970
15°	3031	2888	2814
20°	2973	2750	2623
25°	2914	2595	2438
30°	2835	2436	2204
35°	2758	2266	1999
40°	2679	2090	1765
45°	2588	1895	1552
50°	2493	1698	1345
55°	2394	1489	1145
60°	2279	1270	941
65°	2147	1048	844
70°	1987	841	761
75°	1786	736	688
80°	1494	609	590
85°	1017	394	432

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2588 cd/sqm

TEST NUMBER: P920839

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US935-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	233.5	2.7
10°-20°	640.9	7.5
20°-30°	899.8	10.5
30°-40°	980.8	11.5
40°-50°	901.5	10.6
50°-60°	708.0	8.3
60°-70°	460.8	5.4
70°-80°	237.2	2.8
80°-90°	62.6	0.7
90°-100°	38.3	0.4
100°-110°	142.9	1.7
110°-120°	378.9	4.4
120°-130°	628.5	7.4
130°-140°	667.6	7.8
140°-150°	620.4	7.3
150°-160°	498.8	5.8
160°-170°	321.4	3.8
170°-180°	110.6	1.3
0°-30°	1774.1	20.8
0°-40°	2754.9	32.3
0°-60°	4364.3	51.2
0°-90°	5124.9	60.1
90°-120°	560.1	6.6
90°-150°	2476.6	29.0
90°-180°	3407.0	39.9
0°-180°	8532.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2491	2491	2491	2491	2491	
5°	2491	2480	2450	2471	2464	236
15°	2369	2344	2268	2225	2202	668
25°	2151	2078	1930	1837	1803	989
35°	1853	1738	1540	1398	1348	1160
45°	1515	1364	1127	967	913	1170
55°	1152	976	732	597	555	1029
65°	778	595	392	316	309	771
75°	415	257	180	164	162	439
85°	97	50	43	43	43	111
90°	1	10	17	21	23	8
95°	55	27	33	37	36	65
105°	256	281	51	60	64	273
115°	484	498	519	130	69	476
125°	684	695	711	717	719	610
135°	846	860	867	876	874	654
145°	982	981	995	1001	997	614
155°	1081	1073	1083	1088	1082	498
165°	1139	1134	1136	1142	1136	322
175°	1165	1159	1161	1166	1158	111
180°	1162	1162	1162	1162	1162	

TEST NUMBER: P920839

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2491.0	2491.0	2491.0	2491.0	2491.0
2.5°	2502.1	2491.0	2466.1	2488.8	2484.2
5°	2491.0	2479.7	2450.3	2470.6	2463.9
7.5°	2470.6	2457.2	2425.7	2434.5	2423.3
10°	2443.6	2427.8	2382.8	2375.9	2362.5
12.5°	2409.8	2389.5	2328.6	2315.1	2290.3
15°	2369.2	2344.3	2267.8	2225.0	2202.5
17.5°	2321.9	2285.8	2191.1	2141.5	2105.4
20°	2267.8	2222.6	2110.0	2053.7	2004.0
22.5°	2209.2	2157.3	2026.4	1949.9	1916.2
25°	2150.6	2078.4	1929.6	1837.3	1803.4
27.5°	2080.8	2004.0	1839.4	1733.5	1681.6
30°	2006.4	1920.5	1740.2	1625.4	1564.4
32.5°	1934.1	1830.4	1645.7	1510.4	1453.9
35°	1853.0	1738.0	1539.8	1397.7	1348.0
37.5°	1774.2	1650.0	1440.5	1284.8	1228.6
40°	1690.7	1555.6	1336.7	1176.7	1118.1
42.5°	1605.1	1460.9	1233.1	1066.2	1010.0
45°	1514.9	1363.7	1127.2	967.0	912.9
47.5°	1429.3	1269.3	1025.8	865.6	816.1
50°	1334.5	1174.6	926.5	770.9	723.8
52.5°	1242.0	1072.9	831.8	683.0	640.2
55°	1151.8	976.0	732.5	597.4	554.7
57.5°	1059.5	879.2	644.8	518.5	482.4
60°	964.8	784.5	552.2	437.5	401.3
62.5°	872.4	692.2	473.3	365.2	347.2
65°	777.7	595.0	392.3	315.7	308.8
67.5°	687.6	504.9	315.7	277.2	270.5
70°	592.9	417.1	261.4	238.9	229.8
72.5°	502.7	335.8	218.6	200.7	196.1
75°	414.7	256.8	180.3	164.5	162.4
77.5°	326.9	182.4	142.1	132.9	128.5
80°	245.6	130.8	108.1	99.3	99.3
82.5°	171.3	88.0	74.4	69.8	69.8
85°	96.9	49.5	42.8	42.8	42.8
87.5°	36.1	17.9	17.9	15.8	15.8
90°	0.8	10.1	16.8	21.1	22.6
92.5°	21.1	17.7	20.1	21.9	22.6
95°	54.6	26.9	32.7	37.0	36.2
97.5°	98.4	29.4	42.9	45.5	46.2
100°	148.9	33.7	48.0	54.6	56.3
102.5°	204.3	202.8	49.6	58.8	61.4
105°	255.6	280.9	51.3	60.5	63.9
107.5°	315.4	336.4	53.0	62.3	65.6
110°	372.6	390.2	147.2	63.1	66.4

TEST NUMBER: P920839

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	426.5	441.5	427.2	64.7	67.3
115°	483.5	497.8	518.9	129.5	69.1
117.5°	533.2	550.0	564.4	444.0	223.7
120°	588.8	601.3	616.5	626.6	513.1
122.5°	635.8	649.3	666.2	671.1	672.0
125°	683.7	694.7	710.7	716.6	719.1
127.5°	727.5	739.3	751.9	760.3	761.1
130°	768.7	782.2	791.3	800.6	799.9
132.5°	810.7	821.7	830.9	838.5	837.8
135°	846.1	859.6	867.1	875.5	873.9
137.5°	883.0	893.1	901.6	910.0	907.5
140°	919.2	926.0	935.2	942.8	938.6
142.5°	949.6	955.4	966.4	973.0	968.9
145°	981.5	980.7	994.9	1000.8	996.6
147.5°	1009.2	1006.7	1021.0	1025.2	1021.9
150°	1036.1	1030.3	1043.8	1048.8	1044.6
152.5°	1058.9	1052.1	1064.7	1069.8	1063.9
155°	1080.7	1073.2	1083.3	1088.3	1081.6
157.5°	1098.4	1091.7	1099.3	1105.2	1098.4
160°	1113.5	1108.4	1113.5	1118.5	1112.7
162.5°	1127.0	1122.0	1126.2	1132.0	1124.5
165°	1138.8	1133.8	1136.3	1142.1	1136.3
167.5°	1148.1	1142.9	1145.6	1151.4	1143.8
170°	1155.6	1150.6	1152.2	1158.1	1150.6
172.5°	1160.6	1155.6	1157.4	1163.2	1155.6
175°	1164.8	1158.9	1160.6	1166.5	1158.1
177.5°	1166.5	1160.6	1161.5	1167.4	1159.9
180°	1162.3	1162.3	1162.3	1162.3	1162.3

TEST NUMBER: P920839

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.92	12.84	12.79	13.73	14.85	7.90	8.82	8.77	9.71	10.83
	3H	13.60	14.42	14.48	15.32	16.47	9.09	9.91	9.97	10.81	11.96
	4H	14.20	14.98	15.10	15.88	17.04	9.54	10.32	10.44	11.22	12.38
	6H	14.62	15.34	15.53	16.25	17.42	9.86	10.57	10.77	11.49	12.66
	8H	14.75	15.43	15.67	16.35	17.52	9.95	10.63	10.87	11.56	12.73
	12H	14.81	15.45	15.73	16.38	17.57	9.99	10.64	10.92	11.56	12.76
4H	2H	11.95	12.73	12.86	13.63	14.79	8.50	9.28	9.41	10.18	11.34
	3H	13.78	14.42	14.69	15.36	16.53	9.85	10.50	10.77	11.43	12.61
	4H	14.46	15.05	15.39	15.98	17.18	10.40	10.99	11.33	11.92	13.12
	6H	14.98	15.48	15.92	16.44	17.64	10.82	11.32	11.76	12.28	13.48
	8H	15.15	15.62	16.09	16.57	17.78	10.94	11.42	11.89	12.36	13.58
	12H	15.24	15.67	16.20	16.63	17.85	11.01	11.43	11.97	12.40	13.62
8H	4H	14.44	14.91	15.38	15.86	17.07	10.68	11.15	11.62	12.10	13.31
	6H	15.00	15.39	15.97	16.38	17.59	11.19	11.58	12.16	12.57	13.79
	8H	15.21	15.55	16.19	16.53	17.76	11.38	11.72	12.36	12.70	13.93
	12H	15.34	15.65	16.32	16.62	17.90	11.50	11.80	12.48	12.77	14.05
12H	4H	14.39	14.82	15.36	15.78	17.00	10.69	11.11	11.65	12.08	13.30
	6H	14.97	15.32	15.95	16.30	17.53	11.24	11.58	12.22	12.57	13.80
	8H	15.19	15.49	16.17	16.47	17.74	11.45	11.75	12.43	12.73	14.00