

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920901

Luminaire Tested: DFN2DIP-TR3F0-090D070US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920901
REPORT IS A COMBINATION OF REPORTS P901859 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-090D070US935-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13638.3 lumens
Efficiency: N/A
Efficacy: 92.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 148.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920901

CATALOG NUMBER: DFN2DIP-TR3F0-090D070US935-FLLONL

Luminous Intensity Polar Plot

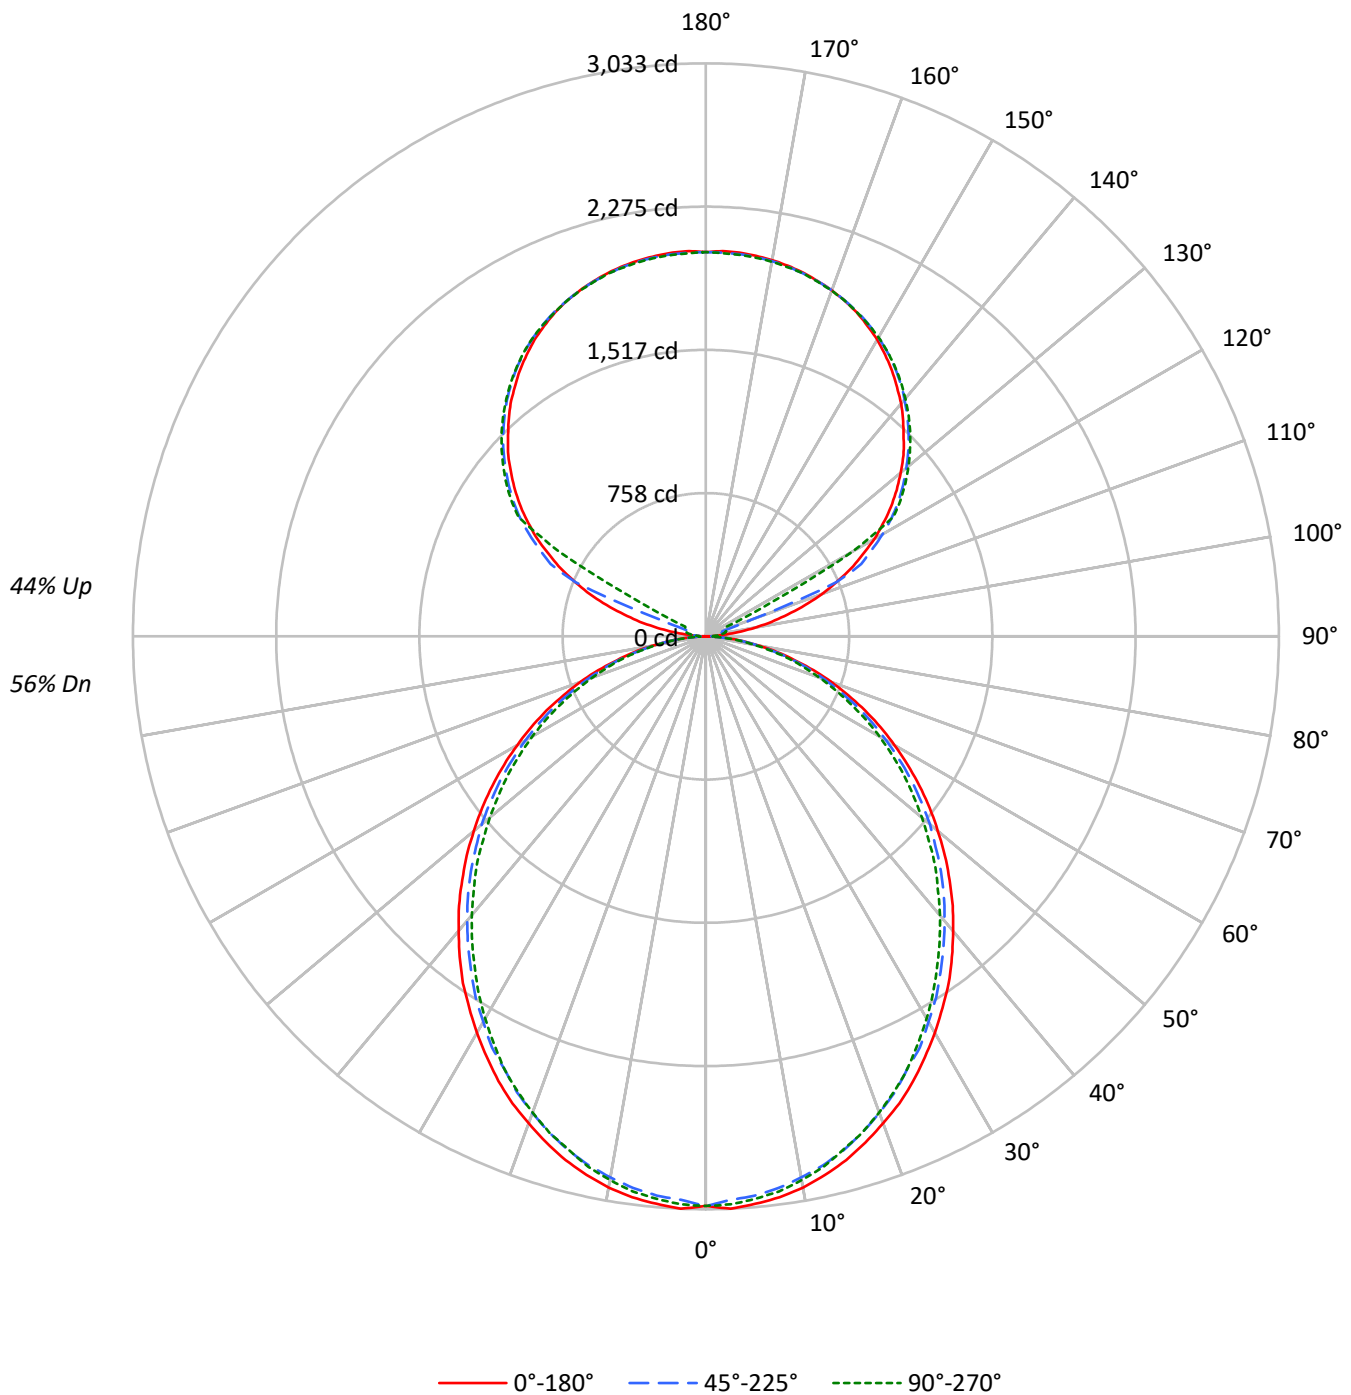

TEST NUMBER: P920901

CATALOG NUMBER: DFN2DIP-TR3F0-090D070US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	99	95	91	87	92	88	85	82	76	74	71	65	63	62	55	53	52
2	90	83	77	71	84	77	72	67	67	63	59	57	54	51	48	46	44
3	82	73	65	59	76	68	61	56	59	54	50	51	47	44	43	40	38
4	75	64	56	50	70	60	53	48	52	47	42	45	41	37	38	35	32
5	69	58	49	43	64	54	46	41	47	41	37	40	36	32	34	31	28
6	64	52	43	38	59	48	41	36	42	36	32	37	32	28	31	28	25
7	59	47	39	33	55	44	37	31	38	33	28	33	29	25	29	25	22
8	55	42	35	29	51	40	33	28	35	29	25	30	26	22	26	23	20
9	51	39	31	26	48	36	30	25	32	26	23	28	23	20	24	21	18
10	48	36	28	23	44	34	27	22	30	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3757	3757	3757
5°	3761	3702	3727
10°	3729	3649	3674
15°	3672	3585	3593
20°	3595	3499	3510
25°	3520	3396	3414
30°	3425	3300	3293
35°	3336	3187	3165
40°	3225	3073	3043
45°	3115	2958	2918
50°	2995	2838	2774
55°	2869	2699	2640
60°	2726	2534	2487
65°	2570	2363	2307
70°	2371	2154	2112
75°	2097	1904	1929
80°	1765	1584	1585
85°	1246	1043	1023

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3115 cd/sqm

TEST NUMBER: P920901

CATALOG NUMBER: DFN2DIP-TR3F0-090D070US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	283.8	2.1
10°-20°	798.5	5.9
20°-30°	1173.4	8.6
30°-40°	1362.9	10.0
40°-50°	1361.2	10.0
50°-60°	1186.9	8.7
60°-70°	877.4	6.4
70°-80°	496.4	3.6
80°-90°	134.6	1.0
90°-100°	67.1	0.5
100°-110°	250.0	1.8
110°-120°	663.1	4.9
120°-130°	1099.8	8.1
130°-140°	1168.3	8.6
140°-150°	1085.8	8.0
150°-160°	872.9	6.4
160°-170°	562.5	4.1
170°-180°	193.6	1.4
0°-30°	2255.7	16.5
0°-40°	3618.6	26.5
0°-60°	6166.7	45.2
0°-90°	7675.1	56.3
90°-120°	980.2	7.2
90°-150°	4334.1	31.8
90°-180°	5963.0	43.7
0°-180°	13638.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3015	3015	3015	3015	3015	
5°	3015	3004	2972	2995	2989	286
15°	2870	2853	2815	2827	2812	808
25°	2598	2575	2526	2531	2526	1195
35°	2241	2212	2166	2148	2134	1400
45°	1824	1804	1760	1728	1716	1408
55°	1380	1363	1328	1293	1279	1234
65°	931	913	884	858	844	920
75°	487	481	467	449	455	520
85°	119	116	113	104	102	132
90°	1	18	29	37	40	13
95°	96	47	57	65	63	113
105°	448	492	90	106	112	478
115°	846	871	908	227	121	833
125°	1196	1216	1244	1254	1258	1067
135°	1481	1504	1517	1532	1529	1144
145°	1718	1716	1741	1751	1744	1074
155°	1891	1878	1896	1904	1893	872
165°	1993	1984	1988	1999	1988	563
175°	2038	2028	2031	2041	2027	194
180°	2034	2034	2034	2034	2034	

TEST NUMBER: P920901

CATALOG NUMBER: DFN2DIP-TR3F0-090D070US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3015.1	3015.1	3015.1	3015.1	3015.1
2.5°	3032.7	3018.2	2986.3	3015.1	3009.6
5°	3015.1	3003.8	2971.8	2994.9	2989.3
7.5°	2994.9	2977.7	2945.6	2969.1	2963.2
10°	2963.2	2942.9	2908.1	2931.2	2922.6
12.5°	2919.5	2902.3	2867.6	2881.9	2876.2
15°	2870.3	2853.1	2815.2	2826.9	2812.4
17.5°	2809.3	2792.1	2754.3	2768.8	2754.3
20°	2742.6	2725.4	2684.8	2693.4	2682.0
22.5°	2676.2	2650.1	2612.2	2612.2	2606.3
25°	2597.7	2574.6	2525.5	2531.0	2525.5
27.5°	2510.7	2490.4	2452.9	2444.3	2429.8
30°	2424.0	2400.5	2357.2	2348.5	2336.9
32.5°	2331.1	2313.8	2267.4	2249.9	2238.2
35°	2241.3	2212.3	2165.8	2148.4	2133.9
37.5°	2139.8	2113.6	2067.1	2046.9	2032.4
40°	2035.4	2012.1	1965.6	1939.7	1928.1
42.5°	1933.9	1910.6	1864.4	1835.2	1818.0
45°	1823.8	1803.5	1759.8	1728.1	1716.5
47.5°	1716.5	1696.2	1649.7	1617.7	1600.5
50°	1603.3	1588.8	1548.2	1507.6	1493.1
52.5°	1493.1	1472.8	1435.3	1403.3	1383.0
55°	1380.3	1362.7	1327.9	1293.2	1278.8
57.5°	1267.0	1252.6	1214.8	1180.0	1168.3
60°	1153.8	1142.5	1101.8	1069.9	1061.3
62.5°	1043.7	1023.4	994.5	965.6	953.9
65°	930.8	913.3	884.3	858.2	843.8
67.5°	814.8	800.1	774.2	754.0	742.3
70°	707.5	695.8	669.7	649.4	638.0
72.5°	597.4	585.7	571.2	551.0	542.3
75°	487.0	481.4	466.7	449.4	455.3
77.5°	388.5	376.9	371.0	362.4	353.8
80°	290.1	287.0	281.1	272.5	266.7
82.5°	197.2	197.2	194.4	182.7	182.7
85°	118.7	116.0	113.2	104.3	101.5
87.5°	52.3	46.4	40.6	32.0	28.9
90°	1.4	17.7	29.4	36.9	39.7
92.5°	36.9	30.9	35.3	38.3	39.7
95°	95.6	47.0	57.3	64.8	63.3
97.5°	172.1	51.6	75.0	79.6	80.9
100°	260.6	58.9	83.9	95.6	98.6
102.5°	357.6	354.8	86.9	103.0	107.5
105°	447.5	491.6	89.8	105.9	111.8
107.5°	551.9	588.7	92.8	108.9	114.9
110°	652.1	682.9	257.6	110.5	116.2



TEST NUMBER: P920901

CATALOG NUMBER: DFN2DIP-TR3F0-090D070US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.3	772.7	747.7	113.2	117.8
115°	846.3	871.2	908.1	226.7	120.8
117.5°	933.1	962.5	987.7	777.1	391.5
120°	1030.3	1052.3	1078.9	1096.6	897.8
122.5°	1112.6	1136.2	1165.8	1174.5	1176.0
125°	1196.5	1215.7	1243.7	1254.0	1258.3
127.5°	1273.1	1293.6	1315.9	1330.6	1332.0
130°	1345.2	1368.8	1384.9	1401.2	1399.8
132.5°	1418.8	1438.0	1454.1	1467.4	1466.0
135°	1480.7	1504.2	1517.4	1532.2	1529.3
137.5°	1545.3	1563.1	1577.9	1592.6	1588.2
140°	1608.6	1620.5	1636.6	1649.8	1642.5
142.5°	1661.7	1672.1	1691.1	1702.8	1695.5
145°	1717.7	1716.1	1741.1	1751.4	1744.1
147.5°	1766.1	1761.8	1786.7	1794.1	1788.3
150°	1813.3	1803.0	1826.6	1835.3	1828.0
152.5°	1853.0	1841.2	1863.3	1872.2	1861.9
155°	1891.3	1878.1	1895.7	1904.5	1892.8
157.5°	1922.2	1910.5	1923.7	1934.1	1922.2
160°	1948.8	1939.8	1948.8	1957.5	1947.1
162.5°	1972.2	1963.4	1970.7	1981.1	1967.8
165°	1992.8	1984.1	1988.4	1998.7	1988.4
167.5°	2009.1	2000.1	2004.7	2015.0	2001.7
170°	2022.3	2013.4	2016.4	2026.7	2013.4
172.5°	2031.1	2022.3	2025.3	2035.6	2022.3
175°	2038.4	2028.1	2031.1	2041.3	2026.7
177.5°	2041.3	2031.1	2032.6	2043.0	2029.6
180°	2034.0	2034.0	2034.0	2034.0	2034.0

TEST NUMBER: P920901

CATALOG NUMBER: DFN2DIP-TR3F0-090D070US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.38	13.30	13.28	14.22	15.40	11.95	12.87	12.85	13.79	14.97
	3H	14.04	14.86	14.95	15.79	16.99	13.57	14.39	14.48	15.32	16.53
	4H	14.62	15.40	15.55	16.34	17.55	14.15	14.93	15.08	15.87	17.08
	6H	15.01	15.74	15.95	16.68	17.90	14.55	15.27	15.49	16.21	17.43
	8H	15.12	15.80	16.06	16.76	17.99	14.65	15.34	15.60	16.29	17.52
	12H	15.16	15.82	16.12	16.77	18.02	14.69	15.34	15.64	16.30	17.55
4H	2H	12.84	13.63	13.78	14.56	15.77	12.50	13.28	13.44	14.22	15.43
	3H	14.71	15.36	15.65	16.32	17.55	14.32	14.97	15.26	15.93	17.16
	4H	15.41	16.01	16.37	16.97	18.22	15.01	15.61	15.97	16.57	17.82
	6H	15.92	16.44	16.89	17.42	18.67	15.52	16.03	16.49	17.02	18.27
	8H	16.07	16.55	17.04	17.53	18.79	15.67	16.14	16.63	17.12	18.39
	12H	16.14	16.58	17.13	17.57	18.84	15.73	16.16	16.72	17.15	18.43
8H	4H	15.61	16.09	16.58	17.07	18.34	15.26	15.74	16.22	16.71	17.98
	6H	16.24	16.63	17.23	17.65	18.92	15.88	16.27	16.87	17.29	18.56
	8H	16.45	16.80	17.45	17.81	19.09	16.09	16.44	17.09	17.44	18.73
	12H	16.58	16.89	17.59	17.89	19.22	16.20	16.51	17.21	17.51	18.84
12H	4H	15.60	16.03	16.59	17.03	18.30	15.25	15.68	16.24	16.68	17.95
	6H	16.26	16.61	17.27	17.62	18.90	15.92	16.27	16.92	17.27	18.56
	8H	16.50	16.81	17.51	17.81	19.14	16.15	16.46	17.16	17.46	18.79