

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923482

Luminaire Tested: DFN2DIP-TR3F0-040D030US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923482
REPORT IS A COMBINATION OF REPORTS P900273 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-040D030US940-FLLFLL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5898.7 lumens
Efficiency: N/A
Efficacy: 102.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 57.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923482

CATALOG NUMBER: DFN2DIP-TR3F0-040D030US940-FLLFLL

Luminous Intensity Polar Plot

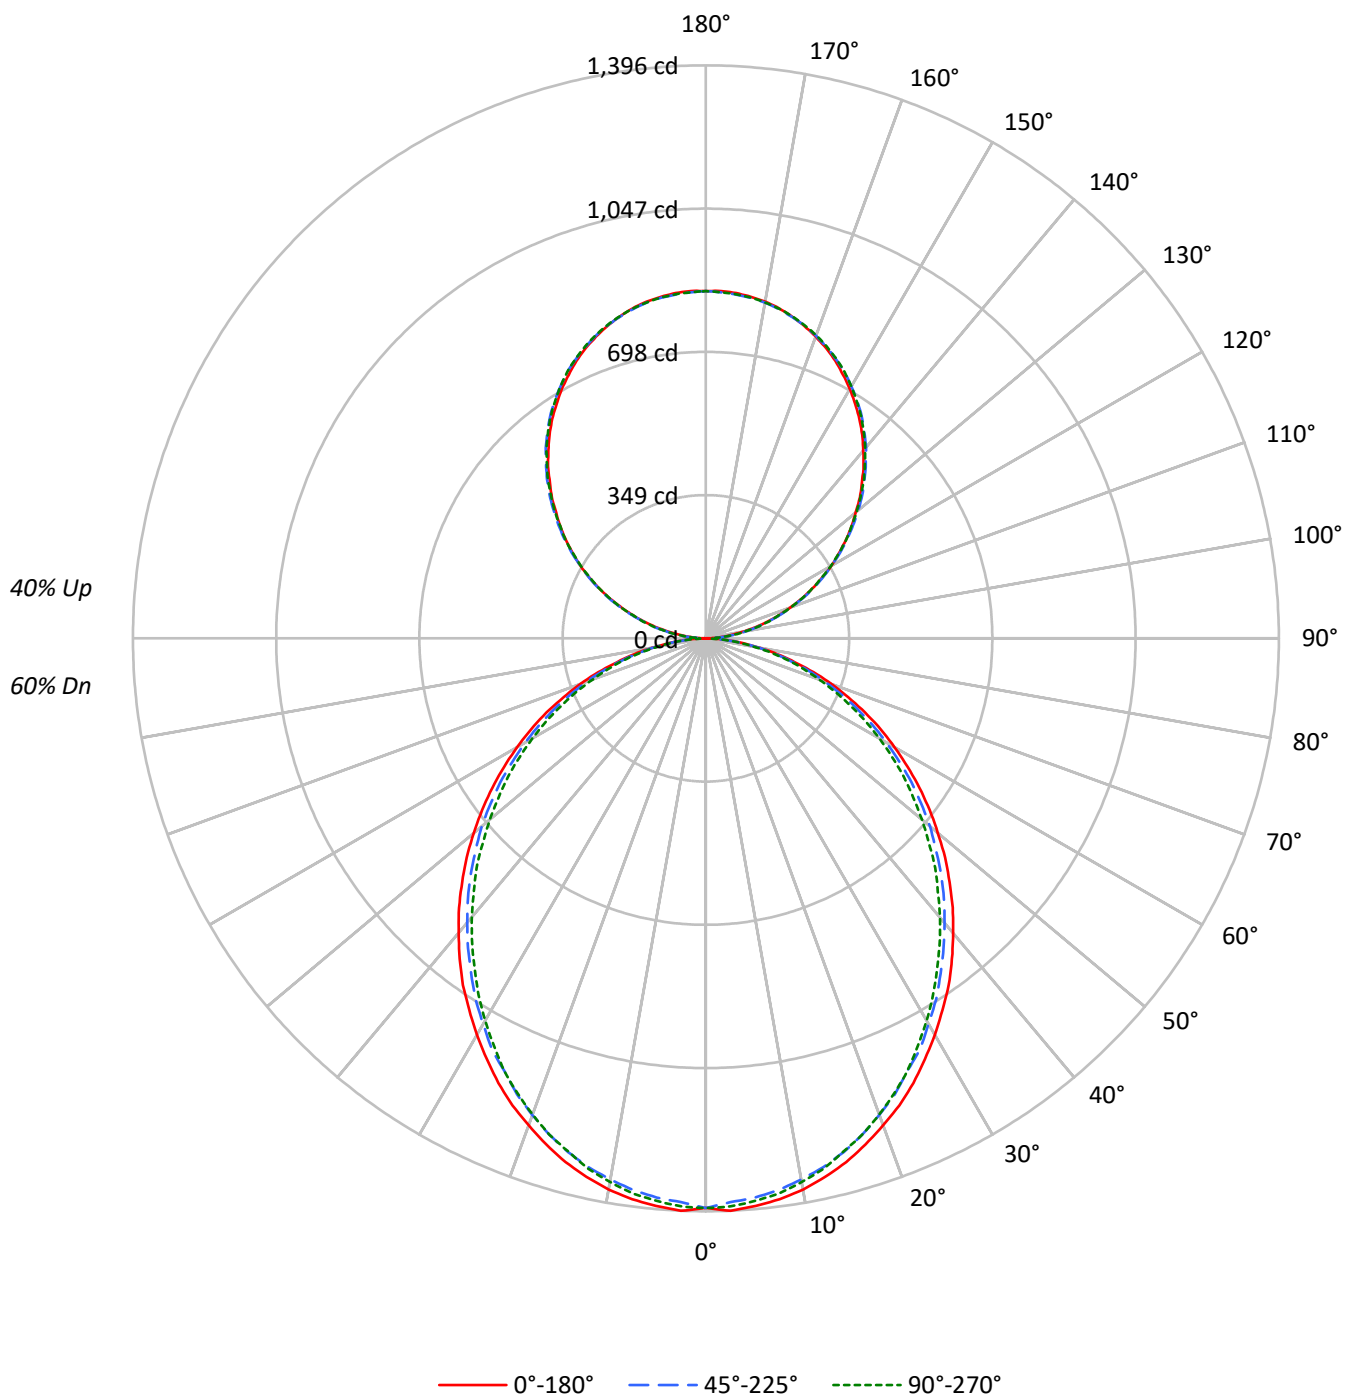

TEST NUMBER: P923482

CATALOG NUMBER: DFN2DIP-TR3F0-040D030US940-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	100	96	92	88	93	89	86	83	78	75	73	67	66	64	58	56	55
2	91	84	77	72	85	78	73	68	68	64	61	59	56	53	51	48	46
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	45	42	40
4	76	65	57	51	71	61	54	48	54	48	43	47	42	39	40	37	34
5	70	58	50	44	65	55	47	42	48	42	38	42	37	34	36	33	30
6	64	52	44	38	60	49	42	36	43	37	33	38	33	29	33	29	26
7	60	47	39	33	56	44	37	32	39	33	29	35	30	26	30	26	23
8	55	43	35	30	52	40	33	28	36	30	26	32	27	23	28	24	21
9	52	39	32	26	48	37	30	25	33	27	23	29	24	21	26	22	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	24	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1729	1729	1729
5°	1731	1704	1716
10°	1716	1679	1691
15°	1690	1650	1654
20°	1655	1610	1616
25°	1620	1563	1571
30°	1577	1519	1516
35°	1535	1467	1457
40°	1485	1414	1401
45°	1434	1362	1343
50°	1379	1307	1277
55°	1320	1242	1215
60°	1255	1167	1145
65°	1183	1088	1062
70°	1092	992	972
75°	965	876	888
80°	812	729	730
85°	574	480	471

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1434 cd/sqm

TEST NUMBER: P923482

CATALOG NUMBER: DFN2DIP-TR3F0-040D030US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	130.6	2.2
10°-20°	367.5	6.2
20°-30°	540.1	9.2
30°-40°	627.3	10.6
40°-50°	626.6	10.6
50°-60°	546.3	9.3
60°-70°	403.9	6.8
70°-80°	228.5	3.9
80°-90°	62.7	1.1
90°-100°	52.3	0.9
100°-110°	166.3	2.8
110°-120°	284.7	4.8
120°-130°	374.4	6.3
130°-140°	420.2	7.1
140°-150°	412.1	7.0
150°-160°	345.7	5.9
160°-170°	229.2	3.9
170°-180°	80.1	1.4
0°-30°	1038.3	17.6
0°-40°	1665.6	28.2
0°-60°	2838.5	48.1
0°-90°	3533.6	59.9
90°-120°	503.4	8.5
90°-150°	1710.0	29.0
90°-180°	2365.0	40.1
0°-180°	5898.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1388	1388	1388	1388	1388	
5°	1388	1383	1368	1378	1376	132
15°	1321	1313	1296	1301	1295	372
25°	1196	1185	1162	1165	1162	550
35°	1032	1018	997	989	982	644
45°	840	830	810	796	790	648
55°	635	627	611	595	589	568
65°	428	420	407	395	388	424
75°	224	222	215	207	210	239
85°	55	53	52	48	47	61
90°	1	9	25	24	24	6
95°	37	44	46	46	44	41
105°	154	156	157	158	158	162
115°	286	290	288	288	286	283
125°	416	422	420	418	417	371
135°	537	545	547	546	544	415
145°	652	658	662	662	660	408
155°	746	748	750	754	752	343
165°	812	811	811	816	812	229
175°	844	842	841	846	842	80
180°	846	846	846	846	846	

TEST NUMBER: P923482

CATALOG NUMBER: DFN2DIP-TR3F0-040D030US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1387.9	1387.9	1387.9	1387.9	1387.9
2.5°	1396.0	1389.3	1374.6	1387.9	1385.4
5°	1387.9	1382.6	1367.9	1378.5	1376.0
7.5°	1378.5	1370.6	1355.8	1366.6	1364.0
10°	1364.0	1354.6	1338.6	1349.2	1345.2
12.5°	1343.8	1335.9	1319.9	1326.6	1323.8
15°	1321.2	1313.2	1295.8	1301.2	1294.6
17.5°	1293.2	1285.2	1267.8	1274.4	1267.8
20°	1262.4	1254.5	1235.8	1239.7	1234.6
22.5°	1231.8	1219.8	1202.4	1202.4	1199.7
25°	1195.7	1185.1	1162.4	1165.0	1162.4
27.5°	1155.7	1146.3	1129.1	1125.1	1118.5
30°	1115.7	1105.0	1085.0	1081.0	1075.7
32.5°	1073.0	1065.1	1043.7	1035.6	1030.2
35°	1031.6	1018.3	996.9	988.9	982.2
37.5°	984.9	972.9	951.5	942.2	935.5
40°	936.9	926.1	904.7	892.9	887.5
42.5°	890.2	879.4	858.2	844.7	836.8
45°	839.5	830.2	810.0	795.5	790.1
47.5°	790.1	780.7	759.4	744.7	736.7
50°	738.0	731.3	712.7	693.9	687.2
52.5°	687.2	678.0	660.7	646.0	636.6
55°	635.3	627.2	611.3	595.2	588.6
57.5°	583.2	576.6	559.1	543.1	537.8
60°	531.1	525.8	507.2	492.5	488.5
62.5°	480.5	471.1	457.8	444.4	439.1
65°	428.5	420.4	407.1	395.0	388.4
67.5°	375.1	368.3	356.4	347.1	341.7
70°	325.7	320.3	308.3	298.9	293.6
72.5°	275.0	269.6	263.0	253.6	249.6
75°	224.2	221.6	214.8	206.9	209.6
77.5°	178.8	173.4	170.8	166.7	162.8
80°	133.5	132.1	129.4	125.5	122.8
82.5°	90.8	90.8	89.5	84.1	84.1
85°	54.7	53.4	52.1	48.0	46.7
87.5°	24.1	21.4	18.7	14.7	13.3
90°	0.8	9.2	25.0	23.5	24.3
92.5°	15.8	21.4	22.2	22.9	22.9
95°	37.3	44.4	45.7	45.7	44.4
97.5°	62.0	68.6	71.4	71.4	71.4
100°	90.5	96.4	98.4	98.4	97.7
102.5°	120.6	125.0	127.8	128.6	127.8
105°	153.6	155.6	157.1	158.4	158.4
107.5°	186.2	189.2	189.2	189.8	186.2
110°	217.8	221.9	221.9	221.9	219.9

TEST NUMBER: P923482

CATALOG NUMBER: DFN2DIP-TR3F0-040D030US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	252.0	256.4	255.6	253.5	252.0
115°	285.7	289.7	288.5	287.8	285.7
117.5°	319.1	324.7	321.1	319.1	317.0
120°	352.8	358.4	352.8	352.8	350.4
122.5°	383.3	390.5	386.9	384.9	383.3
125°	415.5	421.9	419.8	417.5	416.8
127.5°	446.8	454.8	452.0	448.9	446.8
130°	476.2	485.4	484.1	482.6	479.7
132.5°	509.1	516.2	516.7	513.2	511.1
135°	537.4	545.3	546.9	546.1	544.0
137.5°	569.0	575.4	576.7	576.2	573.1
140°	596.8	603.2	606.8	606.8	604.0
142.5°	625.4	631.8	633.8	634.6	631.8
145°	652.5	657.5	661.6	662.4	659.6
147.5°	676.7	683.1	686.1	687.4	684.6
150°	701.7	706.1	708.8	711.1	708.8
152.5°	723.9	728.2	731.7	734.6	731.7
155°	746.1	748.1	750.4	753.9	751.7
157.5°	765.2	766.7	768.0	773.1	769.5
160°	782.3	783.8	784.6	788.9	785.9
162.5°	798.1	798.1	798.9	803.7	800.1
165°	811.6	810.8	810.8	815.9	812.3
167.5°	823.9	821.5	821.5	826.6	823.0
170°	833.0	831.0	830.3	835.4	831.0
172.5°	839.4	837.4	836.6	841.7	837.4
175°	844.5	842.5	841.0	846.1	841.7
177.5°	847.3	845.3	843.7	848.1	843.7
180°	846.1	846.1	846.1	846.1	846.1

TEST NUMBER: P923482

CATALOG NUMBER: DFN2DIP-TR3F0-040D030US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.99	10.95	10.86	11.84	12.96	9.56	10.52	10.43	11.41	12.53
	3H	11.65	12.51	12.53	13.41	14.55	11.18	12.04	12.06	12.94	14.09
	4H	12.23	13.05	13.13	13.95	15.11	11.77	12.58	12.66	13.48	14.64
	6H	12.63	13.38	13.54	14.29	15.46	12.16	12.91	13.07	13.82	14.99
	8H	12.73	13.45	13.65	14.38	15.55	12.27	12.98	13.18	13.91	15.08
	12H	12.78	13.46	13.70	14.39	15.58	12.31	12.99	13.23	13.91	15.11
4H	2H	10.46	11.27	11.36	12.18	13.33	10.12	10.93	11.02	11.83	12.99
	3H	12.32	13.00	13.23	13.94	15.11	11.93	12.61	12.84	13.55	14.72
	4H	13.03	13.65	13.96	14.58	15.78	12.63	13.25	13.56	14.18	15.38
	6H	13.55	14.08	14.48	15.04	16.23	13.14	13.68	14.08	14.63	15.83
	8H	13.69	14.19	14.63	15.14	16.35	13.29	13.79	14.23	14.73	15.95
	12H	13.77	14.22	14.72	15.18	16.40	13.35	13.80	14.31	14.77	15.99
8H	4H	13.23	13.73	14.17	14.68	15.90	12.88	13.38	13.82	14.33	15.54
	6H	13.86	14.27	14.82	15.26	16.47	13.50	13.91	14.47	14.90	16.12
	8H	14.07	14.44	15.05	15.42	16.65	13.71	14.08	14.68	15.06	16.29
	12H	14.20	14.53	15.18	15.50	16.78	13.83	14.15	14.80	15.12	16.40
12H	4H	13.22	13.67	14.18	14.64	15.86	12.87	13.33	13.83	14.29	15.51
	6H	13.89	14.25	14.86	15.23	16.46	13.54	13.91	14.51	14.89	16.12
	8H	14.13	14.45	15.10	15.42	16.70	13.77	14.10	14.75	15.07	16.35

END OF REPORT

FIELD PERFORMANCE MAY DIFFER FROM LABORATORY PERFORMANCE

8 of 8