

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923503

Luminaire Tested: DFN2DIP-TR3F0-040D080US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923503
REPORT IS A COMBINATION OF REPORTS P901863 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-040D080US940-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10593.6 lumens
Efficiency: N/A
Efficacy: 110.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 96.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923503

CATALOG NUMBER: DFN2DIP-TR3F0-040D080US940-FLLONL

Luminous Intensity Polar Plot

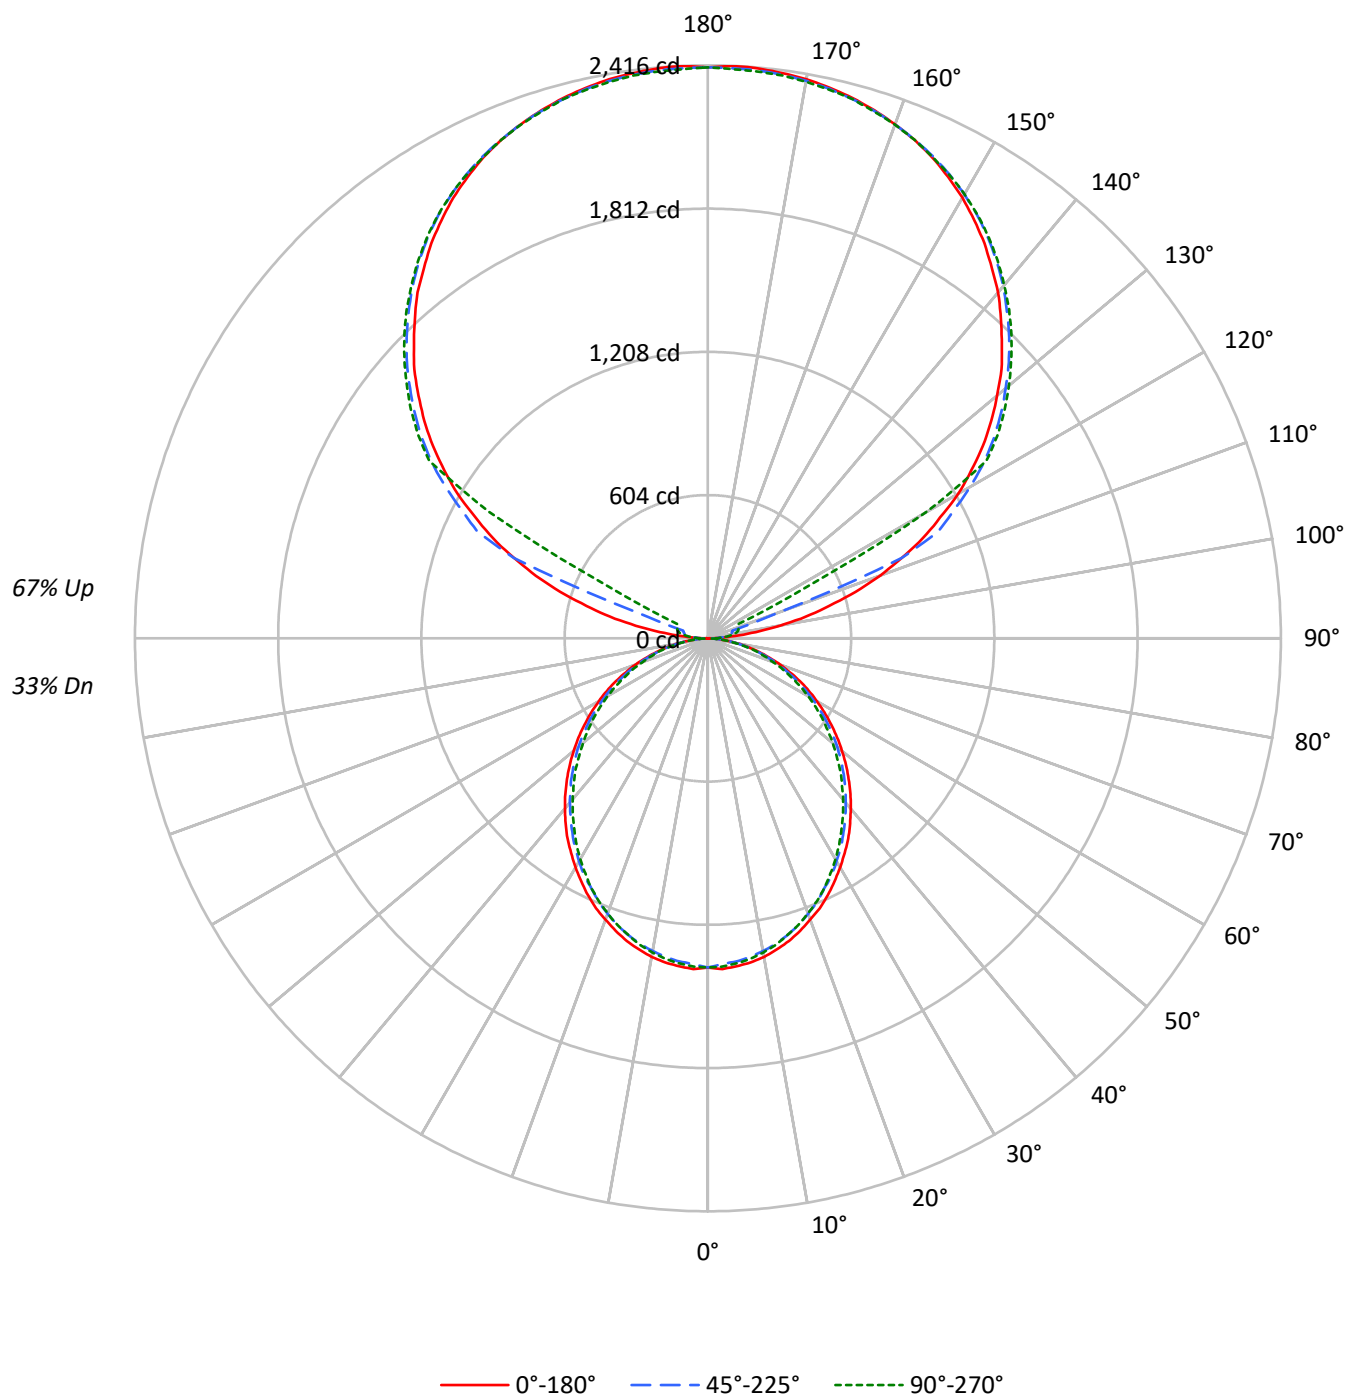

TEST NUMBER: P923503

CATALOG NUMBER: DFN2DIP-TR3F0-040D080US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1729	1729	1729
5°	1731	1704	1716
10°	1716	1679	1691
15°	1690	1650	1654
20°	1655	1610	1616
25°	1620	1563	1571
30°	1577	1519	1516
35°	1535	1467	1457
40°	1485	1414	1401
45°	1434	1362	1343
50°	1379	1307	1277
55°	1320	1242	1215
60°	1255	1167	1145
65°	1183	1088	1062
70°	1092	992	972
75°	965	876	888
80°	812	729	730
85°	574	480	471

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1602 cd/sqm

TEST NUMBER: P923503

CATALOG NUMBER: DFN2DIP-TR3F0-040D080US940-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	130.6	1.2
10°-20°	367.5	3.5
20°-30°	540.1	5.1
30°-40°	627.3	5.9
40°-50°	626.6	5.9
50°-60°	546.3	5.2
60°-70°	403.9	3.8
70°-80°	228.5	2.2
80°-90°	64.6	0.6
90°-100°	79.4	0.7
100°-110°	295.9	2.8
110°-120°	784.9	7.4
120°-130°	1301.8	12.3
130°-140°	1382.8	13.1
140°-150°	1285.1	12.1
150°-160°	1033.2	9.8
160°-170°	665.8	6.3
170°-180°	229.2	2.2
0°-30°	1038.3	9.8
0°-40°	1665.6	15.7
0°-60°	2838.5	26.8
0°-90°	3535.4	33.4
90°-120°	1160.2	11.0
90°-150°	5129.9	48.4
90°-180°	7058.0	66.6
0°-180°	10593.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1388	1388	1388	1388	1388	
5°	1388	1383	1368	1378	1376	132
15°	1321	1313	1296	1301	1295	372
25°	1196	1185	1162	1165	1162	550
35°	1032	1018	997	989	982	644
45°	840	830	810	796	790	648
55°	635	627	611	595	589	568
65°	428	420	407	395	388	424
75°	224	222	215	207	210	239
85°	55	53	52	48	47	61
90°	2	21	35	44	47	10
95°	113	56	68	77	75	134
105°	530	582	106	125	132	566
115°	1002	1031	1075	268	143	986
125°	1416	1439	1472	1484	1489	1263
135°	1753	1780	1796	1814	1810	1354
145°	2033	2031	2061	2073	2064	1272
155°	2238	2223	2244	2254	2240	1032
165°	2359	2348	2354	2366	2354	666
175°	2413	2400	2404	2416	2399	230
180°	2408	2408	2408	2408	2408	

TEST NUMBER: P923503

CATALOG NUMBER: DFN2DIP-TR3F0-040D080US940-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1387.9	1387.9	1387.9	1387.9	1387.9
2.5°	1396.0	1389.3	1374.6	1387.9	1385.4
5°	1387.9	1382.6	1367.9	1378.5	1376.0
7.5°	1378.5	1370.6	1355.8	1366.6	1364.0
10°	1364.0	1354.6	1338.6	1349.2	1345.2
12.5°	1343.8	1335.9	1319.9	1326.6	1323.8
15°	1321.2	1313.2	1295.8	1301.2	1294.6
17.5°	1293.2	1285.2	1267.8	1274.4	1267.8
20°	1262.4	1254.5	1235.8	1239.7	1234.6
22.5°	1231.8	1219.8	1202.4	1202.4	1199.7
25°	1195.7	1185.1	1162.4	1165.0	1162.4
27.5°	1155.7	1146.3	1129.1	1125.1	1118.5
30°	1115.7	1105.0	1085.0	1081.0	1075.7
32.5°	1073.0	1065.1	1043.7	1035.6	1030.2
35°	1031.6	1018.3	996.9	988.9	982.2
37.5°	984.9	972.9	951.5	942.2	935.5
40°	936.9	926.1	904.7	892.9	887.5
42.5°	890.2	879.4	858.2	844.7	836.8
45°	839.5	830.2	810.0	795.5	790.1
47.5°	790.1	780.7	759.4	744.7	736.7
50°	738.0	731.3	712.7	693.9	687.2
52.5°	687.2	678.0	660.7	646.0	636.6
55°	635.3	627.2	611.3	595.2	588.6
57.5°	583.2	576.6	559.1	543.1	537.8
60°	531.1	525.8	507.2	492.5	488.5
62.5°	480.5	471.1	457.8	444.4	439.1
65°	428.5	420.4	407.1	395.0	388.4
67.5°	375.1	368.3	356.4	347.1	341.7
70°	325.7	320.3	308.3	298.9	293.6
72.5°	275.0	269.6	263.0	253.6	249.6
75°	224.2	221.6	214.8	206.9	209.6
77.5°	178.8	173.4	170.8	166.7	162.8
80°	133.5	132.1	129.4	125.5	122.8
82.5°	90.8	90.8	89.5	84.1	84.1
85°	54.7	53.4	52.1	48.0	46.7
87.5°	24.1	21.4	18.7	14.7	13.3
90°	1.7	20.9	34.8	43.6	47.0
92.5°	43.6	36.6	41.8	45.3	47.0
95°	113.2	55.6	67.9	76.8	74.9
97.5°	203.8	61.0	88.7	94.2	95.8
100°	308.4	69.7	99.3	113.2	116.6
102.5°	423.3	419.9	102.8	121.8	127.2
105°	529.6	581.9	106.3	125.4	132.4
107.5°	653.3	696.7	109.9	128.9	135.9
110°	771.9	808.2	305.0	130.7	137.6

TEST NUMBER: P923503

CATALOG NUMBER: DFN2DIP-TR3F0-040D080US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	883.3	914.5	885.0	134.0	139.5
115°	1001.7	1031.3	1074.9	268.3	142.9
117.5°	1104.5	1139.2	1169.0	919.7	463.4
120°	1219.5	1245.5	1277.0	1297.9	1062.7
122.5°	1316.9	1344.9	1379.8	1390.2	1392.0
125°	1416.2	1439.0	1472.0	1484.3	1489.4
127.5°	1506.8	1531.2	1557.6	1574.8	1576.5
130°	1592.2	1620.1	1639.2	1658.5	1656.8
132.5°	1679.4	1702.1	1721.2	1736.9	1735.2
135°	1752.6	1780.5	1796.0	1813.6	1810.1
137.5°	1829.2	1850.0	1867.6	1885.0	1879.8
140°	1904.0	1918.1	1937.2	1952.8	1944.1
142.5°	1966.9	1979.1	2001.6	2015.5	2006.8
145°	2033.1	2031.2	2060.8	2073.0	2064.3
147.5°	2090.4	2085.3	2114.8	2123.5	2116.7
150°	2146.3	2134.0	2162.0	2172.3	2163.6
152.5°	2193.3	2179.3	2205.4	2216.0	2203.8
155°	2238.5	2223.0	2243.9	2254.2	2240.4
157.5°	2275.1	2261.3	2277.0	2289.2	2275.1
160°	2306.6	2296.1	2306.6	2316.9	2304.7
162.5°	2334.3	2324.0	2332.6	2344.8	2329.1
165°	2358.8	2348.4	2353.6	2365.7	2353.6
167.5°	2377.9	2367.4	2372.8	2385.0	2369.3
170°	2393.7	2383.1	2386.7	2398.9	2383.1
172.5°	2404.1	2393.7	2397.2	2409.4	2393.7
175°	2412.7	2400.5	2404.1	2416.2	2398.9
177.5°	2416.2	2404.1	2405.8	2418.1	2402.4
180°	2407.5	2407.5	2407.5	2407.5	2407.5

TEST NUMBER: P923503

CATALOG NUMBER: DFN2DIP-TR3F0-040D080US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.35	8.08	8.44	9.17	10.66	6.92	7.65	8.01	8.74	10.23
	3H	8.99	9.65	10.09	10.74	12.25	8.52	9.18	9.62	10.27	11.78
	4H	9.57	10.19	10.67	11.28	12.80	9.10	9.72	10.21	10.82	12.33
	6H	9.95	10.52	11.07	11.62	13.15	9.48	10.05	10.60	11.15	12.68
	8H	10.05	10.59	11.17	11.71	13.23	9.58	10.12	10.70	11.24	12.76
	12H	10.09	10.61	11.21	11.72	13.26	9.62	10.13	10.74	11.24	12.78
4H	2H	7.79	8.41	8.91	9.51	11.02	7.45	8.07	8.56	9.17	10.68
	3H	9.64	10.15	10.76	11.28	12.80	9.25	9.76	10.37	10.89	12.41
	4H	10.34	10.81	11.46	11.93	13.47	9.94	10.41	11.06	11.52	13.07
	6H	10.84	11.24	11.97	12.38	13.92	10.43	10.84	11.56	11.98	13.51
	8H	10.98	11.36	12.11	12.49	14.04	10.57	10.95	11.70	12.08	13.63
	12H	11.04	11.39	12.19	12.52	14.08	10.62	10.97	11.77	12.11	13.67
8H	4H	10.52	10.90	11.65	12.03	13.58	10.16	10.54	11.29	11.67	13.23
	6H	11.13	11.45	12.29	12.62	14.17	10.78	11.09	11.93	12.26	13.81
	8H	11.35	11.62	12.51	12.77	14.34	10.98	11.26	12.14	12.41	13.98
	12H	11.47	11.71	12.63	12.85	14.46	11.09	11.33	12.25	12.48	14.08
12H	4H	10.50	10.84	11.65	11.98	13.54	10.15	10.49	11.30	11.63	13.19
	6H	11.16	11.44	12.32	12.58	14.16	10.81	11.09	11.97	12.24	13.81
	8H	11.39	11.63	12.55	12.78	14.38	11.04	11.28	12.20	12.42	14.03

END OF REPORT