

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923514

Luminaire Tested: DFN2DIP-TR3F0-050D040US940-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923514
REPORT IS A COMBINATION OF REPORTS P900290 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-050D040US940-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 6946.5 lumens
Efficiency: N/A
Efficacy: 92.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 74.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923514

CATALOG NUMBER: DFN2DIP-TR3F0-050D040US940-RLLFLL

Luminous Intensity Polar Plot

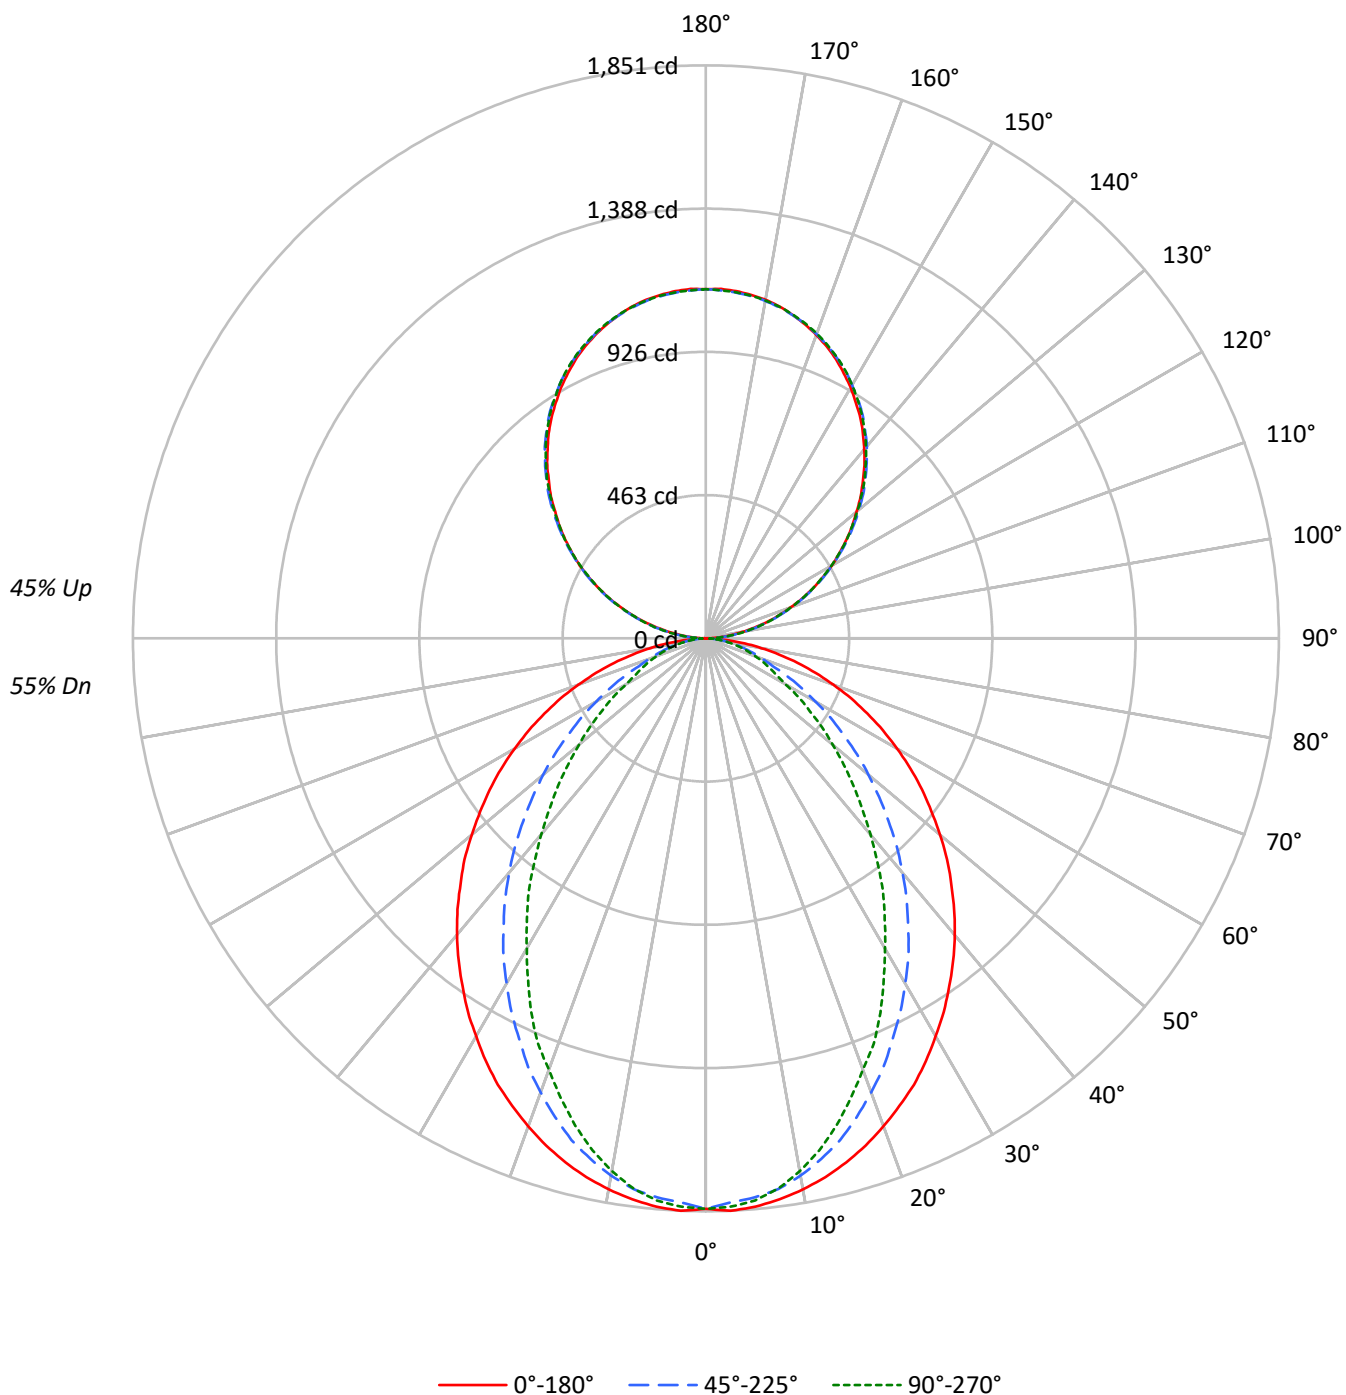

TEST NUMBER: P923514

CATALOG NUMBER: DFN2DIP-TR3F0-050D040US940-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60
1	99	95	91	88	92	89	85	82	76	74	72	65	63	62	54	53	52
2	91	84	78	73	84	78	73	69	67	63	60	57	55	52	48	46	45
3	83	74	67	61	77	69	63	58	60	55	51	51	48	45	43	41	39
4	76	66	58	52	71	62	55	50	54	48	44	46	42	39	39	36	34
5	70	59	51	45	65	55	48	43	48	43	38	42	37	34	35	32	30
6	65	53	45	40	60	50	43	38	44	38	34	38	33	30	32	29	26
7	60	48	40	35	56	45	38	33	40	34	30	35	30	27	30	26	24
8	56	44	36	31	52	41	34	30	36	31	27	32	27	24	27	24	21
9	52	40	33	28	49	38	31	27	34	28	24	29	25	22	25	22	19
10	49	37	30	25	46	35	28	24	31	26	22	27	23	20	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2296	2296	2296
5°	2299	2258	2273
10°	2275	2212	2197
15°	2242	2137	2082
20°	2199	2034	1940
25°	2156	1919	1803
30°	2097	1802	1631
35°	2040	1676	1479
40°	1982	1546	1306
45°	1914	1402	1148
50°	1844	1257	995
55°	1771	1101	847
60°	1686	940	696
65°	1588	775	625
70°	1470	622	563
75°	1321	544	509
80°	1105	451	436
85°	753	292	320

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1914 cd/sqm

TEST NUMBER: P923514

CATALOG NUMBER: DFN2DIP-TR3F0-050D040US940-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.7	2.5
10°-20°	474.1	6.8
20°-30°	665.6	9.6
30°-40°	725.6	10.4
40°-50°	666.9	9.6
50°-60°	523.7	7.5
60°-70°	340.9	4.9
70°-80°	175.5	2.5
80°-90°	48.0	0.7
90°-100°	69.8	1.0
100°-110°	221.8	3.2
110°-120°	379.5	5.5
120°-130°	499.2	7.2
130°-140°	560.3	8.1
140°-150°	549.4	7.9
150°-160°	460.9	6.6
160°-170°	305.7	4.4
170°-180°	106.8	1.5
0°-30°	1312.4	18.9
0°-40°	2038.0	29.3
0°-60°	3228.6	46.5
0°-90°	3793.0	54.6
90°-120°	671.2	9.7
90°-150°	2280.1	32.8
90°-180°	3153.0	45.4
0°-180°	6946.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1843	1843	1843	1843	1843	
5°	1843	1834	1813	1828	1823	175
15°	1753	1734	1678	1646	1629	494
25°	1591	1538	1427	1359	1334	732
35°	1371	1286	1139	1034	997	858
45°	1121	1009	834	715	675	865
55°	852	722	542	442	410	761
65°	575	440	290	234	228	570
75°	307	190	133	122	120	324
85°	72	37	32	32	32	82
90°	1	12	33	31	32	7
95°	50	59	61	61	59	55
105°	205	207	210	211	211	216
115°	381	386	385	384	381	377
125°	554	562	560	557	556	495
135°	717	727	729	728	725	554
145°	870	877	882	883	880	544
155°	995	998	1000	1005	1002	458
165°	1082	1081	1081	1088	1083	305
175°	1126	1123	1121	1128	1122	107
180°	1128	1128	1128	1128	1128	

TEST NUMBER: P923514

CATALOG NUMBER: DFN2DIP-TR3F0-050D040US940-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1842.7	1842.7	1842.7	1842.7	1842.7
2.5°	1851.0	1842.7	1824.4	1841.1	1837.7
5°	1842.7	1834.4	1812.7	1827.6	1822.7
7.5°	1827.6	1817.8	1794.4	1801.0	1792.6
10°	1807.7	1796.0	1762.7	1757.7	1747.7
12.5°	1782.7	1767.7	1722.6	1712.7	1694.2
15°	1752.7	1734.3	1677.7	1646.0	1629.3
17.5°	1717.6	1691.0	1620.9	1584.2	1557.5
20°	1677.7	1644.2	1560.8	1519.3	1482.5
22.5°	1634.3	1595.9	1499.1	1442.5	1417.6
25°	1590.9	1537.5	1427.4	1359.1	1334.0
27.5°	1539.3	1482.5	1360.8	1282.4	1244.0
30°	1484.3	1420.8	1287.4	1202.4	1157.3
32.5°	1430.8	1354.1	1217.5	1117.3	1075.6
35°	1370.8	1285.8	1139.1	1033.9	997.2
37.5°	1312.4	1220.7	1065.7	950.5	908.9
40°	1250.7	1150.8	988.8	870.5	827.2
42.5°	1187.4	1080.7	912.2	788.7	747.2
45°	1120.7	1008.9	833.8	715.3	675.3
47.5°	1057.3	939.0	758.8	640.3	603.7
50°	987.3	868.9	685.5	570.2	535.4
52.5°	918.8	793.7	615.4	505.3	473.7
55°	852.1	722.0	541.9	441.9	410.3
57.5°	783.8	650.4	477.0	383.6	356.9
60°	713.7	580.3	408.5	323.6	296.9
62.5°	645.4	512.0	350.2	270.2	256.9
65°	575.3	440.2	290.2	233.5	228.5
67.5°	508.6	373.5	233.5	205.1	200.1
70°	438.6	308.5	193.4	176.7	170.0
72.5°	371.9	248.4	161.8	148.5	145.1
75°	306.8	190.0	133.4	121.7	120.1
77.5°	241.8	135.0	105.1	98.4	95.0
80°	181.7	96.8	80.0	73.4	73.4
82.5°	126.7	65.1	55.0	51.6	51.6
85°	71.7	36.6	31.7	31.7	31.7
87.5°	26.8	13.3	13.3	11.7	11.7
90°	1.0	12.2	33.3	31.3	32.3
92.5°	21.0	28.5	29.6	30.6	30.6
95°	49.7	59.2	60.9	60.9	59.2
97.5°	82.7	91.5	95.2	95.2	95.2
100°	120.7	128.6	131.3	131.3	130.3
102.5°	160.9	166.7	170.4	171.4	170.4
105°	204.7	207.4	209.5	211.2	211.2
107.5°	248.3	252.4	252.4	253.0	248.3
110°	290.4	295.9	295.9	295.9	293.2

TEST NUMBER: P923514

CATALOG NUMBER: DFN2DIP-TR3F0-050D040US940-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	336.0	341.8	340.7	338.0	336.0
115°	380.8	386.4	384.6	383.6	380.8
117.5°	425.4	432.9	428.2	425.4	422.8
120°	470.4	477.8	470.4	470.4	467.3
122.5°	511.1	520.7	515.9	513.2	511.1
125°	554.0	562.5	559.8	556.7	555.7
127.5°	595.8	606.4	602.6	598.5	595.8
130°	634.9	647.2	645.5	643.5	639.7
132.5°	678.8	688.3	689.0	684.2	681.5
135°	716.6	727.1	729.2	728.1	725.4
137.5°	758.8	767.2	768.9	768.2	764.2
140°	795.8	804.3	809.0	809.0	805.3
142.5°	833.9	842.4	845.1	846.1	842.4
145°	870.0	876.7	882.2	883.2	879.5
147.5°	902.2	910.7	914.8	916.5	912.8
150°	935.6	941.4	945.1	948.2	945.1
152.5°	965.2	970.9	975.7	979.5	975.7
155°	994.7	997.5	1000.5	1005.3	1002.2
157.5°	1020.3	1022.3	1024.0	1030.8	1026.0
160°	1043.0	1045.1	1046.1	1051.9	1047.8
162.5°	1064.1	1064.1	1065.1	1071.6	1066.8
165°	1082.2	1081.1	1081.1	1087.9	1083.2
167.5°	1098.5	1095.4	1095.4	1102.2	1097.4
170°	1110.7	1108.0	1107.0	1113.7	1108.0
172.5°	1119.2	1116.5	1115.4	1122.3	1116.5
175°	1126.1	1123.3	1121.2	1128.0	1122.3
177.5°	1129.8	1127.0	1125.0	1130.8	1125.0
180°	1128.0	1128.0	1128.0	1128.0	1128.0

TEST NUMBER: P923514

CATALOG NUMBER: DFN2DIP-TR3F0-050D040US940-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.40	11.27	11.33	12.21	13.41	6.38	7.25	7.30	8.19	9.39
	3H	12.07	12.85	13.01	13.80	15.03	7.56	8.34	8.50	9.29	10.52
	4H	12.68	13.41	13.63	14.36	15.60	8.01	8.75	8.96	9.70	10.94
	6H	13.09	13.77	14.05	14.73	15.98	8.33	9.01	9.29	9.96	11.22
	8H	13.22	13.86	14.18	14.83	16.08	8.42	9.06	9.39	10.04	11.29
	12H	13.28	13.89	14.25	14.85	16.13	8.46	9.07	9.44	10.04	11.32
4H	2H	10.42	11.16	11.38	12.11	13.35	6.97	7.71	7.93	8.66	9.90
	3H	12.25	12.86	13.21	13.84	15.09	8.32	8.93	9.29	9.91	11.17
	4H	12.93	13.49	13.91	14.46	15.74	8.87	9.42	9.84	10.40	11.68
	6H	13.44	13.92	14.43	14.92	16.20	9.28	9.76	10.27	10.76	12.04
	8H	13.61	14.06	14.60	15.05	16.34	9.41	9.85	10.40	10.85	12.14
	12H	13.70	14.11	14.71	15.11	16.41	9.47	9.87	10.48	10.88	12.18
8H	4H	12.90	13.35	13.89	14.34	15.63	9.14	9.59	10.13	10.58	11.87
	6H	13.46	13.83	14.47	14.86	16.15	9.65	10.02	10.67	11.06	12.35
	8H	13.67	13.99	14.69	15.02	16.32	9.84	10.17	10.86	11.19	12.50
	12H	13.80	14.09	14.83	15.10	16.46	9.96	10.24	10.98	11.26	12.61
12H	4H	12.85	13.26	13.86	14.27	15.56	9.15	9.55	10.15	10.56	11.86
	6H	13.43	13.76	14.45	14.78	16.09	9.70	10.03	10.72	11.05	12.36
	8H	13.65	13.94	14.67	14.95	16.30	9.91	10.19	10.93	11.21	12.56

END OF REPORT