

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923582

Luminaire Tested: DFN2DIP-TR3F0-070D080US940-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923582
REPORT IS A COMBINATION OF REPORTS P900350 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-070D080US940-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11618.9 lumens
Efficiency: N/A
Efficacy: 88.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 131.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923582

CATALOG NUMBER: DFN2DIP-TR3F0-070D080US940-RLLFLL

Luminous Intensity Polar Plot

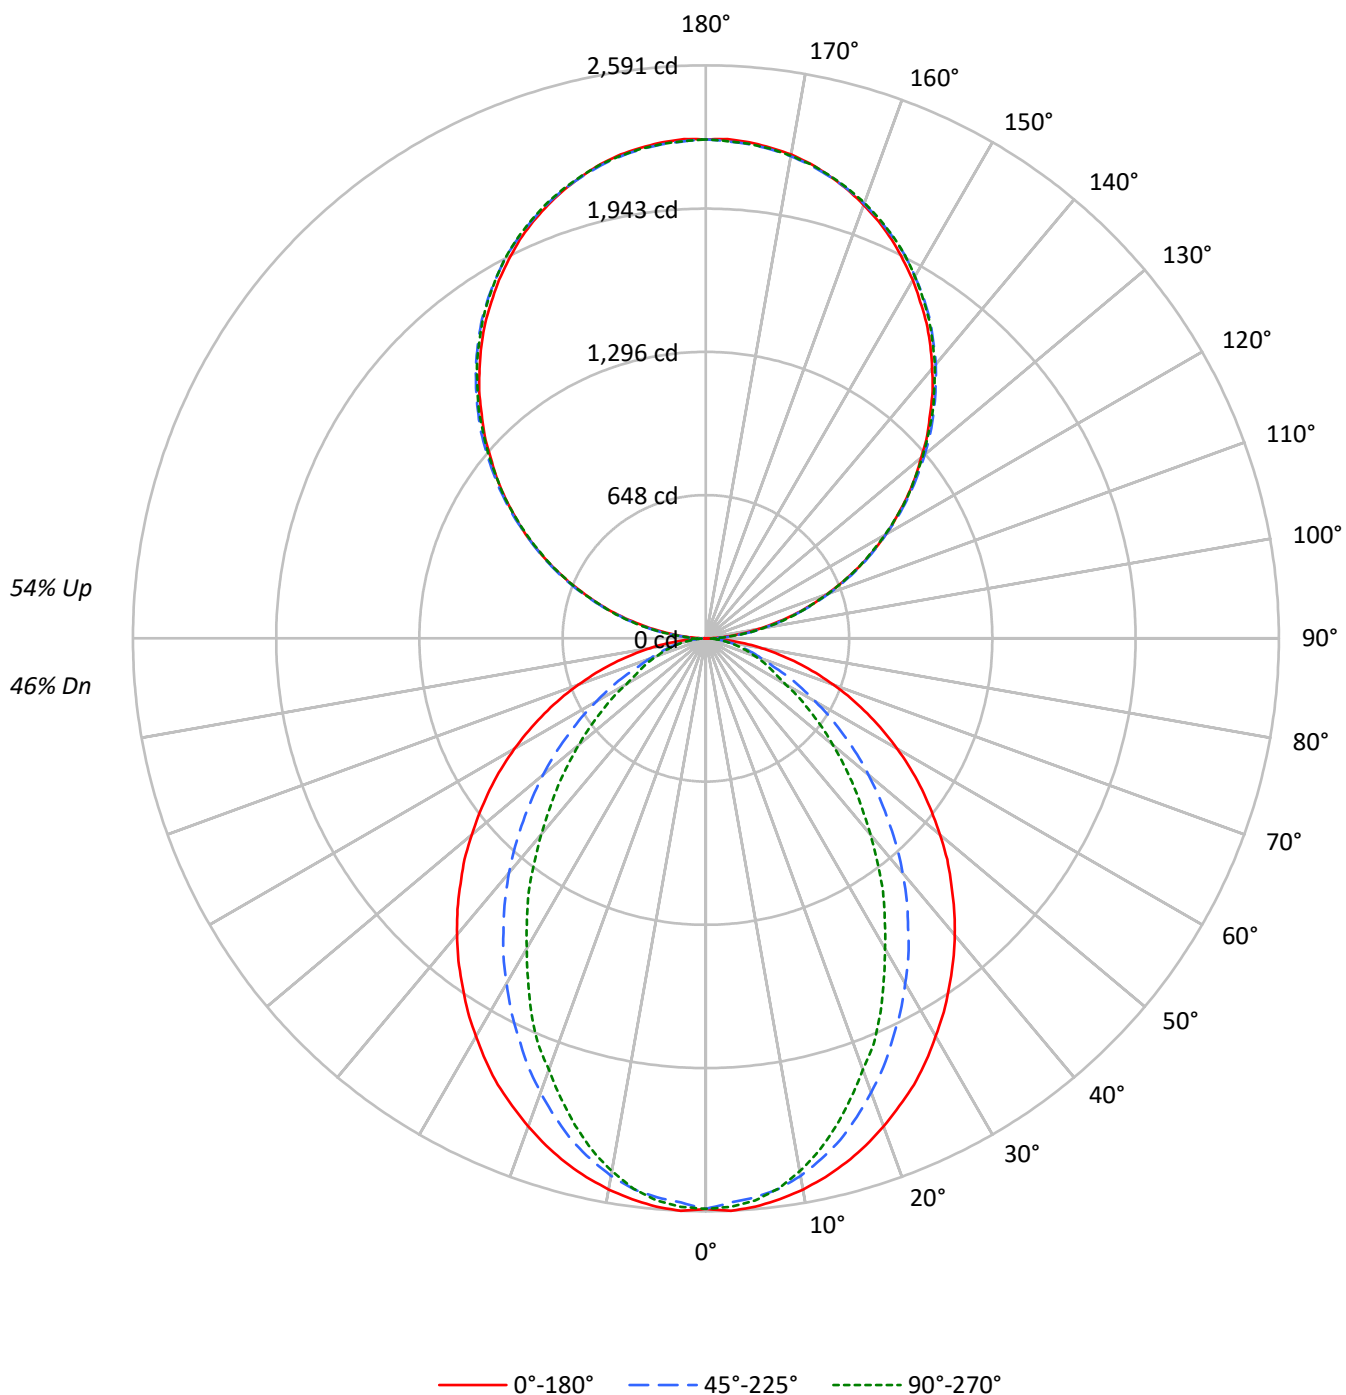

TEST NUMBER: P923582

CATALOG NUMBER: DFN2DIP-TR3F0-070D080US940-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52
1	97	93	89	86	89	86	82	80	72	69	67	59	57	56	47	46	45
2	89	82	76	71	81	75	70	66	63	60	56	52	49	47	42	40	38
3	81	72	65	60	74	67	61	56	56	52	48	46	43	40	37	35	33
4	75	64	57	51	68	59	53	48	50	45	41	42	38	35	34	31	29
5	69	57	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	35	31	34	30	27	28	25	23
7	59	47	39	34	54	43	37	32	37	32	28	31	27	24	26	23	20
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	18
9	51	39	32	27	47	36	30	25	31	26	22	26	22	20	22	19	17
10	47	36	29	24	44	33	27	23	29	24	20	24	20	18	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3215	3215	3215
5°	3218	3161	3182
10°	3185	3096	3076
15°	3139	2991	2914
20°	3079	2848	2716
25°	3018	2687	2525
30°	2936	2523	2283
35°	2856	2347	2071
40°	2775	2164	1828
45°	2680	1963	1607
50°	2582	1759	1392
55°	2479	1542	1186
60°	2361	1315	974
65°	2224	1086	874
70°	2058	871	788
75°	1849	762	713
80°	1548	631	611
85°	1053	408	447

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2680 cd/sqm

TEST NUMBER: P923582

CATALOG NUMBER: DFN2DIP-TR3F0-070D080US940-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	241.8	2.1
10°-20°	663.7	5.7
20°-30°	931.9	8.0
30°-40°	1015.8	8.7
40°-50°	933.6	8.0
50°-60°	733.2	6.3
60°-70°	477.3	4.1
70°-80°	245.7	2.1
80°-90°	69.1	0.6
90°-100°	139.6	1.2
100°-110°	443.6	3.8
110°-120°	759.1	6.5
120°-130°	998.3	8.6
130°-140°	1120.6	9.6
140°-150°	1098.9	9.5
150°-160°	921.8	7.9
160°-170°	611.3	5.3
170°-180°	213.7	1.8
0°-30°	1837.4	15.8
0°-40°	2853.2	24.6
0°-60°	4520.0	38.9
0°-90°	5312.1	45.7
90°-120°	1342.3	11.6
90°-150°	4560.1	39.2
90°-180°	6307.0	54.3
0°-180°	11618.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2580	2580	2580	2580	2580	
5°	2580	2568	2538	2559	2552	245
15°	2454	2428	2349	2304	2281	691
25°	2227	2152	1998	1903	1868	1024
35°	1919	1800	1595	1448	1396	1201
45°	1569	1412	1167	1002	946	1212
55°	1193	1011	759	619	574	1066
65°	806	616	406	327	320	799
75°	430	266	187	170	168	454
85°	100	51	44	44	44	115
90°	2	24	67	63	65	11
95°	99	118	122	122	118	111
105°	410	415	419	422	422	432
115°	762	773	769	767	762	753
125°	1108	1125	1120	1113	1111	990
135°	1433	1454	1458	1456	1451	1108
145°	1740	1754	1764	1766	1759	1087
155°	1990	1995	2001	2010	2004	916
165°	2164	2162	2162	2176	2166	611
175°	2252	2247	2242	2256	2244	214
180°	2256	2256	2256	2256	2256	

TEST NUMBER: P923582

CATALOG NUMBER: DFN2DIP-TR3F0-070D080US940-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2579.8	2579.8	2579.8	2579.8	2579.8
2.5°	2591.4	2579.8	2554.0	2577.6	2572.9
5°	2579.8	2568.1	2537.7	2558.8	2551.8
7.5°	2558.8	2544.9	2512.2	2521.3	2509.7
10°	2530.8	2514.4	2467.8	2460.7	2446.8
12.5°	2495.8	2474.8	2411.6	2397.7	2371.9
15°	2453.7	2427.9	2348.7	2304.4	2281.1
17.5°	2404.7	2367.3	2269.2	2217.9	2180.5
20°	2348.7	2301.9	2185.2	2127.0	2075.5
22.5°	2288.0	2234.3	2098.7	2019.5	1984.6
25°	2227.3	2152.5	1998.4	1902.8	1867.7
27.5°	2155.0	2075.5	1905.1	1795.4	1741.6
30°	2078.0	1989.0	1802.2	1683.4	1620.2
32.5°	2003.1	1895.7	1704.4	1564.2	1505.7
35°	1919.1	1800.0	1594.7	1447.6	1396.1
37.5°	1837.5	1708.9	1491.9	1330.6	1272.5
40°	1751.0	1611.1	1384.4	1218.7	1158.0
42.5°	1662.3	1513.0	1277.1	1104.2	1046.1
45°	1569.0	1412.4	1167.4	1001.5	945.5
47.5°	1480.2	1314.6	1062.4	896.4	845.2
50°	1382.2	1216.5	959.6	798.3	749.6
52.5°	1286.3	1111.2	861.5	707.4	663.1
55°	1192.9	1010.8	758.7	618.8	574.4
57.5°	1097.3	910.5	667.8	537.0	499.6
60°	999.3	812.4	571.9	453.1	415.6
62.5°	903.6	716.8	490.2	378.3	359.6
65°	805.5	616.3	406.3	327.0	319.8
67.5°	712.1	522.9	327.0	287.0	280.2
70°	614.0	431.9	270.7	247.4	238.0
72.5°	520.7	347.8	226.4	207.9	203.1
75°	429.5	266.0	186.7	170.4	168.2
77.5°	338.6	189.0	147.1	137.7	133.0
80°	254.4	135.5	112.0	102.8	102.8
82.5°	177.4	91.1	77.0	72.3	72.3
85°	100.3	51.3	44.3	44.3	44.3
87.5°	37.4	18.5	18.5	16.3	16.3
90°	2.1	24.5	66.7	62.6	64.6
92.5°	42.2	57.2	59.2	61.2	61.2
95°	99.3	118.3	121.7	121.7	118.3
97.5°	165.3	183.0	190.5	190.5	190.5
100°	241.5	257.1	262.5	262.5	260.5
102.5°	321.7	333.3	340.7	342.8	340.7
105°	409.5	414.9	419.0	422.4	422.4
107.5°	496.5	504.7	504.7	506.0	496.5
110°	580.9	591.7	591.7	591.7	586.3

TEST NUMBER: P923582

CATALOG NUMBER: DFN2DIP-TR3F0-070D080US940-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	672.0	683.6	681.5	676.1	672.0
115°	761.8	772.7	769.3	767.2	761.8
117.5°	850.9	865.9	856.3	850.9	845.4
120°	940.7	955.6	940.7	940.7	934.5
122.5°	1022.3	1041.3	1031.8	1026.4	1022.3
125°	1108.0	1125.0	1119.5	1113.4	1111.4
127.5°	1191.7	1212.7	1205.2	1197.1	1191.7
130°	1269.9	1294.3	1290.9	1286.9	1279.4
132.5°	1357.6	1376.6	1378.0	1368.5	1363.1
135°	1433.1	1454.2	1458.3	1456.3	1450.8
137.5°	1517.4	1534.5	1537.8	1536.5	1528.3
140°	1591.6	1608.6	1618.1	1618.1	1610.6
142.5°	1667.8	1684.8	1690.2	1692.3	1684.8
145°	1739.9	1753.5	1764.3	1766.4	1758.9
147.5°	1804.5	1821.5	1829.6	1833.1	1825.6
150°	1871.2	1882.7	1890.2	1896.3	1890.2
152.5°	1930.3	1941.9	1951.4	1958.9	1951.4
155°	1989.5	1994.9	2001.1	2010.5	2004.5
157.5°	2040.5	2044.6	2048.0	2061.5	2052.1
160°	2086.1	2090.2	2092.2	2103.7	2095.6
162.5°	2128.2	2128.2	2130.3	2143.2	2133.7
165°	2164.3	2162.2	2162.2	2175.9	2166.3
167.5°	2196.9	2190.8	2190.8	2204.4	2194.9
170°	2221.4	2216.0	2213.9	2227.6	2216.0
172.5°	2238.5	2233.0	2231.0	2244.5	2233.0
175°	2252.0	2246.6	2242.5	2256.1	2244.5
177.5°	2259.5	2254.1	2250.0	2261.6	2250.0
180°	2256.1	2256.1	2256.1	2256.1	2256.1

TEST NUMBER: P923582

CATALOG NUMBER: DFN2DIP-TR3F0-070D080US940-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.74	11.53	11.74	12.54	13.87	6.71	7.51	7.71	8.52	9.85
	3H	12.40	13.11	13.41	14.13	15.48	7.89	8.61	8.90	9.62	10.98
	4H	13.00	13.68	14.03	14.69	16.06	8.34	9.01	9.36	10.03	11.39
	6H	13.42	14.04	14.45	15.06	16.43	8.65	9.27	9.69	10.30	11.67
	8H	13.54	14.13	14.57	15.16	16.54	8.74	9.33	9.78	10.37	11.74
	12H	13.59	14.15	14.64	15.19	16.58	8.78	9.34	9.82	10.37	11.77
4H	2H	10.75	11.42	11.78	12.44	13.80	7.30	7.97	8.33	8.99	10.35
	3H	12.56	13.13	13.60	14.17	15.55	8.64	9.20	9.68	10.25	11.62
	4H	13.25	13.76	14.29	14.80	16.20	9.18	9.69	10.23	10.73	12.13
	6H	13.75	14.19	14.81	15.25	16.65	9.59	10.03	10.65	11.09	12.49
	8H	13.92	14.33	14.98	15.39	16.80	9.72	10.13	10.77	11.18	12.59
	12H	14.01	14.38	15.08	15.45	16.86	9.78	10.15	10.85	11.22	12.63
8H	4H	13.21	13.62	14.27	14.68	16.09	9.45	9.86	10.51	10.92	12.33
	6H	13.77	14.11	14.84	15.20	16.61	9.96	10.30	11.04	11.40	12.80
	8H	13.98	14.27	15.06	15.36	16.78	10.15	10.45	11.23	11.53	12.95
	12H	14.11	14.37	15.20	15.44	16.91	10.26	10.52	11.35	11.60	13.07
12H	4H	13.16	13.53	14.23	14.60	16.02	9.46	9.83	10.53	10.90	12.31
	6H	13.74	14.04	14.83	15.12	16.55	10.01	10.31	11.09	11.39	12.81
	8H	13.95	14.22	15.04	15.29	16.76	10.21	10.48	11.30	11.55	13.02

END OF REPORT