

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926185

Luminaire Tested: DFN2DIP-TR3F0-030D030US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926185
REPORT IS A COMBINATION OF REPORTS P901791 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-030D030US950-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5666.8 lumens
Efficiency: N/A
Efficacy: 121.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 46.7
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926185

CATALOG NUMBER: DFN2DIP-TR3F0-030D030US950-FLLONL

Luminous Intensity Polar Plot

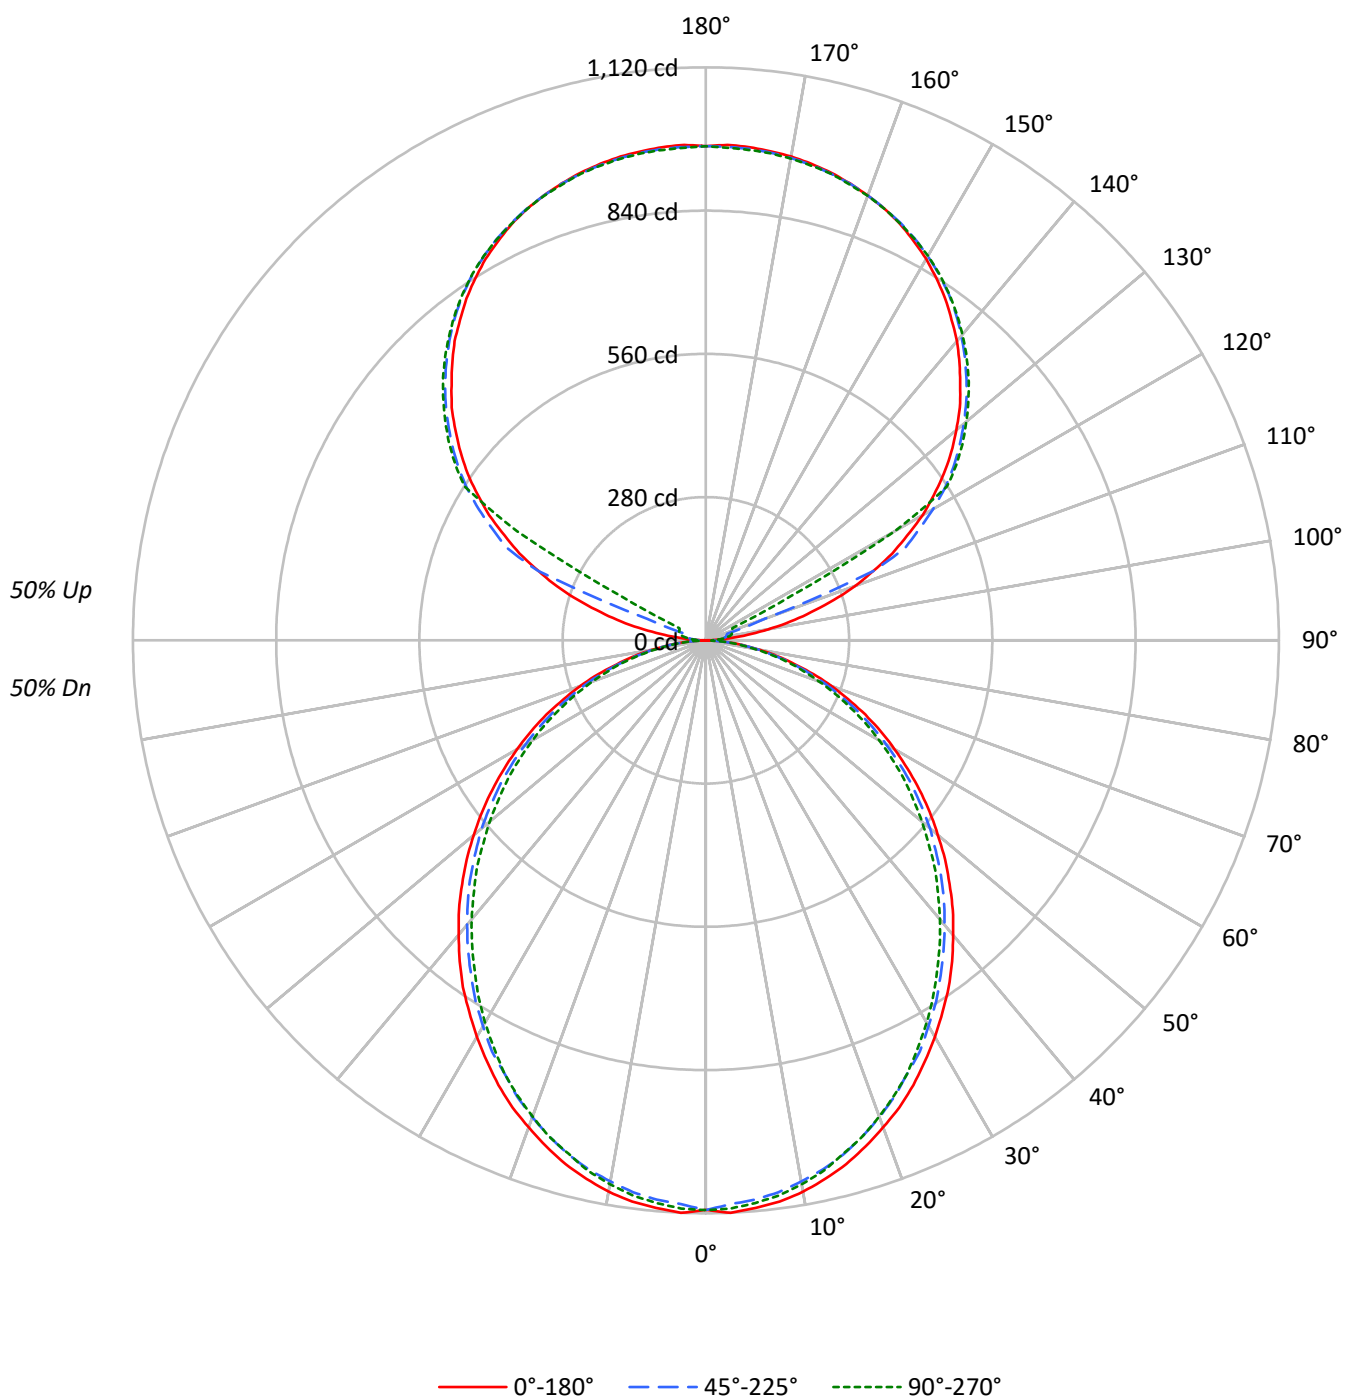

TEST NUMBER: P926185

CATALOG NUMBER: DFN2DIP-TR3F0-030D030US950-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1388	1388	1388
5°	1389	1367	1377
10°	1377	1348	1357
15°	1356	1324	1327
20°	1328	1292	1296
25°	1300	1254	1261
30°	1265	1219	1216
35°	1232	1177	1169
40°	1191	1135	1124
45°	1151	1093	1078
50°	1106	1048	1024
55°	1060	997	975
60°	1007	936	919
65°	949	873	852
70°	876	796	780
75°	774	703	713
80°	652	585	585
85°	461	385	378

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1151 cd/sqm

TEST NUMBER: P926185

CATALOG NUMBER: DFN2DIP-TR3F0-030D030US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	104.8	1.8
10°-20°	294.9	5.2
20°-30°	433.4	7.6
30°-40°	503.4	8.9
40°-50°	502.7	8.9
50°-60°	438.4	7.7
60°-70°	324.1	5.7
70°-80°	183.3	3.2
80°-90°	50.1	0.9
90°-100°	31.9	0.6
100°-110°	118.7	2.1
110°-120°	314.9	5.6
120°-130°	522.3	9.2
130°-140°	554.8	9.8
140°-150°	515.6	9.1
150°-160°	414.5	7.3
160°-170°	267.1	4.7
170°-180°	91.9	1.6
0°-30°	833.1	14.7
0°-40°	1336.5	23.6
0°-60°	2277.6	40.2
0°-90°	2835.1	50.0
90°-120°	465.5	8.2
90°-150°	2058.1	36.3
90°-180°	2832.0	50.0
0°-180°	5666.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1114	1114	1114	1114	1114	
5°	1114	1109	1098	1106	1104	106
15°	1060	1054	1040	1044	1039	299
25°	959	951	933	935	933	441
35°	828	817	800	793	788	517
45°	674	666	650	638	634	520
55°	510	503	490	478	472	456
65°	344	337	327	317	312	340
75°	180	178	172	166	168	192
85°	44	43	42	38	38	49
90°	1	8	14	18	19	5
95°	45	22	27	31	30	54
105°	212	233	43	50	53	227
115°	402	414	431	108	57	396
125°	568	577	591	596	598	507
135°	703	714	721	728	726	543
145°	816	815	827	832	828	510
155°	898	892	900	904	899	414
165°	946	942	944	949	944	267
175°	968	963	964	969	962	92
180°	966	966	966	966	966	

TEST NUMBER: P926185

CATALOG NUMBER: DFN2DIP-TR3F0-030D030US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1113.6	1113.6	1113.6	1113.6	1113.6
2.5°	1120.1	1114.7	1102.9	1113.6	1111.6
5°	1113.6	1109.4	1097.6	1106.2	1104.1
7.5°	1106.2	1099.8	1087.9	1096.6	1094.4
10°	1094.4	1086.9	1074.1	1082.6	1079.5
12.5°	1078.3	1071.9	1059.1	1064.4	1062.3
15°	1060.1	1053.8	1039.8	1044.1	1038.7
17.5°	1037.6	1031.3	1017.3	1022.6	1017.3
20°	1013.0	1006.6	991.6	994.7	990.5
22.5°	988.4	978.8	964.8	964.8	962.6
25°	959.4	950.9	932.7	934.8	932.7
27.5°	927.3	919.8	905.9	902.8	897.4
30°	895.2	886.6	870.6	867.4	863.1
32.5°	861.0	854.6	837.4	830.9	826.6
35°	827.8	817.1	799.9	793.4	788.1
37.5°	790.3	780.7	763.5	755.9	750.6
40°	751.8	743.2	726.0	716.5	712.2
42.5°	714.3	705.7	688.6	677.8	671.4
45°	673.6	666.1	650.0	638.2	633.9
47.5°	633.9	626.5	609.3	597.5	591.1
50°	592.1	586.8	571.8	556.8	551.5
52.5°	551.5	544.0	530.1	518.3	510.8
55°	509.8	503.3	490.5	477.7	472.3
57.5°	467.9	462.6	448.7	435.8	431.5
60°	426.2	422.0	407.0	395.1	392.0
62.5°	385.5	378.0	367.3	356.6	352.3
65°	343.8	337.3	326.6	317.0	311.7
67.5°	301.0	295.5	285.9	278.5	274.2
70°	261.3	257.0	247.4	239.8	235.6
72.5°	220.7	216.3	210.9	203.5	200.3
75°	179.8	177.8	172.4	166.0	168.2
77.5°	143.5	139.2	137.0	133.8	130.7
80°	107.1	106.0	103.8	100.6	98.5
82.5°	72.8	72.8	71.8	67.4	67.4
85°	43.9	42.8	41.8	38.5	37.5
87.5°	19.3	17.2	15.0	11.8	10.7
90°	0.7	8.4	13.9	17.6	18.8
92.5°	17.6	14.7	16.8	18.2	18.8
95°	45.4	22.3	27.2	30.8	30.1
97.5°	81.8	24.5	35.6	37.8	38.4
100°	123.7	28.0	39.9	45.4	46.8
102.5°	169.8	168.5	41.2	48.8	51.0
105°	212.5	233.4	42.6	50.3	53.1
107.5°	262.1	279.5	44.1	51.7	54.6
110°	309.7	324.3	122.3	52.5	55.2



TEST NUMBER: P926185

CATALOG NUMBER: DFN2DIP-TR3F0-030D030US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	354.4	366.9	355.1	53.8	55.9
115°	401.8	413.7	431.2	107.6	57.3
117.5°	443.1	457.1	469.0	369.0	185.9
120°	489.2	499.7	512.3	520.7	426.3
122.5°	528.3	539.6	553.6	557.7	558.5
125°	568.2	577.3	590.6	595.5	597.6
127.5°	604.5	614.3	624.9	631.8	632.5
130°	638.8	650.1	657.7	665.3	664.7
132.5°	673.7	682.9	690.5	696.8	696.1
135°	703.1	714.4	720.6	727.6	726.2
137.5°	733.8	742.2	749.3	756.2	754.1
140°	763.9	769.5	777.1	783.4	780.0
142.5°	789.1	794.0	803.1	808.6	805.2
145°	815.7	814.9	826.8	831.7	828.2
147.5°	838.7	836.6	848.5	851.9	849.2
150°	861.1	856.2	867.4	871.5	868.0
152.5°	879.9	874.3	884.8	889.0	884.2
155°	898.1	891.9	900.2	904.4	898.9
157.5°	912.8	907.3	913.6	918.4	912.8
160°	925.4	921.2	925.4	929.6	924.6
162.5°	936.5	932.3	935.9	940.7	934.4
165°	946.3	942.2	944.3	949.1	944.3
167.5°	954.0	949.8	951.9	956.9	950.6
170°	960.3	956.1	957.5	962.4	956.1
172.5°	964.5	960.3	961.7	966.6	960.3
175°	967.9	963.1	964.5	969.4	962.4
177.5°	969.4	964.5	965.3	970.1	963.8
180°	965.9	965.9	965.9	965.9	965.9

TEST NUMBER: P926185

CATALOG NUMBER: DFN2DIP-TR3F0-030D030US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.36	9.22	9.32	10.19	11.47	7.93	8.79	8.89	9.77	11.04
	3H	10.01	10.79	10.98	11.77	13.06	9.54	10.32	10.51	11.30	12.59
	4H	10.59	11.33	11.58	12.31	13.61	10.13	10.86	11.11	11.84	13.14
	6H	10.99	11.66	11.98	12.65	13.97	10.52	11.19	11.51	12.18	13.50
	8H	11.09	11.73	12.09	12.74	14.05	10.62	11.26	11.62	12.27	13.58
	12H	11.13	11.74	12.14	12.74	14.08	10.66	11.27	11.66	12.27	13.61
4H	2H	8.82	9.55	9.81	10.54	11.84	8.48	9.21	9.46	10.19	11.50
	3H	10.67	11.29	11.67	12.30	13.62	10.29	10.90	11.28	11.91	13.23
	4H	11.38	11.94	12.39	12.95	14.29	10.98	11.54	11.99	12.55	13.89
	6H	11.89	12.37	12.90	13.40	14.74	11.48	11.96	12.50	13.00	14.33
	8H	12.03	12.48	13.05	13.51	14.86	11.63	12.08	12.64	13.10	14.45
	12H	12.10	12.51	13.14	13.55	14.90	11.69	12.09	12.72	13.13	14.49
8H	4H	11.57	12.02	12.59	13.05	14.40	11.22	11.67	12.24	12.69	14.04
	6H	12.19	12.57	13.24	13.63	14.98	11.84	12.21	12.88	13.27	14.62
	8H	12.41	12.74	13.46	13.79	15.15	12.04	12.37	13.09	13.42	14.79
	12H	12.53	12.82	13.59	13.87	15.28	12.16	12.44	13.21	13.49	14.90
12H	4H	11.56	11.96	12.60	13.00	14.36	11.21	11.62	12.25	12.66	14.01
	6H	12.22	12.55	13.27	13.60	14.97	11.87	12.20	12.93	13.25	14.62
	8H	12.46	12.75	13.51	13.79	15.20	12.10	12.39	13.16	13.44	14.85

END OF REPORT