

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926269

Luminaire Tested: DFN2DIP-TR3F0-060D040US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926269
REPORT IS A COMBINATION OF REPORTS P901812 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D040US950-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8643.2 lumens
Efficiency: N/A
Efficacy: 99.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 86.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926269

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US950-RLLONL

Luminous Intensity Polar Plot

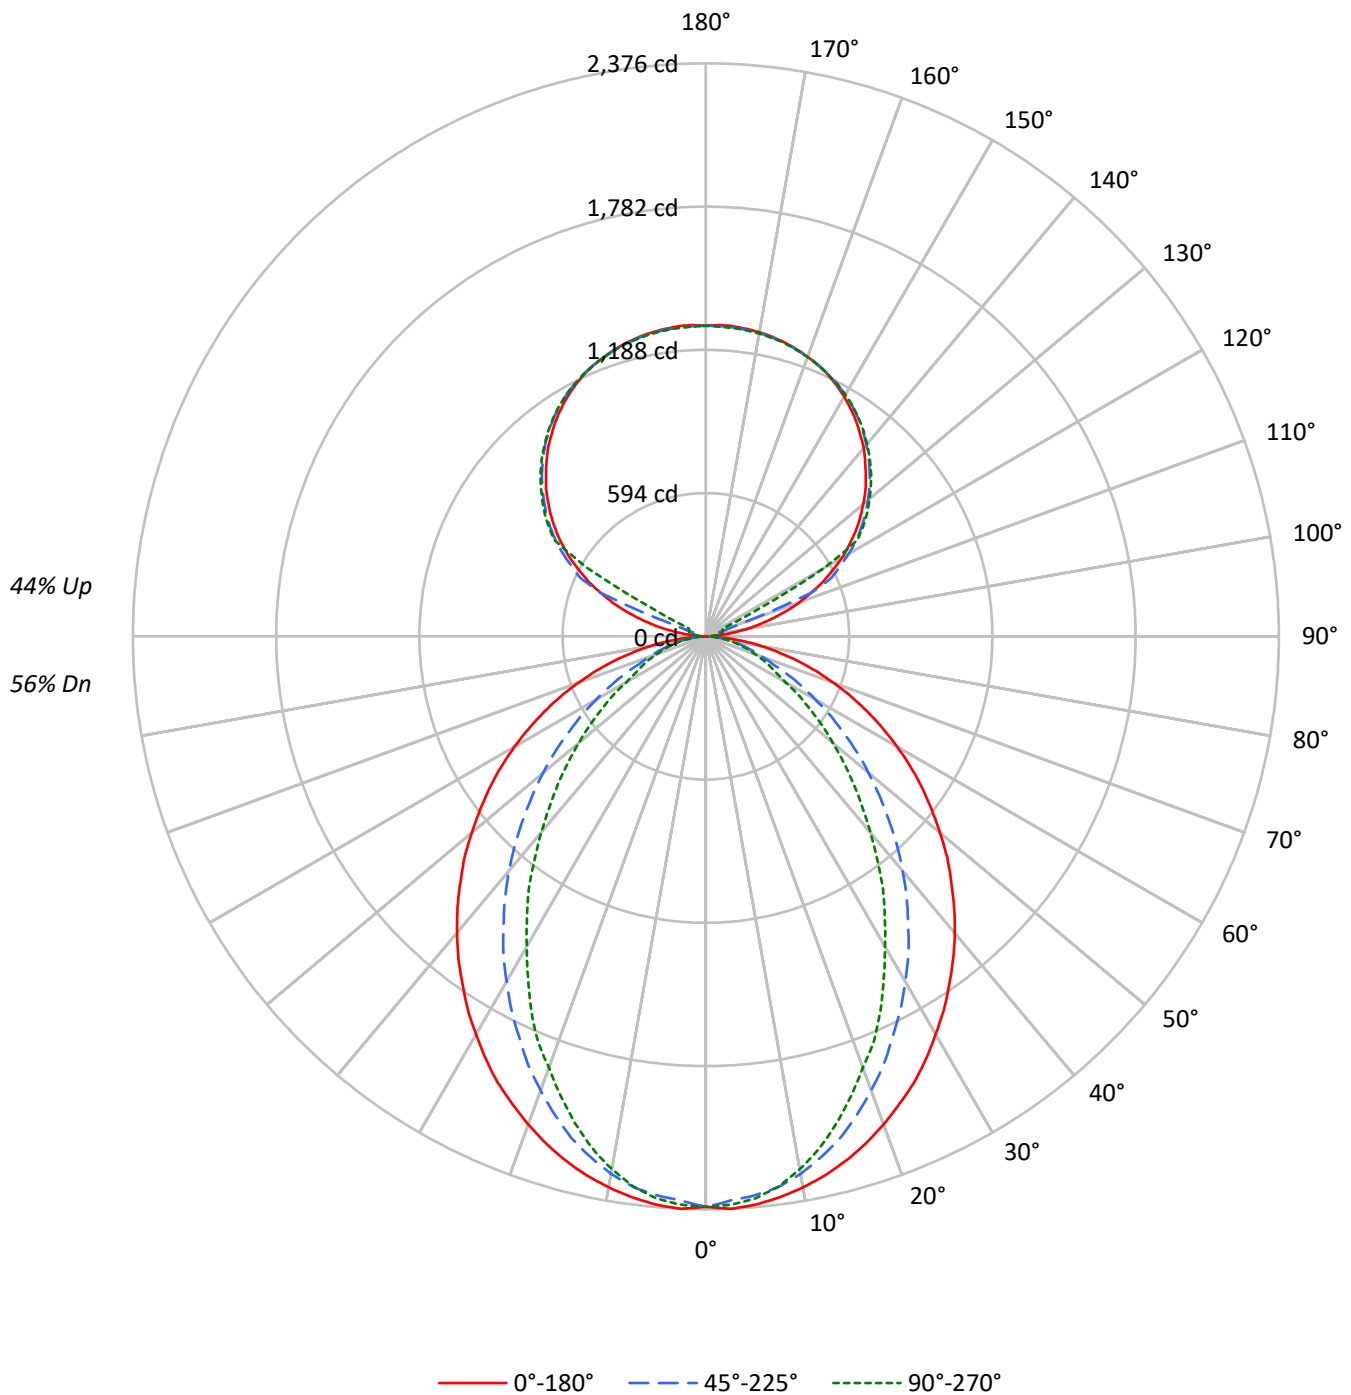

TEST NUMBER: P926269

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	100	96	92	88	93	89	86	83	77	75	72	66	64	63	56	54	53
2	91	84	78	73	85	79	73	69	68	64	61	58	56	53	50	48	46
3	84	74	67	62	78	70	63	58	61	56	52	52	49	46	44	42	40
4	77	66	59	53	71	62	55	50	54	49	45	47	43	40	40	37	35
5	71	59	51	46	66	56	49	43	49	43	39	42	38	35	36	33	31
6	65	54	46	40	61	50	43	38	44	39	34	39	34	31	33	30	27
7	61	49	41	35	56	46	39	34	40	35	30	35	31	27	30	27	24
8	56	44	37	31	52	42	35	30	37	31	27	32	28	25	28	25	22
9	53	41	33	28	49	38	32	27	34	28	25	30	25	22	26	23	20
10	49	37	30	25	46	35	29	24	31	26	22	28	23	20	24	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2948	2948	2948
5°	2951	2899	2918
10°	2920	2839	2821
15°	2878	2743	2672
20°	2824	2611	2491
25°	2767	2464	2315
30°	2693	2314	2094
35°	2619	2152	1899
40°	2544	1985	1676
45°	2458	1800	1474
50°	2368	1613	1277
55°	2274	1414	1087
60°	2165	1206	893
65°	2040	995	802
70°	1887	798	723
75°	1696	698	654
80°	1419	579	560
85°	966	374	409

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2458 cd/sqm

TEST NUMBER: P926269

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.7	2.6
10°-20°	608.7	7.0
20°-30°	854.5	9.9
30°-40°	931.5	10.8
40°-50°	856.2	9.9
50°-60°	672.4	7.8
60°-70°	437.7	5.1
70°-80°	225.3	2.6
80°-90°	59.8	0.7
90°-100°	42.5	0.5
100°-110°	158.3	1.8
110°-120°	419.9	4.9
120°-130°	696.4	8.1
130°-140°	739.7	8.6
140°-150°	687.5	8.0
150°-160°	552.7	6.4
160°-170°	356.1	4.1
170°-180°	122.6	1.4
0°-30°	1684.9	19.5
0°-40°	2616.4	30.3
0°-60°	4144.9	48.0
0°-90°	4867.7	56.3
90°-120°	620.6	7.2
90°-150°	2744.1	31.7
90°-180°	3776.0	43.7
0°-180°	8643.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2366	2366	2366	2366	2366	
5°	2366	2355	2327	2346	2340	224
15°	2250	2226	2154	2113	2092	634
25°	2042	1974	1833	1745	1713	939
35°	1760	1651	1462	1327	1280	1102
45°	1439	1295	1071	918	867	1111
55°	1094	927	696	567	527	978
65°	739	565	372	300	293	732
75°	394	244	171	156	154	417
85°	92	47	41	41	41	106
90°	1	11	19	23	25	8
95°	60	30	36	41	40	72
105°	283	311	57	67	71	303
115°	536	552	575	144	76	527
125°	758	770	787	794	797	676
135°	938	952	961	970	968	724
145°	1088	1087	1102	1109	1104	680
155°	1198	1189	1200	1206	1198	552
165°	1262	1256	1259	1266	1259	356
175°	1291	1284	1286	1292	1283	123
180°	1288	1288	1288	1288	1288	

TEST NUMBER: P926269

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2365.7	2365.7	2365.7	2365.7	2365.7
2.5°	2376.4	2365.7	2342.1	2363.6	2359.3
5°	2365.7	2355.0	2327.1	2346.5	2340.1
7.5°	2346.5	2333.7	2303.7	2312.1	2301.4
10°	2320.7	2305.7	2263.1	2256.5	2243.7
12.5°	2288.7	2269.4	2211.5	2198.8	2175.1
15°	2250.1	2226.4	2153.8	2113.1	2091.7
17.5°	2205.2	2170.8	2080.9	2033.8	1999.6
20°	2153.8	2110.8	2003.9	1950.5	1903.2
22.5°	2098.1	2048.8	1924.6	1851.9	1819.9
25°	2042.5	1973.9	1832.6	1745.0	1712.7
27.5°	1976.2	1903.2	1747.0	1646.3	1597.1
30°	1905.5	1824.0	1652.7	1543.7	1485.8
32.5°	1836.9	1738.4	1563.0	1434.4	1380.8
35°	1759.9	1650.7	1462.4	1327.4	1280.2
37.5°	1685.0	1567.0	1368.1	1220.3	1166.8
40°	1605.7	1477.4	1269.5	1117.5	1061.9
42.5°	1524.4	1387.4	1171.1	1012.6	959.2
45°	1438.7	1295.2	1070.6	918.3	867.0
47.5°	1357.4	1205.5	974.2	822.1	775.0
50°	1267.5	1115.5	880.0	732.1	687.4
52.5°	1179.5	1019.0	790.0	648.7	608.1
55°	1094.0	927.0	695.8	567.4	526.7
57.5°	1006.3	834.9	612.4	492.5	458.1
60°	916.3	745.1	524.5	415.5	381.1
62.5°	828.6	657.4	449.5	346.9	329.8
65°	738.7	565.1	372.5	299.8	293.3
67.5°	653.0	479.5	299.8	263.3	256.9
70°	563.1	396.1	248.2	227.0	218.3
72.5°	477.5	318.9	207.6	190.6	186.2
75°	393.9	243.9	171.2	156.3	154.3
77.5°	310.5	173.3	134.9	126.3	122.0
80°	233.3	124.2	102.7	94.3	94.3
82.5°	162.7	83.6	70.6	66.3	66.3
85°	92.0	47.0	40.6	40.6	40.6
87.5°	34.3	17.1	17.1	15.0	15.0
90°	0.9	11.2	18.6	23.4	25.1
92.5°	23.4	19.6	22.3	24.2	25.1
95°	60.5	29.8	36.3	41.0	40.1
97.5°	109.0	32.6	47.5	50.4	51.2
100°	164.9	37.3	53.1	60.5	62.4
102.5°	226.4	224.7	55.0	65.2	68.0
105°	283.2	311.3	56.9	67.1	70.8
107.5°	349.5	372.7	58.8	69.0	72.7
110°	412.9	432.4	163.1	69.9	73.6



TEST NUMBER: P926269

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	472.5	489.2	473.4	71.7	74.6
115°	535.8	551.6	575.0	143.5	76.5
117.5°	590.8	609.4	625.3	492.0	247.8
120°	652.3	666.3	683.1	694.3	568.5
122.5°	704.4	719.4	738.1	743.6	744.6
125°	757.6	769.8	787.4	794.0	796.8
127.5°	806.0	819.1	833.1	842.5	843.3
130°	851.7	866.7	876.8	887.1	886.3
132.5°	898.3	910.5	920.7	929.1	928.2
135°	937.5	952.5	960.8	970.1	968.3
137.5°	978.4	989.6	999.0	1008.3	1005.5
140°	1018.5	1026.0	1036.2	1044.6	1040.0
142.5°	1052.2	1058.7	1070.8	1078.1	1073.5
145°	1087.6	1086.6	1102.3	1108.9	1104.3
147.5°	1118.2	1115.4	1131.3	1135.9	1132.3
150°	1148.0	1141.6	1156.5	1162.1	1157.4
152.5°	1173.2	1165.8	1179.7	1185.3	1178.9
155°	1197.5	1189.2	1200.3	1205.9	1198.4
157.5°	1217.0	1209.6	1218.1	1224.6	1217.0
160°	1233.8	1228.2	1233.8	1239.3	1232.9
162.5°	1248.7	1243.2	1247.8	1254.3	1245.9
165°	1261.8	1256.2	1259.0	1265.5	1259.0
167.5°	1272.1	1266.3	1269.3	1275.8	1267.4
170°	1280.5	1274.8	1276.6	1283.2	1274.8
172.5°	1286.0	1280.5	1282.4	1288.9	1280.5
175°	1290.6	1284.1	1286.0	1292.5	1283.2
177.5°	1292.5	1286.0	1286.9	1293.5	1285.1
180°	1287.9	1287.9	1287.9	1287.9	1287.9

TEST NUMBER: P926269

CATALOG NUMBER: DFN2DIP-TR3F0-060D040US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.42	12.31	12.33	13.23	14.41	7.40	8.28	8.31	9.21	10.39
	3H	13.09	13.89	14.01	14.82	16.02	8.59	9.38	9.51	10.31	11.52
	4H	13.70	14.45	14.63	15.38	16.60	9.04	9.78	9.97	10.72	11.93
	6H	14.12	14.80	15.06	15.75	16.97	9.36	10.04	10.30	10.99	12.21
	8H	14.24	14.89	15.19	15.85	17.08	9.44	10.10	10.40	11.06	12.28
	12H	14.30	14.92	15.26	15.87	17.12	9.49	10.11	10.45	11.06	12.31
4H	2H	11.45	12.19	12.39	13.13	14.34	8.00	8.74	8.94	9.68	10.89
	3H	13.27	13.89	14.22	14.86	16.09	9.34	9.97	10.30	10.93	12.16
	4H	13.96	14.52	14.92	15.48	16.74	9.89	10.46	10.85	11.42	12.67
	6H	14.47	14.95	15.44	15.94	17.19	10.31	10.79	11.28	11.78	13.03
	8H	14.64	15.09	15.61	16.07	17.34	10.43	10.89	11.41	11.87	13.13
	12H	14.73	15.14	15.72	16.13	17.41	10.50	10.91	11.49	11.90	13.17
8H	4H	13.93	14.38	14.90	15.36	16.63	10.17	10.62	11.14	11.60	12.87
	6H	14.48	14.86	15.48	15.88	17.15	10.68	11.06	11.68	12.08	13.34
	8H	14.70	15.03	15.70	16.03	17.32	10.87	11.20	11.88	12.21	13.49
	12H	14.83	15.12	15.84	16.12	17.45	10.98	11.28	11.99	12.28	13.61
12H	4H	13.88	14.29	14.87	15.29	16.56	10.17	10.58	11.17	11.58	12.85
	6H	14.46	14.79	15.47	15.80	17.08	10.73	11.06	11.74	12.07	13.35
	8H	14.68	14.97	15.69	15.97	17.30	10.94	11.23	11.95	12.23	13.56

END OF REPORT