

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926284

Luminaire Tested: DFN2DIP-TR3F0-060D080US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926284
REPORT IS A COMBINATION OF REPORTS P900348 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-060D080US950-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11619.7 lumens
Efficiency: N/A
Efficacy: 98.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 118.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926284

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US950-RLLFLL

Luminous Intensity Polar Plot

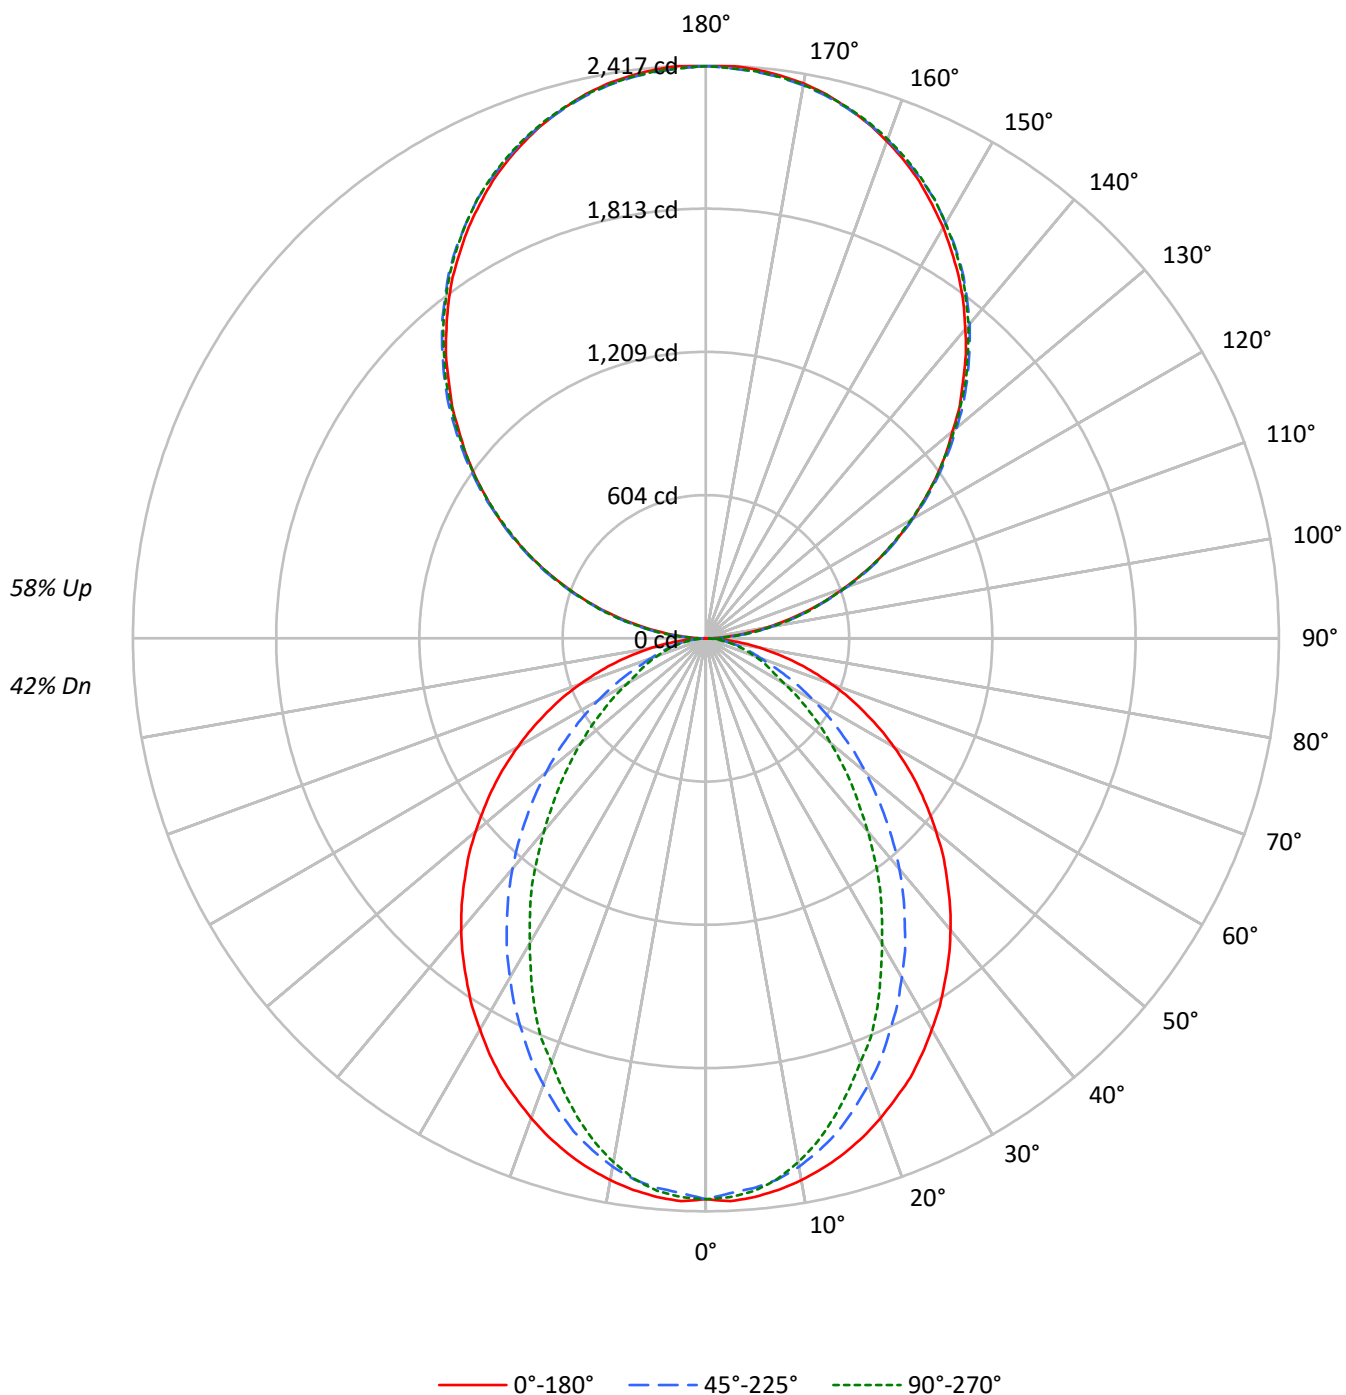

TEST NUMBER: P926284

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	89	85	88	84	81	78	70	67	65	56	55	53	44	43	42
2	88	81	75	70	80	74	69	65	61	58	55	50	47	45	39	37	36
3	81	72	65	59	73	66	60	55	55	50	47	44	41	39	35	33	31
4	74	64	56	50	67	58	52	47	49	44	40	40	36	33	31	29	27
5	68	57	49	43	62	52	45	40	44	39	35	36	32	29	28	26	24
6	63	51	43	38	57	47	40	35	40	34	30	33	29	26	26	23	21
7	58	46	38	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	34	29	49	39	32	28	33	28	24	27	23	21	22	19	17
9	50	38	31	26	46	36	29	25	30	25	22	25	21	19	20	18	16
10	47	35	28	24	43	33	26	22	28	23	19	23	19	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2948	2948	2948
5°	2951	2899	2918
10°	2920	2839	2821
15°	2878	2743	2672
20°	2824	2611	2491
25°	2767	2464	2315
30°	2693	2314	2094
35°	2619	2152	1899
40°	2544	1985	1676
45°	2458	1800	1474
50°	2368	1613	1277
55°	2274	1414	1087
60°	2165	1206	893
65°	2040	995	802
70°	1887	798	723
75°	1696	698	654
80°	1419	579	560
85°	966	374	409

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2458 cd/sqm

TEST NUMBER: P926284

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US950-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.7	1.9
10°-20°	608.7	5.2
20°-30°	854.5	7.4
30°-40°	931.5	8.0
40°-50°	856.2	7.4
50°-60°	672.4	5.8
60°-70°	437.7	3.8
70°-80°	225.3	1.9
80°-90°	64.4	0.6
90°-100°	149.4	1.3
100°-110°	474.6	4.1
110°-120°	812.1	7.0
120°-130°	1068.1	9.2
130°-140°	1198.9	10.3
140°-150°	1175.6	10.1
150°-160°	986.2	8.5
160°-170°	654.0	5.6
170°-180°	228.6	2.0
0°-30°	1684.9	14.5
0°-40°	2616.4	22.5
0°-60°	4144.9	35.7
0°-90°	4872.3	41.9
90°-120°	1436.1	12.4
90°-150°	4878.6	42.0
90°-180°	6747.0	58.1
0°-180°	11619.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2366	2366	2366	2366	2366	
5°	2366	2355	2327	2346	2340	224
15°	2250	2226	2154	2113	2092	634
25°	2042	1974	1833	1745	1713	939
35°	1760	1651	1462	1327	1280	1102
45°	1439	1295	1071	918	867	1111
55°	1094	927	696	567	527	978
65°	739	565	372	300	293	732
75°	394	244	171	156	154	417
85°	92	47	41	41	41	106
90°	2	26	71	67	69	11
95°	106	127	130	130	127	118
105°	438	444	448	452	452	462
115°	815	827	823	821	815	806
125°	1185	1204	1198	1191	1189	1059
135°	1533	1556	1560	1558	1552	1185
145°	1861	1876	1888	1890	1882	1163
155°	2128	2134	2141	2151	2144	980
165°	2316	2313	2313	2328	2318	653
175°	2409	2404	2399	2414	2401	229
180°	2414	2414	2414	2414	2414	

TEST NUMBER: P926284

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US950-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2365.7	2365.7	2365.7	2365.7	2365.7
2.5°	2376.4	2365.7	2342.1	2363.6	2359.3
5°	2365.7	2355.0	2327.1	2346.5	2340.1
7.5°	2346.5	2333.7	2303.7	2312.1	2301.4
10°	2320.7	2305.7	2263.1	2256.5	2243.7
12.5°	2288.7	2269.4	2211.5	2198.8	2175.1
15°	2250.1	2226.4	2153.8	2113.1	2091.7
17.5°	2205.2	2170.8	2080.9	2033.8	1999.6
20°	2153.8	2110.8	2003.9	1950.5	1903.2
22.5°	2098.1	2048.8	1924.6	1851.9	1819.9
25°	2042.5	1973.9	1832.6	1745.0	1712.7
27.5°	1976.2	1903.2	1747.0	1646.3	1597.1
30°	1905.5	1824.0	1652.7	1543.7	1485.8
32.5°	1836.9	1738.4	1563.0	1434.4	1380.8
35°	1759.9	1650.7	1462.4	1327.4	1280.2
37.5°	1685.0	1567.0	1368.1	1220.3	1166.8
40°	1605.7	1477.4	1269.5	1117.5	1061.9
42.5°	1524.4	1387.4	1171.1	1012.6	959.2
45°	1438.7	1295.2	1070.6	918.3	867.0
47.5°	1357.4	1205.5	974.2	822.1	775.0
50°	1267.5	1115.5	880.0	732.1	687.4
52.5°	1179.5	1019.0	790.0	648.7	608.1
55°	1094.0	927.0	695.8	567.4	526.7
57.5°	1006.3	834.9	612.4	492.5	458.1
60°	916.3	745.1	524.5	415.5	381.1
62.5°	828.6	657.4	449.5	346.9	329.8
65°	738.7	565.1	372.5	299.8	293.3
67.5°	653.0	479.5	299.8	263.3	256.9
70°	563.1	396.1	248.2	227.0	218.3
72.5°	477.5	318.9	207.6	190.6	186.2
75°	393.9	243.9	171.2	156.3	154.3
77.5°	310.5	173.3	134.9	126.3	122.0
80°	233.3	124.2	102.7	94.3	94.3
82.5°	162.7	83.6	70.6	66.3	66.3
85°	92.0	47.0	40.6	40.6	40.6
87.5°	34.3	17.1	17.1	15.0	15.0
90°	2.2	26.2	71.4	67.0	69.2
92.5°	45.1	61.2	63.3	65.4	65.4
95°	106.3	126.6	130.2	130.2	126.6
97.5°	176.9	195.8	203.8	203.8	203.8
100°	258.3	275.0	280.9	280.9	278.7
102.5°	344.2	356.6	364.5	366.7	364.5
105°	438.1	443.9	448.3	451.9	451.9
107.5°	531.2	540.0	540.0	541.4	531.2
110°	621.4	633.1	633.1	633.1	627.3

TEST NUMBER: P926284

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	718.9	731.3	729.1	723.3	718.9
115°	815.0	826.6	823.0	820.8	815.0
117.5°	910.3	926.3	916.1	910.3	904.5
120°	1006.4	1022.4	1006.4	1006.4	999.8
122.5°	1093.7	1114.1	1103.9	1098.1	1093.7
125°	1185.3	1203.6	1197.7	1191.2	1189.1
127.5°	1274.9	1297.4	1289.4	1280.7	1274.9
130°	1358.6	1384.7	1381.1	1376.8	1368.8
132.5°	1452.5	1472.8	1474.3	1464.1	1458.3
135°	1533.2	1555.8	1560.2	1558.0	1552.2
137.5°	1623.4	1641.6	1645.3	1643.8	1635.1
140°	1702.8	1720.9	1731.1	1731.1	1723.1
142.5°	1784.3	1802.5	1808.3	1810.5	1802.5
145°	1861.4	1875.9	1887.6	1889.8	1881.8
147.5°	1930.5	1948.7	1957.4	1961.1	1953.1
150°	2001.9	2014.2	2022.2	2028.8	2022.2
152.5°	2065.1	2077.5	2087.7	2095.7	2087.7
155°	2128.5	2134.3	2140.9	2151.0	2144.5
157.5°	2183.0	2187.4	2191.1	2205.6	2195.4
160°	2231.8	2236.2	2238.4	2250.7	2242.0
162.5°	2276.9	2276.9	2279.1	2292.9	2282.7
165°	2315.5	2313.3	2313.3	2327.9	2317.6
167.5°	2350.4	2343.9	2343.9	2358.4	2348.2
170°	2376.6	2370.8	2368.6	2383.2	2370.8
172.5°	2394.8	2389.0	2386.8	2401.3	2389.0
175°	2409.3	2403.5	2399.1	2413.7	2401.3
177.5°	2417.3	2411.5	2407.1	2419.5	2407.1
180°	2413.7	2413.7	2413.7	2413.7	2413.7

TEST NUMBER: P926284

CATALOG NUMBER: DFN2DIP-TR3F0-060D080US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.05	10.81	11.08	11.85	13.23	6.02	6.79	7.05	7.82	9.21
	3H	11.71	12.40	12.75	13.44	14.84	7.20	7.89	8.24	8.93	10.34
	4H	12.31	12.96	13.36	14.00	15.42	7.65	8.30	8.70	9.34	10.75
	6H	12.72	13.32	13.78	14.37	15.79	7.96	8.56	9.02	9.61	11.03
	8H	12.84	13.41	13.91	14.47	15.89	8.05	8.61	9.11	9.68	11.10
	12H	12.90	13.44	13.97	14.49	15.94	8.08	8.62	9.15	9.68	11.12
4H	2H	10.06	10.71	11.11	11.75	13.16	6.61	7.26	7.66	8.30	9.71
	3H	11.87	12.41	12.93	13.48	14.91	7.94	8.49	9.01	9.56	10.98
	4H	12.55	13.05	13.62	14.11	15.56	8.49	8.98	9.56	10.04	11.49
	6H	13.05	13.48	14.13	14.56	16.01	8.90	9.32	9.98	10.41	11.85
	8H	13.22	13.62	14.30	14.70	16.15	9.02	9.42	10.10	10.49	11.95
	12H	13.31	13.67	14.41	14.76	16.22	9.08	9.44	10.18	10.53	11.99
8H	4H	12.51	12.91	13.59	13.99	15.44	8.76	9.15	9.84	10.23	11.69
	6H	13.07	13.39	14.17	14.51	15.97	9.26	9.59	10.37	10.71	12.16
	8H	13.28	13.56	14.39	14.67	16.14	9.45	9.74	10.56	10.84	12.31
	12H	13.41	13.66	14.52	14.76	16.27	9.56	9.81	10.67	10.91	12.42
12H	4H	12.46	12.82	13.56	13.91	15.37	8.76	9.11	9.85	10.21	11.67
	6H	13.04	13.33	14.15	14.43	15.90	9.31	9.60	10.42	10.70	12.17
	8H	13.25	13.50	14.37	14.60	16.11	9.51	9.76	10.62	10.86	12.37

END OF REPORT