

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926293

Luminaire Tested: DFN2DIP-TR3F0-070D040US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926293
REPORT IS A COMBINATION OF REPORTS P901813 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-070D040US950-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10389.1 lumens
Efficiency: N/A
Efficacy: 104.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 99.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926293

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US950-FLLONL

Luminous Intensity Polar Plot

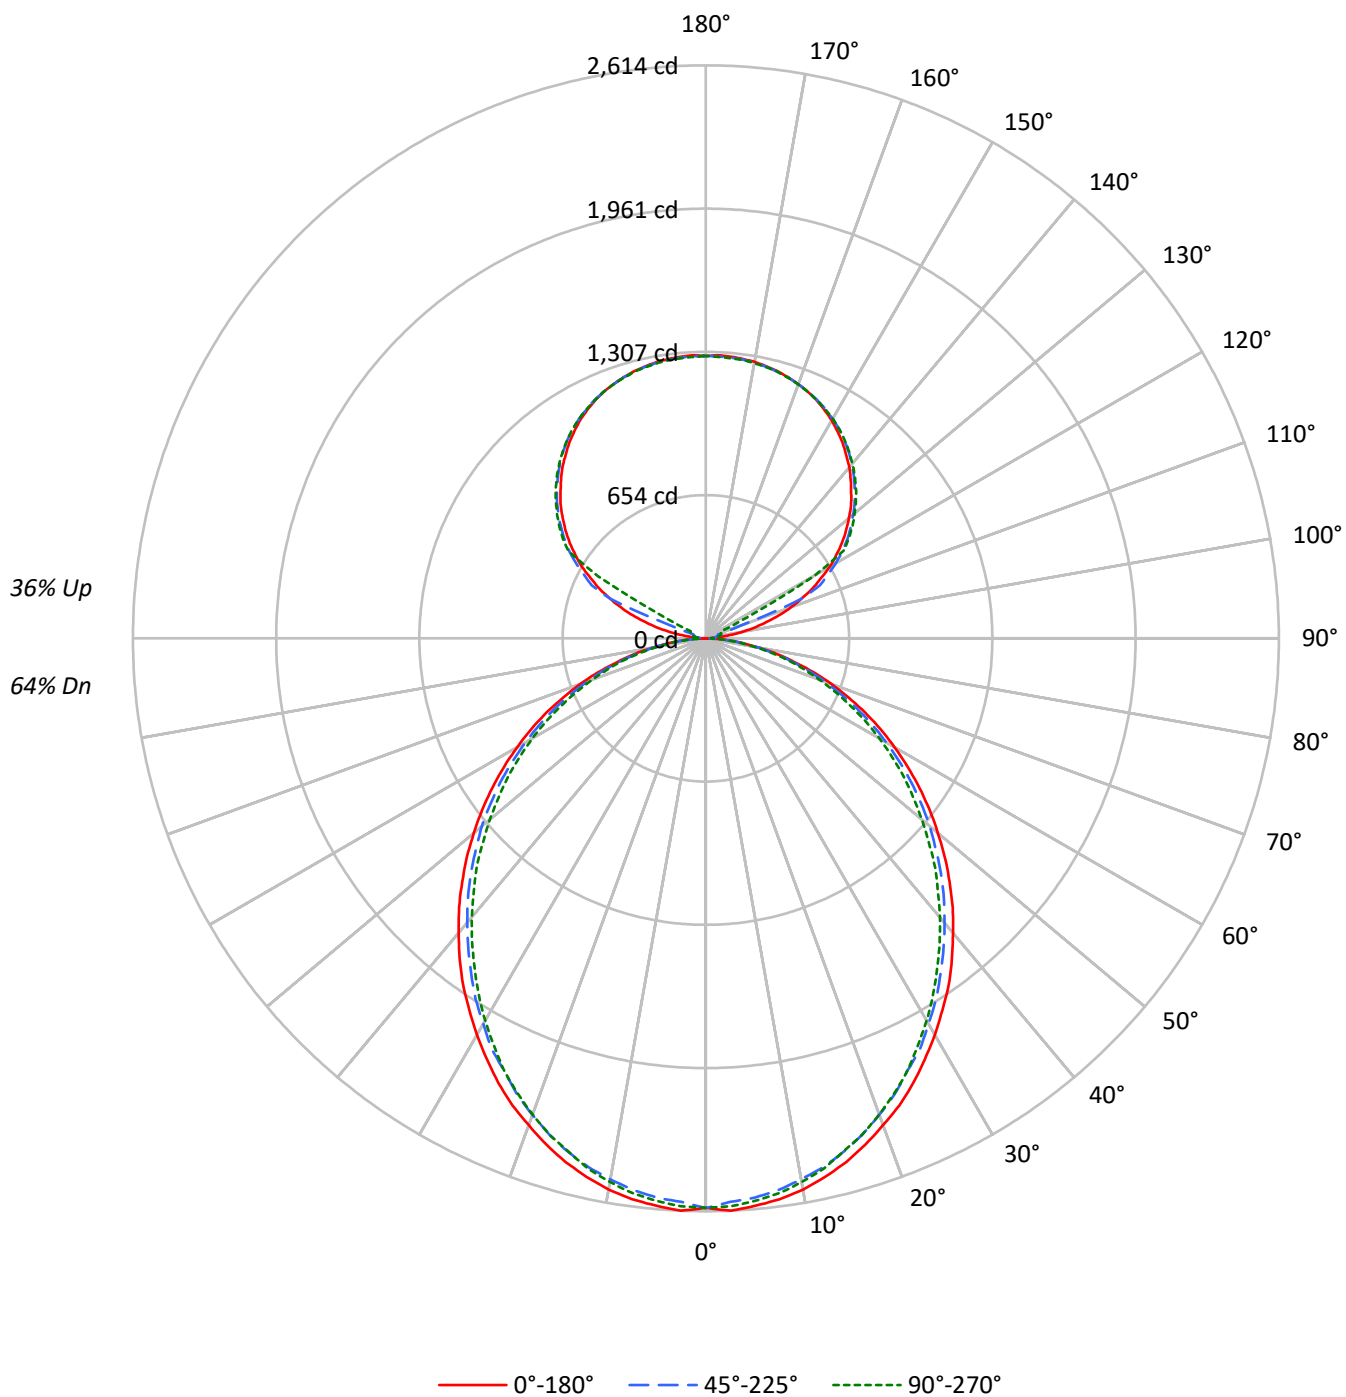

TEST NUMBER: P926293

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US950-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	104	104	104	104	91	91	91	79	79	79	69	69	69
1	101	96	92	89	94	91	87	84	80	77	75	70	68	66	61	59	58
2	92	84	78	73	86	79	74	69	70	66	62	61	58	55	53	51	49
3	84	74	67	61	78	70	63	58	62	57	52	54	50	47	47	44	42
4	77	66	58	51	72	62	55	49	55	49	45	48	44	40	42	39	36
5	71	59	50	44	66	55	48	42	49	43	39	44	39	35	38	34	31
6	65	53	44	38	61	50	42	37	44	38	34	39	34	31	35	31	28
7	60	48	39	34	56	45	38	32	40	34	30	36	31	27	32	28	25
8	56	43	35	30	52	41	34	29	37	31	27	33	28	24	29	25	22
9	52	40	32	27	49	38	31	26	34	28	24	30	25	22	27	23	20
10	49	36	29	24	46	35	28	23	31	26	22	28	23	20	25	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3238	3238	3238
5°	3241	3190	3212
10°	3213	3144	3167
15°	3164	3090	3096
20°	3098	3015	3025
25°	3033	2927	2942
30°	2952	2844	2838
35°	2874	2747	2728
40°	2780	2648	2622
45°	2685	2550	2515
50°	2581	2446	2390
55°	2472	2326	2275
60°	2349	2184	2144
65°	2215	2037	1988
70°	2044	1857	1820
75°	1807	1641	1662
80°	1520	1365	1366
85°	1075	899	882

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2685 cd/sqm

TEST NUMBER: P926293

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	244.6	2.4
10°-20°	688.1	6.6
20°-30°	1011.3	9.7
30°-40°	1174.5	11.3
40°-50°	1173.1	11.3
50°-60°	1022.9	9.8
60°-70°	756.1	7.3
70°-80°	427.8	4.1
80°-90°	115.2	1.1
90°-100°	42.5	0.4
100°-110°	158.3	1.5
110°-120°	419.9	4.0
120°-130°	696.4	6.7
130°-140°	739.7	7.1
140°-150°	687.5	6.6
150°-160°	552.7	5.3
160°-170°	356.1	3.4
170°-180°	122.6	1.2
0°-30°	1943.9	18.7
0°-40°	3118.5	30.0
0°-60°	5314.4	51.2
0°-90°	6613.5	63.7
90°-120°	620.6	6.0
90°-150°	2744.1	26.4
90°-180°	3776.0	36.3
0°-180°	10389.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2598	2598	2598	2598	2598	
5°	2598	2589	2561	2581	2576	247
15°	2474	2459	2426	2436	2424	697
25°	2239	2219	2176	2181	2176	1030
35°	1932	1907	1866	1851	1839	1206
45°	1572	1554	1517	1489	1479	1213
55°	1189	1174	1144	1114	1102	1063
65°	802	787	762	740	727	793
75°	420	415	402	387	392	448
85°	102	100	98	90	88	114
90°	1	11	19	23	25	10
95°	60	30	36	41	40	72
105°	283	311	57	67	71	303
115°	536	552	575	144	76	527
125°	758	770	787	794	797	676
135°	938	952	961	970	968	724
145°	1088	1087	1102	1109	1104	680
155°	1198	1189	1200	1206	1198	552
165°	1262	1256	1259	1266	1259	356
175°	1291	1284	1286	1292	1283	123
180°	1288	1288	1288	1288	1288	

TEST NUMBER: P926293

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2598.4	2598.4	2598.4	2598.4	2598.4
2.5°	2613.6	2601.1	2573.5	2598.4	2593.6
5°	2598.4	2588.7	2561.1	2581.0	2576.2
7.5°	2581.0	2566.1	2538.5	2558.7	2553.7
10°	2553.7	2536.1	2506.2	2526.1	2518.7
12.5°	2516.0	2501.2	2471.2	2483.6	2478.6
15°	2473.6	2458.7	2426.1	2436.2	2423.7
17.5°	2421.1	2406.3	2373.6	2386.1	2373.6
20°	2363.5	2348.7	2313.7	2321.2	2311.4
22.5°	2306.3	2283.8	2251.2	2251.2	2246.1
25°	2238.8	2218.8	2176.5	2181.2	2176.5
27.5°	2163.7	2146.2	2113.9	2106.4	2093.9
30°	2089.0	2068.7	2031.4	2024.0	2013.9
32.5°	2008.8	1994.1	1954.0	1938.9	1928.8
35°	1931.5	1906.6	1866.5	1851.4	1838.9
37.5°	1844.0	1821.5	1781.4	1763.9	1751.4
40°	1754.1	1734.0	1693.9	1671.7	1661.6
42.5°	1666.6	1646.5	1606.7	1581.5	1566.7
45°	1571.7	1554.3	1516.6	1489.3	1479.2
47.5°	1479.2	1461.7	1421.7	1394.1	1379.3
50°	1381.7	1369.2	1334.2	1299.3	1286.8
52.5°	1286.8	1269.3	1237.0	1209.4	1191.8
55°	1189.4	1174.4	1144.4	1114.5	1102.0
57.5°	1091.9	1079.5	1046.8	1016.9	1006.9
60°	994.4	984.5	949.6	922.0	914.6
62.5°	899.4	882.0	857.1	832.2	822.1
65°	802.2	787.0	762.2	739.6	727.1
67.5°	702.2	689.6	667.2	649.8	639.7
70°	609.7	599.7	577.1	559.6	549.8
72.5°	514.8	504.8	492.3	474.8	467.4
75°	419.7	414.9	402.1	387.3	392.4
77.5°	334.9	324.7	319.7	312.2	304.9
80°	249.9	247.4	242.3	234.9	229.8
82.5°	169.9	169.9	167.5	157.5	157.5
85°	102.4	100.0	97.6	89.9	87.5
87.5°	45.0	40.1	35.0	27.6	24.9
90°	0.9	11.2	18.6	23.4	25.1
92.5°	23.4	19.6	22.3	24.2	25.1
95°	60.5	29.8	36.3	41.0	40.1
97.5°	109.0	32.6	47.5	50.4	51.2
100°	164.9	37.3	53.1	60.5	62.4
102.5°	226.4	224.7	55.0	65.2	68.0
105°	283.2	311.3	56.9	67.1	70.8
107.5°	349.5	372.7	58.8	69.0	72.7
110°	412.9	432.4	163.1	69.9	73.6



TEST NUMBER: P926293

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	472.5	489.2	473.4	71.7	74.6
115°	535.8	551.6	575.0	143.5	76.5
117.5°	590.8	609.4	625.3	492.0	247.8
120°	652.3	666.3	683.1	694.3	568.5
122.5°	704.4	719.4	738.1	743.6	744.6
125°	757.6	769.8	787.4	794.0	796.8
127.5°	806.0	819.1	833.1	842.5	843.3
130°	851.7	866.7	876.8	887.1	886.3
132.5°	898.3	910.5	920.7	929.1	928.2
135°	937.5	952.5	960.8	970.1	968.3
137.5°	978.4	989.6	999.0	1008.3	1005.5
140°	1018.5	1026.0	1036.2	1044.6	1040.0
142.5°	1052.2	1058.7	1070.8	1078.1	1073.5
145°	1087.6	1086.6	1102.3	1108.9	1104.3
147.5°	1118.2	1115.4	1131.3	1135.9	1132.3
150°	1148.0	1141.6	1156.5	1162.1	1157.4
152.5°	1173.2	1165.8	1179.7	1185.3	1178.9
155°	1197.5	1189.2	1200.3	1205.9	1198.4
157.5°	1217.0	1209.6	1218.1	1224.6	1217.0
160°	1233.8	1228.2	1233.8	1239.3	1232.9
162.5°	1248.7	1243.2	1247.8	1254.3	1245.9
165°	1261.8	1256.2	1259.0	1265.5	1259.0
167.5°	1272.1	1266.3	1269.3	1275.8	1267.4
170°	1280.5	1274.8	1276.6	1283.2	1274.8
172.5°	1286.0	1280.5	1282.4	1288.9	1280.5
175°	1290.6	1284.1	1286.0	1292.5	1283.2
177.5°	1292.5	1286.0	1286.9	1293.5	1285.1
180°	1287.9	1287.9	1287.9	1287.9	1287.9

TEST NUMBER: P926293

CATALOG NUMBER: DFN2DIP-TR3F0-070D040US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.48	13.47	13.31	14.33	15.39	12.05	13.05	12.88	13.90	14.96
	3H	14.14	15.03	14.98	15.90	16.99	13.67	14.57	14.51	15.43	16.52
	4H	14.72	15.57	15.58	16.44	17.54	14.26	15.10	15.12	15.97	17.07
	6H	15.12	15.91	16.00	16.78	17.90	14.65	15.44	15.53	16.31	17.43
	8H	15.23	15.97	16.11	16.87	17.98	14.76	15.51	15.64	16.40	17.51
	12H	15.28	15.99	16.16	16.88	18.02	14.80	15.51	15.69	16.40	17.54
4H	2H	12.95	13.80	13.81	14.67	15.77	12.61	13.46	13.47	14.32	15.42
	3H	14.82	15.53	15.69	16.43	17.54	14.43	15.14	15.30	16.04	17.15
	4H	15.53	16.18	16.42	17.07	18.21	15.13	15.77	16.02	16.67	17.81
	6H	16.04	16.60	16.95	17.52	18.67	15.64	16.20	16.54	17.12	18.26
	8H	16.19	16.71	17.10	17.63	18.79	15.79	16.31	16.69	17.22	18.38
	12H	16.27	16.74	17.19	17.67	18.84	15.85	16.32	16.78	17.26	18.42
8H	4H	15.73	16.25	16.64	17.17	18.33	15.38	15.90	16.28	16.81	17.97
	6H	16.36	16.79	17.29	17.75	18.91	16.00	16.43	16.93	17.39	18.55
	8H	16.58	16.96	17.52	17.91	19.08	16.21	16.59	17.15	17.54	18.72
	12H	16.71	17.04	17.65	17.99	19.21	16.33	16.67	17.27	17.61	18.83
12H	4H	15.73	16.20	16.65	17.13	18.29	15.38	15.85	16.30	16.78	17.94
	6H	16.39	16.77	17.33	17.72	18.90	16.04	16.42	16.98	17.37	18.55
	8H	16.63	16.97	17.58	17.91	19.13	16.28	16.61	17.22	17.56	18.78

END OF REPORT