

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926305

Luminaire Tested: DFN2DIP-TR3F0-070D070US950-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926305
REPORT IS A COMBINATION OF REPORTS P901855 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-070D070US950-FLLONL
Description: 3 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13222.5 lumens
Efficiency: N/A
Efficacy: 107.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 123.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926305

CATALOG NUMBER: DFN2DIP-TR3F0-070D070US950-FLLONL

Luminous Intensity Polar Plot

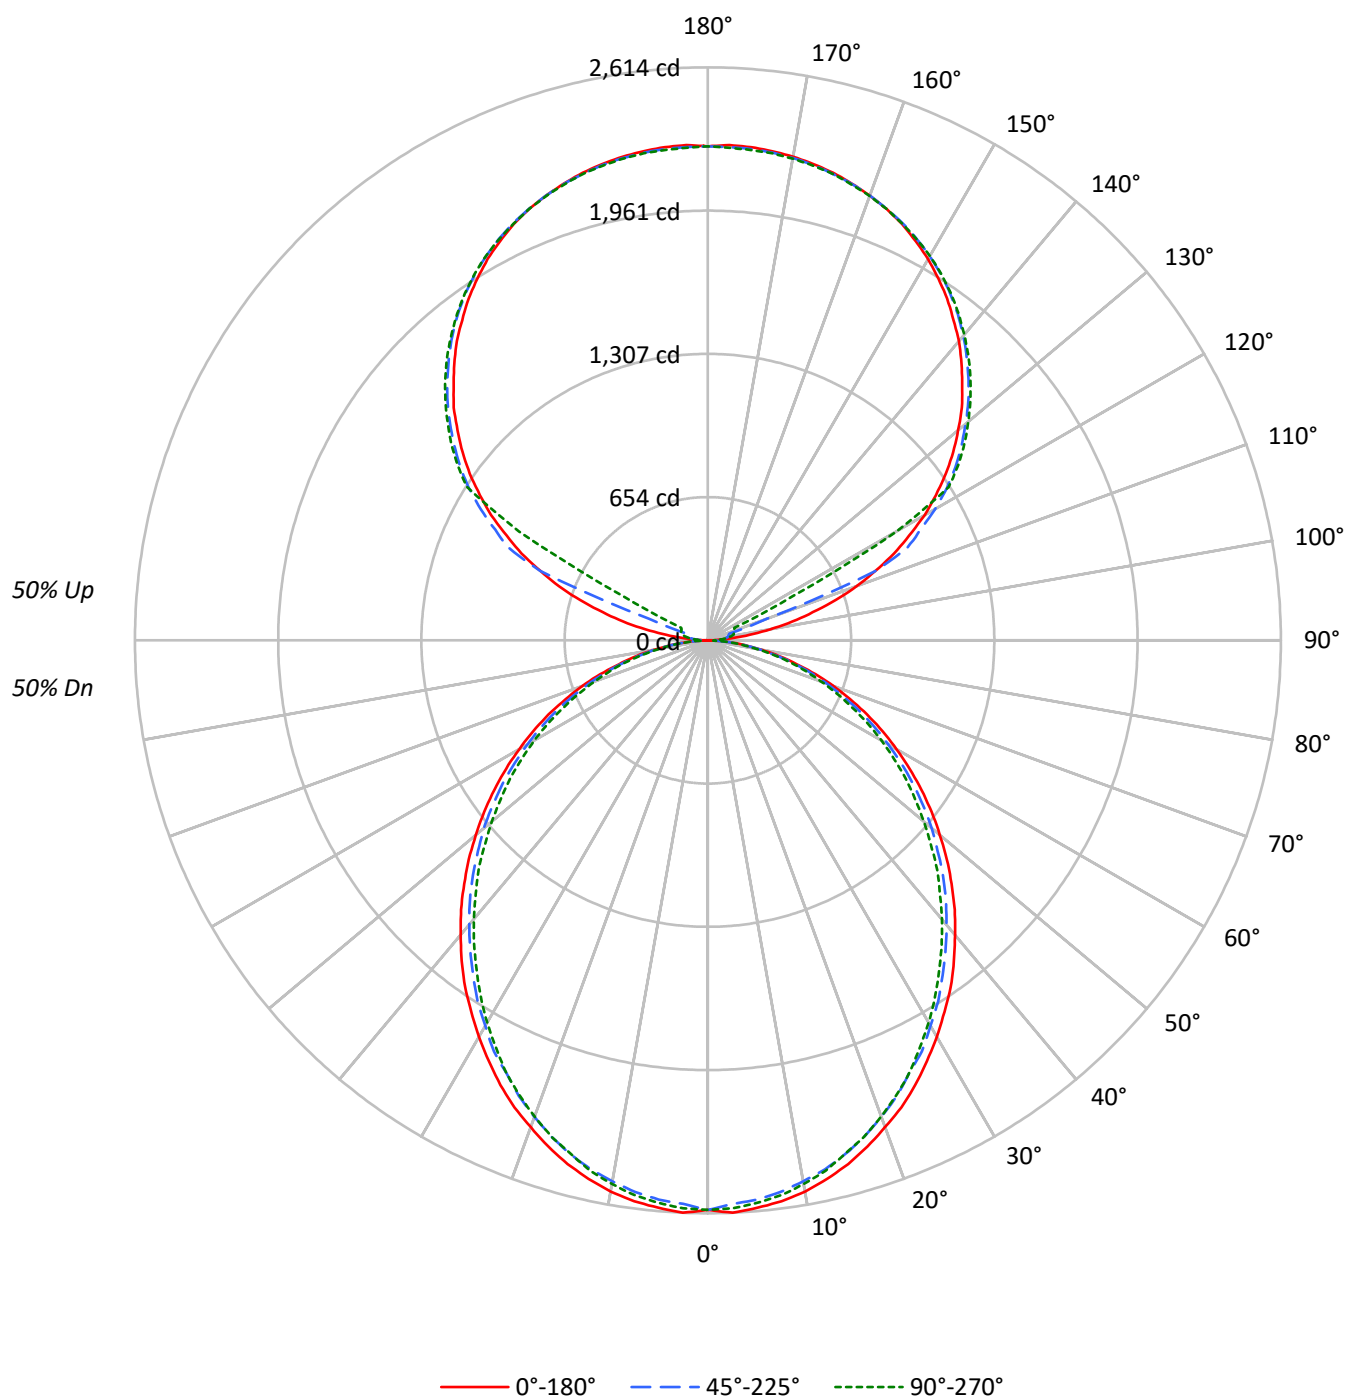

TEST NUMBER: P926305

CATALOG NUMBER: DFN2DIP-TR3F0-070D070US950-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	68	61	59	58	50	48	47
2	89	82	75	70	82	76	70	66	64	60	57	53	51	48	44	42	40
3	81	72	64	59	75	66	60	55	56	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	40	35	31	34	30	27	28	25	23
7	58	46	38	32	53	43	36	30	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	33	28	24	28	24	21	24	20	18
9	50	38	30	25	46	35	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3238	3238	3238
5°	3241	3190	3212
10°	3213	3144	3167
15°	3164	3090	3096
20°	3098	3015	3025
25°	3033	2927	2942
30°	2952	2844	2838
35°	2874	2747	2728
40°	2780	2648	2622
45°	2685	2550	2515
50°	2581	2446	2390
55°	2472	2326	2275
60°	2349	2184	2144
65°	2215	2037	1988
70°	2044	1857	1820
75°	1807	1641	1662
80°	1520	1365	1366
85°	1075	899	882

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2685 cd/sqm

TEST NUMBER: P926305

CATALOG NUMBER: DFN2DIP-TR3F0-070D070US950-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	244.6	1.8
10°-20°	688.1	5.2
20°-30°	1011.3	7.6
30°-40°	1174.5	8.9
40°-50°	1173.1	8.9
50°-60°	1022.9	7.7
60°-70°	756.1	5.7
70°-80°	427.8	3.2
80°-90°	116.9	0.9
90°-100°	74.3	0.6
100°-110°	277.0	2.1
110°-120°	734.8	5.6
120°-130°	1218.6	9.2
130°-140°	1294.5	9.8
140°-150°	1203.1	9.1
150°-160°	967.2	7.3
160°-170°	623.3	4.7
170°-180°	214.5	1.6
0°-30°	1943.9	14.7
0°-40°	3118.5	23.6
0°-60°	5314.4	40.2
0°-90°	6615.2	50.0
90°-120°	1086.1	8.2
90°-150°	4802.2	36.3
90°-180°	6607.0	50.0
0°-180°	13222.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2598	2598	2598	2598	2598	
5°	2598	2589	2561	2581	2576	247
15°	2474	2459	2426	2436	2424	697
25°	2239	2219	2176	2181	2176	1030
35°	1932	1907	1866	1851	1839	1206
45°	1572	1554	1517	1489	1479	1213
55°	1189	1174	1144	1114	1102	1063
65°	802	787	762	740	727	793
75°	420	415	402	387	392	448
85°	102	100	98	90	88	114
90°	2	20	32	41	44	12
95°	106	52	64	72	70	125
105°	496	545	100	117	124	530
115°	938	965	1006	251	134	923
125°	1326	1347	1378	1390	1394	1182
135°	1641	1667	1681	1698	1694	1267
145°	1903	1902	1929	1941	1932	1190
155°	2096	2081	2100	2110	2097	966
165°	2208	2198	2203	2215	2203	624
175°	2259	2247	2250	2262	2246	215
180°	2254	2254	2254	2254	2254	

TEST NUMBER: P926305

CATALOG NUMBER: DFN2DIP-TR3F0-070D070US950-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2598.4	2598.4	2598.4	2598.4	2598.4
2.5°	2613.6	2601.1	2573.5	2598.4	2593.6
5°	2598.4	2588.7	2561.1	2581.0	2576.2
7.5°	2581.0	2566.1	2538.5	2558.7	2553.7
10°	2553.7	2536.1	2506.2	2526.1	2518.7
12.5°	2516.0	2501.2	2471.2	2483.6	2478.6
15°	2473.6	2458.7	2426.1	2436.2	2423.7
17.5°	2421.1	2406.3	2373.6	2386.1	2373.6
20°	2363.5	2348.7	2313.7	2321.2	2311.4
22.5°	2306.3	2283.8	2251.2	2251.2	2246.1
25°	2238.8	2218.8	2176.5	2181.2	2176.5
27.5°	2163.7	2146.2	2113.9	2106.4	2093.9
30°	2089.0	2068.7	2031.4	2024.0	2013.9
32.5°	2008.8	1994.1	1954.0	1938.9	1928.8
35°	1931.5	1906.6	1866.5	1851.4	1838.9
37.5°	1844.0	1821.5	1781.4	1763.9	1751.4
40°	1754.1	1734.0	1693.9	1671.7	1661.6
42.5°	1666.6	1646.5	1606.7	1581.5	1566.7
45°	1571.7	1554.3	1516.6	1489.3	1479.2
47.5°	1479.2	1461.7	1421.7	1394.1	1379.3
50°	1381.7	1369.2	1334.2	1299.3	1286.8
52.5°	1286.8	1269.3	1237.0	1209.4	1191.8
55°	1189.4	1174.4	1144.4	1114.5	1102.0
57.5°	1091.9	1079.5	1046.8	1016.9	1006.9
60°	994.4	984.5	949.6	922.0	914.6
62.5°	899.4	882.0	857.1	832.2	822.1
65°	802.2	787.0	762.2	739.6	727.1
67.5°	702.2	689.6	667.2	649.8	639.7
70°	609.7	599.7	577.1	559.6	549.8
72.5°	514.8	504.8	492.3	474.8	467.4
75°	419.7	414.9	402.1	387.3	392.4
77.5°	334.9	324.7	319.7	312.2	304.9
80°	249.9	247.4	242.3	234.9	229.8
82.5°	169.9	169.9	167.5	157.5	157.5
85°	102.4	100.0	97.6	89.9	87.5
87.5°	45.0	40.1	35.0	27.6	24.9
90°	1.5	19.6	32.5	40.8	44.0
92.5°	40.8	34.2	39.1	42.5	44.0
95°	105.9	52.1	63.5	71.8	70.1
97.5°	190.7	57.1	83.1	88.1	89.7
100°	288.8	65.3	92.9	105.9	109.2
102.5°	396.2	393.1	96.3	114.1	119.1
105°	495.8	544.7	99.5	117.3	123.9
107.5°	611.5	652.2	102.8	120.7	127.3
110°	722.6	756.6	285.4	122.4	128.8

TEST NUMBER: P926305

CATALOG NUMBER: DFN2DIP-TR3F0-070D070US950-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	826.9	856.1	828.5	125.5	130.5
115°	937.7	965.4	1006.2	251.2	133.8
117.5°	1033.9	1066.5	1094.3	861.0	433.8
120°	1141.6	1166.0	1195.5	1215.0	994.8
122.5°	1232.8	1258.9	1291.7	1301.4	1303.1
125°	1325.8	1347.0	1378.1	1389.5	1394.3
127.5°	1410.6	1433.4	1458.0	1474.3	1475.8
130°	1490.5	1516.7	1534.5	1552.5	1551.0
132.5°	1572.1	1593.4	1611.2	1625.9	1624.4
135°	1640.6	1666.7	1681.3	1697.7	1694.5
137.5°	1712.2	1731.9	1748.3	1764.6	1759.7
140°	1782.4	1795.5	1813.4	1828.1	1819.9
142.5°	1841.2	1852.7	1873.8	1886.7	1878.6
145°	1903.2	1901.5	1929.2	1940.6	1932.5
147.5°	1956.8	1952.1	1979.7	1987.8	1981.5
150°	2009.1	1997.8	2023.9	2033.5	2025.4
152.5°	2053.1	2040.1	2064.6	2074.4	2063.0
155°	2095.6	2081.0	2100.5	2110.2	2097.3
157.5°	2129.8	2116.8	2131.5	2143.0	2129.8
160°	2159.3	2149.4	2159.3	2168.9	2157.5
162.5°	2185.2	2175.5	2183.6	2195.1	2180.4
165°	2208.0	2198.4	2203.2	2214.6	2203.2
167.5°	2226.1	2216.1	2221.2	2232.6	2218.0
170°	2240.8	2230.9	2234.2	2245.6	2230.9
172.5°	2250.5	2240.8	2244.1	2255.4	2240.8
175°	2258.6	2247.1	2250.5	2261.8	2245.6
177.5°	2261.8	2250.5	2252.2	2263.7	2248.9
180°	2253.7	2253.7	2253.7	2253.7	2253.7

TEST NUMBER: P926305

CATALOG NUMBER: DFN2DIP-TR3F0-070D070US950-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.31	12.17	12.26	13.14	14.41	10.88	11.74	11.83	12.71	13.98
	3H	12.96	13.73	13.92	14.71	16.00	12.49	13.26	13.46	14.24	15.54
	4H	13.54	14.27	14.52	15.25	16.56	13.07	13.80	14.05	14.79	16.09
	6H	13.93	14.60	14.92	15.59	16.91	13.46	14.14	14.45	15.13	16.44
	8H	14.03	14.67	15.03	15.68	16.99	13.56	14.20	14.56	15.21	16.52
	12H	14.08	14.69	15.08	15.69	17.02	13.60	14.21	14.61	15.21	16.55
4H	2H	11.76	12.50	12.75	13.48	14.78	11.42	12.15	12.41	13.14	14.44
	3H	13.62	14.23	14.62	15.24	16.56	13.23	13.84	14.23	14.85	16.17
	4H	14.33	14.88	15.33	15.89	17.23	13.92	14.48	14.93	15.49	16.83
	6H	14.83	15.31	15.85	16.34	17.68	14.43	14.91	15.44	15.94	17.28
	8H	14.98	15.43	16.00	16.45	17.80	14.57	15.02	15.59	16.04	17.39
	12H	15.05	15.45	16.08	16.49	17.85	14.63	15.04	15.67	16.08	17.43
8H	4H	14.52	14.97	15.54	15.99	17.34	14.16	14.61	15.18	15.63	16.99
	6H	15.14	15.51	16.18	16.58	17.92	14.78	15.15	15.82	16.22	17.57
	8H	15.35	15.68	16.40	16.73	18.10	14.99	15.32	16.04	16.37	17.74
	12H	15.48	15.77	16.53	16.81	18.22	15.10	15.39	16.15	16.43	17.84
12H	4H	14.50	14.91	15.54	15.95	17.30	14.15	14.56	15.19	15.60	16.96
	6H	15.17	15.49	16.22	16.55	17.91	14.82	15.15	15.87	16.20	17.57
	8H	15.40	15.69	16.46	16.74	18.15	15.05	15.34	16.10	16.38	17.79

END OF REPORT