

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926307

Luminaire Tested: DFN2DIP-TR3F0-070D070US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926307
REPORT IS A COMBINATION OF REPORTS P901856 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-070D070US950-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12287.5 lumens
Efficiency: N/A
Efficacy: 99.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 123.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926307

CATALOG NUMBER: DFN2DIP-TR3F0-070D070US950-RLLONL

Luminous Intensity Polar Plot

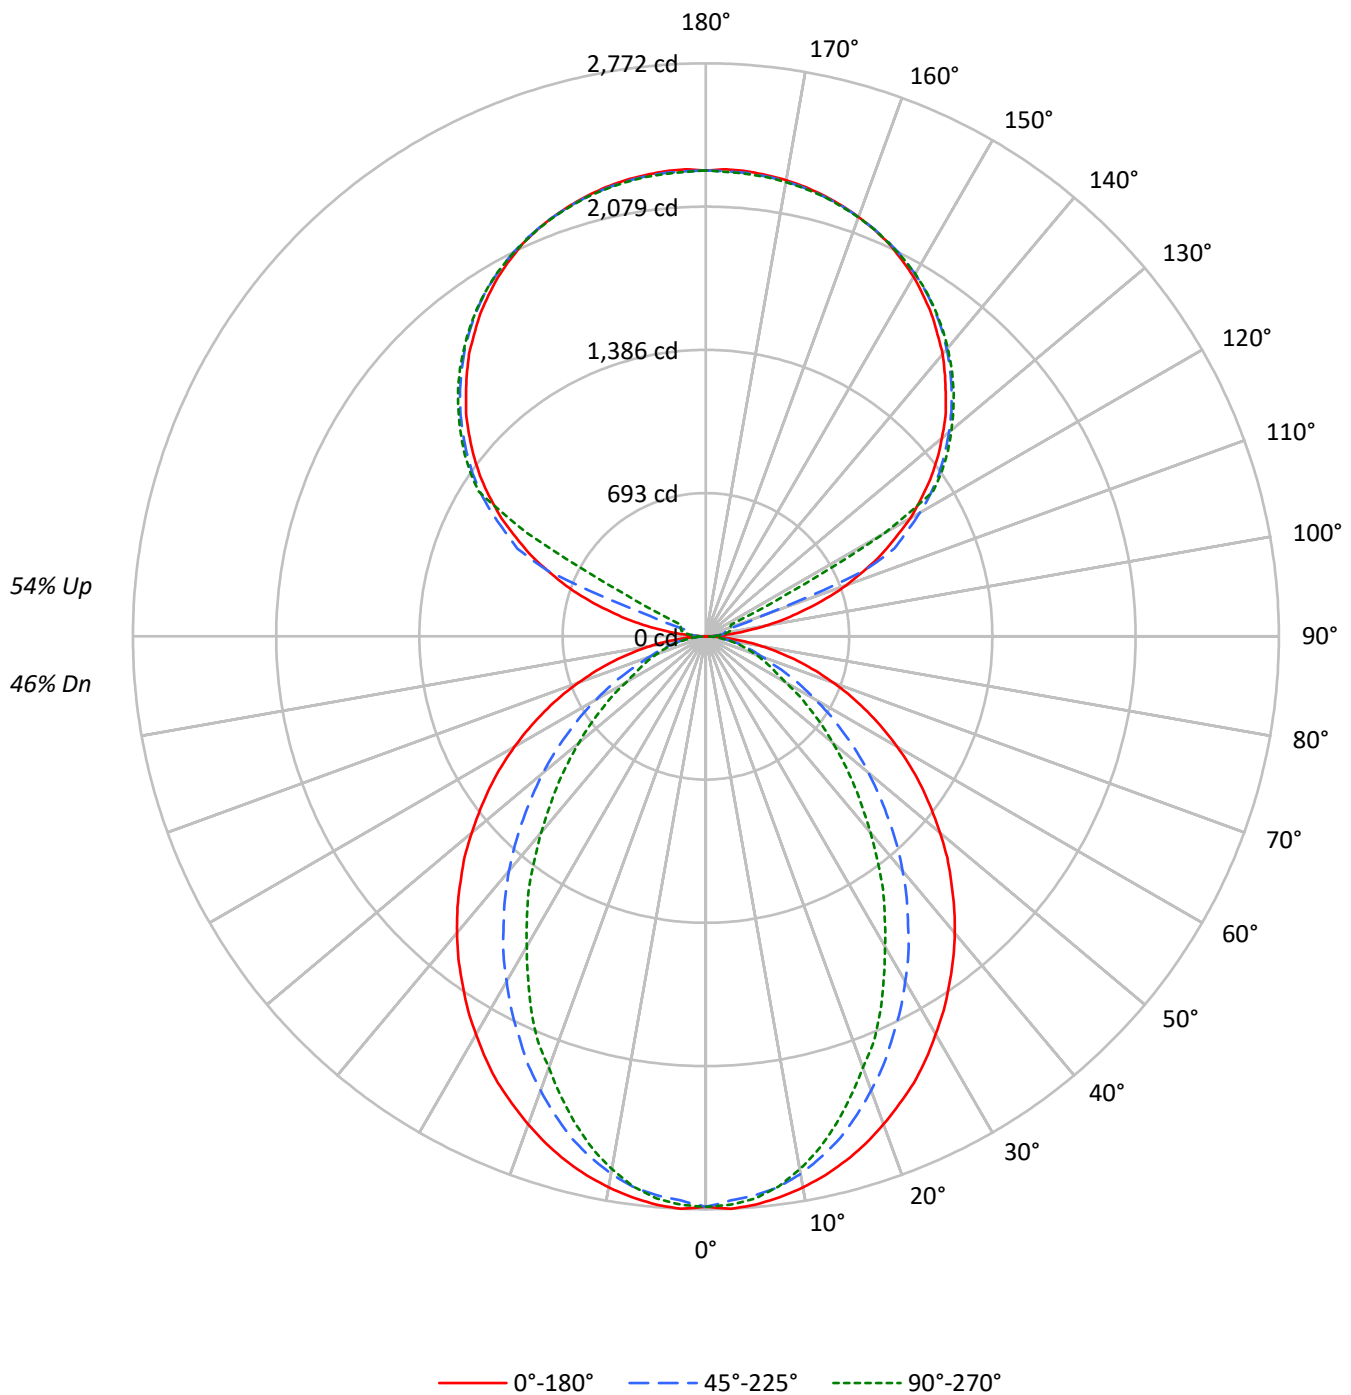

TEST NUMBER: P926307

CATALOG NUMBER: DFN2DIP-TR3F0-070D070US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3439	3439	3439
5°	3443	3382	3404
10°	3407	3313	3291
15°	3358	3200	3118
20°	3294	3047	2906
25°	3229	2875	2701
30°	3141	2699	2443
35°	3056	2511	2215
40°	2968	2316	1955
45°	2867	2100	1720
50°	2762	1882	1490
55°	2653	1650	1269
60°	2526	1407	1042
65°	2379	1161	935
70°	2202	932	843
75°	1979	815	762
80°	1656	675	654
85°	1126	437	478

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2867 cd/sqm

TEST NUMBER: P926307

CATALOG NUMBER: DFN2DIP-TR3F0-070D070US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	258.7	2.1
10°-20°	710.1	5.8
20°-30°	997.0	8.1
30°-40°	1086.8	8.8
40°-50°	998.8	8.1
50°-60°	784.4	6.4
60°-70°	510.6	4.2
70°-80°	262.8	2.1
80°-90°	71.1	0.6
90°-100°	74.3	0.6
100°-110°	277.0	2.3
110°-120°	734.8	6.0
120°-130°	1218.6	9.9
130°-140°	1294.5	10.5
140°-150°	1203.1	9.8
150°-160°	967.2	7.9
160°-170°	623.3	5.1
170°-180°	214.5	1.7
0°-30°	1965.7	16.0
0°-40°	3052.5	24.8
0°-60°	4835.8	39.4
0°-90°	5680.2	46.2
90°-120°	1086.1	8.8
90°-150°	4802.2	39.1
90°-180°	6607.0	53.8
0°-180°	12287.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2760	2760	2760	2760	2760	
5°	2760	2748	2715	2738	2730	262
15°	2625	2598	2513	2465	2440	740
25°	2383	2303	2138	2036	1998	1096
35°	2053	1926	1706	1549	1494	1285
45°	1679	1511	1249	1071	1012	1296
55°	1276	1082	812	662	615	1140
65°	862	659	435	350	342	854
75°	460	285	200	182	180	486
85°	107	55	47	47	47	123
90°	2	20	32	41	44	11
95°	106	52	64	72	70	125
105°	496	545	100	117	124	530
115°	938	965	1006	251	134	923
125°	1326	1347	1378	1390	1394	1182
135°	1641	1667	1681	1698	1694	1267
145°	1903	1902	1929	1941	1932	1190
155°	2096	2081	2100	2110	2097	966
165°	2208	2198	2203	2215	2203	624
175°	2259	2247	2250	2262	2246	215
180°	2254	2254	2254	2254	2254	

TEST NUMBER: P926307

CATALOG NUMBER: DFN2DIP-TR3F0-070D070US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2760.0	2760.0	2760.0	2760.0	2760.0
2.5°	2772.4	2760.0	2732.4	2757.6	2752.6
5°	2760.0	2747.5	2715.0	2737.5	2730.1
7.5°	2737.5	2722.6	2687.7	2697.4	2685.0
10°	2707.5	2690.1	2640.2	2632.6	2617.7
12.5°	2670.2	2647.6	2580.1	2565.2	2537.6
15°	2625.1	2597.6	2512.7	2465.3	2440.4
17.5°	2572.7	2532.7	2427.7	2372.8	2332.8
20°	2512.7	2462.7	2337.9	2275.6	2220.4
22.5°	2447.9	2390.3	2245.3	2160.5	2123.2
25°	2382.9	2302.9	2138.0	2035.7	1998.2
27.5°	2305.5	2220.4	2038.1	1920.8	1863.3
30°	2223.1	2128.0	1928.1	1801.0	1733.4
32.5°	2143.1	2028.1	1823.5	1673.5	1610.9
35°	2053.2	1925.7	1706.1	1548.7	1493.6
37.5°	1965.8	1828.2	1596.1	1423.6	1361.4
40°	1873.3	1723.6	1481.1	1303.8	1238.9
42.5°	1778.4	1618.7	1366.3	1181.3	1119.1
45°	1678.6	1511.0	1249.0	1071.4	1011.5
47.5°	1583.6	1406.4	1136.6	959.1	904.2
50°	1478.7	1301.4	1026.6	854.1	801.9
52.5°	1376.1	1188.8	921.7	756.8	709.4
55°	1276.3	1081.5	811.7	662.0	614.6
57.5°	1174.0	974.1	714.5	574.5	534.5
60°	1069.1	869.2	611.9	484.7	444.7
62.5°	966.7	766.9	524.4	404.7	384.7
65°	861.7	659.3	434.6	349.8	342.1
67.5°	761.9	559.4	349.8	307.1	299.7
70°	656.9	462.1	289.6	264.7	254.6
72.5°	557.0	372.1	242.2	222.4	217.3
75°	459.5	284.6	199.8	182.3	179.9
77.5°	362.2	202.2	157.4	147.3	142.3
80°	272.2	144.9	119.8	110.0	110.0
82.5°	189.8	97.5	82.4	77.4	77.4
85°	107.3	54.9	47.4	47.4	47.4
87.5°	40.0	19.8	19.8	17.5	17.5
90°	1.5	19.6	32.5	40.8	44.0
92.5°	40.8	34.2	39.1	42.5	44.0
95°	105.9	52.1	63.5	71.8	70.1
97.5°	190.7	57.1	83.1	88.1	89.7
100°	288.8	65.3	92.9	105.9	109.2
102.5°	396.2	393.1	96.3	114.1	119.1
105°	495.8	544.7	99.5	117.3	123.9
107.5°	611.5	652.2	102.8	120.7	127.3
110°	722.6	756.6	285.4	122.4	128.8



TEST NUMBER: P926307

CATALOG NUMBER: DFN2DIP-TR3F0-070D070US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	826.9	856.1	828.5	125.5	130.5
115°	937.7	965.4	1006.2	251.2	133.8
117.5°	1033.9	1066.5	1094.3	861.0	433.8
120°	1141.6	1166.0	1195.5	1215.0	994.8
122.5°	1232.8	1258.9	1291.7	1301.4	1303.1
125°	1325.8	1347.0	1378.1	1389.5	1394.3
127.5°	1410.6	1433.4	1458.0	1474.3	1475.8
130°	1490.5	1516.7	1534.5	1552.5	1551.0
132.5°	1572.1	1593.4	1611.2	1625.9	1624.4
135°	1640.6	1666.7	1681.3	1697.7	1694.5
137.5°	1712.2	1731.9	1748.3	1764.6	1759.7
140°	1782.4	1795.5	1813.4	1828.1	1819.9
142.5°	1841.2	1852.7	1873.8	1886.7	1878.6
145°	1903.2	1901.5	1929.2	1940.6	1932.5
147.5°	1956.8	1952.1	1979.7	1987.8	1981.5
150°	2009.1	1997.8	2023.9	2033.5	2025.4
152.5°	2053.1	2040.1	2064.6	2074.4	2063.0
155°	2095.6	2081.0	2100.5	2110.2	2097.3
157.5°	2129.8	2116.8	2131.5	2143.0	2129.8
160°	2159.3	2149.4	2159.3	2168.9	2157.5
162.5°	2185.2	2175.5	2183.6	2195.1	2180.4
165°	2208.0	2198.4	2203.2	2214.6	2203.2
167.5°	2226.1	2216.1	2221.2	2232.6	2218.0
170°	2240.8	2230.9	2234.2	2245.6	2230.9
172.5°	2250.5	2240.8	2244.1	2255.4	2240.8
175°	2258.6	2247.1	2250.5	2261.8	2245.6
177.5°	2261.8	2250.5	2252.2	2263.7	2248.9
180°	2253.7	2253.7	2253.7	2253.7	2253.7

TEST NUMBER: P926307

CATALOG NUMBER: DFN2DIP-TR3F0-070D070US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.02	11.82	12.02	12.83	14.15	7.00	7.80	8.00	8.80	10.13
	3H	12.69	13.41	13.70	14.42	15.76	8.18	8.90	9.19	9.91	11.26
	4H	13.29	13.97	14.31	14.98	16.34	8.63	9.30	9.65	10.32	11.67
	6H	13.70	14.33	14.73	15.34	16.71	8.94	9.56	9.97	10.58	11.95
	8H	13.82	14.42	14.86	15.45	16.82	9.03	9.62	10.06	10.66	12.02
	12H	13.88	14.44	14.92	15.47	16.86	9.07	9.63	10.11	10.66	12.05
4H	2H	11.04	11.71	12.06	12.73	14.08	7.59	8.26	8.61	9.28	10.63
	3H	12.85	13.42	13.89	14.46	15.83	8.93	9.49	9.96	10.53	11.90
	4H	13.54	14.05	14.58	15.09	16.48	9.47	9.98	10.51	11.02	12.41
	6H	14.04	14.48	15.09	15.54	16.93	9.88	10.32	10.93	11.38	12.77
	8H	14.21	14.62	15.26	15.67	17.08	10.01	10.42	11.06	11.47	12.87
	12H	14.30	14.67	15.37	15.74	17.14	10.07	10.44	11.14	11.50	12.91
8H	4H	13.50	13.91	14.55	14.96	16.37	9.74	10.15	10.79	11.21	12.61
	6H	14.06	14.40	15.13	15.49	16.89	10.25	10.59	11.33	11.68	13.08
	8H	14.27	14.56	15.35	15.64	17.06	10.44	10.74	11.52	11.81	13.23
	12H	14.40	14.66	15.48	15.73	17.19	10.55	10.81	11.64	11.89	13.35
12H	4H	13.45	13.82	14.52	14.89	16.30	9.74	10.12	10.81	11.18	12.59
	6H	14.03	14.33	15.11	15.41	16.83	10.30	10.60	11.38	11.67	13.09
	8H	14.24	14.51	15.33	15.58	17.04	10.50	10.77	11.59	11.84	13.30

END OF REPORT