

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926332

Luminaire Tested: DFN2DIP-TR3F0-080D070US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926332
REPORT IS A COMBINATION OF REPORTS P900338 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-080D070US950-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12397.3 lumens
Efficiency: N/A
Efficacy: 92.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 134.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926332

CATALOG NUMBER: DFN2DIP-TR3F0-080D070US950-RLLFLL

Luminous Intensity Polar Plot

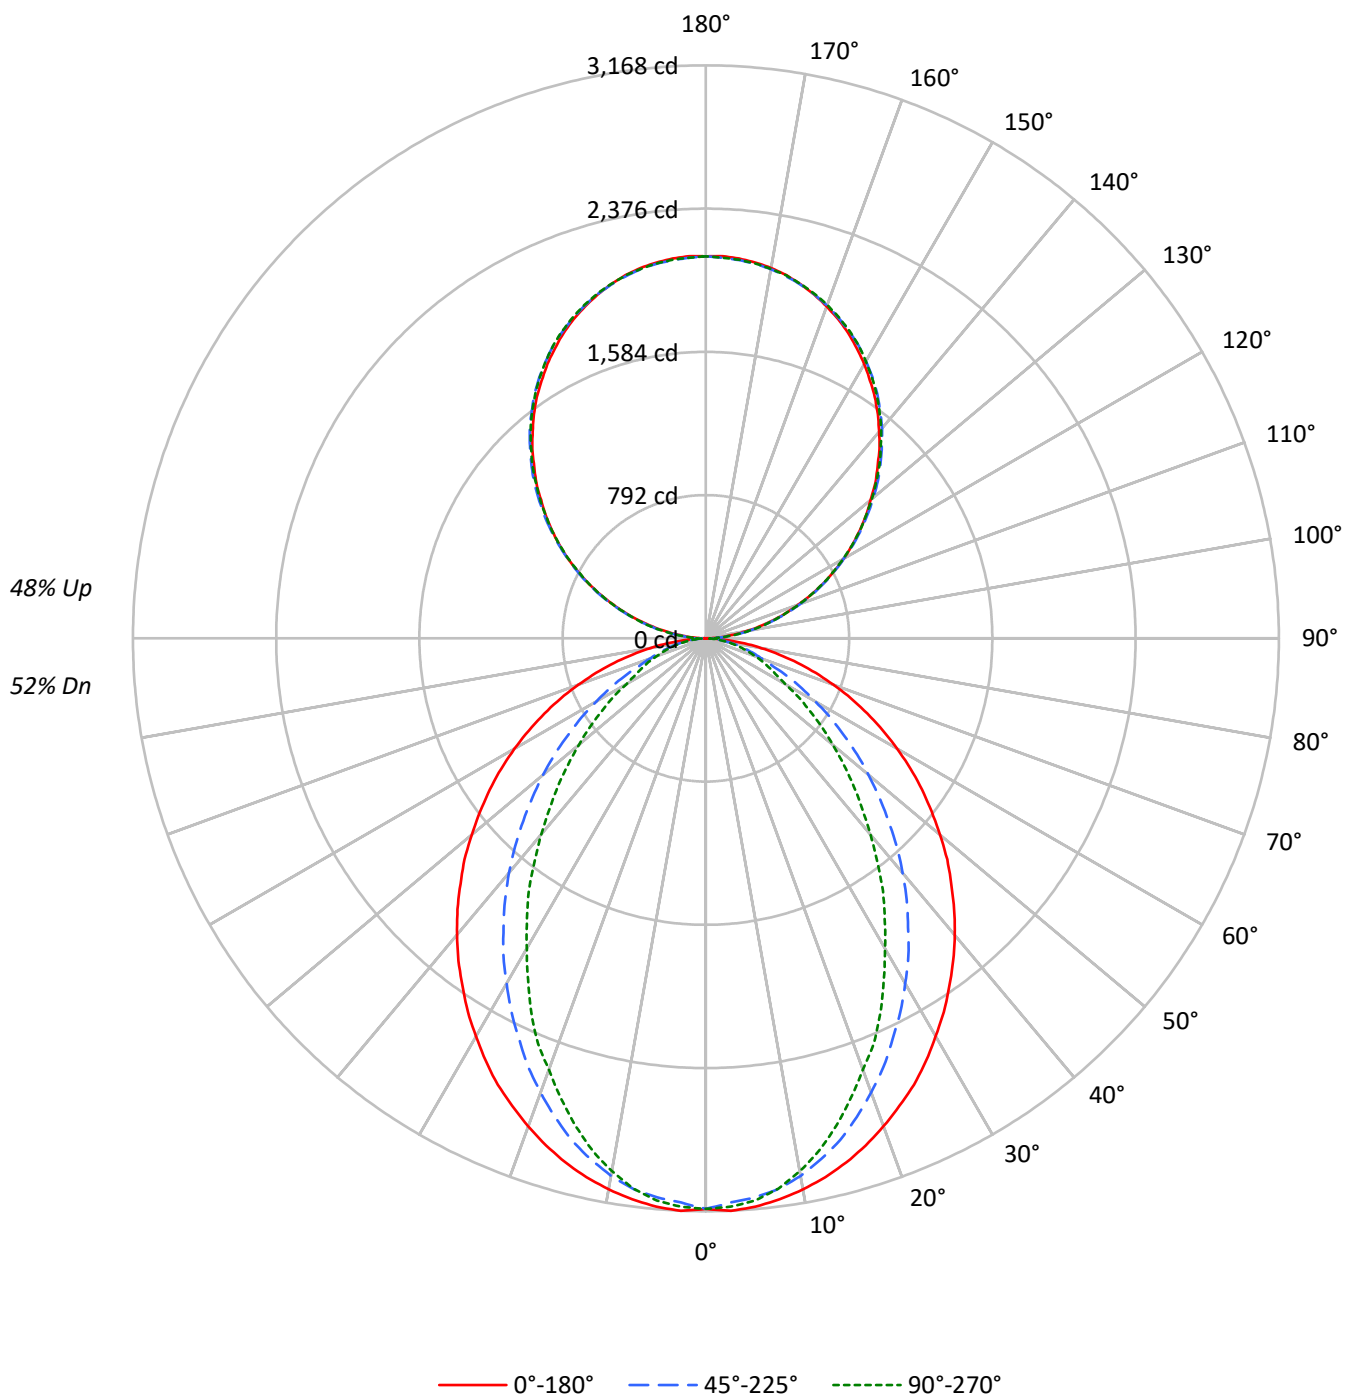

TEST NUMBER: P926332

CATALOG NUMBER: DFN2DIP-TR3F0-080D070US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	58	58	58
1	99	95	91	88	91	88	85	82	75	73	71	63	62	60	52	51	50
2	90	83	77	72	83	77	72	68	66	63	59	56	53	51	47	45	43
3	83	74	67	61	76	69	62	57	59	54	50	50	47	44	42	39	37
4	76	66	58	52	70	61	54	49	53	48	43	45	41	38	38	35	33
5	70	59	51	45	65	55	48	43	47	42	38	41	36	33	34	31	29
6	65	53	45	39	60	49	42	37	43	37	33	37	33	29	31	28	25
7	60	48	40	35	55	45	38	33	39	34	30	34	29	26	29	25	23
8	56	44	36	31	52	41	34	29	36	30	26	31	27	23	26	23	21
9	52	40	33	28	48	38	31	26	33	28	24	29	24	21	24	21	19
10	49	37	30	25	45	35	28	24	30	25	22	26	22	19	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3931	3931	3931
5°	3935	3865	3890
10°	3894	3786	3761
15°	3838	3657	3563
20°	3765	3482	3321
25°	3690	3286	3087
30°	3590	3085	2791
35°	3492	2869	2532
40°	3393	2646	2234
45°	3277	2400	1965
50°	3157	2151	1702
55°	3032	1886	1450
60°	2886	1608	1191
65°	2719	1327	1069
70°	2517	1065	964
75°	2261	932	871
80°	1892	771	747
85°	1288	499	547

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3277 cd/sqm

TEST NUMBER: P926332

CATALOG NUMBER: DFN2DIP-TR3F0-080D070US950-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	295.6	2.4
10°-20°	811.5	6.5
20°-30°	1139.4	9.2
30°-40°	1242.0	10.0
40°-50°	1141.5	9.2
50°-60°	896.5	7.2
60°-70°	583.5	4.7
70°-80°	300.4	2.4
80°-90°	82.7	0.7
90°-100°	130.7	1.1
100°-110°	415.3	3.3
110°-120°	710.6	5.7
120°-130°	934.6	7.5
130°-140°	1049.0	8.5
140°-150°	1028.7	8.3
150°-160°	862.9	7.0
160°-170°	572.3	4.6
170°-180°	200.0	1.6
0°-30°	2246.6	18.1
0°-40°	3488.6	28.1
0°-60°	5526.6	44.6
0°-90°	6493.2	52.4
90°-120°	1256.6	10.1
90°-150°	4268.9	34.4
90°-180°	5904.0	47.6
0°-180°	12397.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3154	3154	3154	3154	3154	
5°	3154	3140	3103	3128	3120	299
15°	3000	2969	2872	2818	2789	845
25°	2723	2632	2444	2327	2284	1252
35°	2347	2201	1950	1770	1707	1469
45°	1918	1727	1427	1224	1156	1481
55°	1459	1236	928	756	702	1303
65°	985	754	497	400	391	976
75°	525	325	228	208	206	555
85°	123	63	54	54	54	141
90°	2	23	62	59	60	12
95°	93	111	114	114	111	103
105°	383	388	392	395	395	405
115°	713	723	720	718	713	705
125°	1037	1053	1048	1042	1040	927
135°	1342	1361	1365	1363	1358	1037
145°	1629	1642	1652	1654	1647	1018
155°	1862	1868	1873	1882	1876	857
165°	2026	2024	2024	2037	2028	572
175°	2108	2103	2099	2112	2101	200
180°	2112	2112	2112	2112	2112	

TEST NUMBER: P926332

CATALOG NUMBER: DFN2DIP-TR3F0-080D070US950-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3154.3	3154.3	3154.3	3154.3	3154.3
2.5°	3168.5	3154.3	3122.8	3151.5	3145.8
5°	3154.3	3140.1	3102.8	3128.5	3120.1
7.5°	3128.5	3111.6	3071.6	3082.9	3068.5
10°	3094.3	3074.4	3017.4	3008.6	2991.6
12.5°	3051.7	3025.9	2948.6	2931.6	2900.2
15°	3000.1	2968.7	2871.7	2817.5	2789.0
17.5°	2940.1	2894.4	2774.5	2711.8	2666.0
20°	2871.7	2814.5	2671.9	2600.7	2537.6
22.5°	2797.5	2731.8	2566.2	2469.2	2426.5
25°	2723.3	2631.9	2443.5	2326.6	2283.6
27.5°	2634.9	2537.6	2329.3	2195.2	2129.4
30°	2540.7	2431.9	2203.6	2058.3	1981.0
32.5°	2449.2	2317.8	2084.0	1912.6	1841.1
35°	2346.6	2200.9	1949.8	1770.0	1706.9
37.5°	2246.6	2089.5	1824.1	1627.0	1555.8
40°	2141.0	1969.8	1692.7	1490.1	1415.8
42.5°	2032.5	1849.9	1561.5	1350.2	1278.9
45°	1918.3	1726.9	1427.4	1224.5	1156.1
47.5°	1809.9	1607.3	1299.0	1096.1	1033.4
50°	1689.9	1487.4	1173.3	976.1	916.4
52.5°	1572.8	1358.6	1053.3	865.0	810.8
55°	1458.6	1236.0	927.7	756.5	702.3
57.5°	1341.7	1113.3	816.5	656.6	610.8
60°	1221.7	993.4	699.3	553.9	508.2
62.5°	1104.8	876.4	599.4	462.5	439.8
65°	984.9	753.5	496.7	399.8	390.9
67.5°	870.7	639.4	399.8	351.0	342.6
70°	750.8	528.2	331.0	302.5	291.1
72.5°	636.6	425.2	276.9	254.1	248.3
75°	525.2	325.3	228.4	208.4	205.7
77.5°	414.0	231.1	179.9	168.4	162.7
80°	311.0	165.7	136.9	125.6	125.6
82.5°	216.8	111.4	94.2	88.4	88.4
85°	122.7	62.7	54.2	54.2	54.2
87.5°	45.7	22.7	22.7	20.0	20.0
90°	1.9	22.9	62.4	58.6	60.5
92.5°	39.5	53.5	55.4	57.3	57.3
95°	92.9	110.8	114.0	114.0	110.8
97.5°	154.7	171.2	178.3	178.3	178.3
100°	226.0	240.7	245.8	245.8	243.8
102.5°	301.2	312.0	319.0	320.9	319.0
105°	383.3	388.4	392.2	395.4	395.4
107.5°	464.8	472.4	472.4	473.8	464.8
110°	543.8	554.0	554.0	554.0	548.8

TEST NUMBER: P926332

CATALOG NUMBER: DFN2DIP-TR3F0-080D070US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	629.1	639.9	638.0	632.9	629.1
115°	713.1	723.3	720.2	718.3	713.1
117.5°	796.5	810.5	801.6	796.5	791.4
120°	880.5	894.6	880.5	880.5	874.8
122.5°	957.0	974.8	965.9	960.8	957.0
125°	1037.2	1053.1	1048.1	1042.3	1040.4
127.5°	1115.5	1135.3	1128.3	1120.7	1115.5
130°	1188.8	1211.7	1208.5	1204.7	1197.7
132.5°	1270.9	1288.8	1290.0	1281.1	1276.0
135°	1341.6	1361.3	1365.2	1363.2	1358.1
137.5°	1420.5	1436.4	1439.6	1438.3	1430.7
140°	1490.0	1505.9	1514.8	1514.8	1507.8
142.5°	1561.2	1577.2	1582.2	1584.1	1577.2
145°	1628.8	1641.5	1651.7	1653.6	1646.6
147.5°	1689.2	1705.2	1712.8	1716.0	1709.0
150°	1751.6	1762.4	1769.5	1775.2	1769.5
152.5°	1807.0	1817.8	1826.7	1833.8	1826.7
155°	1862.4	1867.5	1873.3	1882.1	1876.4
157.5°	1910.2	1914.0	1917.2	1929.9	1921.0
160°	1952.8	1956.7	1958.6	1969.3	1961.7
162.5°	1992.3	1992.3	1994.2	2006.3	1997.4
165°	2026.0	2024.1	2024.1	2036.9	2027.9
167.5°	2056.6	2050.9	2050.9	2063.6	2054.7
170°	2079.5	2074.5	2072.6	2085.3	2074.5
172.5°	2095.5	2090.3	2088.4	2101.2	2090.3
175°	2108.1	2103.1	2099.3	2112.0	2101.2
177.5°	2115.2	2110.1	2106.2	2117.1	2106.2
180°	2112.0	2112.0	2112.0	2112.0	2112.0

TEST NUMBER: P926332

CATALOG NUMBER: DFN2DIP-TR3F0-080D070US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.07	12.92	13.01	13.87	15.11	8.05	8.90	8.99	9.85	11.09
	3H	13.74	14.50	14.69	15.46	16.73	9.23	9.99	10.19	10.96	12.22
	4H	14.34	15.06	15.31	16.03	17.30	9.68	10.40	10.65	11.37	12.64
	6H	14.76	15.42	15.74	16.39	17.68	10.00	10.66	10.98	11.63	12.91
	8H	14.88	15.51	15.87	16.50	17.78	10.08	10.71	11.07	11.70	12.98
	12H	14.94	15.54	15.93	16.52	17.83	10.13	10.72	11.12	11.71	13.01
4H	2H	12.09	12.81	13.06	13.78	15.05	8.64	9.36	9.61	10.33	11.60
	3H	13.91	14.51	14.89	15.50	16.79	9.98	10.58	10.97	11.58	12.86
	4H	14.59	15.14	15.59	16.13	17.44	10.53	11.07	11.52	12.06	13.37
	6H	15.10	15.57	16.11	16.59	17.89	10.94	11.41	11.95	12.43	13.73
	8H	15.27	15.71	16.28	16.72	18.04	11.07	11.51	12.07	12.51	13.84
	12H	15.36	15.76	16.39	16.78	18.11	11.13	11.52	12.15	12.55	13.88
8H	4H	14.56	15.00	15.57	16.01	17.33	10.80	11.24	11.81	12.25	13.57
	6H	15.12	15.48	16.15	16.53	17.85	11.32	11.68	12.34	12.73	14.05
	8H	15.33	15.65	16.37	16.68	18.02	11.50	11.82	12.54	12.86	14.19
	12H	15.46	15.74	16.50	16.77	18.16	11.62	11.90	12.66	12.93	14.31
12H	4H	14.52	14.91	15.54	15.93	17.26	10.81	11.20	11.83	12.23	13.55
	6H	15.09	15.41	16.13	16.45	17.79	11.36	11.68	12.40	12.72	14.06
	8H	15.31	15.59	16.35	16.62	18.00	11.57	11.85	12.61	12.88	14.26