

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926333

Luminaire Tested: DFN2DIP-TR3F0-080D070US950-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926333
REPORT IS A COMBINATION OF REPORTS P901858 AND P898751
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-080D070US950-RLLONL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13098.4 lumens
Efficiency: N/A
Efficacy: 97.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 134.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926333

CATALOG NUMBER: DFN2DIP-TR3F0-080D070US950-RLLONL

Luminous Intensity Polar Plot

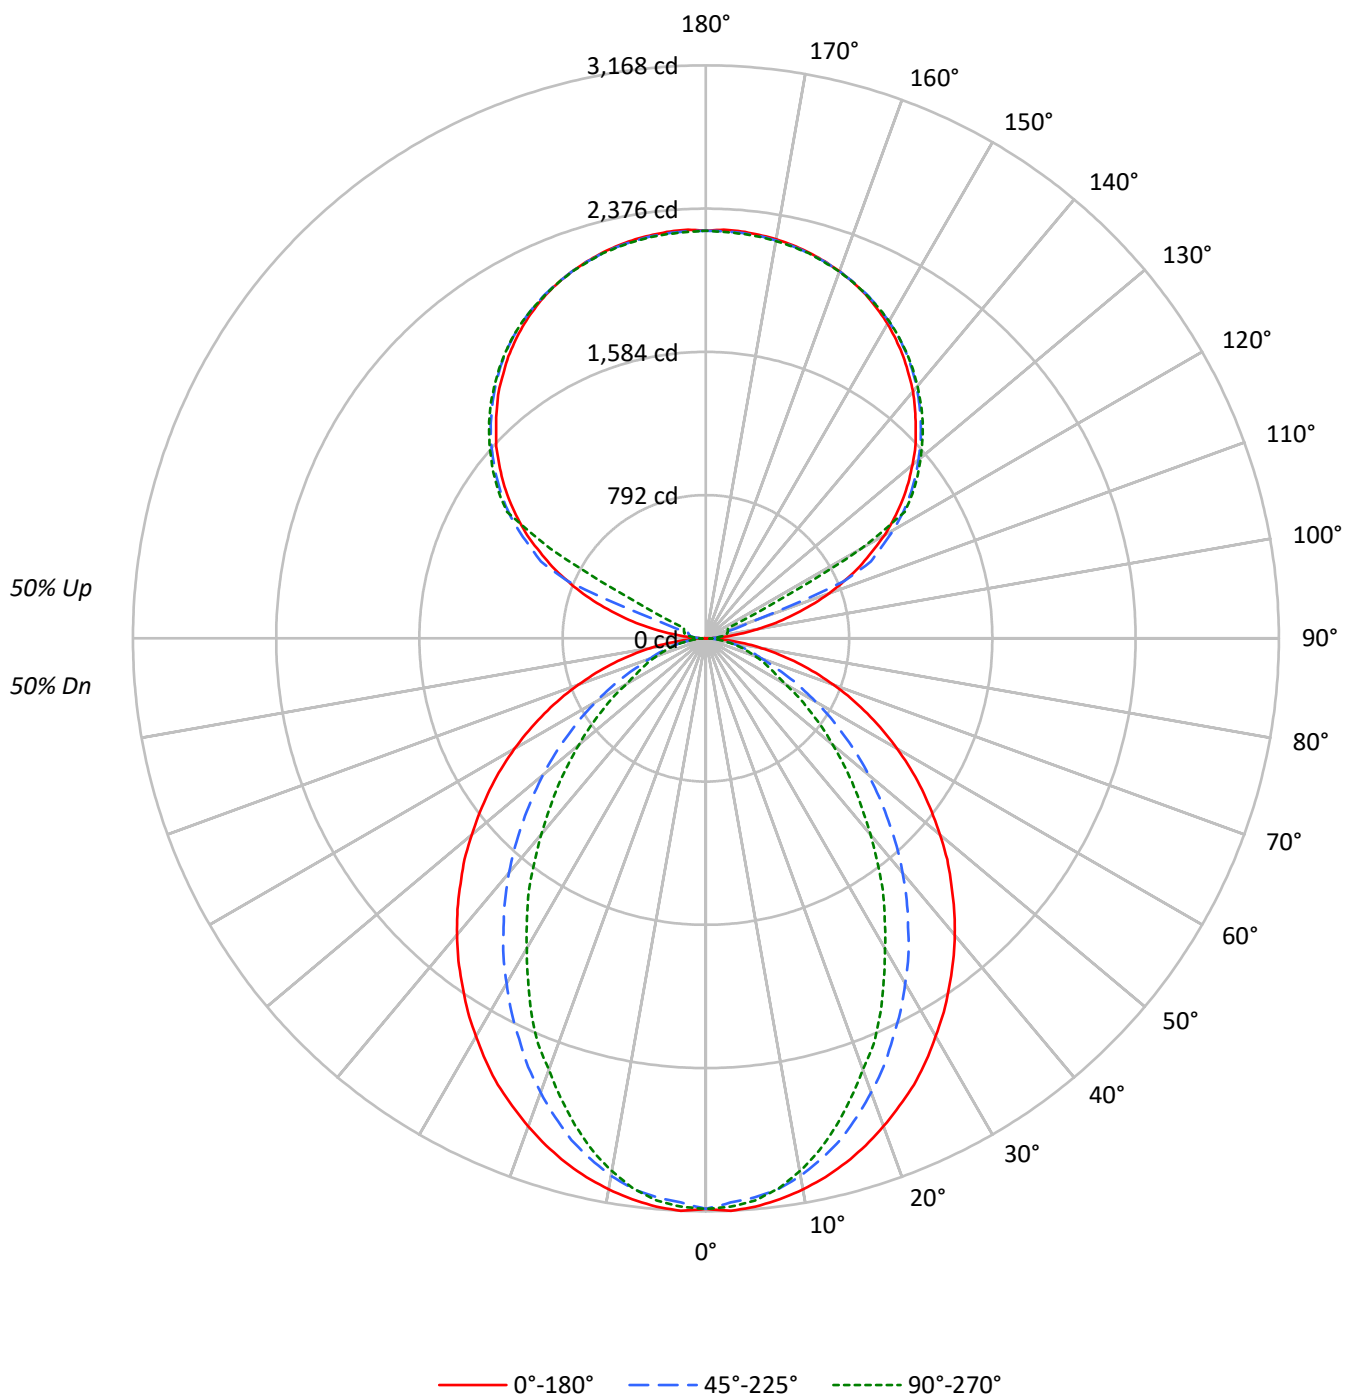

TEST NUMBER: P926333

CATALOG NUMBER: DFN2DIP-TR3F0-080D070US950-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	94	90	87	90	87	84	81	74	71	69	61	60	58	50	49	48
2	90	83	77	72	83	77	71	67	65	61	58	54	52	49	45	43	41
3	82	73	66	60	76	68	62	57	58	53	49	49	45	42	40	38	36
4	75	65	57	52	69	60	54	48	52	47	42	44	40	37	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	33	30	27
6	64	52	44	39	59	49	42	37	42	37	32	36	32	28	30	27	24
7	59	47	40	34	55	44	37	32	38	33	29	33	28	25	27	24	22
8	55	43	36	30	51	40	34	29	35	30	26	30	26	23	25	22	20
9	51	39	32	27	48	37	30	26	32	27	23	28	23	21	23	20	18
10	48	36	29	25	45	34	28	23	30	25	21	26	22	19	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3931	3931	3931
5°	3935	3865	3890
10°	3894	3786	3761
15°	3838	3657	3563
20°	3765	3482	3321
25°	3690	3286	3087
30°	3590	3085	2791
35°	3492	2869	2532
40°	3393	2646	2234
45°	3277	2400	1965
50°	3157	2151	1702
55°	3032	1886	1450
60°	2886	1608	1191
65°	2719	1327	1069
70°	2517	1065	964
75°	2261	932	871
80°	1892	771	747
85°	1288	499	547

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3277 cd/sqm

TEST NUMBER: P926333

CATALOG NUMBER: DFN2DIP-TR3F0-080D070US950-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	295.6	2.3
10°-20°	811.5	6.2
20°-30°	1139.4	8.7
30°-40°	1242.0	9.5
40°-50°	1141.5	8.7
50°-60°	896.5	6.8
60°-70°	583.5	4.5
70°-80°	300.4	2.3
80°-90°	80.6	0.6
90°-100°	74.3	0.6
100°-110°	277.0	2.1
110°-120°	734.8	5.6
120°-130°	1218.6	9.3
130°-140°	1294.5	9.9
140°-150°	1203.1	9.2
150°-160°	967.2	7.4
160°-170°	623.3	4.8
170°-180°	214.5	1.6
0°-30°	2246.6	17.2
0°-40°	3488.6	26.6
0°-60°	5526.6	42.2
0°-90°	6491.2	49.6
90°-120°	1086.1	8.3
90°-150°	4802.2	36.7
90°-180°	6607.0	50.4
0°-180°	13098.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3154	3154	3154	3154	3154	
5°	3154	3140	3103	3128	3120	299
15°	3000	2969	2872	2818	2789	845
25°	2723	2632	2444	2327	2284	1252
35°	2347	2201	1950	1770	1707	1469
45°	1918	1727	1427	1224	1156	1481
55°	1459	1236	928	756	702	1303
65°	985	754	497	400	391	976
75°	525	325	228	208	206	555
85°	123	63	54	54	54	141
90°	2	20	32	41	44	12
95°	106	52	64	72	70	125
105°	496	545	100	117	124	530
115°	938	965	1006	251	134	923
125°	1326	1347	1378	1390	1394	1182
135°	1641	1667	1681	1698	1694	1267
145°	1903	1902	1929	1941	1932	1190
155°	2096	2081	2100	2110	2097	966
165°	2208	2198	2203	2215	2203	624
175°	2259	2247	2250	2262	2246	215
180°	2254	2254	2254	2254	2254	



TEST NUMBER: P926333

CATALOG NUMBER: DFN2DIP-TR3F0-080D070US950-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3154.3	3154.3	3154.3	3154.3	3154.3
2.5°	3168.5	3154.3	3122.8	3151.5	3145.8
5°	3154.3	3140.1	3102.8	3128.5	3120.1
7.5°	3128.5	3111.6	3071.6	3082.9	3068.5
10°	3094.3	3074.4	3017.4	3008.6	2991.6
12.5°	3051.7	3025.9	2948.6	2931.6	2900.2
15°	3000.1	2968.7	2871.7	2817.5	2789.0
17.5°	2940.1	2894.4	2774.5	2711.8	2666.0
20°	2871.7	2814.5	2671.9	2600.7	2537.6
22.5°	2797.5	2731.8	2566.2	2469.2	2426.5
25°	2723.3	2631.9	2443.5	2326.6	2283.6
27.5°	2634.9	2537.6	2329.3	2195.2	2129.4
30°	2540.7	2431.9	2203.6	2058.3	1981.0
32.5°	2449.2	2317.8	2084.0	1912.6	1841.1
35°	2346.6	2200.9	1949.8	1770.0	1706.9
37.5°	2246.6	2089.5	1824.1	1627.0	1555.8
40°	2141.0	1969.8	1692.7	1490.1	1415.8
42.5°	2032.5	1849.9	1561.5	1350.2	1278.9
45°	1918.3	1726.9	1427.4	1224.5	1156.1
47.5°	1809.9	1607.3	1299.0	1096.1	1033.4
50°	1689.9	1487.4	1173.3	976.1	916.4
52.5°	1572.8	1358.6	1053.3	865.0	810.8
55°	1458.6	1236.0	927.7	756.5	702.3
57.5°	1341.7	1113.3	816.5	656.6	610.8
60°	1221.7	993.4	699.3	553.9	508.2
62.5°	1104.8	876.4	599.4	462.5	439.8
65°	984.9	753.5	496.7	399.8	390.9
67.5°	870.7	639.4	399.8	351.0	342.6
70°	750.8	528.2	331.0	302.5	291.1
72.5°	636.6	425.2	276.9	254.1	248.3
75°	525.2	325.3	228.4	208.4	205.7
77.5°	414.0	231.1	179.9	168.4	162.7
80°	311.0	165.7	136.9	125.6	125.6
82.5°	216.8	111.4	94.2	88.4	88.4
85°	122.7	62.7	54.2	54.2	54.2
87.5°	45.7	22.7	22.7	20.0	20.0
90°	1.5	19.6	32.5	40.8	44.0
92.5°	40.8	34.2	39.1	42.5	44.0
95°	105.9	52.1	63.5	71.8	70.1
97.5°	190.7	57.1	83.1	88.1	89.7
100°	288.8	65.3	92.9	105.9	109.2
102.5°	396.2	393.1	96.3	114.1	119.1
105°	495.8	544.7	99.5	117.3	123.9
107.5°	611.5	652.2	102.8	120.7	127.3
110°	722.6	756.6	285.4	122.4	128.8

TEST NUMBER: P926333

CATALOG NUMBER: DFN2DIP-TR3F0-080D070US950-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	826.9	856.1	828.5	125.5	130.5
115°	937.7	965.4	1006.2	251.2	133.8
117.5°	1033.9	1066.5	1094.3	861.0	433.8
120°	1141.6	1166.0	1195.5	1215.0	994.8
122.5°	1232.8	1258.9	1291.7	1301.4	1303.1
125°	1325.8	1347.0	1378.1	1389.5	1394.3
127.5°	1410.6	1433.4	1458.0	1474.3	1475.8
130°	1490.5	1516.7	1534.5	1552.5	1551.0
132.5°	1572.1	1593.4	1611.2	1625.9	1624.4
135°	1640.6	1666.7	1681.3	1697.7	1694.5
137.5°	1712.2	1731.9	1748.3	1764.6	1759.7
140°	1782.4	1795.5	1813.4	1828.1	1819.9
142.5°	1841.2	1852.7	1873.8	1886.7	1878.6
145°	1903.2	1901.5	1929.2	1940.6	1932.5
147.5°	1956.8	1952.1	1979.7	1987.8	1981.5
150°	2009.1	1997.8	2023.9	2033.5	2025.4
152.5°	2053.1	2040.1	2064.6	2074.4	2063.0
155°	2095.6	2081.0	2100.5	2110.2	2097.3
157.5°	2129.8	2116.8	2131.5	2143.0	2129.8
160°	2159.3	2149.4	2159.3	2168.9	2157.5
162.5°	2185.2	2175.5	2183.6	2195.1	2180.4
165°	2208.0	2198.4	2203.2	2214.6	2203.2
167.5°	2226.1	2216.1	2221.2	2232.6	2218.0
170°	2240.8	2230.9	2234.2	2245.6	2230.9
172.5°	2250.5	2240.8	2244.1	2255.4	2240.8
175°	2258.6	2247.1	2250.5	2261.8	2245.6
177.5°	2261.8	2250.5	2252.2	2263.7	2248.9
180°	2253.7	2253.7	2253.7	2253.7	2253.7

TEST NUMBER: P926333

CATALOG NUMBER: DFN2DIP-TR3F0-080D070US950-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.81	12.64	12.78	13.61	14.89	7.79	8.61	8.75	9.59	10.87
	3H	13.48	14.22	14.46	15.20	16.51	8.97	9.71	9.95	10.69	12.00
	4H	14.08	14.78	15.07	15.77	17.08	9.42	10.11	10.41	11.10	12.42
	6H	14.49	15.14	15.50	16.13	17.45	9.73	10.37	10.73	11.37	12.69
	8H	14.62	15.23	15.62	16.24	17.56	9.82	10.43	10.83	11.44	12.76
	12H	14.67	15.25	15.69	16.26	17.60	9.86	10.44	10.87	11.45	12.79
4H	2H	11.83	12.52	12.82	13.51	14.83	8.38	9.07	9.37	10.06	11.38
	3H	13.64	14.22	14.65	15.24	16.57	9.72	10.30	10.73	11.32	12.64
	4H	14.33	14.86	15.34	15.87	17.22	10.26	10.79	11.28	11.80	13.15
	6H	14.84	15.29	15.86	16.33	17.67	10.68	11.13	11.70	12.17	13.51
	8H	15.00	15.43	16.03	16.46	17.82	10.80	11.23	11.83	12.25	13.61
	12H	15.09	15.48	16.14	16.52	17.89	10.86	11.25	11.91	12.29	13.65
8H	4H	14.30	14.72	15.32	15.75	17.11	10.54	10.96	11.56	11.99	13.35
	6H	14.85	15.20	15.90	16.27	17.63	11.05	11.40	12.10	12.47	13.83
	8H	15.06	15.37	16.12	16.43	17.80	11.23	11.54	12.29	12.60	13.97
	12H	15.19	15.46	16.25	16.51	17.93	11.35	11.62	12.41	12.67	14.09
12H	4H	14.25	14.63	15.29	15.67	17.04	10.54	10.92	11.58	11.97	13.33
	6H	14.83	15.13	15.88	16.19	17.57	11.09	11.40	12.15	12.46	13.83
	8H	15.04	15.31	16.10	16.36	17.78	11.30	11.57	12.36	12.62	14.04