

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P926354

Luminaire Tested: DFN2DIP-TR3F0-090D060US950-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P926354
REPORT IS A COMBINATION OF REPORTS P900326 AND P897195
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR3F0-090D060US950-RLLFLL
Description: 3 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12363.9 lumens
Efficiency: N/A
Efficacy: 88.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 2.74' x L: 3.16' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 140
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P926354

CATALOG NUMBER: DFN2DIP-TR3F0-090D060US950-RLLFLL

Luminous Intensity Polar Plot

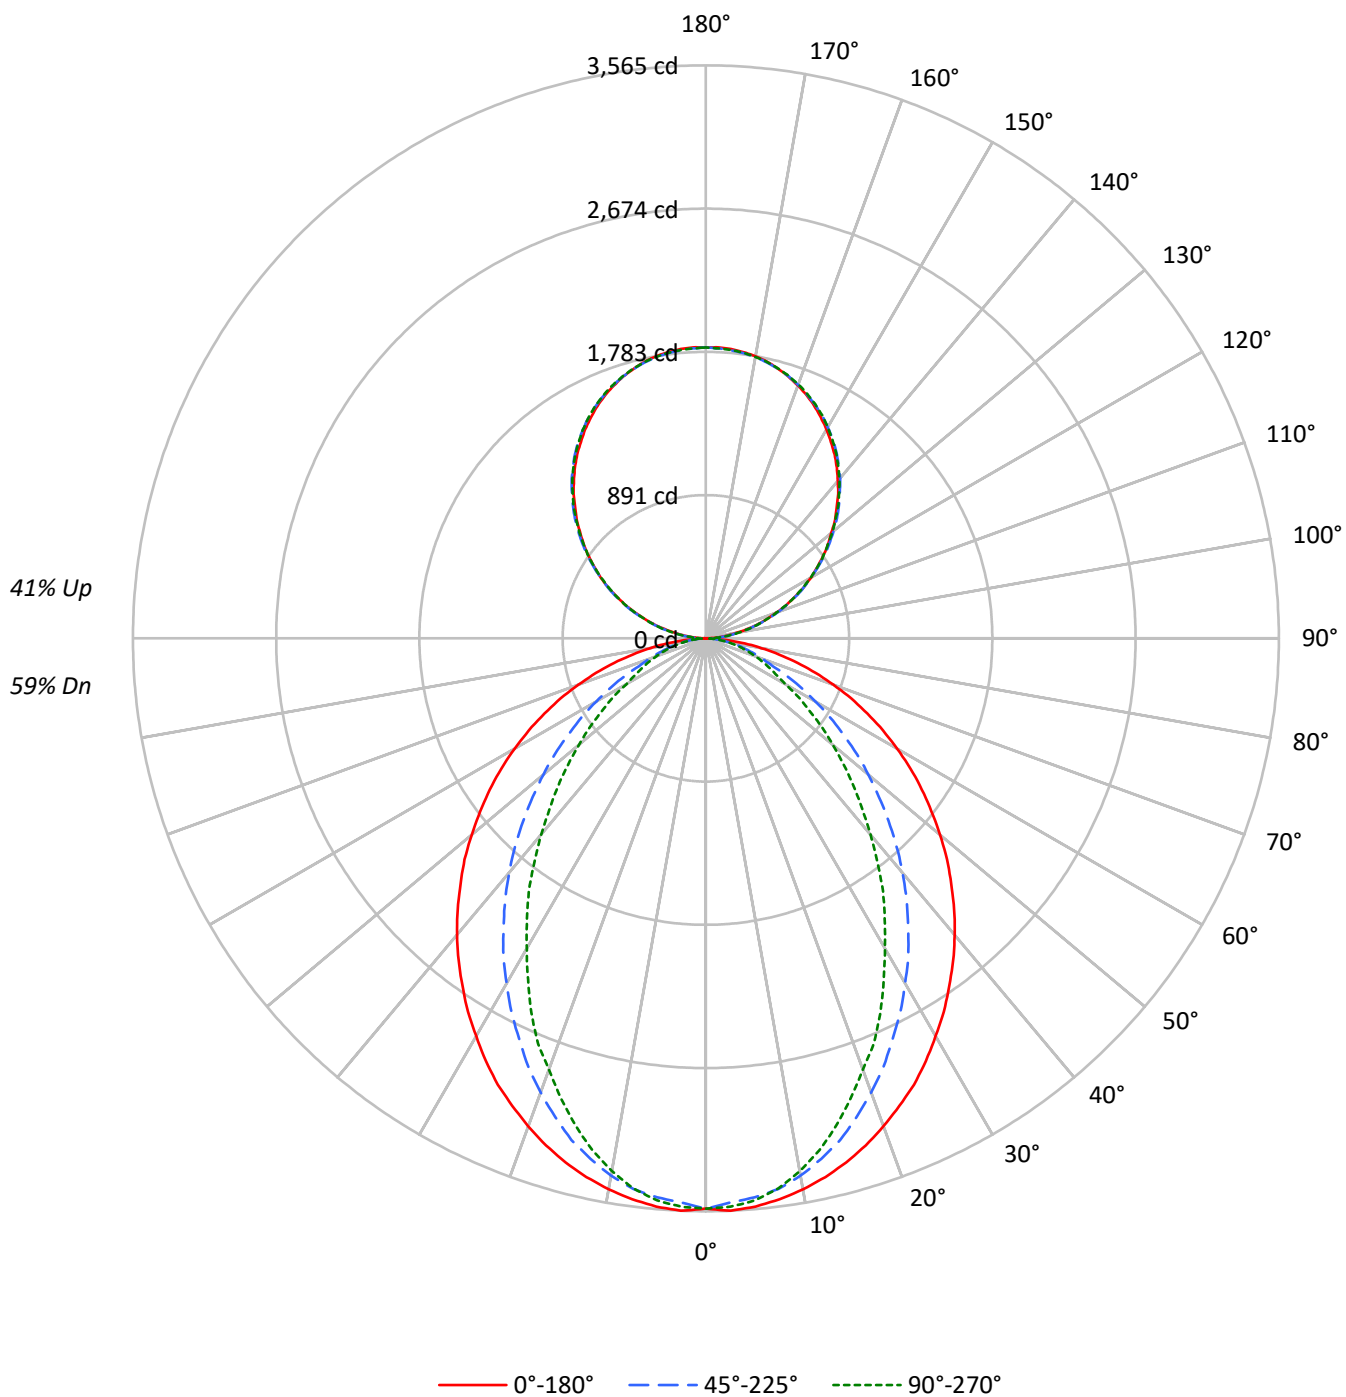

TEST NUMBER: P926354

CATALOG NUMBER: DFN2DIP-TR3F0-090D060US950-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	76	76	76	64	64	64
1	100	96	92	89	94	90	87	84	78	76	74	68	66	64	58	57	56
2	92	85	79	74	86	79	74	70	69	65	62	60	57	55	52	50	48
3	84	75	68	62	78	70	64	59	62	57	53	54	50	47	46	44	41
4	77	67	59	53	72	63	56	51	55	50	46	48	44	41	42	39	36
5	71	60	52	46	66	56	49	44	50	44	40	44	39	36	38	34	32
6	66	54	46	40	61	51	44	39	45	39	35	40	35	32	35	31	28
7	61	49	41	36	57	46	39	34	41	35	31	36	32	28	32	28	25
8	57	45	37	32	53	42	35	30	38	32	28	33	29	25	29	26	23
9	53	41	34	29	50	39	32	27	35	29	25	31	26	23	27	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	25	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4422	4422	4422
5°	4427	4348	4377
10°	4380	4259	4231
15°	4318	4115	4009
20°	4235	3917	3736
25°	4151	3697	3473
30°	4039	3470	3140
35°	3929	3228	2848
40°	3817	2977	2514
45°	3686	2700	2211
50°	3552	2420	1915
55°	3411	2121	1631
60°	3247	1810	1340
65°	3059	1493	1203
70°	2831	1198	1084
75°	2544	1048	980
80°	2129	868	840
85°	1448	562	615

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3686 cd/sqm

TEST NUMBER: P926354

CATALOG NUMBER: DFN2DIP-TR3F0-090D060US950-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	332.6	2.7
10°-20°	913.0	7.4
20°-30°	1281.8	10.4
30°-40°	1397.3	11.3
40°-50°	1284.2	10.4
50°-60°	1008.6	8.2
60°-70°	656.5	5.3
70°-80°	337.9	2.7
80°-90°	91.4	0.7
90°-100°	112.0	0.9
100°-110°	355.9	2.9
110°-120°	609.1	4.9
120°-130°	801.1	6.5
130°-140°	899.2	7.3
140°-150°	881.7	7.1
150°-160°	739.6	6.0
160°-170°	490.5	4.0
170°-180°	171.4	1.4
0°-30°	2527.4	20.4
0°-40°	3924.6	31.7
0°-60°	6217.4	50.3
0°-90°	7303.3	59.1
90°-120°	1077.0	8.7
90°-150°	3659.0	29.6
90°-180°	5061.0	40.9
0°-180°	12363.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3549	3549	3549	3549	3549	
5°	3549	3533	3491	3520	3510	336
15°	3375	3340	3231	3170	3138	951
25°	3064	2961	2749	2617	2569	1409
35°	2640	2476	2194	1991	1920	1652
45°	2158	1943	1606	1378	1300	1667
55°	1641	1390	1044	851	790	1466
65°	1108	848	559	450	440	1099
75°	591	366	257	234	231	625
85°	138	70	61	61	61	158
90°	2	20	54	50	52	12
95°	80	95	98	98	95	89
105°	329	333	336	339	339	347
115°	611	620	617	616	611	605
125°	889	903	898	893	892	794
135°	1150	1167	1170	1168	1164	889
145°	1396	1407	1416	1417	1411	872
155°	1596	1601	1606	1613	1608	735
165°	1737	1735	1735	1746	1738	490
175°	1807	1803	1799	1810	1801	172
180°	1810	1810	1810	1810	1810	

TEST NUMBER: P926354

CATALOG NUMBER: DFN2DIP-TR3F0-090D060US950-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3548.6	3548.6	3548.6	3548.6	3548.6
2.5°	3564.6	3548.6	3513.1	3545.5	3539.1
5°	3548.6	3532.6	3490.7	3519.6	3510.1
7.5°	3519.6	3500.5	3455.6	3468.2	3452.1
10°	3481.1	3458.6	3394.6	3384.7	3365.6
12.5°	3433.1	3404.2	3317.2	3298.2	3262.7
15°	3375.2	3339.8	3230.7	3169.7	3137.7
17.5°	3307.7	3256.3	3121.3	3050.8	2999.4
20°	3230.7	3166.3	3005.8	2925.7	2854.8
22.5°	3147.2	3073.3	2886.9	2777.9	2729.9
25°	3063.8	2960.8	2749.0	2617.4	2569.0
27.5°	2964.3	2854.8	2620.4	2469.5	2395.6
30°	2858.3	2736.0	2479.1	2315.5	2228.6
32.5°	2755.3	2607.5	2344.5	2151.7	2071.2
35°	2639.9	2476.0	2193.5	1991.2	1920.3
37.5°	2527.4	2350.7	2052.1	1830.3	1750.3
40°	2408.6	2216.0	1904.3	1676.4	1592.9
42.5°	2286.5	2081.2	1756.7	1519.0	1438.8
45°	2158.1	1942.8	1605.8	1377.5	1300.5
47.5°	2036.1	1808.2	1461.3	1233.0	1162.5
50°	1901.2	1673.2	1320.0	1098.1	1031.0
52.5°	1769.4	1528.5	1185.1	973.1	912.1
55°	1640.9	1390.5	1043.6	851.2	790.1
57.5°	1509.4	1252.5	918.6	738.7	687.3
60°	1374.4	1117.5	786.8	623.2	571.7
62.5°	1243.0	986.1	674.3	520.3	494.7
65°	1108.0	847.7	558.8	449.7	439.9
67.5°	979.6	719.2	449.7	394.9	385.3
70°	844.7	594.2	372.4	340.4	327.4
72.5°	716.2	478.3	311.4	285.8	279.4
75°	590.8	366.0	256.9	234.4	231.3
77.5°	465.7	260.0	202.3	189.5	183.0
80°	349.9	186.4	154.0	141.4	141.4
82.5°	243.9	125.4	106.0	99.5	99.5
85°	137.9	70.5	61.0	61.0	61.0
87.5°	51.4	25.6	25.6	22.5	22.5
90°	1.6	19.7	53.5	50.2	51.8
92.5°	33.9	45.9	47.5	49.1	49.1
95°	79.7	94.9	97.7	97.7	94.9
97.5°	132.6	146.8	152.8	152.8	152.8
100°	193.8	206.3	210.6	210.6	209.0
102.5°	258.2	267.4	273.4	275.0	273.4
105°	328.6	332.9	336.2	339.0	339.0
107.5°	398.4	405.0	405.0	406.0	398.4
110°	466.1	474.8	474.8	474.8	470.4

TEST NUMBER: P926354

CATALOG NUMBER: DFN2DIP-TR3F0-090D060US950-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	539.2	548.5	546.8	542.4	539.2
115°	611.2	620.0	617.2	615.6	611.2
117.5°	682.8	694.8	687.1	682.8	678.4
120°	754.8	766.8	754.8	754.8	749.8
122.5°	820.2	835.5	827.9	823.6	820.2
125°	889.0	902.7	898.3	893.4	891.8
127.5°	956.2	973.1	967.1	960.6	956.2
130°	1019.0	1038.6	1035.9	1032.6	1026.6
132.5°	1089.4	1104.6	1105.7	1098.1	1093.7
135°	1150.0	1166.8	1170.1	1168.5	1164.1
137.5°	1217.6	1231.2	1234.0	1232.9	1226.4
140°	1277.1	1290.8	1298.4	1298.4	1292.4
142.5°	1338.2	1351.8	1356.2	1357.8	1351.8
145°	1396.1	1407.0	1415.7	1417.4	1411.3
147.5°	1447.9	1461.5	1468.1	1470.8	1464.8
150°	1501.4	1510.7	1516.7	1521.5	1516.7
152.5°	1548.8	1558.2	1565.8	1571.8	1565.8
155°	1596.3	1600.7	1605.6	1613.3	1608.3
157.5°	1637.3	1640.6	1643.3	1654.2	1646.6
160°	1673.9	1677.1	1678.8	1688.0	1681.5
162.5°	1707.7	1707.7	1709.3	1719.7	1712.0
165°	1736.6	1734.9	1734.9	1745.9	1738.3
167.5°	1762.8	1757.9	1757.9	1768.8	1761.2
170°	1782.5	1778.1	1776.4	1787.3	1778.1
172.5°	1796.1	1791.7	1790.1	1801.0	1791.7
175°	1807.0	1802.7	1799.3	1810.3	1801.0
177.5°	1813.0	1808.7	1805.3	1814.6	1805.3
180°	1810.3	1810.3	1810.3	1810.3	1810.3

TEST NUMBER: P926354

CATALOG NUMBER: DFN2DIP-TR3F0-090D060US950-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.07	13.98	13.95	14.87	16.01	9.04	9.95	9.93	10.85	11.99
	3H	14.74	15.55	15.64	16.46	17.63	10.23	11.05	11.13	11.95	13.12
	4H	15.35	16.11	16.26	17.03	18.20	10.68	11.45	11.59	12.36	13.54
	6H	15.76	16.47	16.69	17.39	18.58	11.00	11.71	11.92	12.63	13.82
	8H	15.89	16.56	16.82	17.50	18.68	11.09	11.77	12.02	12.70	13.89
	12H	15.95	16.59	16.88	17.52	18.73	11.14	11.78	12.07	12.71	13.92
4H	2H	13.09	13.86	14.01	14.77	15.95	9.64	10.41	10.56	11.32	12.50
	3H	14.92	15.56	15.84	16.50	17.69	10.99	11.63	11.92	12.58	13.76
	4H	15.61	16.19	16.54	17.13	18.34	11.54	12.12	12.48	13.06	14.27
	6H	16.12	16.62	17.07	17.58	18.80	11.96	12.46	12.91	13.42	14.64
	8H	16.29	16.76	17.24	17.71	18.94	12.08	12.55	13.04	13.51	14.74
	12H	16.38	16.80	17.35	17.78	19.01	12.15	12.57	13.12	13.55	14.78
8H	4H	15.58	16.05	16.53	17.00	18.23	11.82	12.29	12.77	13.24	14.47
	6H	16.14	16.52	17.12	17.52	18.75	12.33	12.72	13.31	13.72	14.95
	8H	16.35	16.69	17.33	17.68	18.92	12.52	12.86	13.51	13.85	15.09
	12H	16.48	16.78	17.47	17.76	19.06	12.64	12.94	13.63	13.92	15.21
12H	4H	15.53	15.96	16.50	16.93	18.16	11.83	12.25	12.80	13.22	14.46
	6H	16.11	16.45	17.10	17.44	18.69	12.38	12.72	13.37	13.71	14.95
	8H	16.33	16.63	17.32	17.61	18.90	12.59	12.89	13.58	13.87	15.16