

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904555

Luminaire Tested: DFN2DIP-TR4F0-040D070US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904555
REPORT IS A COMBINATION OF REPORTS P901943 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-040D070US830-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10264.3 lumens
Efficiency: N/A
Efficacy: 122.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 84.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904555

CATALOG NUMBER: DFN2DIP-TR4F0-040D070US830-FLLONL

Luminous Intensity Polar Plot

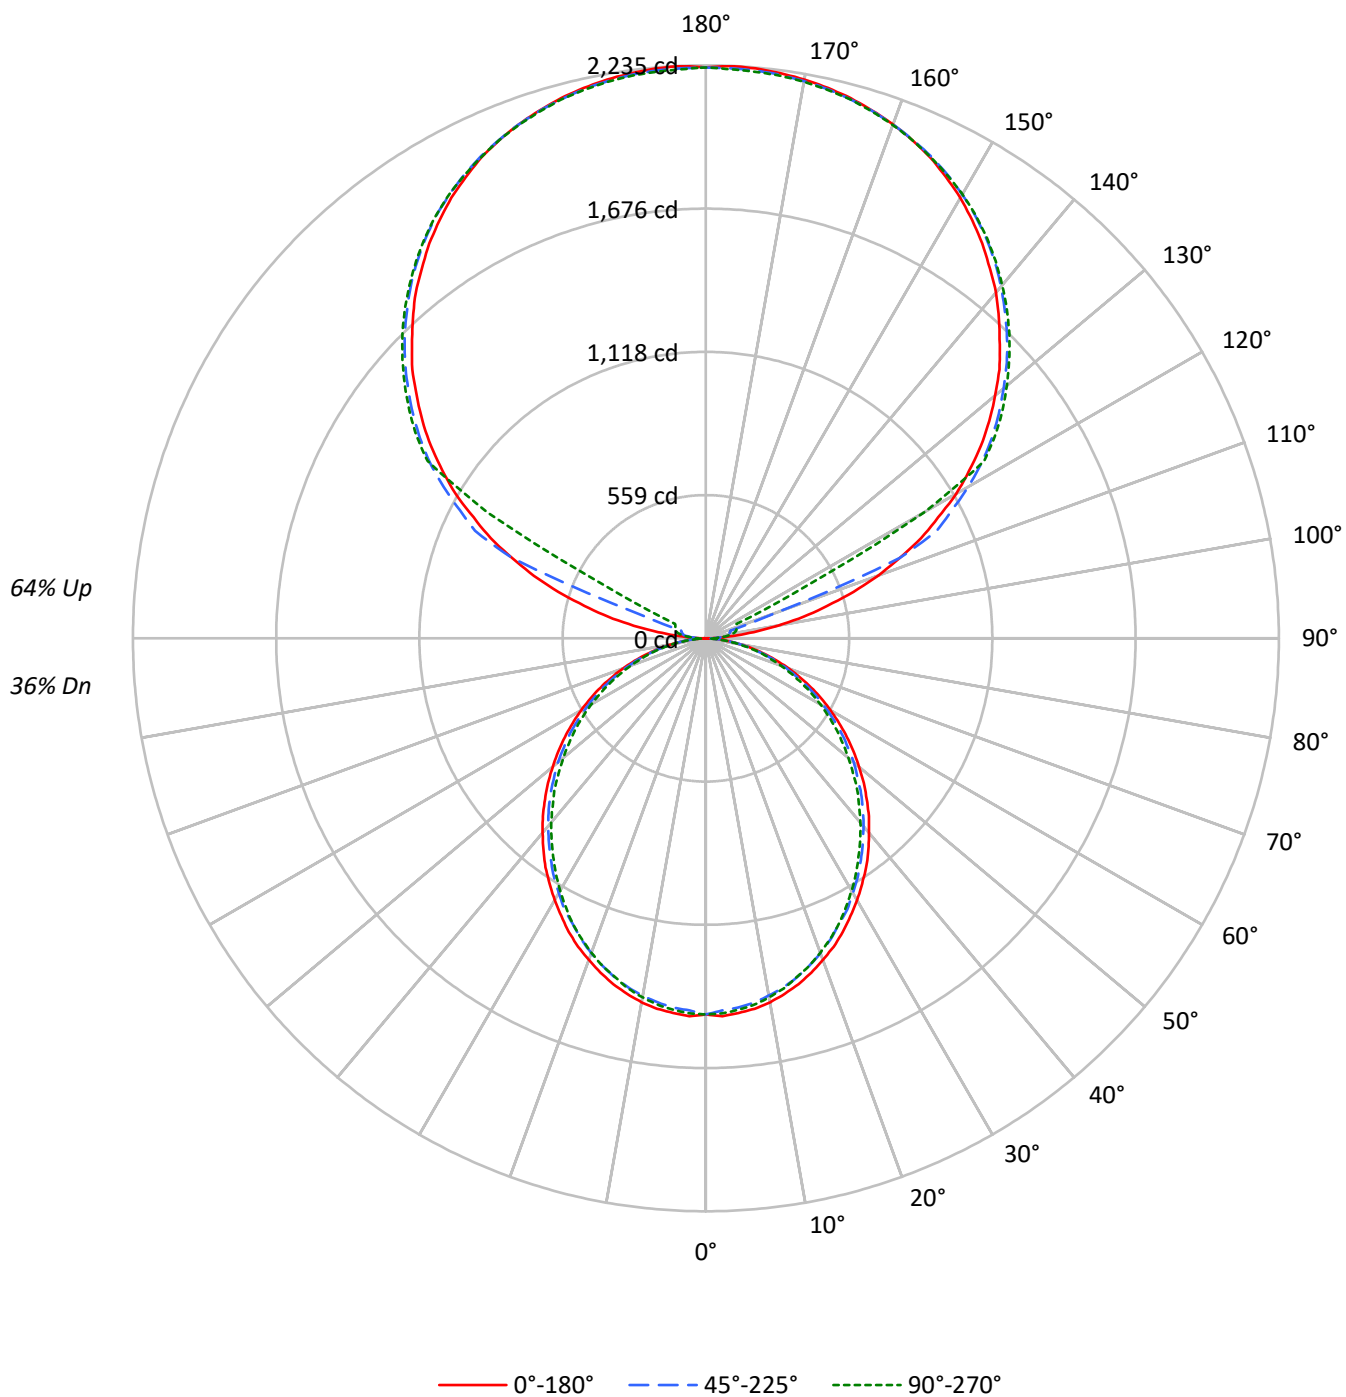

TEST NUMBER: P904555

CATALOG NUMBER: DFN2DIP-TR4F0-040D070US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	90	87	83	86	82	79	76	66	64	62	52	50	49	39	38	37
2	86	79	73	68	78	72	67	62	58	54	51	46	43	41	34	32	31
3	79	69	62	57	71	63	57	52	51	47	43	40	37	35	30	28	26
4	72	61	54	48	65	56	49	44	45	41	37	36	32	30	27	25	23
5	66	55	47	41	59	50	43	38	41	35	32	32	28	26	24	22	20
6	61	49	41	35	55	45	38	33	37	31	27	29	25	22	22	19	17
7	56	44	36	31	51	40	33	29	33	28	24	26	23	20	20	17	15
8	52	40	32	27	47	37	30	25	30	25	21	24	20	18	18	16	14
9	48	36	29	24	44	33	27	22	28	23	19	22	18	16	17	14	12
10	45	33	26	21	41	31	24	20	25	20	17	20	17	14	16	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1165	1165	1165
5°	1167	1149	1157
10°	1158	1134	1141
15°	1141	1115	1117
20°	1118	1089	1092
25°	1095	1058	1063
30°	1066	1029	1026
35°	1039	995	987
40°	1006	961	950
45°	972	926	912
50°	936	890	868
55°	898	848	827
60°	855	799	781
65°	808	747	726
70°	748	684	667
75°	665	609	613
80°	565	514	509
85°	409	348	338

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1184 cd/sqm

TEST NUMBER: P904555

CATALOG NUMBER: DFN2DIP-TR4F0-040D070US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	138.1	1.3
10°-20°	388.5	3.8
20°-30°	570.9	5.6
30°-40°	663.1	6.5
40°-50°	662.3	6.5
50°-60°	577.5	5.6
60°-70°	426.9	4.2
70°-80°	241.5	2.4
80°-90°	67.7	0.7
90°-100°	73.4	0.7
100°-110°	273.7	2.7
110°-120°	725.9	7.1
120°-130°	1204.0	11.7
130°-140°	1278.9	12.5
140°-150°	1188.6	11.6
150°-160°	955.6	9.3
160°-170°	615.8	6.0
170°-180°	211.9	2.1
0°-30°	1097.5	10.7
0°-40°	1760.6	17.2
0°-60°	3000.3	29.2
0°-90°	3736.4	36.4
90°-120°	1073.0	10.5
90°-150°	4744.6	46.2
90°-180°	6528.0	63.6
0°-180°	10264.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1467	1467	1467	1467	1467	
5°	1467	1461	1446	1457	1454	139
15°	1396	1388	1370	1375	1368	393
25°	1264	1253	1229	1231	1229	582
35°	1090	1076	1054	1045	1038	681
45°	887	878	856	841	835	685
55°	672	663	646	629	622	600
65°	453	444	430	418	411	448
75°	237	234	227	219	222	253
85°	58	56	55	51	49	64
90°	2	19	32	40	44	9
95°	105	52	63	71	69	124
105°	490	538	98	116	122	523
115°	926	954	994	248	132	912
125°	1310	1331	1362	1373	1378	1168
135°	1621	1647	1661	1677	1674	1252
145°	1880	1879	1906	1917	1909	1176
155°	2070	2056	2075	2085	2072	954
165°	2182	2172	2177	2188	2177	616
175°	2232	2220	2224	2235	2219	212
180°	2227	2227	2227	2227	2227	

TEST NUMBER: P904555

CATALOG NUMBER: DFN2DIP-TR4F0-040D070US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1467.0	1467.0	1467.0	1467.0	1467.0
2.5°	1475.5	1468.5	1452.9	1467.0	1464.3
5°	1467.0	1461.4	1445.9	1457.1	1454.4
7.5°	1457.1	1448.7	1433.1	1444.5	1441.7
10°	1441.7	1431.8	1414.9	1426.2	1421.9
12.5°	1420.4	1412.0	1395.2	1402.2	1399.3
15°	1396.5	1388.1	1369.7	1375.4	1368.4
17.5°	1366.9	1358.5	1340.1	1347.1	1340.1
20°	1334.4	1326.0	1306.3	1310.4	1304.9
22.5°	1302.0	1289.3	1270.9	1270.9	1268.1
25°	1263.9	1252.6	1228.7	1231.4	1228.7
27.5°	1221.5	1211.6	1193.4	1189.2	1182.2
30°	1179.3	1168.0	1146.9	1142.6	1137.0
32.5°	1134.2	1125.8	1103.2	1094.7	1088.9
35°	1090.4	1076.4	1053.8	1045.3	1038.2
37.5°	1041.0	1028.3	1005.7	995.9	988.8
40°	990.3	978.9	956.3	943.8	938.1
42.5°	940.9	929.5	907.1	892.9	884.5
45°	887.3	877.5	856.2	840.8	835.1
47.5°	835.1	825.2	802.7	787.1	778.7
50°	780.0	773.0	753.3	733.5	726.4
52.5°	726.4	716.6	698.3	682.8	672.9
55°	671.6	663.0	646.1	629.1	622.2
57.5°	616.4	609.4	591.0	574.1	568.4
60°	561.4	555.8	536.1	520.6	516.3
62.5°	507.8	497.9	483.9	469.8	464.1
65°	452.9	444.3	430.3	417.5	410.6
67.5°	396.4	389.3	376.7	366.8	361.2
70°	344.2	338.6	325.8	315.9	310.4
72.5°	290.7	284.9	278.0	268.1	263.8
75°	237.0	234.2	227.1	218.7	221.5
77.5°	189.0	183.3	180.5	176.3	172.1
80°	141.1	139.6	136.8	132.6	129.8
82.5°	96.0	96.0	94.6	88.9	88.9
85°	57.8	56.5	55.0	50.7	49.4
87.5°	25.4	22.6	19.8	15.6	14.0
90°	1.5	19.3	32.1	40.3	43.5
92.5°	40.3	33.8	38.6	41.9	43.5
95°	104.6	51.5	62.8	71.0	69.3
97.5°	188.4	56.5	82.1	87.1	88.6
100°	285.3	64.5	91.8	104.6	107.9
102.5°	391.4	388.4	95.1	112.7	117.6
105°	489.8	538.2	98.3	115.9	122.4
107.5°	604.2	644.4	101.6	119.2	125.7
110°	713.9	747.5	282.0	120.9	127.2

TEST NUMBER: P904555

CATALOG NUMBER: DFN2DIP-TR4F0-040D070US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	817.0	845.8	818.5	123.9	128.9
115°	926.4	953.8	994.1	248.2	132.2
117.5°	1021.5	1053.7	1081.2	850.6	428.6
120°	1127.8	1152.0	1181.1	1200.4	982.9
122.5°	1218.0	1243.8	1276.2	1285.7	1287.4
125°	1309.9	1330.9	1361.5	1372.8	1377.5
127.5°	1393.6	1416.2	1440.5	1456.6	1458.1
130°	1472.6	1498.5	1516.1	1533.9	1532.4
132.5°	1553.2	1574.2	1591.9	1606.4	1604.9
135°	1620.9	1646.7	1661.1	1677.3	1674.1
137.5°	1691.7	1711.1	1727.3	1743.4	1738.6
140°	1761.0	1774.0	1791.6	1806.1	1798.1
142.5°	1819.1	1830.4	1851.2	1864.1	1856.1
145°	1880.4	1878.7	1906.0	1917.3	1909.3
147.5°	1933.3	1928.6	1956.0	1964.0	1957.7
150°	1985.0	1973.8	1999.6	2009.1	2001.1
152.5°	2028.4	2015.6	2039.8	2049.5	2038.2
155°	2070.4	2056.0	2075.3	2084.9	2072.1
157.5°	2104.2	2091.4	2105.9	2117.2	2104.2
160°	2133.4	2123.5	2133.4	2142.9	2131.6
162.5°	2159.0	2149.4	2157.4	2168.7	2154.2
165°	2181.5	2172.0	2176.7	2188.0	2176.7
167.5°	2199.3	2189.5	2194.5	2205.8	2191.3
170°	2213.8	2204.1	2207.3	2218.7	2204.1
172.5°	2223.5	2213.8	2217.1	2228.4	2213.8
175°	2231.5	2220.2	2223.5	2234.7	2218.7
177.5°	2234.7	2223.5	2225.2	2236.5	2221.9
180°	2226.7	2226.7	2226.7	2226.7	2226.7

TEST NUMBER: P904555

CATALOG NUMBER: DFN2DIP-TR4F0-040D070US830-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.39	7.14	7.46	8.21	9.66	5.96	6.71	7.03	7.78	9.23
	3H	8.04	8.72	9.12	9.79	11.26	7.57	8.24	8.65	9.32	10.79
	4H	8.63	9.26	9.71	10.34	11.82	8.15	8.79	9.24	9.87	11.35
	6H	9.02	9.61	10.12	10.69	12.18	8.54	9.13	9.64	10.21	11.70
	8H	9.12	9.68	10.22	10.78	12.26	8.65	9.21	9.75	10.30	11.79
	12H	9.17	9.70	10.27	10.79	12.30	8.69	9.22	9.79	10.31	11.82
4H	2H	6.84	7.48	7.93	8.56	10.03	6.50	7.13	7.59	8.21	9.69
	3H	8.70	9.23	9.80	10.33	11.82	8.30	8.84	9.40	9.94	11.43
	4H	9.41	9.89	10.51	10.99	12.50	9.00	9.49	10.11	10.58	12.10
	6H	9.91	10.33	11.03	11.45	12.96	9.51	9.92	10.62	11.04	12.55
	8H	10.06	10.45	11.17	11.56	13.08	9.65	10.04	10.76	11.15	12.67
	12H	10.13	10.48	11.26	11.61	13.13	9.71	10.06	10.84	11.19	12.71
8H	4H	9.59	9.99	10.71	11.10	12.62	9.23	9.63	10.35	10.74	12.26
	6H	10.22	10.54	11.35	11.70	13.21	9.86	10.18	10.99	11.33	12.85
	8H	10.44	10.72	11.58	11.86	13.39	10.07	10.35	11.21	11.49	13.02
	12H	10.57	10.82	11.71	11.94	13.52	10.18	10.43	11.33	11.56	13.13
12H	4H	9.57	9.93	10.70	11.05	12.58	9.22	9.58	10.35	10.70	12.22
	6H	10.25	10.53	11.39	11.67	13.20	9.90	10.18	11.04	11.31	12.85
	8H	10.49	10.73	11.63	11.86	13.44	10.13	10.38	11.27	11.51	13.08

END OF REPORT