

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904586

Luminaire Tested: DFN2DIP-TR4F0-050D060US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904586
REPORT IS A COMBINATION OF REPORTS P900407 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-050D060US830-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9670.5 lumens
Efficiency: N/A
Efficacy: 111.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 86.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904586

CATALOG NUMBER: DFN2DIP-TR4F0-050D060US830-FLLFLL

Luminous Intensity Polar Plot

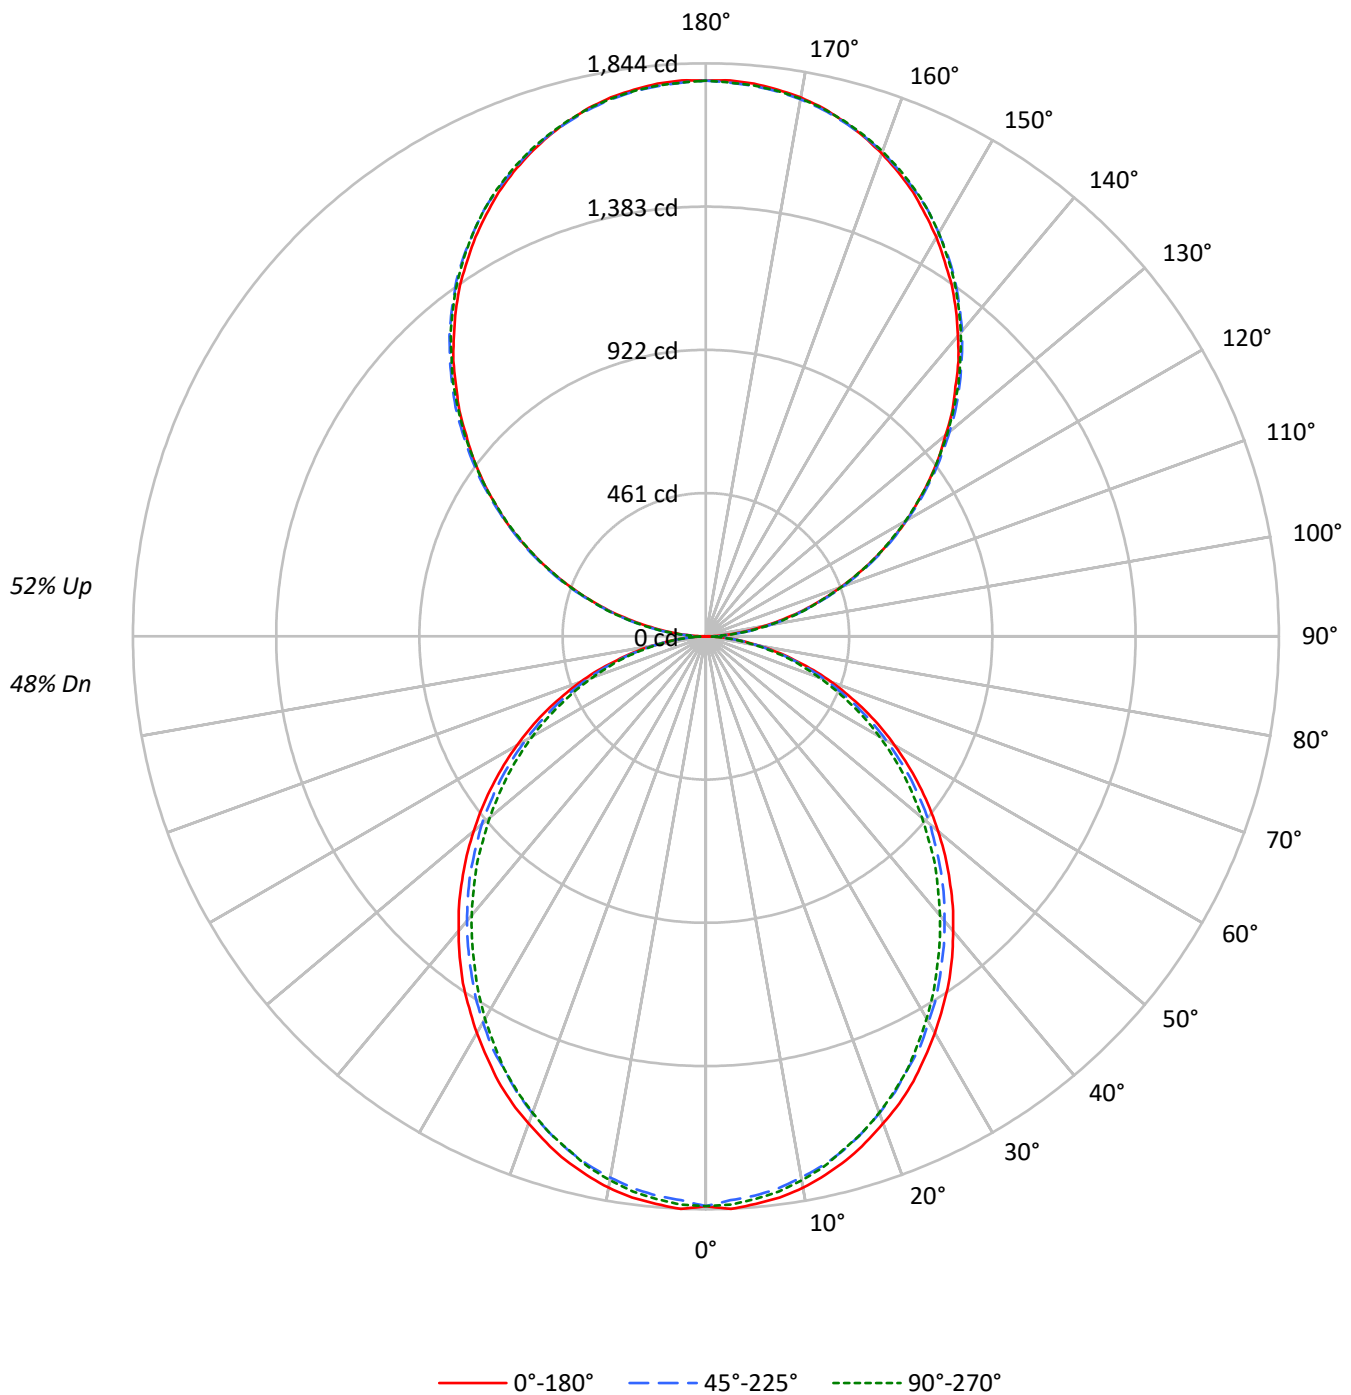

TEST NUMBER: P904586

CATALOG NUMBER: DFN2DIP-TR4F0-050D060US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	68	68	68	55	55	55
1	97	93	89	86	89	86	82	79	72	70	68	60	58	57	48	47	46
2	89	81	75	70	81	75	70	65	63	59	56	52	50	47	42	41	39
3	81	71	64	58	74	66	60	54	56	51	47	46	43	40	38	35	33
4	74	63	55	49	68	59	52	46	50	44	40	41	37	34	34	31	28
5	68	56	48	42	62	52	45	40	44	39	35	37	33	30	30	27	25
6	63	51	42	37	57	47	40	34	40	34	30	34	29	26	27	24	22
7	58	46	38	32	53	42	35	30	36	31	27	30	26	23	25	22	19
8	54	41	34	28	49	39	32	27	33	28	24	28	24	20	23	20	17
9	50	38	30	25	46	35	28	24	30	25	21	26	21	18	21	18	16
10	47	35	27	23	43	32	26	21	28	23	19	24	20	17	20	17	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1457	1457	1457
5°	1459	1436	1446
10°	1447	1417	1426
15°	1426	1394	1396
20°	1397	1361	1365
25°	1369	1323	1328
30°	1333	1286	1282
35°	1299	1244	1233
40°	1257	1201	1187
45°	1215	1158	1140
50°	1170	1113	1084
55°	1122	1060	1034
60°	1068	998	976
65°	1009	934	908
70°	935	856	834
75°	830	762	766
80°	706	642	637
85°	511	435	422

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1393 cd/sqm

TEST NUMBER: P904586

CATALOG NUMBER: DFN2DIP-TR4F0-050D060US830-FLLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.6	1.8
10°-20°	485.6	5.0
20°-30°	713.7	7.4
30°-40°	828.9	8.6
40°-50°	827.8	8.6
50°-60°	721.8	7.5
60°-70°	533.6	5.5
70°-80°	301.9	3.1
80°-90°	84.8	0.9
90°-100°	110.7	1.1
100°-110°	351.6	3.6
110°-120°	601.8	6.2
120°-130°	791.4	8.2
130°-140°	888.4	9.2
140°-150°	871.1	9.0
150°-160°	730.8	7.6
160°-170°	484.6	5.0
170°-180°	169.4	1.8
0°-30°	1371.9	14.2
0°-40°	2200.7	22.8
0°-60°	3750.4	38.8
0°-90°	4670.7	48.3
90°-120°	1064.1	11.0
90°-150°	3615.0	37.4
90°-180°	5000.0	51.7
0°-180°	9670.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1834	1834	1834	1834	1834	
5°	1834	1827	1807	1821	1818	174
15°	1746	1735	1712	1719	1710	492
25°	1580	1566	1536	1539	1536	727
35°	1363	1346	1317	1307	1298	851
45°	1109	1097	1070	1051	1044	856
55°	839	829	808	786	778	750
65°	566	555	538	522	513	560
75°	296	293	284	273	277	316
85°	72	70	69	63	62	81
90°	2	19	53	50	51	9
95°	79	94	96	96	94	88
105°	325	329	332	335	335	343
115°	604	613	610	608	604	597
125°	878	892	888	883	881	785
135°	1136	1153	1156	1154	1150	878
145°	1379	1390	1399	1400	1394	862
155°	1577	1582	1586	1594	1589	726
165°	1716	1714	1714	1725	1717	484
175°	1785	1781	1778	1789	1779	170
180°	1789	1789	1789	1789	1789	

TEST NUMBER: P904586

CATALOG NUMBER: DFN2DIP-TR4F0-050D060US830-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1833.7	1833.7	1833.7	1833.7	1833.7
2.5°	1844.4	1835.6	1816.2	1833.7	1830.4
5°	1833.7	1826.8	1807.3	1821.4	1818.1
7.5°	1821.4	1810.9	1791.5	1805.7	1802.1
10°	1802.1	1789.8	1768.7	1782.6	1777.4
12.5°	1775.6	1765.1	1744.0	1752.8	1749.2
15°	1745.6	1735.1	1712.1	1719.3	1710.4
17.5°	1708.5	1698.1	1675.1	1683.9	1675.1
20°	1668.0	1657.6	1632.9	1638.0	1631.2
22.5°	1627.6	1611.7	1588.7	1588.7	1585.1
25°	1579.9	1565.8	1535.9	1539.3	1535.9
27.5°	1526.9	1514.6	1491.8	1486.5	1477.7
30°	1474.1	1460.0	1433.6	1428.3	1421.3
32.5°	1417.7	1407.2	1378.9	1368.3	1361.2
35°	1363.0	1345.5	1317.2	1306.6	1297.8
37.5°	1301.3	1285.4	1257.2	1244.8	1236.0
40°	1237.9	1223.7	1195.4	1179.7	1172.6
42.5°	1176.2	1162.0	1133.9	1116.1	1105.6
45°	1109.2	1096.8	1070.3	1051.0	1043.9
47.5°	1043.9	1031.5	1003.3	983.8	973.4
50°	975.1	966.3	941.6	916.9	908.0
52.5°	908.0	895.7	872.9	853.5	841.1
55°	839.4	828.8	807.6	786.5	777.7
57.5°	770.5	761.8	738.8	717.7	710.5
60°	701.7	694.8	670.1	650.6	645.5
62.5°	634.8	622.5	604.8	587.2	580.1
65°	566.1	555.4	537.8	522.0	513.1
67.5°	495.6	486.6	470.9	458.5	451.4
70°	430.3	423.2	407.3	394.9	388.0
72.5°	363.4	356.2	347.4	335.1	329.8
75°	296.1	292.8	283.8	273.3	276.9
77.5°	236.3	229.1	225.6	220.4	215.2
80°	176.4	174.6	171.0	165.8	162.2
82.5°	119.9	119.9	118.2	111.1	111.1
85°	72.2	70.5	68.8	63.4	61.7
87.5°	31.8	28.3	24.7	19.4	17.6
90°	1.6	19.4	52.9	49.6	51.2
92.5°	33.5	45.3	46.9	48.5	48.5
95°	78.7	93.8	96.5	96.5	93.8
97.5°	131.0	145.1	151.0	151.0	151.0
100°	191.4	203.8	208.1	208.1	206.5
102.5°	255.1	264.2	270.1	271.7	270.1
105°	324.6	328.9	332.2	334.9	334.9
107.5°	393.6	400.1	400.1	401.1	393.6
110°	460.5	469.1	469.1	469.1	464.8

TEST NUMBER: P904586

CATALOG NUMBER: DFN2DIP-TR4F0-050D060US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	532.7	541.9	540.3	535.9	532.7
115°	603.9	612.6	609.8	608.2	603.9
117.5°	674.6	686.5	678.8	674.6	670.2
120°	745.7	757.6	745.7	745.7	740.8
122.5°	810.4	825.5	817.9	813.7	810.4
125°	878.4	891.8	887.5	882.7	881.1
127.5°	944.7	961.4	955.5	949.0	944.7
130°	1006.7	1026.1	1023.4	1020.2	1014.3
132.5°	1076.3	1091.4	1092.4	1084.9	1080.5
135°	1136.1	1152.8	1156.0	1154.4	1150.1
137.5°	1203.0	1216.4	1219.2	1218.0	1211.6
140°	1261.8	1275.3	1282.8	1282.8	1276.9
142.5°	1322.1	1335.6	1339.9	1341.5	1335.6
145°	1379.3	1390.1	1398.7	1400.3	1394.4
147.5°	1430.5	1444.0	1450.5	1453.1	1447.2
150°	1483.4	1492.5	1498.5	1503.3	1498.5
152.5°	1530.2	1539.5	1547.0	1552.9	1547.0
155°	1577.2	1581.5	1586.3	1593.9	1589.0
157.5°	1617.6	1620.9	1623.5	1634.4	1626.8
160°	1653.8	1657.0	1658.6	1667.7	1661.3
162.5°	1687.2	1687.2	1688.8	1699.0	1691.5
165°	1715.7	1714.1	1714.1	1724.9	1717.4
167.5°	1741.6	1736.8	1736.8	1747.6	1740.0
170°	1761.0	1756.7	1755.1	1765.9	1756.7
172.5°	1774.5	1770.2	1768.6	1779.3	1770.2
175°	1785.3	1781.0	1777.7	1788.6	1779.3
177.5°	1791.2	1787.0	1783.7	1792.8	1783.7
180°	1788.6	1788.6	1788.6	1788.6	1788.6

TEST NUMBER: P904586

CATALOG NUMBER: DFN2DIP-TR4F0-050D060US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.41	9.26	9.38	10.24	11.54	7.98	8.83	8.95	9.81	11.11
	3H	10.07	10.83	11.05	11.83	13.14	9.60	10.36	10.58	11.35	12.67
	4H	10.66	11.38	11.65	12.38	13.70	10.19	10.90	11.18	11.90	13.23
	6H	11.06	11.72	12.06	12.72	14.06	10.58	11.24	11.59	12.25	13.59
	8H	11.16	11.79	12.17	12.81	14.15	10.69	11.32	11.70	12.34	13.67
	12H	11.21	11.81	12.23	12.82	14.18	10.73	11.33	11.75	12.34	13.70
4H	2H	8.87	9.59	9.87	10.59	11.91	8.53	9.25	9.53	10.25	11.57
	3H	10.74	11.34	11.75	12.36	13.70	10.34	10.94	11.36	11.97	13.31
	4H	11.45	12.00	12.47	13.02	14.38	11.05	11.59	12.06	12.61	13.98
	6H	11.96	12.44	12.99	13.48	14.84	11.56	12.03	12.59	13.07	14.43
	8H	12.11	12.56	13.14	13.59	14.96	11.70	12.14	12.73	13.18	14.55
	12H	12.19	12.58	13.24	13.64	15.01	11.76	12.16	12.81	13.21	14.59
8H	4H	11.65	12.09	12.68	13.12	14.50	11.29	11.73	12.32	12.76	14.14
	6H	12.28	12.64	13.33	13.72	15.09	11.91	12.28	12.97	13.36	14.73
	8H	12.50	12.82	13.56	13.88	15.27	12.13	12.45	13.19	13.51	14.90
	12H	12.63	12.91	13.69	13.97	15.40	12.24	12.53	13.31	13.58	15.02
12H	4H	11.63	12.03	12.68	13.08	14.46	11.28	11.68	12.33	12.73	14.11
	6H	12.31	12.63	13.37	13.69	15.08	11.96	12.28	13.02	13.34	14.73
	8H	12.55	12.83	13.61	13.89	15.32	12.19	12.47	13.26	13.53	14.96

END OF REPORT