

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904592

Luminaire Tested: DFN2DIP-TR4F0-050D070US830-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904592
REPORT IS A COMBINATION OF REPORTS P900426 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-050D070US830-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9844.9 lumens
Efficiency: N/A
Efficacy: 104.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 94.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904592

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US830-RLLFLL

Luminous Intensity Polar Plot

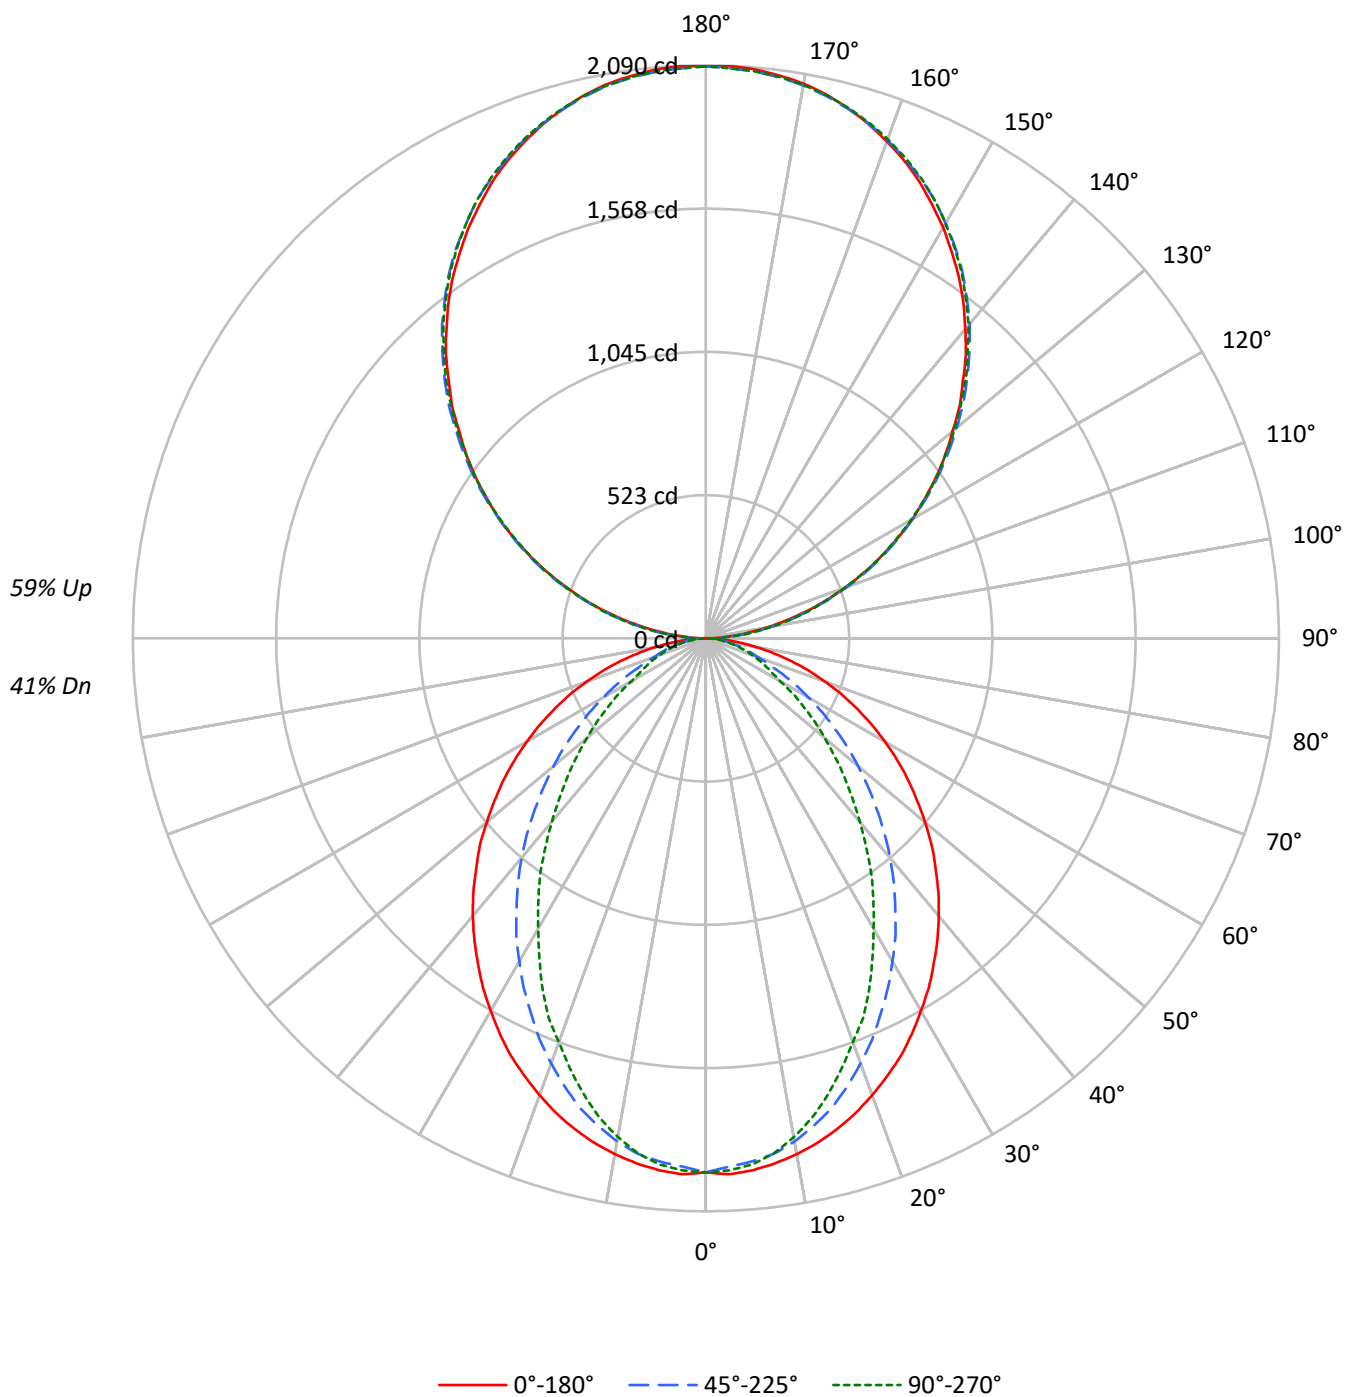

TEST NUMBER: P904592

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US830-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	62	62	62	48	48	48
1	96	92	88	85	87	84	81	78	69	67	65	55	54	53	43	42	41
2	88	81	75	70	80	74	69	65	61	57	54	49	47	44	38	36	35
3	80	71	64	59	73	65	59	54	54	50	46	44	41	38	34	32	30
4	74	63	56	50	67	58	52	46	48	43	40	39	36	33	31	28	26
5	68	57	49	43	62	52	45	40	43	38	34	35	32	29	28	25	23
6	62	51	43	37	57	47	40	35	39	34	30	32	28	25	25	23	21
7	58	46	38	33	53	42	36	31	36	30	27	29	25	23	23	21	19
8	54	42	34	29	49	39	32	27	32	27	24	27	23	20	21	19	17
9	50	38	31	26	46	35	29	24	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	32	26	22	27	23	19	23	19	17	18	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1547	1547	1547
5°	1550	1523	1533
10°	1534	1493	1483
15°	1513	1444	1405
20°	1486	1375	1311
25°	1457	1299	1219
30°	1418	1221	1103
35°	1381	1137	1002
40°	1343	1050	885
45°	1298	954	779
50°	1252	856	676
55°	1204	752	577
60°	1148	643	475
65°	1084	533	427
70°	1007	429	386
75°	910	378	352
80°	769	317	305
85°	536	212	229

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1628 cd/sqm

TEST NUMBER: P904592

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US830-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	182.5	1.9
10°-20°	501.1	5.1
20°-30°	703.6	7.1
30°-40°	766.9	7.8
40°-50°	704.9	7.2
50°-60°	553.6	5.6
60°-70°	360.3	3.7
70°-80°	185.5	1.9
80°-90°	53.3	0.5
90°-100°	129.1	1.3
100°-110°	410.3	4.2
110°-120°	702.1	7.1
120°-130°	923.3	9.4
130°-140°	1036.4	10.5
140°-150°	1016.3	10.3
150°-160°	852.6	8.7
160°-170°	565.4	5.7
170°-180°	197.6	2.0
0°-30°	1387.2	14.1
0°-40°	2154.2	21.9
0°-60°	3412.7	34.7
0°-90°	4011.8	40.7
90°-120°	1241.5	12.6
90°-150°	4217.6	42.8
90°-180°	5833.0	59.2
0°-180°	9844.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1948	1948	1948	1948	1948	
5°	1948	1939	1916	1932	1927	185
15°	1853	1833	1773	1740	1722	522
25°	1682	1625	1509	1437	1410	773
35°	1449	1359	1204	1093	1054	907
45°	1185	1066	881	756	714	915
55°	901	763	573	467	434	805
65°	608	465	307	247	242	603
75°	324	201	141	129	127	343
85°	76	39	34	34	34	87
90°	2	23	62	58	60	10
95°	92	109	113	113	109	102
105°	379	384	388	391	391	400
115°	705	715	712	710	705	697
125°	1025	1040	1036	1030	1028	916
135°	1326	1345	1349	1347	1342	1025
145°	1609	1622	1632	1634	1627	1005
155°	1840	1845	1851	1860	1854	847
165°	2002	2000	2000	2012	2004	565
175°	2083	2078	2074	2087	2076	198
180°	2087	2087	2087	2087	2087	

TEST NUMBER: P904592

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US830-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1947.8	1947.8	1947.8	1947.8	1947.8
2.5°	1956.5	1947.8	1928.3	1946.1	1942.5
5°	1947.8	1939.0	1916.0	1931.8	1926.7
7.5°	1931.8	1921.4	1896.7	1903.7	1894.8
10°	1910.7	1898.4	1863.2	1857.8	1847.3
12.5°	1884.3	1868.5	1820.8	1810.3	1790.8
15°	1852.6	1833.2	1773.3	1739.8	1722.2
17.5°	1815.5	1787.3	1713.3	1674.5	1646.2
20°	1773.3	1738.0	1649.8	1605.9	1567.0
22.5°	1727.5	1686.9	1584.6	1524.8	1498.4
25°	1681.6	1625.1	1508.8	1436.6	1410.0
27.5°	1627.0	1567.0	1438.3	1355.5	1314.9
30°	1568.9	1501.8	1360.7	1270.9	1223.2
32.5°	1512.4	1431.3	1286.9	1181.0	1136.9
35°	1449.0	1359.1	1204.0	1092.9	1054.0
37.5°	1387.2	1290.2	1126.4	1004.7	960.7
40°	1322.0	1216.4	1045.2	920.1	874.3
42.5°	1255.1	1142.3	964.2	833.7	789.8
45°	1184.6	1066.4	881.4	756.1	713.8
47.5°	1117.6	992.5	802.1	676.8	638.1
50°	1043.6	918.4	724.5	602.8	565.9
52.5°	971.2	839.0	650.4	534.1	500.7
55°	900.7	763.2	572.8	467.1	433.7
57.5°	828.5	687.5	504.2	405.5	377.2
60°	754.4	613.4	431.8	342.0	313.8
62.5°	682.2	541.2	370.1	285.6	271.5
65°	608.1	465.3	306.7	246.9	241.5
67.5°	537.6	394.8	246.9	216.8	211.5
70°	463.6	326.1	204.4	186.8	179.7
72.5°	393.1	262.6	171.0	156.9	153.4
75°	324.3	200.9	141.0	128.7	127.0
77.5°	255.6	142.7	111.1	104.0	100.4
80°	192.1	102.3	84.5	77.6	77.6
82.5°	133.9	68.8	58.2	54.6	54.6
85°	75.8	38.7	33.5	33.5	33.5
87.5°	28.3	14.0	14.0	12.3	12.3
90°	1.9	22.6	61.6	57.9	59.8
92.5°	39.0	52.9	54.8	56.6	56.6
95°	91.8	109.4	112.6	112.6	109.4
97.5°	152.9	169.2	176.2	176.2	176.2
100°	223.3	237.8	242.8	242.8	240.9
102.5°	297.6	308.2	315.2	317.1	315.2
105°	378.7	383.7	387.5	390.7	390.7
107.5°	459.2	466.7	466.7	468.1	459.2
110°	537.2	547.3	547.3	547.3	542.2

TEST NUMBER: P904592

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US830-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	621.5	632.3	630.4	625.3	621.5
115°	704.6	714.6	711.5	709.6	704.6
117.5°	786.9	800.8	792.0	786.9	781.9
120°	870.0	883.8	870.0	870.0	864.3
122.5°	945.5	963.1	954.3	949.2	945.5
125°	1024.7	1040.5	1035.5	1029.8	1027.9
127.5°	1102.1	1121.6	1114.7	1107.2	1102.1
130°	1174.5	1197.1	1194.0	1190.2	1183.3
132.5°	1255.7	1273.3	1274.5	1265.7	1260.7
135°	1325.5	1344.9	1348.8	1346.8	1341.8
137.5°	1403.4	1419.2	1422.3	1421.1	1413.5
140°	1472.1	1487.8	1496.6	1496.6	1489.7
142.5°	1542.5	1558.2	1563.2	1565.1	1558.2
145°	1609.2	1621.7	1631.8	1633.7	1626.8
147.5°	1669.0	1684.7	1692.2	1695.4	1688.5
150°	1730.6	1741.3	1748.2	1753.9	1748.2
152.5°	1785.3	1796.0	1804.8	1811.8	1804.8
155°	1840.0	1845.0	1850.8	1859.5	1853.9
157.5°	1887.3	1891.0	1894.1	1906.8	1897.9
160°	1929.4	1933.2	1935.0	1945.7	1938.1
162.5°	1968.4	1968.4	1970.3	1982.2	1973.4
165°	2001.7	1999.8	1999.8	2012.4	2003.6
167.5°	2031.9	2026.3	2026.3	2038.8	2030.0
170°	2054.6	2049.6	2047.7	2060.2	2049.6
172.5°	2070.3	2065.2	2063.3	2075.9	2065.2
175°	2082.8	2077.8	2074.1	2086.6	2075.9
177.5°	2089.8	2084.7	2080.9	2091.7	2080.9
180°	2086.6	2086.6	2086.6	2086.6	2086.6

TEST NUMBER: P904592

CATALOG NUMBER: DFN2DIP-TR4F0-050D070US830-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.73	8.49	8.77	9.53	10.93	3.70	4.46	4.74	5.50	6.90
	3H	9.40	10.08	10.45	11.13	12.55	4.89	5.56	5.93	6.61	8.03
	4H	10.00	10.65	11.06	11.70	13.13	5.33	5.98	6.39	7.03	8.45
	6H	10.42	11.01	11.49	12.07	13.51	5.65	6.24	6.72	7.30	8.74
	8H	10.55	11.11	11.62	12.18	13.61	5.74	6.30	6.81	7.37	8.81
	12H	10.61	11.14	11.68	12.21	13.66	5.78	6.32	6.86	7.38	8.84
4H	2H	7.74	8.38	8.80	9.43	10.86	4.29	4.93	5.35	5.98	7.41
	3H	9.56	10.09	10.63	11.17	12.61	5.63	6.17	6.71	7.25	8.69
	4H	10.25	10.74	11.33	11.81	13.27	6.18	6.67	7.26	7.74	9.20
	6H	10.76	11.18	11.85	12.27	13.73	6.59	7.02	7.68	8.11	9.56
	8H	10.93	11.33	12.02	12.41	13.88	6.72	7.12	7.81	8.20	9.67
	12H	11.03	11.38	12.13	12.48	13.95	6.79	7.14	7.89	8.24	9.71
8H	4H	10.21	10.60	11.30	11.69	13.16	6.45	6.85	7.54	7.93	9.40
	6H	10.78	11.10	11.89	12.23	13.69	6.97	7.29	8.08	8.42	9.89
	8H	10.99	11.27	12.11	12.38	13.87	7.16	7.45	8.28	8.55	10.04
	12H	11.13	11.38	12.25	12.48	14.01	7.28	7.53	8.40	8.63	10.16
12H	4H	10.16	10.52	11.27	11.61	13.09	6.45	6.81	7.56	7.91	9.38
	6H	10.75	11.03	11.87	12.14	13.63	7.02	7.30	8.14	8.41	9.90
	8H	10.97	11.22	12.09	12.32	13.85	7.23	7.48	8.35	8.58	10.11

END OF REPORT