

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904605

Luminaire Tested: DFN2DIP-TR4F0-050D100US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904605
REPORT IS A COMBINATION OF REPORTS P902000 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-050D100US830-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13337.0 lumens
Efficiency: N/A
Efficacy: 112.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 118.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.996
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904605

CATALOG NUMBER: DFN2DIP-TR4F0-050D100US830-RLLONL

Luminous Intensity Polar Plot

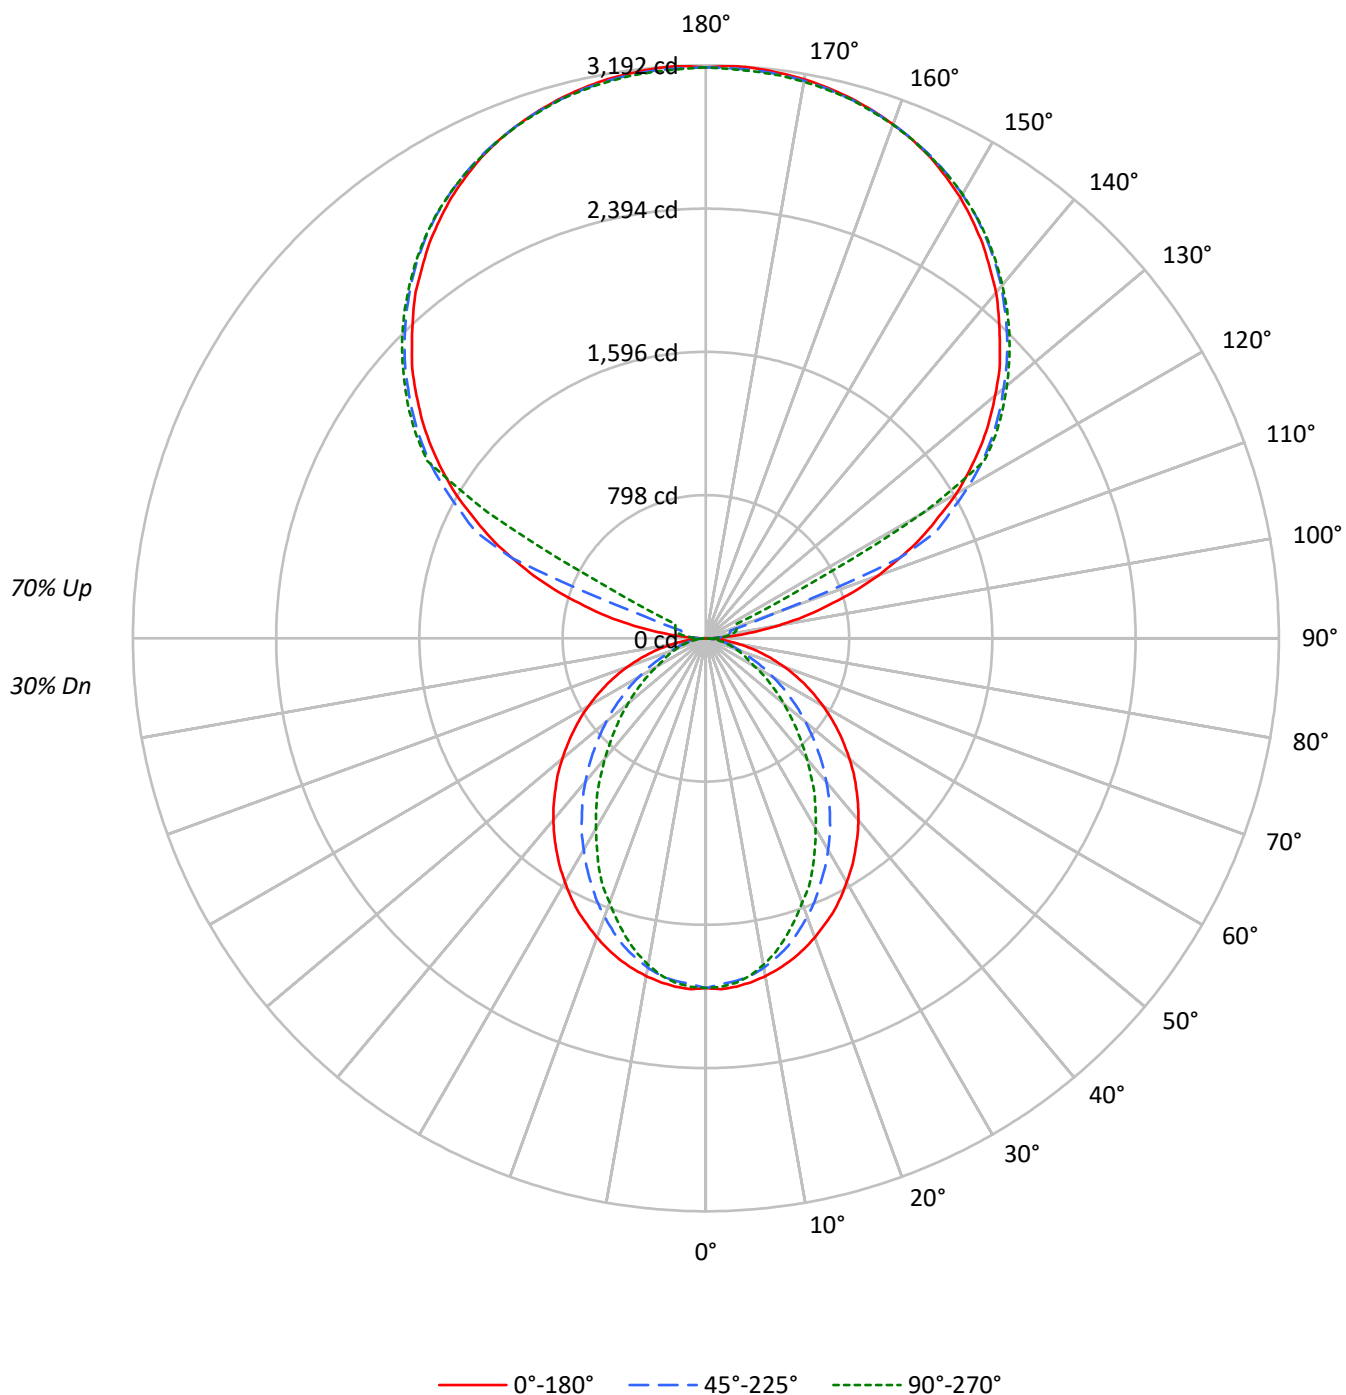

TEST NUMBER: P904605

CATALOG NUMBER: DFN2DIP-TR4F0-050D100US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	92	92	92	92	72	72	72	54	54	54	38	38	38
1	94	90	86	83	84	81	77	75	64	62	60	48	47	46	34	33	32
2	85	78	73	68	76	71	66	62	56	53	50	43	40	39	30	29	28
3	78	69	62	57	70	62	57	52	50	46	42	38	35	33	27	25	24
4	71	61	54	48	64	55	49	44	44	40	36	34	31	28	24	22	21
5	66	55	47	41	59	49	43	38	40	35	31	30	27	25	22	20	18
6	60	49	41	36	54	44	38	33	36	31	27	28	24	22	20	18	16
7	56	44	37	31	50	40	34	29	32	28	24	25	22	19	18	16	15
8	52	40	33	28	46	36	30	25	29	25	21	23	20	17	17	15	13
9	48	37	29	25	43	33	27	23	27	22	19	21	18	15	16	13	12
10	45	33	27	22	40	30	24	20	25	20	17	20	16	14	14	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1547	1547	1547
5°	1550	1523	1533
10°	1534	1493	1483
15°	1513	1444	1405
20°	1486	1375	1311
25°	1457	1299	1219
30°	1418	1221	1103
35°	1381	1137	1002
40°	1343	1050	885
45°	1298	954	779
50°	1252	856	676
55°	1204	752	577
60°	1148	643	475
65°	1084	533	427
70°	1007	429	386
75°	910	378	352
80°	769	317	305
85°	536	212	229

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1687 cd/sqm

TEST NUMBER: P904605

CATALOG NUMBER: DFN2DIP-TR4F0-050D100US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	182.5	1.4
10°-20°	501.1	3.8
20°-30°	703.6	5.3
30°-40°	766.9	5.8
40°-50°	704.9	5.3
50°-60°	553.6	4.2
60°-70°	360.3	2.7
70°-80°	185.5	1.4
80°-90°	52.9	0.4
90°-100°	104.9	0.8
100°-110°	391.0	2.9
110°-120°	1037.0	7.8
120°-130°	1720.0	12.9
130°-140°	1827.0	13.7
140°-150°	1698.0	12.7
150°-160°	1365.2	10.2
160°-170°	879.7	6.6
170°-180°	302.8	2.3
0°-30°	1387.2	10.4
0°-40°	2154.2	16.2
0°-60°	3412.7	25.6
0°-90°	4011.4	30.1
90°-120°	1532.9	11.5
90°-150°	6778.0	50.8
90°-180°	9326.0	69.9
0°-180°	13337.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1948	1948	1948	1948	1948	
5°	1948	1939	1916	1932	1927	185
15°	1853	1833	1773	1740	1722	522
25°	1682	1625	1509	1437	1410	773
35°	1449	1359	1204	1093	1054	907
45°	1185	1066	881	756	714	915
55°	901	763	573	467	434	805
65°	608	465	307	247	242	603
75°	324	201	141	129	127	343
85°	76	39	34	34	34	87
90°	2	28	46	58	62	12
95°	150	74	90	101	99	177
105°	700	769	140	166	175	748
115°	1323	1362	1420	354	189	1303
125°	1871	1901	1945	1961	1968	1669
135°	2316	2352	2373	2396	2392	1789
145°	2686	2684	2723	2739	2728	1680
155°	2958	2937	2965	2978	2960	1363
165°	3116	3103	3110	3126	3110	880
175°	3188	3172	3176	3192	3170	303
180°	3181	3181	3181	3181	3181	

TEST NUMBER: P904605

CATALOG NUMBER: DFN2DIP-TR4F0-050D100US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1947.8	1947.8	1947.8	1947.8	1947.8
2.5°	1956.5	1947.8	1928.3	1946.1	1942.5
5°	1947.8	1939.0	1916.0	1931.8	1926.7
7.5°	1931.8	1921.4	1896.7	1903.7	1894.8
10°	1910.7	1898.4	1863.2	1857.8	1847.3
12.5°	1884.3	1868.5	1820.8	1810.3	1790.8
15°	1852.6	1833.2	1773.3	1739.8	1722.2
17.5°	1815.5	1787.3	1713.3	1674.5	1646.2
20°	1773.3	1738.0	1649.8	1605.9	1567.0
22.5°	1727.5	1686.9	1584.6	1524.8	1498.4
25°	1681.6	1625.1	1508.8	1436.6	1410.0
27.5°	1627.0	1567.0	1438.3	1355.5	1314.9
30°	1568.9	1501.8	1360.7	1270.9	1223.2
32.5°	1512.4	1431.3	1286.9	1181.0	1136.9
35°	1449.0	1359.1	1204.0	1092.9	1054.0
37.5°	1387.2	1290.2	1126.4	1004.7	960.7
40°	1322.0	1216.4	1045.2	920.1	874.3
42.5°	1255.1	1142.3	964.2	833.7	789.8
45°	1184.6	1066.4	881.4	756.1	713.8
47.5°	1117.6	992.5	802.1	676.8	638.1
50°	1043.6	918.4	724.5	602.8	565.9
52.5°	971.2	839.0	650.4	534.1	500.7
55°	900.7	763.2	572.8	467.1	433.7
57.5°	828.5	687.5	504.2	405.5	377.2
60°	754.4	613.4	431.8	342.0	313.8
62.5°	682.2	541.2	370.1	285.6	271.5
65°	608.1	465.3	306.7	246.9	241.5
67.5°	537.6	394.8	246.9	216.8	211.5
70°	463.6	326.1	204.4	186.8	179.7
72.5°	393.1	262.6	171.0	156.9	153.4
75°	324.3	200.9	141.0	128.7	127.0
77.5°	255.6	142.7	111.1	104.0	100.4
80°	192.1	102.3	84.5	77.6	77.6
82.5°	133.9	68.8	58.2	54.6	54.6
85°	75.8	38.7	33.5	33.5	33.5
87.5°	28.3	14.0	14.0	12.3	12.3
90°	2.2	27.6	45.9	57.7	62.0
92.5°	57.7	48.4	55.2	59.9	62.0
95°	149.5	73.5	89.6	101.4	99.0
97.5°	269.2	80.6	117.3	124.3	126.6
100°	407.6	92.1	131.2	149.5	154.2
102.5°	559.2	554.9	135.8	161.0	168.1
105°	699.7	768.8	140.5	165.6	174.9
107.5°	863.2	920.6	145.2	170.3	179.6
110°	1019.7	1067.9	402.8	172.8	181.7

TEST NUMBER: P904605

CATALOG NUMBER: DFN2DIP-TR4F0-050D100US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1167.1	1208.3	1169.3	177.1	184.3
115°	1323.4	1362.5	1420.2	354.5	188.9
117.5°	1459.2	1505.2	1544.5	1215.2	612.3
120°	1611.3	1645.7	1687.2	1714.9	1404.1
122.5°	1740.0	1776.9	1823.1	1836.7	1839.2
125°	1871.2	1901.3	1945.0	1961.1	1967.9
127.5°	1990.9	2023.2	2057.9	2080.9	2083.0
130°	2103.8	2140.7	2165.9	2191.2	2189.1
132.5°	2218.8	2248.9	2274.1	2294.8	2292.6
135°	2315.6	2352.5	2373.0	2396.2	2391.6
137.5°	2416.8	2444.4	2467.6	2490.6	2483.7
140°	2515.6	2534.3	2559.4	2580.2	2568.7
142.5°	2598.8	2614.9	2644.7	2663.0	2651.6
145°	2686.2	2683.8	2722.9	2739.0	2727.5
147.5°	2761.9	2755.1	2794.2	2805.7	2796.7
150°	2835.7	2819.6	2856.6	2870.2	2858.7
152.5°	2897.8	2879.5	2914.0	2927.8	2911.7
155°	2957.7	2937.2	2964.8	2978.4	2960.1
157.5°	3006.1	2987.8	3008.5	3024.6	3006.1
160°	3047.6	3033.7	3047.6	3061.3	3045.2
162.5°	3084.2	3070.5	3082.0	3098.1	3077.4
165°	3116.4	3102.8	3109.6	3125.8	3109.6
167.5°	3141.9	3127.9	3135.1	3151.2	3130.4
170°	3162.6	3148.8	3153.4	3169.5	3148.8
172.5°	3176.3	3162.6	3167.3	3183.4	3162.6
175°	3187.8	3171.7	3176.3	3192.5	3169.5
177.5°	3192.5	3176.3	3178.8	3194.9	3174.1
180°	3181.0	3181.0	3181.0	3181.0	3181.0

TEST NUMBER: P904605

CATALOG NUMBER: DFN2DIP-TR4F0-050D100US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.44	7.13	7.55	8.24	9.77	2.41	3.10	3.53	4.21	5.74
	3H	8.10	8.72	9.23	9.84	11.38	3.59	4.21	4.71	5.32	6.87
	4H	8.71	9.29	9.84	10.41	11.96	4.03	4.62	5.17	5.74	7.29
	6H	9.12	9.66	10.26	10.78	12.34	4.35	4.89	5.49	6.01	7.57
	8H	9.24	9.75	10.39	10.89	12.45	4.44	4.95	5.58	6.08	7.64
	12H	9.30	9.79	10.45	10.91	12.49	4.48	4.96	5.62	6.09	7.67
4H	2H	6.44	7.02	7.58	8.14	9.69	2.99	3.57	4.13	4.69	6.24
	3H	8.25	8.74	9.40	9.88	11.45	4.33	4.81	5.47	5.96	7.52
	4H	8.94	9.39	10.09	10.52	12.11	4.87	5.32	6.02	6.45	8.04
	6H	9.45	9.83	10.60	10.99	12.56	5.28	5.67	6.44	6.82	8.40
	8H	9.62	9.98	10.78	11.12	12.72	5.41	5.77	6.56	6.91	8.51
	12H	9.71	10.03	10.88	11.19	12.79	5.47	5.79	6.64	6.95	8.55
8H	4H	8.90	9.26	10.05	10.40	11.99	5.14	5.50	6.29	6.64	8.24
	6H	9.46	9.75	10.63	10.94	12.53	5.65	5.95	6.83	7.14	8.73
	8H	9.68	9.93	10.86	11.10	12.71	5.85	6.10	7.03	7.27	8.88
	12H	9.81	10.03	10.99	11.20	12.84	5.96	6.19	7.14	7.35	8.99
12H	4H	8.84	9.17	10.01	10.33	11.92	5.14	5.46	6.31	6.62	8.22
	6H	9.43	9.69	10.61	10.86	12.47	5.70	5.96	6.88	7.13	8.74
	8H	9.65	9.87	10.83	11.04	12.68	5.91	6.13	7.09	7.30	8.94

END OF REPORT