

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904615

Luminaire Tested: DFN2DIP-TR4F0-060D040US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904615
REPORT IS A COMBINATION OF REPORTS P901893 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D040US830-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9331.2 lumens
Efficiency: N/A
Efficacy: 111.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 83.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904615

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US830-FLLONL

Luminous Intensity Polar Plot

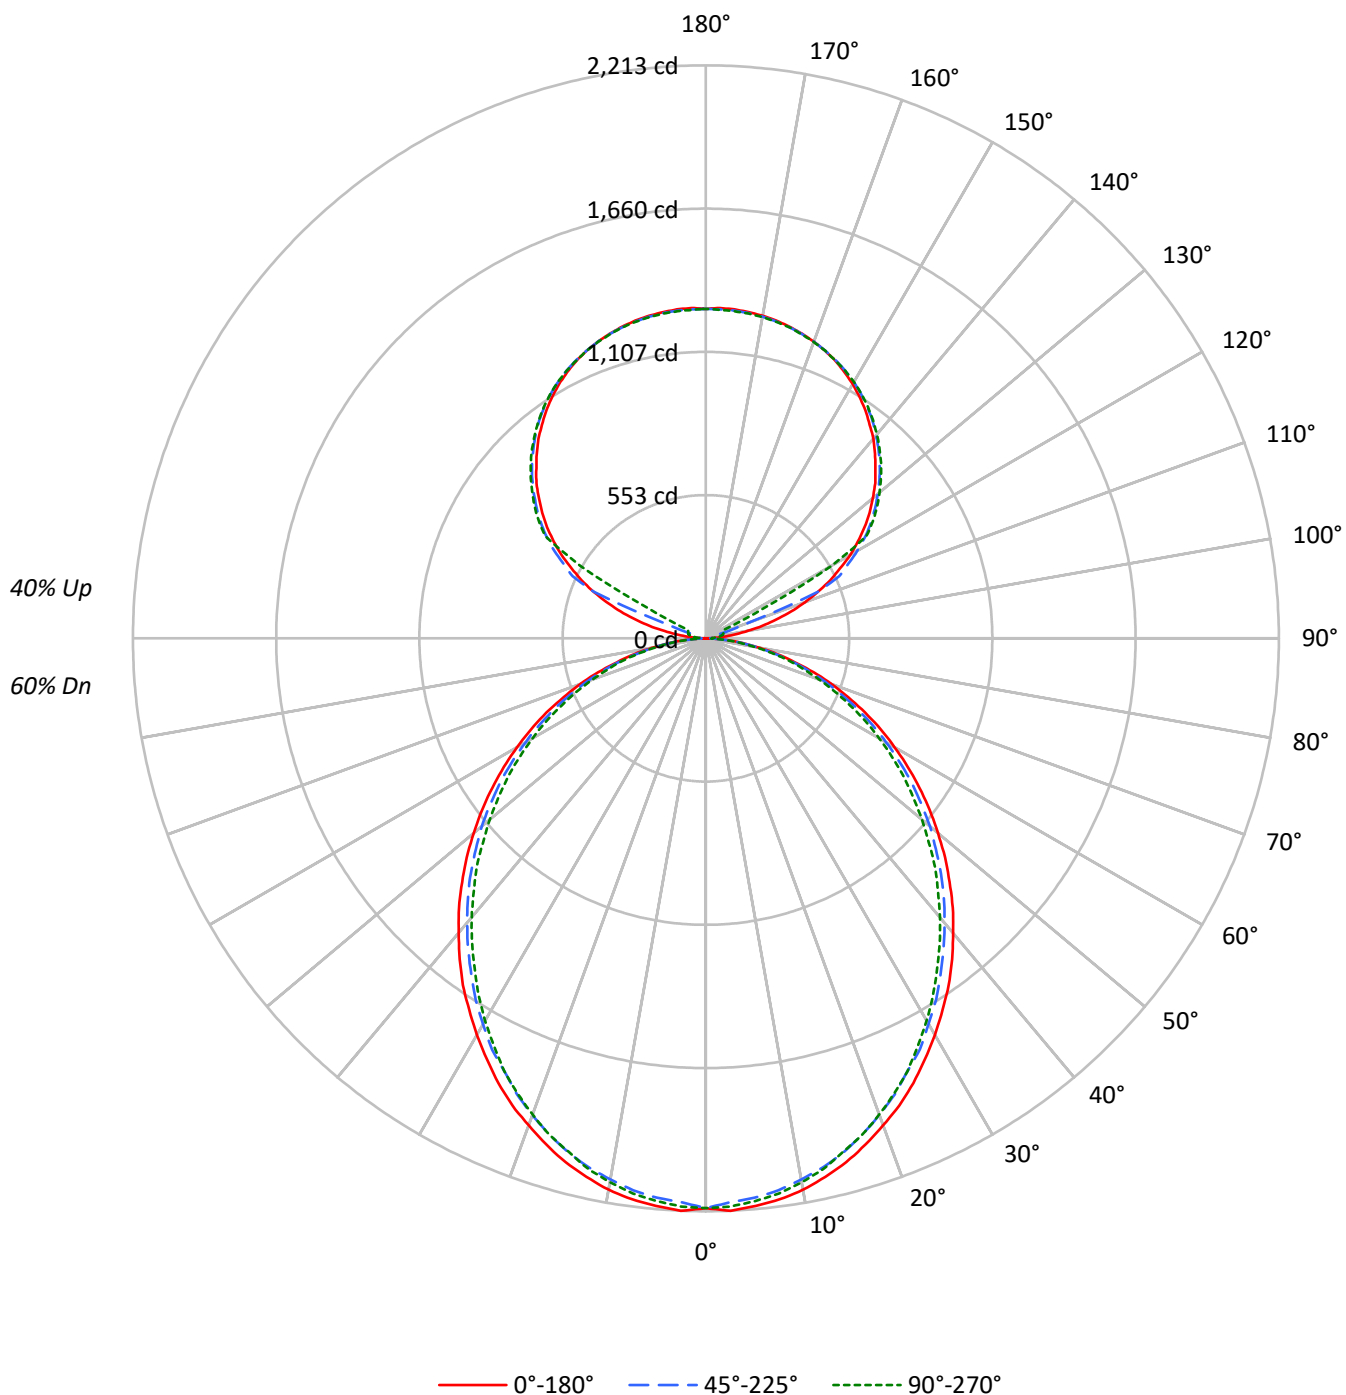

TEST NUMBER: P904615

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	100	96	92	88	93	90	86	83	78	75	73	67	66	64	58	56	55
2	91	84	77	72	85	78	73	68	68	64	61	59	56	53	51	49	47
3	83	73	66	60	77	69	62	57	60	55	51	52	48	45	45	42	40
4	76	65	57	51	71	61	54	48	54	48	44	47	42	39	40	37	34
5	70	58	50	44	65	55	47	42	48	42	38	42	37	34	36	33	30
6	64	52	44	38	60	49	42	36	43	37	33	38	33	30	33	29	26
7	60	47	39	33	56	44	37	32	39	33	29	35	30	26	30	26	23
8	55	43	35	30	52	40	33	28	36	30	26	32	27	23	28	24	21
9	52	39	32	26	48	37	30	25	33	27	23	29	24	21	26	22	19
10	48	36	29	24	45	34	27	23	30	25	21	27	22	19	24	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1748	1748	1748
5°	1751	1724	1735
10°	1737	1700	1712
15°	1711	1673	1675
20°	1677	1634	1637
25°	1642	1587	1594
30°	1600	1544	1538
35°	1559	1493	1480
40°	1508	1441	1424
45°	1459	1389	1367
50°	1404	1335	1302
55°	1347	1272	1241
60°	1282	1198	1171
65°	1211	1121	1089
70°	1121	1027	1001
75°	997	914	920
80°	847	770	764
85°	612	523	506

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1459 cd/sqm

TEST NUMBER: P904615

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.1	2.2
10°-20°	582.7	6.2
20°-30°	856.4	9.2
30°-40°	994.6	10.7
40°-50°	993.4	10.6
50°-60°	866.2	9.3
60°-70°	640.3	6.9
70°-80°	362.3	3.9
80°-90°	97.9	1.0
90°-100°	41.9	0.4
100°-110°	156.4	1.7
110°-120°	414.8	4.4
120°-130°	688.0	7.4
130°-140°	730.8	7.8
140°-150°	679.2	7.3
150°-160°	546.1	5.9
160°-170°	351.9	3.8
170°-180°	121.1	1.3
0°-30°	1646.2	17.6
0°-40°	2640.9	28.3
0°-60°	4500.5	48.2
0°-90°	5600.9	60.0
90°-120°	613.2	6.6
90°-150°	2711.2	29.1
90°-180°	3730.0	40.0
0°-180°	9331.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2200	2200	2200	2200	2200	
5°	2200	2192	2169	2186	2182	209
15°	2095	2082	2055	2063	2053	590
25°	1896	1879	1843	1847	1843	872
35°	1636	1615	1581	1568	1557	1021
45°	1331	1316	1284	1261	1253	1027
55°	1007	994	969	944	933	901
65°	679	667	646	626	616	672
75°	355	351	340	328	332	379
85°	87	85	83	76	74	97
90°	1	11	18	23	25	9
95°	60	29	36	40	40	71
105°	280	308	56	66	70	299
115°	529	545	568	142	76	521
125°	748	760	778	784	787	668
135°	926	941	949	958	957	715
145°	1074	1074	1089	1096	1091	672
155°	1183	1175	1186	1191	1184	545
165°	1247	1241	1244	1250	1244	352
175°	1275	1269	1270	1277	1268	121
180°	1272	1272	1272	1272	1272	

TEST NUMBER: P904615

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2200.5	2200.5	2200.5	2200.5	2200.5
2.5°	2213.3	2202.7	2179.3	2200.5	2196.4
5°	2200.5	2192.2	2168.8	2185.7	2181.6
7.5°	2185.7	2173.1	2149.8	2166.8	2162.6
10°	2162.6	2147.8	2122.3	2139.2	2132.9
12.5°	2130.7	2118.1	2092.7	2103.3	2099.0
15°	2094.7	2082.2	2054.6	2063.1	2052.6
17.5°	2050.3	2037.8	2010.2	2020.6	2010.2
20°	2001.6	1989.0	1959.4	1965.7	1957.4
22.5°	1953.1	1934.0	1906.4	1906.4	1902.1
25°	1895.8	1879.1	1843.0	1847.1	1843.0
27.5°	1832.3	1817.5	1790.1	1783.9	1773.3
30°	1769.1	1751.9	1720.3	1714.0	1705.4
32.5°	1701.2	1688.7	1654.7	1641.9	1633.4
35°	1635.7	1614.6	1580.6	1567.8	1557.3
37.5°	1561.6	1542.5	1508.6	1493.7	1483.2
40°	1485.4	1468.4	1434.5	1415.7	1407.1
42.5°	1411.4	1394.3	1360.7	1339.4	1326.7
45°	1331.1	1316.2	1284.3	1261.2	1252.6
47.5°	1252.6	1237.8	1204.0	1180.6	1168.0
50°	1170.1	1159.5	1129.9	1100.2	1089.7
52.5°	1089.7	1074.9	1047.4	1024.2	1009.4
55°	1007.3	994.5	969.1	943.8	933.2
57.5°	924.7	914.2	886.6	861.2	852.6
60°	842.1	833.8	804.2	780.8	774.5
62.5°	761.7	746.9	725.8	704.6	696.2
65°	679.3	666.6	645.5	626.3	615.8
67.5°	594.6	583.9	565.1	550.3	541.7
70°	516.3	507.8	488.7	473.9	465.6
72.5°	435.9	427.4	416.9	402.1	395.8
75°	355.3	351.4	340.5	328.0	332.2
77.5°	283.5	275.0	270.7	264.5	258.2
80°	211.7	209.4	205.2	198.9	194.6
82.5°	143.9	143.9	141.9	133.4	133.4
85°	86.6	84.6	82.6	76.1	74.1
87.5°	38.2	33.9	29.6	23.4	21.1
90°	0.8	11.0	18.4	23.1	24.8
92.5°	23.1	19.3	22.1	23.9	24.8
95°	59.8	29.4	35.8	40.5	39.6
97.5°	107.7	32.2	46.9	49.8	50.6
100°	163.0	36.9	52.5	59.8	61.6
102.5°	223.7	222.0	54.3	64.4	67.2
105°	279.8	307.6	56.2	66.3	69.9
107.5°	345.3	368.3	58.1	68.1	71.8
110°	407.9	427.2	161.2	69.1	72.7

TEST NUMBER: P904615

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	466.8	483.3	467.7	70.9	73.7
115°	529.3	545.0	568.1	141.8	75.6
117.5°	583.7	602.1	617.8	486.1	244.9
120°	644.5	658.3	674.9	686.0	561.7
122.5°	696.0	710.8	729.2	734.7	735.7
125°	748.5	760.5	778.0	784.5	787.2
127.5°	796.4	809.3	823.1	832.4	833.2
130°	841.5	856.3	866.3	876.5	875.6
132.5°	887.5	899.6	909.6	917.9	917.1
135°	926.2	941.0	949.2	958.5	956.7
137.5°	966.7	977.7	987.0	996.2	993.4
140°	1006.3	1013.7	1023.8	1032.1	1027.5
142.5°	1039.5	1045.9	1057.9	1065.2	1060.6
145°	1074.5	1073.6	1089.1	1095.6	1091.0
147.5°	1104.8	1102.0	1117.7	1122.3	1118.7
150°	1134.3	1127.8	1142.6	1148.1	1143.5
152.5°	1159.1	1151.8	1165.5	1171.1	1164.7
155°	1183.1	1174.9	1185.9	1191.4	1184.0
157.5°	1202.4	1195.0	1203.4	1209.8	1202.4
160°	1219.0	1213.4	1219.0	1224.5	1218.0
162.5°	1233.7	1228.2	1232.8	1239.3	1231.0
165°	1246.6	1241.1	1243.9	1250.3	1243.9
167.5°	1256.8	1251.1	1254.1	1260.5	1252.2
170°	1265.1	1259.5	1261.3	1267.8	1259.5
172.5°	1270.5	1265.1	1267.0	1273.4	1265.1
175°	1275.1	1268.7	1270.5	1277.0	1267.8
177.5°	1277.0	1270.5	1271.5	1278.0	1269.7
180°	1272.4	1272.4	1272.4	1272.4	1272.4

TEST NUMBER: P904615

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.08	11.04	10.95	11.93	13.05	9.65	10.61	10.52	11.50	12.62
	3H	11.75	12.61	12.63	13.51	14.66	11.28	12.14	12.16	13.04	14.18
	4H	12.34	13.16	13.24	14.06	15.22	11.87	12.68	12.76	13.59	14.74
	6H	12.75	13.50	13.65	14.41	15.58	12.27	13.02	13.18	13.93	15.10
	8H	12.86	13.57	13.77	14.50	15.67	12.38	13.10	13.30	14.02	15.19
	12H	12.91	13.59	13.83	14.51	15.70	12.43	13.11	13.35	14.03	15.22
4H	2H	10.56	11.37	11.46	12.27	13.43	10.21	11.03	11.11	11.93	13.09
	3H	12.43	13.11	13.34	14.05	15.22	12.04	12.72	12.95	13.65	14.83
	4H	13.15	13.77	14.07	14.70	15.90	12.75	13.37	13.67	14.29	15.49
	6H	13.67	14.21	14.61	15.16	16.36	13.26	13.80	14.20	14.75	15.95
	8H	13.82	14.32	14.76	15.27	16.48	13.41	13.91	14.35	14.86	16.07
	12H	13.90	14.35	14.86	15.32	16.53	13.48	13.93	14.44	14.90	16.11
8H	4H	13.36	13.86	14.29	14.80	16.01	13.00	13.50	13.93	14.44	15.65
	6H	13.99	14.40	14.95	15.39	16.60	13.63	14.04	14.59	15.03	16.24
	8H	14.21	14.58	15.19	15.56	16.79	13.84	14.21	14.82	15.19	16.42
	12H	14.35	14.67	15.32	15.64	16.92	13.96	14.29	14.94	15.26	16.54
12H	4H	13.35	13.80	14.30	14.76	15.98	12.99	13.44	13.95	14.41	15.63
	6H	14.02	14.39	14.99	15.37	16.59	13.67	14.04	14.64	15.02	16.24
	8H	14.27	14.59	15.24	15.56	16.84	13.91	14.23	14.89	15.21	16.48