

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904617

Luminaire Tested: DFN2DIP-TR4F0-060D040US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904617
REPORT IS A COMBINATION OF REPORTS P901894 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D040US830-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8539.4 lumens
Efficiency: N/A
Efficacy: 102.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 83.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904617

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US830-RLLONL

Luminous Intensity Polar Plot

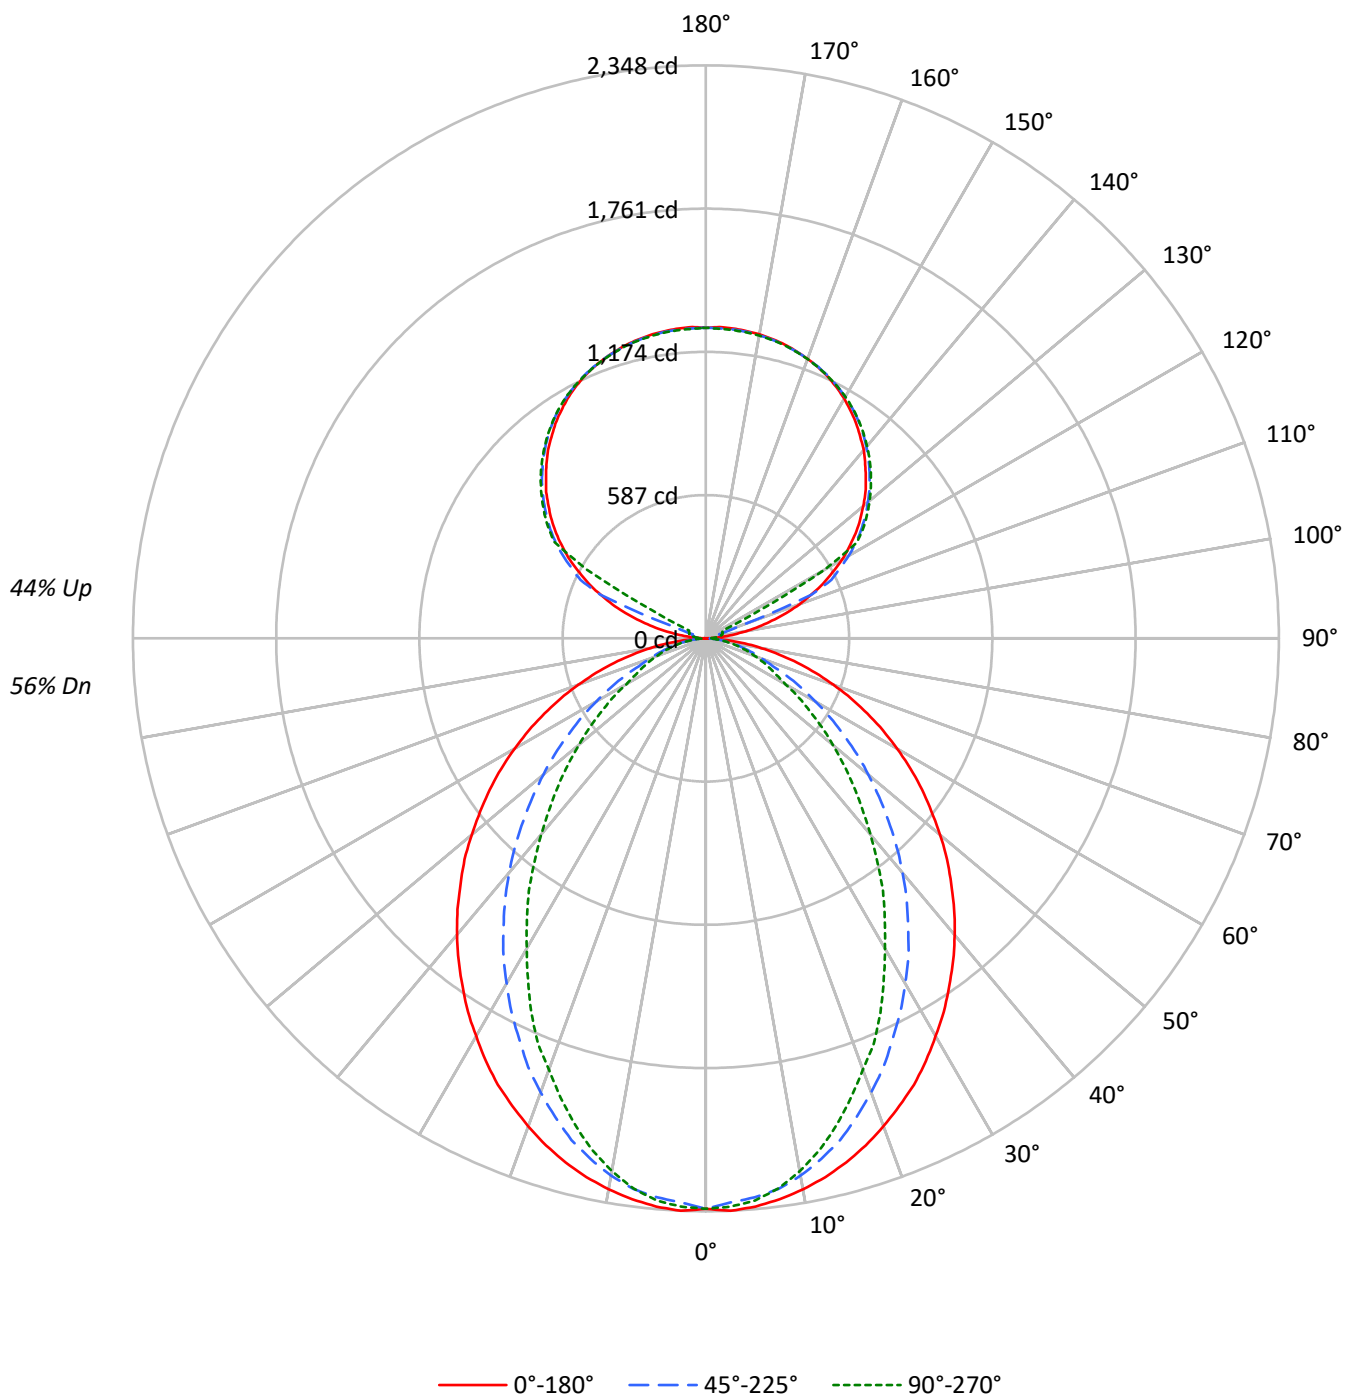

TEST NUMBER: P904617

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	109	109	109	109		101	101	101	101		87	87	87		74	74	74		62	62	62
1	100	96	92	88		93	89	86	83		77	75	72		66	64	63		56	54	53
2	91	84	78	73		85	79	73	69		68	64	61		58	56	53		50	48	46
3	84	74	67	62		78	70	63	58		61	56	52		52	49	46		44	42	40
4	77	66	59	53		71	62	55	50		54	49	45		47	43	40		40	37	35
5	71	59	51	46		66	56	49	43		49	43	39		42	38	35		36	33	31
6	65	54	46	40		61	50	43	38		44	39	34		39	34	31		33	30	27
7	61	49	41	35		56	46	39	34		40	35	30		35	31	27		30	27	24
8	56	44	37	31		52	42	35	30		37	31	27		32	28	25		28	25	22
9	53	41	33	28		49	38	32	27		34	28	25		30	25	22		26	23	20
10	49	37	30	25		46	35	29	24		31	26	22		28	23	20		24	21	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1857	1857	1857
5°	1860	1827	1839
10°	1841	1792	1779
15°	1816	1732	1687
20°	1783	1651	1573
25°	1748	1559	1463
30°	1702	1465	1324
35°	1657	1364	1202
40°	1611	1260	1062
45°	1558	1144	935
50°	1502	1027	811
55°	1445	902	692
60°	1378	772	569
65°	1301	639	512
70°	1208	515	464
75°	1092	454	422
80°	922	381	365
85°	643	254	275

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1558 cd/sqm

TEST NUMBER: P904617

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US830-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.1	2.6
10°-20°	601.3	7.0
20°-30°	844.3	9.9
30°-40°	920.3	10.8
40°-50°	845.9	9.9
50°-60°	664.3	7.8
60°-70°	432.4	5.1
70°-80°	222.6	2.6
80°-90°	59.1	0.7
90°-100°	41.9	0.5
100°-110°	156.4	1.8
110°-120°	414.8	4.9
120°-130°	688.0	8.1
130°-140°	730.8	8.6
140°-150°	679.2	8.0
150°-160°	546.1	6.4
160°-170°	351.9	4.1
170°-180°	121.1	1.4
0°-30°	1664.7	19.5
0°-40°	2585.0	30.3
0°-60°	4095.1	48.0
0°-90°	4809.2	56.3
90°-120°	613.2	7.2
90°-150°	2711.2	31.7
90°-180°	3730.0	43.7
0°-180°	8539.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2337	2337	2337	2337	2337	
5°	2337	2327	2299	2318	2312	222
15°	2223	2200	2128	2088	2067	626
25°	2018	1950	1811	1724	1692	928
35°	1739	1631	1445	1312	1265	1088
45°	1421	1280	1058	907	857	1098
55°	1081	916	687	561	520	966
65°	730	558	368	296	290	724
75°	389	241	169	154	152	412
85°	91	46	40	40	40	104
90°	1	11	18	23	25	8
95°	60	29	36	40	40	71
105°	280	308	56	66	70	299
115°	529	545	568	142	76	521
125°	748	760	778	784	787	668
135°	926	941	949	958	957	715
145°	1074	1074	1089	1096	1091	672
155°	1183	1175	1186	1191	1184	545
165°	1247	1241	1244	1250	1244	352
175°	1275	1269	1270	1277	1268	121
180°	1272	1272	1272	1272	1272	

TEST NUMBER: P904617

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2337.3	2337.3	2337.3	2337.3	2337.3
2.5°	2347.9	2337.3	2313.9	2335.2	2331.0
5°	2337.3	2326.8	2299.1	2318.3	2312.0
7.5°	2318.3	2305.6	2276.1	2284.3	2273.8
10°	2292.8	2278.0	2235.9	2229.4	2216.8
12.5°	2261.3	2242.1	2184.9	2172.4	2149.0
15°	2223.1	2199.7	2127.9	2087.7	2066.6
17.5°	2178.7	2144.8	2055.9	2009.4	1975.6
20°	2127.9	2085.5	1979.8	1927.0	1880.4
22.5°	2072.9	2024.2	1901.5	1829.7	1798.0
25°	2018.0	1950.2	1810.6	1724.0	1692.1
27.5°	1952.5	1880.4	1726.0	1626.5	1577.9
30°	1882.6	1802.0	1632.9	1525.1	1467.9
32.5°	1814.9	1717.5	1544.3	1417.2	1364.2
35°	1738.8	1630.9	1444.8	1311.5	1264.8
37.5°	1664.7	1548.2	1351.7	1205.6	1152.8
40°	1586.4	1459.6	1254.2	1104.1	1049.1
42.5°	1506.1	1370.7	1157.1	1000.4	947.7
45°	1421.4	1279.6	1057.7	907.3	856.6
47.5°	1341.1	1191.0	962.5	812.2	765.7
50°	1252.3	1102.1	869.4	723.3	679.1
52.5°	1165.4	1006.7	780.5	640.9	600.8
55°	1080.8	915.9	687.4	560.6	520.4
57.5°	994.2	824.9	605.0	486.5	452.6
60°	905.3	736.1	518.2	410.5	376.5
62.5°	818.7	649.5	444.1	342.7	325.8
65°	729.8	558.4	368.1	296.2	289.7
67.5°	645.2	473.7	296.2	260.1	253.8
70°	556.3	391.3	245.2	224.2	215.7
72.5°	471.7	315.1	205.1	188.3	184.0
75°	389.2	241.0	169.2	154.4	152.4
77.5°	306.8	171.3	133.3	124.8	120.6
80°	230.5	122.7	101.4	93.1	93.1
82.5°	160.7	82.6	69.7	65.5	65.5
85°	90.9	46.5	40.2	40.2	40.2
87.5°	33.9	16.9	16.9	14.8	14.8
90°	0.8	11.0	18.4	23.1	24.8
92.5°	23.1	19.3	22.1	23.9	24.8
95°	59.8	29.4	35.8	40.5	39.6
97.5°	107.7	32.2	46.9	49.8	50.6
100°	163.0	36.9	52.5	59.8	61.6
102.5°	223.7	222.0	54.3	64.4	67.2
105°	279.8	307.6	56.2	66.3	69.9
107.5°	345.3	368.3	58.1	68.1	71.8
110°	407.9	427.2	161.2	69.1	72.7



TEST NUMBER: P904617

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	466.8	483.3	467.7	70.9	73.7
115°	529.3	545.0	568.1	141.8	75.6
117.5°	583.7	602.1	617.8	486.1	244.9
120°	644.5	658.3	674.9	686.0	561.7
122.5°	696.0	710.8	729.2	734.7	735.7
125°	748.5	760.5	778.0	784.5	787.2
127.5°	796.4	809.3	823.1	832.4	833.2
130°	841.5	856.3	866.3	876.5	875.6
132.5°	887.5	899.6	909.6	917.9	917.1
135°	926.2	941.0	949.2	958.5	956.7
137.5°	966.7	977.7	987.0	996.2	993.4
140°	1006.3	1013.7	1023.8	1032.1	1027.5
142.5°	1039.5	1045.9	1057.9	1065.2	1060.6
145°	1074.5	1073.6	1089.1	1095.6	1091.0
147.5°	1104.8	1102.0	1117.7	1122.3	1118.7
150°	1134.3	1127.8	1142.6	1148.1	1143.5
152.5°	1159.1	1151.8	1165.5	1171.1	1164.7
155°	1183.1	1174.9	1185.9	1191.4	1184.0
157.5°	1202.4	1195.0	1203.4	1209.8	1202.4
160°	1219.0	1213.4	1219.0	1224.5	1218.0
162.5°	1233.7	1228.2	1232.8	1239.3	1231.0
165°	1246.6	1241.1	1243.9	1250.3	1243.9
167.5°	1256.8	1251.1	1254.1	1260.5	1252.2
170°	1265.1	1259.5	1261.3	1267.8	1259.5
172.5°	1270.5	1265.1	1267.0	1273.4	1265.1
175°	1275.1	1268.7	1270.5	1277.0	1267.8
177.5°	1277.0	1270.5	1271.5	1278.0	1269.7
180°	1272.4	1272.4	1272.4	1272.4	1272.4

TEST NUMBER: P904617

CATALOG NUMBER: DFN2DIP-TR4F0-060D040US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.86	10.75	10.77	11.67	12.85	5.84	6.72	6.74	7.64	8.82
	3H	11.54	12.33	12.46	13.27	14.47	7.03	7.82	7.95	8.75	9.96
	4H	12.15	12.90	13.09	13.84	15.05	7.48	8.23	8.42	9.17	10.38
	6H	12.58	13.27	13.53	14.21	15.44	7.81	8.50	8.75	9.44	10.67
	8H	12.71	13.36	13.66	14.32	15.55	7.90	8.55	8.85	9.51	10.74
	12H	12.77	13.39	13.73	14.35	15.60	7.95	8.57	8.90	9.52	10.77
4H	2H	9.89	10.63	10.83	11.57	12.79	6.44	7.19	7.38	8.12	9.34
	3H	11.72	12.34	12.67	13.31	14.54	7.79	8.41	8.74	9.38	10.61
	4H	12.42	12.98	13.38	13.94	15.20	8.35	8.91	9.30	9.87	11.13
	6H	12.93	13.42	13.91	14.41	15.66	8.77	9.26	9.74	10.24	11.49
	8H	13.11	13.56	14.08	14.54	15.81	8.90	9.35	9.87	10.33	11.60
	12H	13.21	13.62	14.20	14.61	15.88	8.97	9.38	9.96	10.37	11.64
8H	4H	12.39	12.84	13.36	13.82	15.09	8.63	9.08	9.60	10.06	11.33
	6H	12.96	13.33	13.96	14.35	15.62	9.15	9.53	10.15	10.55	11.81
	8H	13.17	13.50	14.18	14.51	15.80	9.34	9.67	10.35	10.68	11.97
	12H	13.31	13.60	14.32	14.61	15.94	9.46	9.76	10.48	10.76	12.09
12H	4H	12.34	12.75	13.33	13.75	15.02	8.64	9.05	9.63	10.04	11.31
	6H	12.93	13.26	13.94	14.27	15.56	9.20	9.53	10.21	10.54	11.82
	8H	13.15	13.45	14.17	14.45	15.78	9.41	9.70	10.42	10.71	12.04