

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904661

Luminaire Tested: DFN2DIP-TR4F0-070D060US830-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904661
REPORT IS A COMBINATION OF REPORTS P901932 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D060US830-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11206.8 lumens
Efficiency: N/A
Efficacy: 101.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 110.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904661

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US830-RLLONL

Luminous Intensity Polar Plot

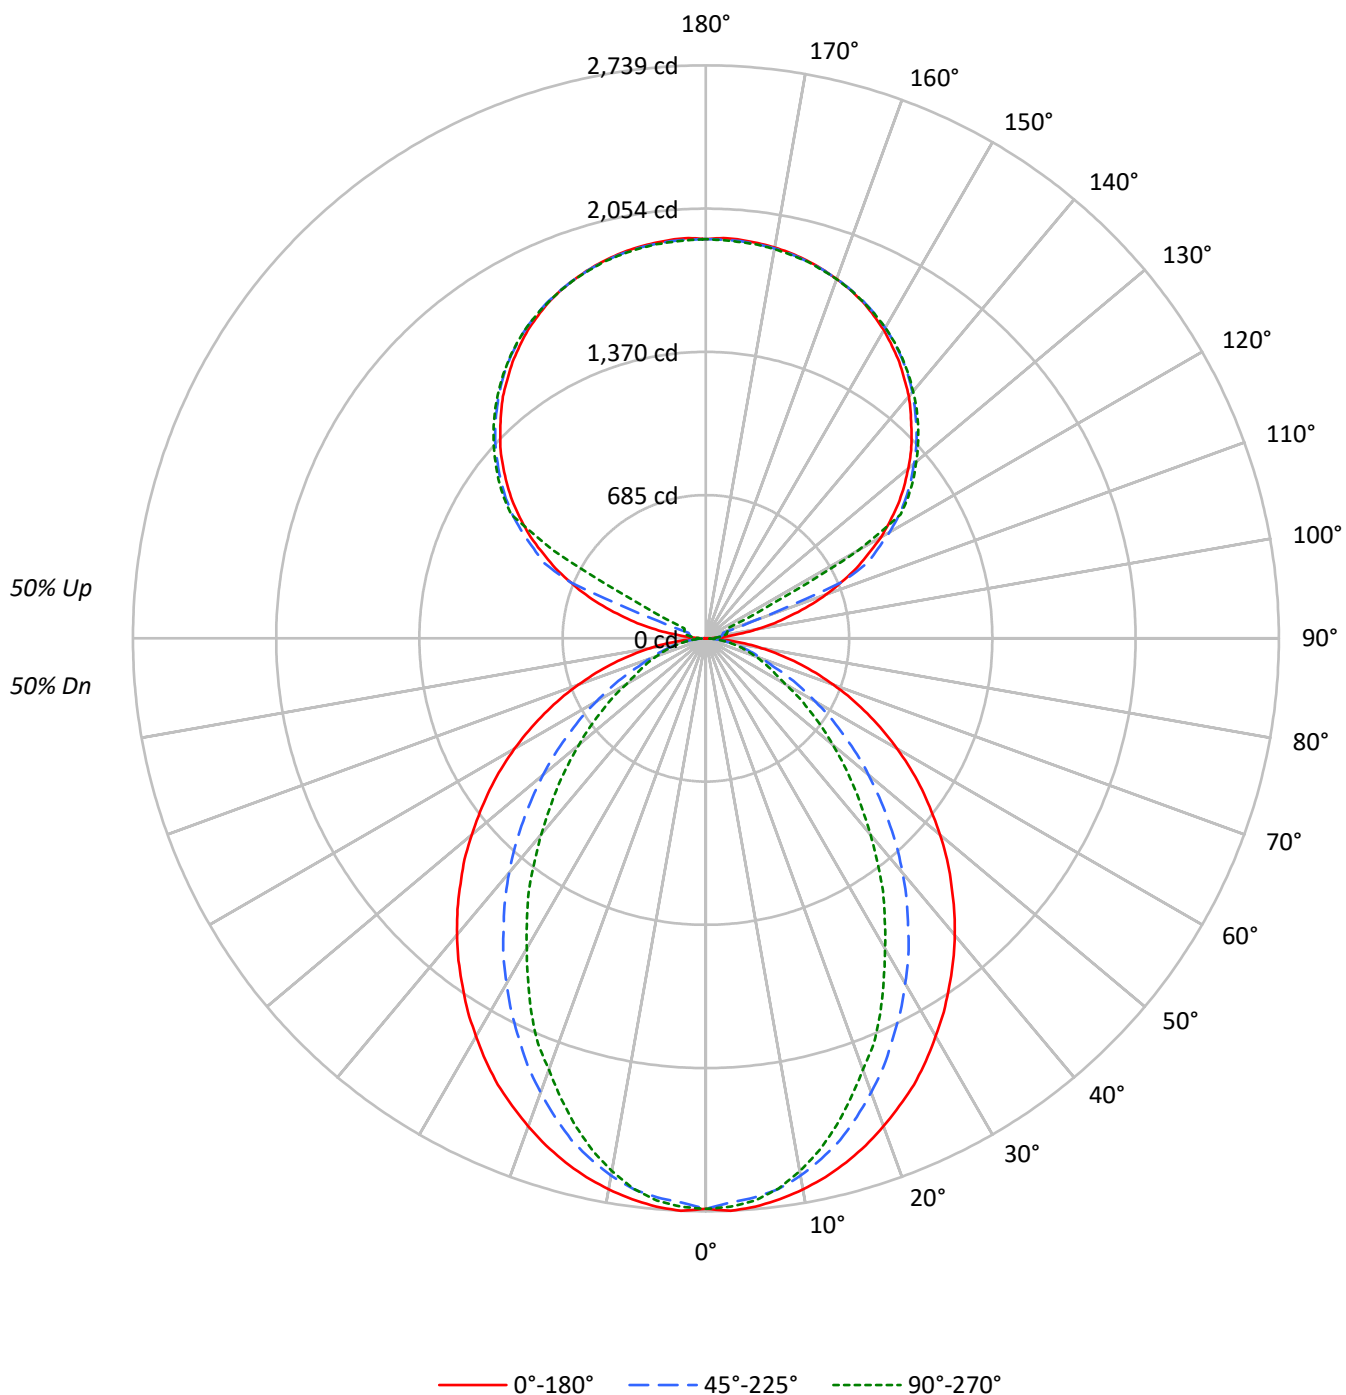

TEST NUMBER: P904661

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US830-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	94	90	87	91	87	84	81	74	72	69	62	60	59	50	49	48
2	90	83	77	72	83	77	72	67	65	62	58	55	52	50	45	43	41
3	82	73	66	60	76	68	62	57	58	53	50	49	45	43	40	38	36
4	76	65	57	52	70	60	54	49	52	47	43	44	40	37	36	34	31
5	70	58	50	45	64	54	47	42	47	41	37	40	35	32	33	30	28
6	64	52	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	59	47	40	34	55	44	37	32	38	33	29	33	29	25	28	24	22
8	55	43	36	30	51	40	34	29	35	30	26	30	26	23	25	22	20
9	52	40	32	27	48	37	30	26	32	27	23	28	24	21	24	20	18
10	48	36	29	25	45	34	28	23	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2166	2166	2166
5°	2170	2132	2146
10°	2148	2090	2076
15°	2119	2021	1968
20°	2080	1926	1835
25°	2040	1819	1707
30°	1986	1710	1545
35°	1933	1592	1402
40°	1880	1470	1239
45°	1817	1335	1091
50°	1753	1199	946
55°	1686	1053	807
60°	1608	900	664
65°	1518	746	598
70°	1410	601	541
75°	1273	530	492
80°	1076	445	427
85°	750	296	320

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1817 cd/sqm

TEST NUMBER: P904661

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US830-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	255.6	2.3
10°-20°	701.6	6.3
20°-30°	985.0	8.8
30°-40°	1073.7	9.6
40°-50°	986.9	8.8
50°-60°	775.0	6.9
60°-70°	504.5	4.5
70°-80°	259.7	2.3
80°-90°	69.6	0.6
90°-100°	62.9	0.6
100°-110°	234.6	2.1
110°-120°	622.2	5.6
120°-130°	1032.0	9.2
130°-140°	1096.2	9.8
140°-150°	1018.8	9.1
150°-160°	819.1	7.3
160°-170°	527.8	4.7
170°-180°	181.7	1.6
0°-30°	1942.1	17.3
0°-40°	3015.8	26.9
0°-60°	4777.7	42.6
0°-90°	5611.4	50.1
90°-120°	919.8	8.2
90°-150°	4066.8	36.3
90°-180°	5595.0	49.9
0°-180°	11206.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2727	2727	2727	2727	2727	
5°	2727	2714	2682	2705	2697	259
15°	2594	2566	2483	2436	2411	731
25°	2354	2275	2112	2011	1974	1083
35°	2028	1903	1686	1530	1476	1270
45°	1658	1493	1234	1059	999	1281
55°	1261	1068	802	654	607	1127
65°	851	651	429	346	338	844
75°	454	281	197	180	178	480
85°	106	54	47	47	47	122
90°	1	17	28	35	37	11
95°	90	44	54	61	59	106
105°	420	461	84	99	105	449
115°	794	818	852	213	113	782
125°	1123	1141	1167	1177	1181	1001
135°	1389	1412	1424	1438	1435	1073
145°	1612	1610	1634	1643	1636	1008
155°	1775	1762	1779	1787	1776	818
165°	1870	1862	1866	1876	1866	528
175°	1913	1903	1906	1915	1902	182
180°	1909	1909	1909	1909	1909	

TEST NUMBER: P904661

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US830-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2726.9	2726.9	2726.9	2726.9	2726.9
2.5°	2739.1	2726.9	2699.6	2724.5	2719.5
5°	2726.9	2714.5	2682.4	2704.6	2697.3
7.5°	2704.6	2689.9	2655.4	2665.0	2652.8
10°	2675.0	2657.8	2608.5	2600.9	2586.2
12.5°	2638.1	2615.8	2549.1	2534.4	2507.2
15°	2593.6	2566.4	2482.6	2435.7	2411.1
17.5°	2541.8	2502.3	2398.6	2344.3	2304.8
20°	2482.6	2433.1	2309.8	2248.2	2193.8
22.5°	2418.5	2361.6	2218.4	2134.6	2097.7
25°	2354.3	2275.2	2112.3	2011.3	1974.2
27.5°	2277.8	2193.8	2013.6	1897.7	1840.9
30°	2196.4	2102.4	1905.0	1779.3	1712.6
32.5°	2117.3	2003.8	1801.6	1653.4	1591.6
35°	2028.5	1902.6	1685.6	1530.1	1475.6
37.5°	1942.2	1806.3	1577.0	1406.5	1345.0
40°	1850.8	1702.9	1463.3	1288.2	1224.0
42.5°	1757.1	1599.2	1349.9	1167.2	1105.7
45°	1658.4	1492.9	1234.0	1058.6	999.4
47.5°	1564.6	1389.5	1122.9	947.5	893.3
50°	1460.9	1285.8	1014.3	843.9	792.3
52.5°	1359.6	1174.5	910.6	747.7	700.9
55°	1260.9	1068.5	801.9	654.0	607.2
57.5°	1159.9	962.4	705.9	567.6	528.1
60°	1056.2	858.8	604.5	478.9	439.3
62.5°	955.1	757.7	518.1	399.8	380.1
65°	851.4	651.4	429.4	345.6	338.0
67.5°	752.7	552.7	345.6	303.4	296.1
70°	649.0	456.6	286.2	261.6	251.6
72.5°	550.4	367.6	239.3	219.7	214.7
75°	454.0	281.2	197.4	180.1	177.8
77.5°	357.9	199.7	155.5	145.5	140.6
80°	268.9	143.2	118.4	108.7	108.7
82.5°	187.5	96.3	81.4	76.4	76.4
85°	106.0	54.2	46.8	46.8	46.8
87.5°	39.5	19.6	19.6	17.2	17.2
90°	1.3	16.6	27.5	34.6	37.2
92.5°	34.6	29.0	33.1	35.9	37.2
95°	89.7	44.1	53.8	60.9	59.4
97.5°	161.6	48.4	70.3	74.6	76.0
100°	244.5	55.2	78.7	89.7	92.5
102.5°	335.5	332.9	81.5	96.6	100.9
105°	419.8	461.3	84.3	99.3	105.0
107.5°	517.9	552.3	87.1	102.2	107.7
110°	611.9	640.7	241.8	103.7	109.1



TEST NUMBER: P904661

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US830-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	700.2	725.0	701.5	106.2	110.6
115°	794.1	817.6	852.2	212.7	113.3
117.5°	875.5	903.1	926.7	729.2	367.3
120°	966.8	987.4	1012.4	1028.9	842.4
122.5°	1044.0	1066.1	1093.8	1102.0	1103.5
125°	1122.8	1140.8	1167.0	1176.7	1180.7
127.5°	1194.6	1213.9	1234.7	1248.5	1249.8
130°	1262.3	1284.4	1299.5	1314.8	1313.4
132.5°	1331.3	1349.3	1364.4	1376.9	1375.5
135°	1389.4	1411.6	1423.8	1437.8	1434.9
137.5°	1450.0	1466.6	1480.5	1494.3	1490.3
140°	1509.4	1520.6	1535.7	1548.1	1541.2
142.5°	1559.2	1569.0	1586.9	1597.8	1590.9
145°	1611.7	1610.2	1633.7	1643.4	1636.5
147.5°	1657.2	1653.0	1676.5	1683.4	1678.0
150°	1701.5	1691.8	1713.9	1722.1	1715.2
152.5°	1738.7	1727.7	1748.3	1756.7	1747.0
155°	1774.6	1762.3	1778.9	1787.1	1776.0
157.5°	1803.6	1792.6	1805.1	1814.8	1803.6
160°	1828.5	1820.1	1828.5	1836.7	1827.1
162.5°	1850.5	1842.3	1849.2	1858.9	1846.4
165°	1869.9	1861.7	1865.8	1875.5	1865.8
167.5°	1885.1	1876.8	1881.0	1890.7	1878.2
170°	1897.6	1889.2	1892.1	1901.7	1889.2
172.5°	1905.8	1897.6	1900.4	1910.1	1897.6
175°	1912.7	1903.0	1905.8	1915.4	1901.7
177.5°	1915.4	1905.8	1907.2	1916.9	1904.5
180°	1908.6	1908.6	1908.6	1908.6	1908.6

TEST NUMBER: P904661

CATALOG NUMBER: DFN2DIP-TR4F0-070D060US830-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.83	10.67	10.80	11.64	12.91	5.81	6.64	6.77	7.61	8.88
	3H	11.51	12.25	12.49	13.24	14.53	7.00	7.74	7.97	8.72	10.02
	4H	12.12	12.82	13.11	13.81	15.11	7.45	8.15	8.44	9.14	10.44
	6H	12.54	13.19	13.54	14.18	15.50	7.77	8.42	8.77	9.41	10.72
	8H	12.67	13.28	13.67	14.29	15.60	7.86	8.48	8.87	9.48	10.80
	12H	12.73	13.31	13.74	14.32	15.65	7.91	8.49	8.91	9.49	10.83
4H	2H	9.85	10.55	10.85	11.54	12.85	6.40	7.11	7.40	8.09	9.40
	3H	11.68	12.27	12.68	13.28	14.60	7.75	8.34	8.76	9.35	10.67
	4H	12.37	12.91	13.38	13.92	15.26	8.30	8.84	9.31	9.84	11.19
	6H	12.89	13.35	13.91	14.38	15.72	8.72	9.18	9.75	10.21	11.55
	8H	13.06	13.49	14.09	14.52	15.87	8.85	9.28	9.88	10.31	11.66
	12H	13.16	13.54	14.20	14.58	15.94	8.92	9.30	9.96	10.34	11.70
8H	4H	12.34	12.77	13.37	13.79	15.15	8.58	9.01	9.61	10.04	11.39
	6H	12.91	13.26	13.95	14.33	15.68	9.10	9.46	10.15	10.52	11.87
	8H	13.12	13.43	14.18	14.49	15.86	9.29	9.60	10.35	10.66	12.03
	12H	13.26	13.54	14.32	14.58	15.99	9.41	9.69	10.47	10.73	12.15
12H	4H	12.29	12.68	13.33	13.72	15.08	8.59	8.97	9.63	10.01	11.37
	6H	12.88	13.19	13.94	14.25	15.62	9.15	9.46	10.21	10.52	11.88
	8H	13.10	13.38	14.16	14.42	15.84	9.36	9.64	10.42	10.68	12.10

END OF REPORT