

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904675

Luminaire Tested: DFN2DIP-TR4F0-070D100US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904675
REPORT IS A COMBINATION OF REPORTS P902003 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D100US830-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15863.0 lumens
Efficiency: N/A
Efficacy: 111.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 141.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904675

CATALOG NUMBER: DFN2DIP-TR4F0-070D100US830-FLLONL

Luminous Intensity Polar Plot

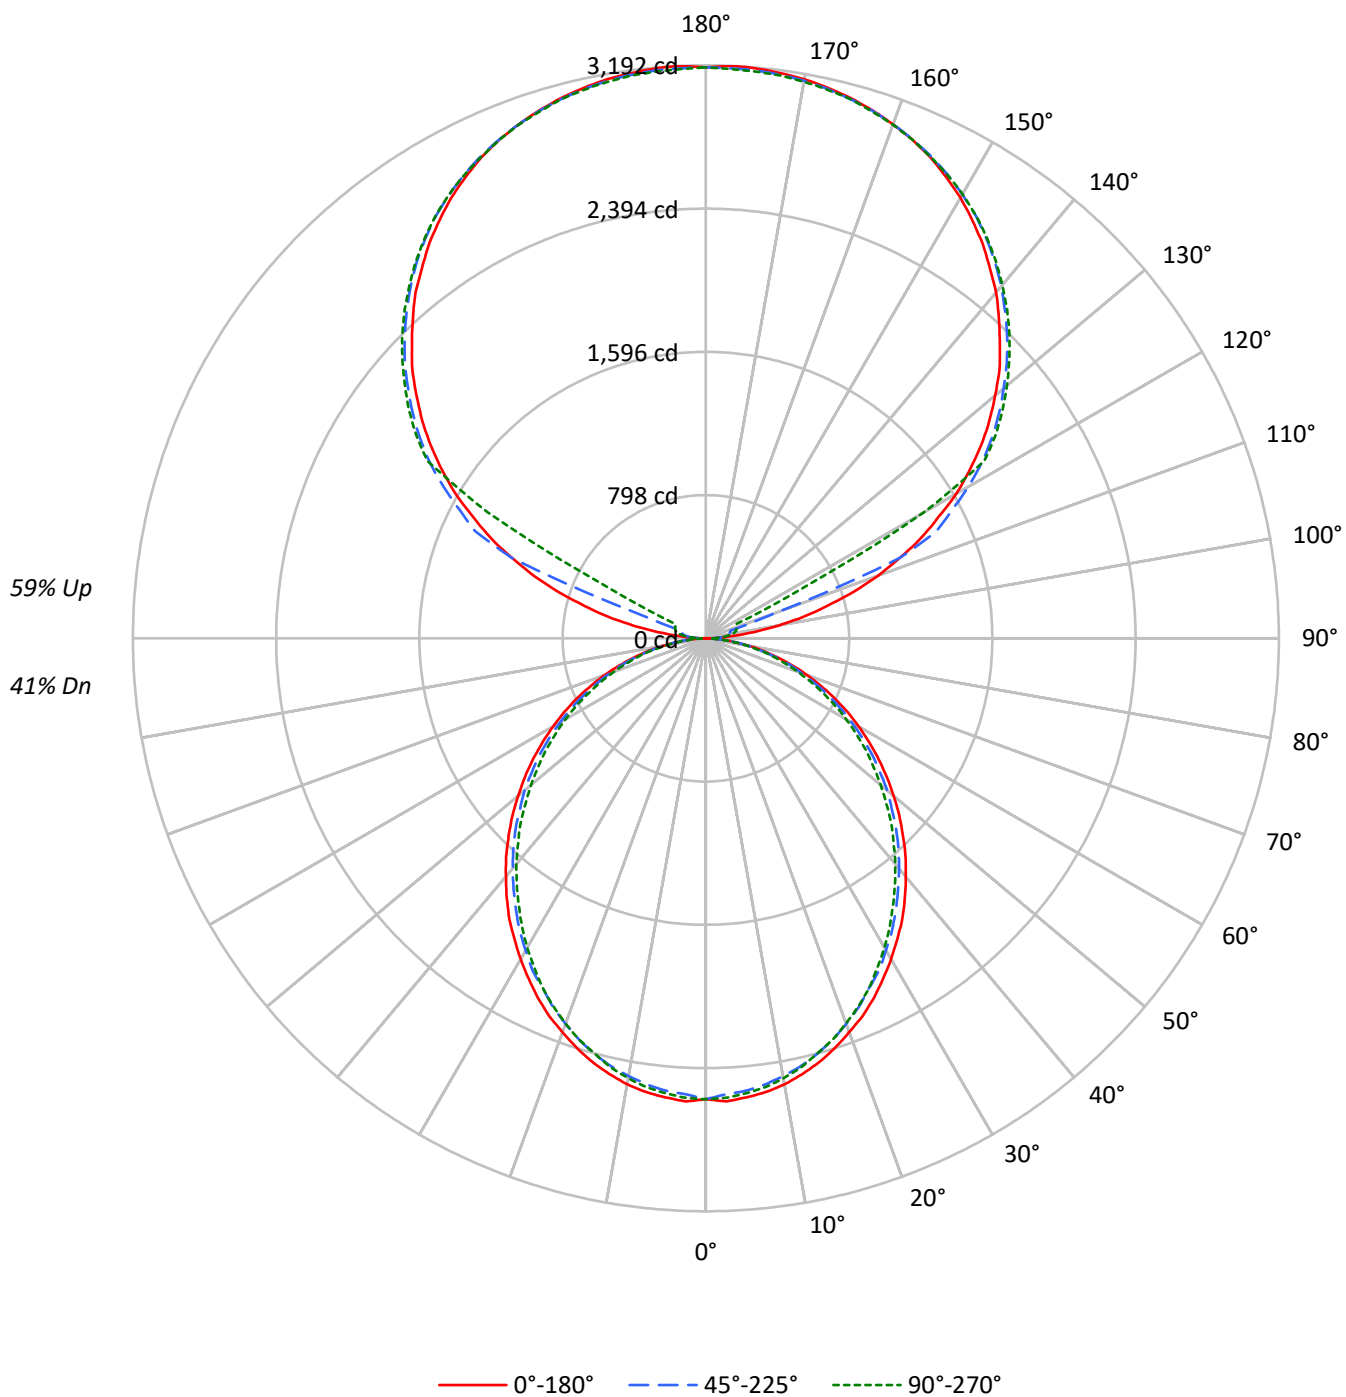

TEST NUMBER: P904675

CATALOG NUMBER: DFN2DIP-TR4F0-070D100US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	63	63	63	48	48	48
1	96	92	88	84	87	84	80	77	69	66	64	55	54	52	42	41	41
2	87	80	74	69	79	73	68	63	60	56	53	48	46	43	37	36	34
3	80	70	63	57	72	64	58	53	53	49	45	43	39	37	33	31	29
4	73	62	54	48	66	57	50	45	47	42	38	38	34	31	30	27	25
5	67	55	47	41	61	51	44	38	42	37	33	34	30	27	27	24	22
6	61	50	42	36	56	46	38	33	38	33	29	31	27	24	24	21	19
7	57	45	37	31	52	41	34	29	34	29	25	28	24	21	22	19	17
8	53	40	33	28	48	37	31	26	31	26	22	26	22	19	20	17	15
9	49	37	30	25	45	34	27	23	29	23	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	26	21	18	22	18	15	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2039	2039	2039
5°	2043	2011	2025
10°	2026	1984	1997
15°	1996	1951	1954
20°	1956	1906	1910
25°	1916	1852	1860
30°	1866	1801	1795
35°	1819	1741	1727
40°	1760	1681	1662
45°	1702	1621	1595
50°	1638	1558	1518
55°	1571	1484	1448
60°	1495	1397	1367
65°	1413	1307	1271
70°	1308	1197	1168
75°	1163	1066	1073
80°	988	899	891
85°	715	610	591

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1702 cd/sqm

TEST NUMBER: P904675

CATALOG NUMBER: DFN2DIP-TR4F0-070D100US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	241.6	1.5
10°-20°	679.9	4.3
20°-30°	999.1	6.3
30°-40°	1160.4	7.3
40°-50°	1159.0	7.3
50°-60°	1010.6	6.4
60°-70°	747.1	4.7
70°-80°	422.7	2.7
80°-90°	117.2	0.7
90°-100°	104.9	0.7
100°-110°	391.0	2.5
110°-120°	1037.0	6.5
120°-130°	1720.0	10.8
130°-140°	1827.0	11.5
140°-150°	1698.0	10.7
150°-160°	1365.2	8.6
160°-170°	879.7	5.5
170°-180°	302.8	1.9
0°-30°	1920.6	12.1
0°-40°	3081.0	19.4
0°-60°	5250.6	33.1
0°-90°	6537.5	41.2
90°-120°	1532.9	9.7
90°-150°	6778.0	42.7
90°-180°	9326.0	58.8
0°-180°	15863.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2567	2567	2567	2567	2567	
5°	2567	2558	2530	2550	2545	244
15°	2444	2429	2397	2407	2395	688
25°	2212	2192	2150	2155	2150	1018
35°	1908	1884	1844	1829	1817	1192
45°	1553	1536	1498	1471	1461	1198
55°	1175	1160	1131	1101	1089	1051
65°	793	778	753	731	718	784
75°	415	410	397	383	388	443
85°	101	99	96	89	86	113
90°	2	28	46	58	62	15
95°	150	74	90	101	99	177
105°	700	769	140	166	175	748
115°	1323	1362	1420	354	189	1303
125°	1871	1901	1945	1961	1968	1669
135°	2316	2352	2373	2396	2392	1789
145°	2686	2684	2723	2739	2728	1680
155°	2958	2937	2965	2978	2960	1363
165°	3116	3103	3110	3126	3110	880
175°	3188	3172	3176	3192	3170	303
180°	3181	3181	3181	3181	3181	

TEST NUMBER: P904675

CATALOG NUMBER: DFN2DIP-TR4F0-070D100US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2567.2	2567.2	2567.2	2567.2	2567.2
2.5°	2582.2	2569.8	2542.6	2567.2	2562.5
5°	2567.2	2557.6	2530.3	2550.0	2545.2
7.5°	2550.0	2535.3	2508.0	2528.0	2523.0
10°	2523.0	2505.7	2476.1	2495.8	2488.4
12.5°	2485.8	2471.2	2441.6	2453.8	2448.8
15°	2443.9	2429.2	2397.0	2407.0	2394.6
17.5°	2392.0	2377.4	2345.1	2357.5	2345.1
20°	2335.1	2320.5	2285.9	2293.3	2283.6
22.5°	2278.6	2256.4	2224.1	2224.1	2219.1
25°	2211.9	2192.2	2150.3	2155.0	2150.3
27.5°	2137.7	2120.4	2088.5	2081.1	2068.8
30°	2063.9	2043.9	2007.0	1999.7	1989.7
32.5°	1984.7	1970.1	1930.5	1915.6	1905.6
35°	1908.3	1883.7	1844.1	1829.2	1816.8
37.5°	1821.8	1799.6	1760.0	1742.8	1730.4
40°	1733.1	1713.2	1673.6	1651.6	1641.6
42.5°	1646.6	1626.7	1587.4	1562.5	1547.8
45°	1552.8	1535.6	1498.4	1471.4	1461.4
47.5°	1461.4	1444.2	1404.6	1377.3	1362.7
50°	1365.1	1352.7	1318.1	1283.6	1271.3
52.5°	1271.3	1254.1	1222.1	1194.9	1177.5
55°	1175.2	1160.3	1130.7	1101.1	1088.7
57.5°	1078.8	1066.5	1034.3	1004.7	994.8
60°	982.4	972.7	938.2	911.0	903.6
62.5°	888.6	871.4	846.8	822.2	812.2
65°	792.6	777.6	753.0	730.8	718.4
67.5°	693.8	681.3	659.2	642.0	632.0
70°	602.4	592.5	570.1	552.9	543.2
72.5°	508.6	498.7	486.4	469.1	461.8
75°	414.6	409.9	397.3	382.7	387.7
77.5°	330.8	320.8	315.8	308.5	301.2
80°	246.9	244.4	239.4	232.1	227.1
82.5°	167.9	167.9	165.5	155.6	155.6
85°	101.1	98.8	96.4	88.8	86.4
87.5°	44.5	39.6	34.6	27.2	24.6
90°	2.2	27.6	45.9	57.7	62.0
92.5°	57.7	48.4	55.2	59.9	62.0
95°	149.5	73.5	89.6	101.4	99.0
97.5°	269.2	80.6	117.3	124.3	126.6
100°	407.6	92.1	131.2	149.5	154.2
102.5°	559.2	554.9	135.8	161.0	168.1
105°	699.7	768.8	140.5	165.6	174.9
107.5°	863.2	920.6	145.2	170.3	179.6
110°	1019.7	1067.9	402.8	172.8	181.7

TEST NUMBER: P904675

CATALOG NUMBER: DFN2DIP-TR4F0-070D100US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1167.1	1208.3	1169.3	177.1	184.3
115°	1323.4	1362.5	1420.2	354.5	188.9
117.5°	1459.2	1505.2	1544.5	1215.2	612.3
120°	1611.3	1645.7	1687.2	1714.9	1404.1
122.5°	1740.0	1776.9	1823.1	1836.7	1839.2
125°	1871.2	1901.3	1945.0	1961.1	1967.9
127.5°	1990.9	2023.2	2057.9	2080.9	2083.0
130°	2103.8	2140.7	2165.9	2191.2	2189.1
132.5°	2218.8	2248.9	2274.1	2294.8	2292.6
135°	2315.6	2352.5	2373.0	2396.2	2391.6
137.5°	2416.8	2444.4	2467.6	2490.6	2483.7
140°	2515.6	2534.3	2559.4	2580.2	2568.7
142.5°	2598.8	2614.9	2644.7	2663.0	2651.6
145°	2686.2	2683.8	2722.9	2739.0	2727.5
147.5°	2761.9	2755.1	2794.2	2805.7	2796.7
150°	2835.7	2819.6	2856.6	2870.2	2858.7
152.5°	2897.8	2879.5	2914.0	2927.8	2911.7
155°	2957.7	2937.2	2964.8	2978.4	2960.1
157.5°	3006.1	2987.8	3008.5	3024.6	3006.1
160°	3047.6	3033.7	3047.6	3061.3	3045.2
162.5°	3084.2	3070.5	3082.0	3098.1	3077.4
165°	3116.4	3102.8	3109.6	3125.8	3109.6
167.5°	3141.9	3127.9	3135.1	3151.2	3130.4
170°	3162.6	3148.8	3153.4	3169.5	3148.8
172.5°	3176.3	3162.6	3167.3	3183.4	3162.6
175°	3187.8	3171.7	3176.3	3192.5	3169.5
177.5°	3192.5	3176.3	3178.8	3194.9	3174.1
180°	3181.0	3181.0	3181.0	3181.0	3181.0

TEST NUMBER: P904675

CATALOG NUMBER: DFN2DIP-TR4F0-070D100US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.87	9.66	9.90	10.70	12.09	8.44	9.23	9.47	10.26	11.66
	3H	10.53	11.23	11.57	12.28	13.69	10.05	10.76	11.09	11.81	13.22
	4H	11.11	11.78	12.16	12.83	14.25	10.64	11.31	11.69	12.35	13.77
	6H	11.51	12.12	12.57	13.17	14.60	11.03	11.65	12.09	12.70	14.13
	8H	11.61	12.20	12.67	13.26	14.69	11.13	11.72	12.20	12.79	14.21
	12H	11.65	12.21	12.73	13.27	14.72	11.17	11.73	12.25	12.79	14.24
4H	2H	9.32	9.99	10.38	11.04	12.46	8.98	9.65	10.04	10.70	12.12
	3H	11.18	11.74	12.25	12.82	14.25	10.79	11.35	11.86	12.43	13.86
	4H	11.90	12.41	12.97	13.47	14.93	11.49	12.00	12.56	13.07	14.52
	6H	12.41	12.85	13.49	13.94	15.38	12.00	12.44	13.08	13.53	14.97
	8H	12.55	12.96	13.63	14.05	15.51	12.14	12.55	13.22	13.63	15.10
	12H	12.62	12.99	13.72	14.09	15.56	12.20	12.57	13.30	13.67	15.14
8H	4H	12.09	12.50	13.17	13.58	15.04	11.73	12.14	12.81	13.22	14.68
	6H	12.71	13.05	13.82	14.18	15.64	12.35	12.69	13.46	13.81	15.27
	8H	12.93	13.23	14.04	14.34	15.82	12.57	12.86	13.68	13.97	15.45
	12H	13.06	13.32	14.18	14.43	15.94	12.68	12.94	13.79	14.04	15.56
12H	4H	12.07	12.44	13.17	13.54	15.00	11.72	12.09	12.81	13.18	14.65
	6H	12.74	13.04	13.85	14.15	15.63	12.39	12.69	13.50	13.80	15.28
	8H	12.98	13.24	14.10	14.35	15.86	12.62	12.89	13.74	13.99	15.51

END OF REPORT