

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904691

Luminaire Tested: DFN2DIP-TR4F0-080D050US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904691
REPORT IS A COMBINATION OF REPORTS P901915 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-080D050US830-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12130.5 lumens
Efficiency: N/A
Efficacy: 107.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 112.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9957
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904691

CATALOG NUMBER: DFN2DIP-TR4F0-080D050US830-FLLONL

Luminous Intensity Polar Plot

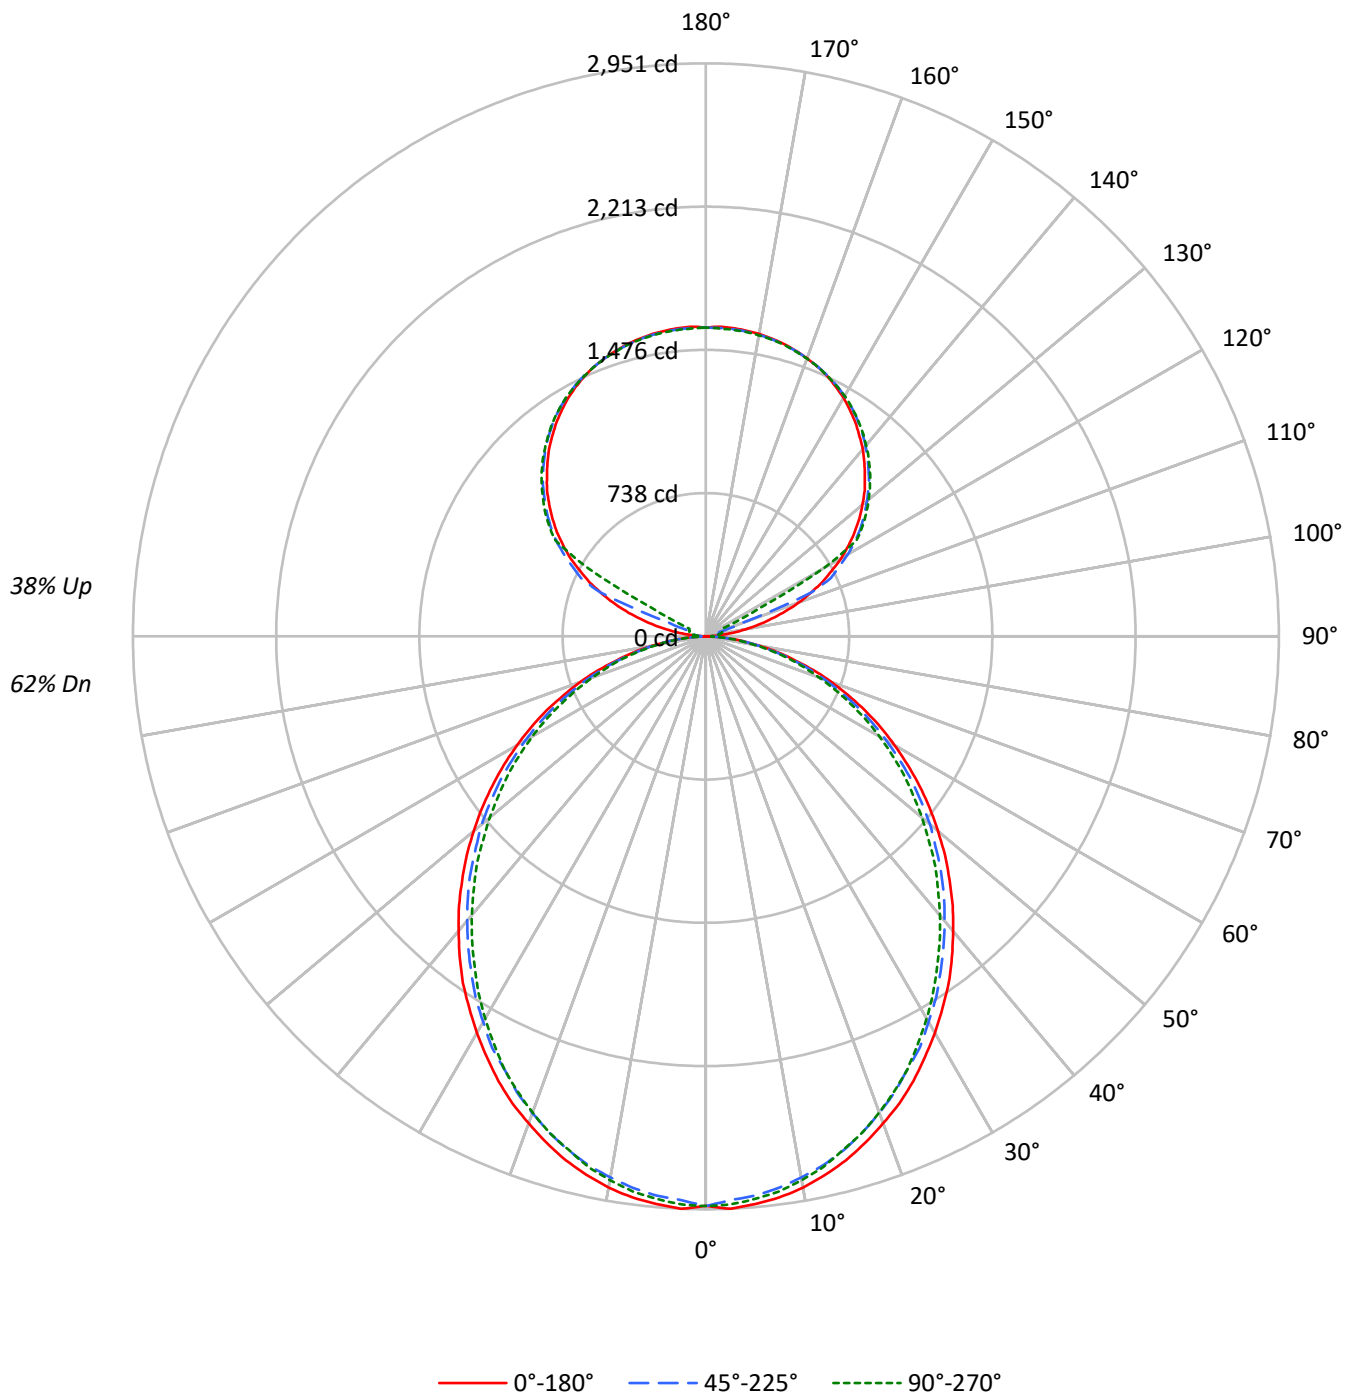

TEST NUMBER: P904691

CATALOG NUMBER: DFN2DIP-TR4F0-080D050US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	78	78	78	67	67	67
1	100	96	92	88	94	90	87	83	79	76	74	69	67	65	59	58	56
2	91	84	78	72	85	79	73	69	69	65	61	60	57	54	52	50	48
3	83	74	66	60	78	69	63	57	61	56	51	53	49	46	46	43	40
4	76	65	57	51	71	61	54	49	54	48	44	47	43	39	41	38	35
5	70	58	50	44	65	55	47	42	49	43	38	43	38	34	37	33	30
6	65	52	44	38	60	49	42	36	44	38	33	39	34	30	34	30	27
7	60	47	39	34	56	45	37	32	40	34	29	35	30	27	31	27	24
8	56	43	35	30	52	41	34	29	36	30	26	32	27	24	28	24	21
9	52	39	32	27	49	37	30	26	33	28	23	30	25	21	26	22	19
10	49	36	29	24	45	34	28	23	31	25	21	27	23	19	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2331	2331	2331
5°	2335	2298	2314
10°	2316	2267	2282
15°	2282	2230	2233
20°	2236	2178	2183
25°	2190	2116	2125
30°	2133	2058	2051
35°	2078	1990	1973
40°	2011	1921	1899
45°	1945	1853	1823
50°	1872	1780	1735
55°	1795	1696	1654
60°	1709	1597	1562
65°	1615	1494	1452
70°	1495	1369	1335
75°	1329	1219	1226
80°	1130	1027	1019
85°	817	697	675

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1945 cd/sqm

TEST NUMBER: P904691

CATALOG NUMBER: DFN2DIP-TR4F0-080D050US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	276.1	2.3
10°-20°	777.0	6.4
20°-30°	1141.8	9.4
30°-40°	1326.2	10.9
40°-50°	1324.5	10.9
50°-60°	1155.0	9.5
60°-70°	853.8	7.0
70°-80°	483.0	4.0
80°-90°	130.3	1.1
90°-100°	52.5	0.4
100°-110°	195.5	1.6
110°-120°	518.5	4.3
120°-130°	860.0	7.1
130°-140°	913.5	7.5
140°-150°	849.0	7.0
150°-160°	682.6	5.6
160°-170°	439.8	3.6
170°-180°	151.4	1.2
0°-30°	2195.0	18.1
0°-40°	3521.1	29.0
0°-60°	6000.6	49.5
0°-90°	7467.7	61.6
90°-120°	766.5	6.3
90°-150°	3389.0	27.9
90°-180°	4663.0	38.4
0°-180°	12130.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2934	2934	2934	2934	2934	
5°	2934	2923	2892	2914	2909	279
15°	2793	2776	2739	2751	2737	787
25°	2528	2505	2458	2463	2458	1163
35°	2181	2153	2108	2090	2076	1362
45°	1775	1755	1712	1682	1670	1370
55°	1343	1326	1292	1258	1244	1201
65°	906	889	860	835	821	896
75°	474	468	454	437	443	506
85°	116	113	110	102	99	129
90°	1	14	23	29	31	11
95°	75	37	45	51	50	89
105°	350	384	70	83	88	374
115°	662	681	710	177	94	651
125°	936	951	972	980	984	834
135°	1158	1176	1186	1198	1196	894
145°	1343	1342	1361	1370	1364	840
155°	1479	1469	1482	1489	1480	681
165°	1558	1551	1555	1563	1555	440
175°	1594	1586	1588	1596	1585	152
180°	1590	1590	1590	1590	1590	

TEST NUMBER: P904691

CATALOG NUMBER: DFN2DIP-TR4F0-080D050US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2933.9	2933.9	2933.9	2933.9	2933.9
2.5°	2951.0	2937.0	2905.9	2933.9	2928.6
5°	2933.9	2922.9	2891.8	2914.2	2908.9
7.5°	2914.2	2897.5	2866.4	2889.1	2883.4
10°	2883.4	2863.6	2829.8	2852.2	2843.9
12.5°	2840.9	2824.1	2790.3	2804.3	2798.7
15°	2793.0	2776.3	2739.4	2750.8	2736.8
17.5°	2733.7	2717.0	2680.1	2694.3	2680.1
20°	2668.8	2652.0	2612.5	2620.9	2609.8
22.5°	2604.2	2578.7	2541.8	2541.8	2536.2
25°	2527.8	2505.4	2457.5	2462.9	2457.5
27.5°	2443.1	2423.4	2386.8	2378.4	2364.4
30°	2358.7	2335.9	2293.8	2285.4	2274.0
32.5°	2268.3	2251.5	2206.3	2189.2	2177.9
35°	2180.9	2152.8	2107.5	2090.5	2076.4
37.5°	2082.1	2056.6	2011.5	1991.7	1977.6
40°	1980.7	1957.8	1912.7	1887.5	1876.1
42.5°	1881.9	1859.1	1814.2	1785.7	1769.1
45°	1774.7	1754.9	1712.4	1681.6	1670.3
47.5°	1670.3	1650.5	1605.2	1574.1	1557.4
50°	1560.1	1546.1	1506.5	1467.0	1452.9
52.5°	1452.9	1433.1	1396.7	1365.6	1345.8
55°	1343.0	1326.0	1292.2	1258.4	1244.3
57.5°	1232.9	1218.9	1182.0	1148.2	1136.8
60°	1122.8	1111.7	1072.1	1041.0	1032.6
62.5°	1015.6	995.9	967.7	939.6	928.2
65°	905.8	888.7	860.5	835.1	821.0
67.5°	792.9	778.5	753.4	733.7	722.3
70°	688.4	677.0	651.7	631.9	620.8
72.5°	581.3	570.0	555.8	536.1	527.7
75°	473.8	468.4	454.1	437.3	443.0
77.5°	378.1	366.6	361.0	352.6	344.2
80°	282.3	279.3	273.6	265.2	259.5
82.5°	191.9	191.9	189.2	177.8	177.8
85°	115.6	112.8	110.2	101.5	98.8
87.5°	50.9	45.2	39.5	31.1	28.2
90°	1.1	13.8	23.0	28.8	31.0
92.5°	28.8	24.2	27.6	30.0	31.0
95°	74.7	36.8	44.9	50.7	49.5
97.5°	134.6	40.3	58.6	62.2	63.2
100°	203.8	46.1	65.6	74.7	77.1
102.5°	279.7	277.4	68.0	80.5	84.1
105°	349.9	384.5	70.2	82.8	87.5
107.5°	431.6	460.2	72.6	85.1	89.8
110°	509.9	534.0	201.4	86.3	90.9



TEST NUMBER: P904691

CATALOG NUMBER: DFN2DIP-TR4F0-080D050US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	583.5	604.2	584.7	88.6	92.1
115°	661.8	681.3	710.1	177.3	94.4
117.5°	729.6	752.6	772.3	607.6	306.1
120°	805.6	822.8	843.6	857.4	702.0
122.5°	870.0	888.4	911.5	918.4	919.6
125°	935.6	950.6	972.5	980.5	984.0
127.5°	995.4	1011.5	1029.0	1040.4	1041.5
130°	1051.9	1070.4	1082.9	1095.6	1094.6
132.5°	1109.5	1124.5	1137.0	1147.5	1146.3
135°	1157.8	1176.3	1186.5	1198.2	1195.8
137.5°	1208.3	1222.2	1233.8	1245.3	1241.9
140°	1257.8	1267.2	1279.7	1290.1	1284.4
142.5°	1299.4	1307.5	1322.4	1331.5	1325.8
145°	1343.1	1341.9	1361.4	1369.5	1363.8
147.5°	1381.0	1377.5	1397.1	1402.9	1398.4
150°	1417.9	1409.9	1428.2	1435.1	1429.4
152.5°	1448.9	1439.7	1457.0	1464.0	1455.9
155°	1478.8	1468.6	1482.3	1489.2	1480.1
157.5°	1503.0	1493.8	1504.2	1512.3	1503.0
160°	1523.8	1516.8	1523.8	1530.6	1522.6
162.5°	1542.1	1535.3	1541.0	1549.1	1538.7
165°	1558.2	1551.4	1554.8	1562.8	1554.8
167.5°	1570.9	1564.0	1567.5	1575.6	1565.2
170°	1581.3	1574.3	1576.7	1584.7	1574.3
172.5°	1588.2	1581.3	1583.7	1591.7	1581.3
175°	1593.9	1585.8	1588.2	1596.2	1584.7
177.5°	1596.2	1588.2	1589.4	1597.4	1587.1
180°	1590.4	1590.4	1590.4	1590.4	1590.4

TEST NUMBER: P904691

CATALOG NUMBER: DFN2DIP-TR4F0-080D050US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.21	12.19	12.06	13.06	14.16	10.78	11.75	11.63	12.63	13.72
	3H	12.88	13.75	13.74	14.64	15.76	12.41	13.28	13.27	14.16	15.29
	4H	13.47	14.30	14.35	15.19	16.32	13.00	13.83	13.88	14.72	15.85
	6H	13.88	14.64	14.77	15.54	16.68	13.40	14.17	14.29	15.06	16.21
	8H	13.98	14.71	14.88	15.63	16.77	13.51	14.24	14.41	15.15	16.30
	12H	14.04	14.73	14.94	15.64	16.81	13.56	14.25	14.46	15.16	16.33
4H	2H	11.69	12.51	12.57	13.40	14.54	11.34	12.17	12.23	13.06	14.19
	3H	13.56	14.25	14.46	15.17	16.32	13.17	13.86	14.06	14.78	15.93
	4H	14.28	14.91	15.19	15.83	17.00	13.88	14.51	14.78	15.42	16.60
	6H	14.80	15.35	15.72	16.29	17.46	14.39	14.94	15.31	15.88	17.05
	8H	14.95	15.46	15.88	16.40	17.59	14.54	15.05	15.47	15.99	17.17
	12H	15.03	15.49	15.98	16.44	17.64	14.61	15.07	15.55	16.02	17.22
8H	4H	14.49	15.00	15.41	15.93	17.12	14.13	14.64	15.05	15.57	16.76
	6H	15.12	15.54	16.07	16.52	17.71	14.76	15.18	15.71	16.16	17.35
	8H	15.34	15.72	16.30	16.68	17.89	14.98	15.35	15.94	16.31	17.52
	12H	15.48	15.81	16.44	16.77	18.02	15.10	15.43	16.06	16.38	17.64
12H	4H	14.48	14.94	15.42	15.89	17.08	14.13	14.58	15.07	15.54	16.73
	6H	15.15	15.53	16.11	16.49	17.70	14.80	15.18	15.76	16.14	17.35
	8H	15.40	15.73	16.36	16.69	17.94	15.04	15.37	16.01	16.33	17.59