

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904744

Luminaire Tested: DFN2DIP-TR4F0-090D090US830-RLFL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904744
REPORT IS A COMBINATION OF REPORTS P900470 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D090US830-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14717.8 lumens
Efficiency: N/A
Efficacy: 94.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 155.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904744

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US830-RLLFLL

Luminous Intensity Polar Plot

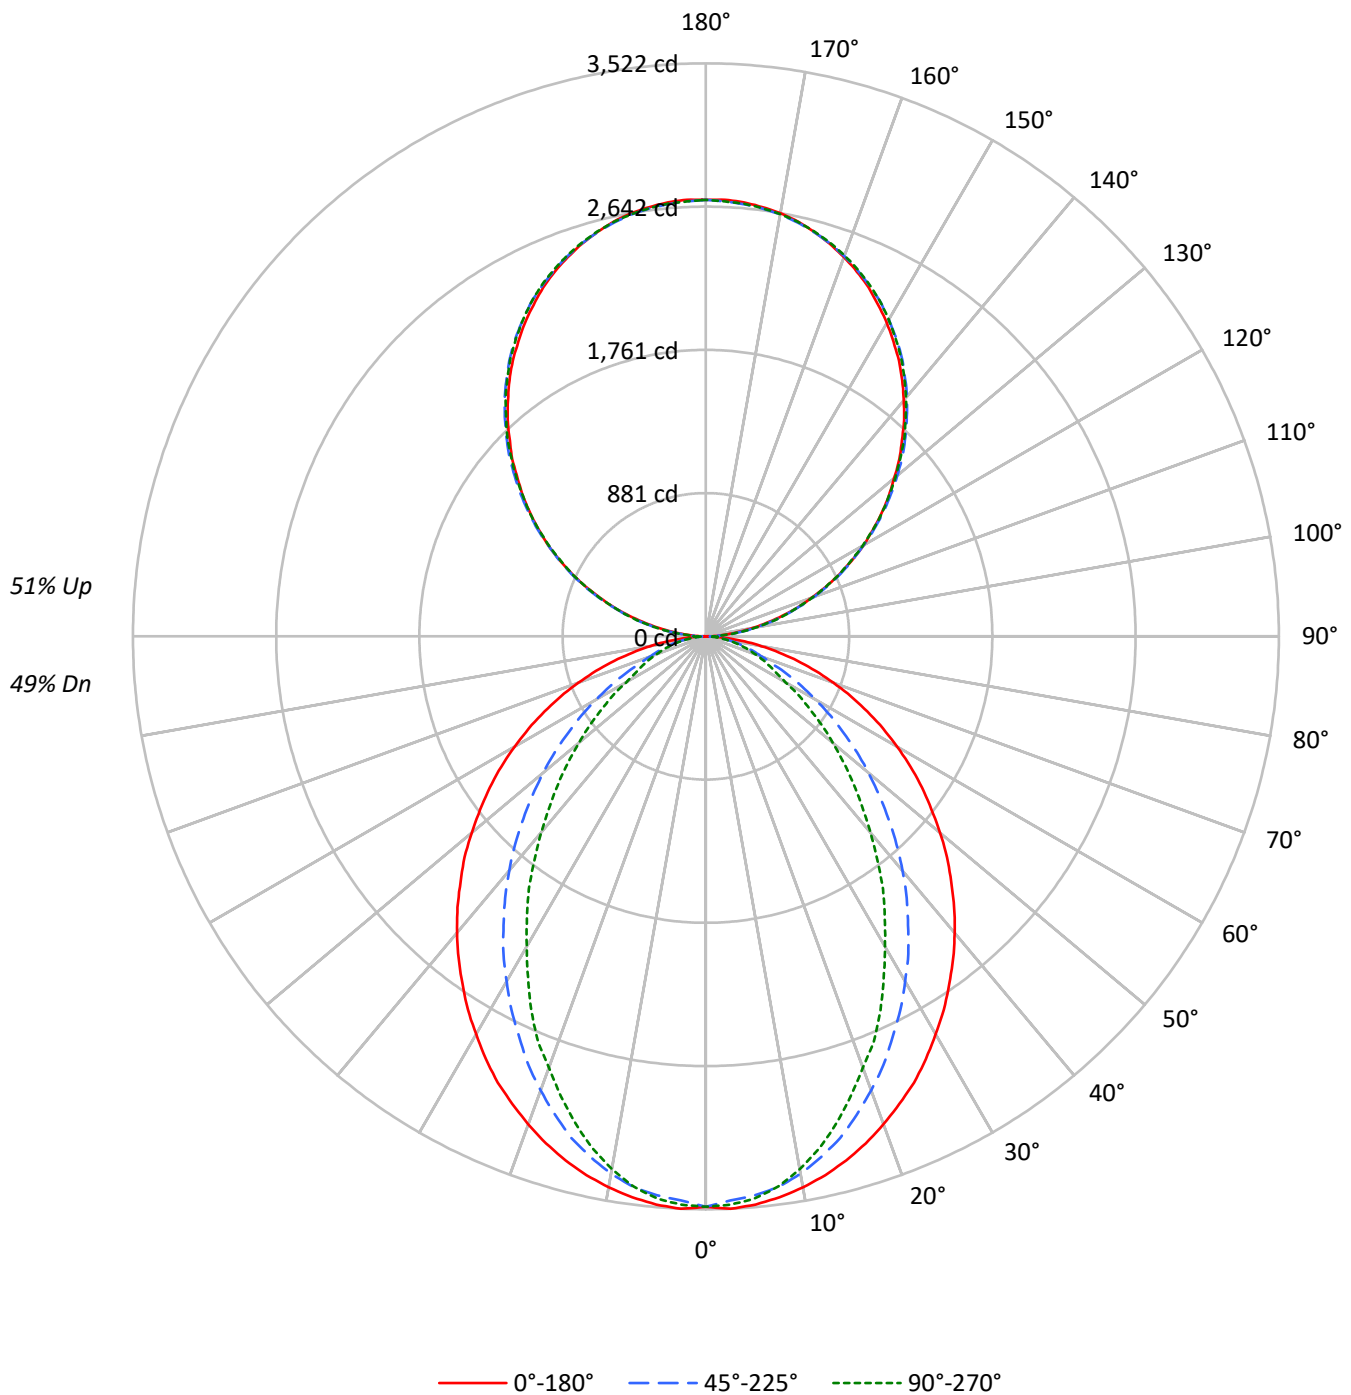

TEST NUMBER: P904744

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US830-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2785	2785	2785
5°	2790	2741	2758
10°	2762	2687	2669
15°	2724	2598	2530
20°	2674	2476	2360
25°	2622	2339	2195
30°	2553	2198	1986
35°	2485	2047	1803
40°	2417	1890	1593
45°	2336	1716	1403
50°	2254	1541	1217
55°	2167	1354	1038
60°	2067	1158	854
65°	1952	958	769
70°	1812	773	696
75°	1637	681	633
80°	1383	571	548
85°	964	381	411

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2336 cd/sqm

TEST NUMBER: P904744

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US830-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	328.6	2.2
10°-20°	902.0	6.1
20°-30°	1266.4	8.6
30°-40°	1380.5	9.4
40°-50°	1268.8	8.6
50°-60°	996.5	6.8
60°-70°	648.6	4.4
70°-80°	333.9	2.3
80°-90°	92.9	0.6
90°-100°	166.0	1.1
100°-110°	527.5	3.6
110°-120°	902.7	6.1
120°-130°	1187.2	8.1
130°-140°	1332.5	9.1
140°-150°	1306.7	8.9
150°-160°	1096.1	7.4
160°-170°	726.9	4.9
170°-180°	254.1	1.7
0°-30°	2497.0	17.0
0°-40°	3877.5	26.3
0°-60°	6142.8	41.7
0°-90°	7218.1	49.0
90°-120°	1596.2	10.8
90°-150°	5422.6	36.8
90°-180°	7500.0	51.0
0°-180°	14717.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3506	3506	3506	3506	3506	
5°	3506	3490	3449	3477	3468	332
15°	3335	3300	3192	3132	3100	940
25°	3027	2925	2716	2586	2538	1392
35°	2608	2446	2167	1967	1897	1632
45°	2132	1920	1586	1361	1285	1647
55°	1621	1374	1031	841	781	1449
65°	1095	838	552	444	435	1085
75°	584	362	254	232	229	617
85°	136	70	60	60	60	156
90°	2	29	79	74	77	15
95°	118	141	145	145	141	131
105°	487	493	498	502	502	514
115°	906	919	915	912	906	896
125°	1318	1338	1331	1324	1322	1177
135°	1704	1729	1734	1732	1725	1317
145°	2069	2085	2098	2100	2092	1293
155°	2366	2372	2380	2391	2384	1089
165°	2574	2571	2571	2587	2576	726
175°	2678	2671	2667	2683	2669	254
180°	2683	2683	2683	2683	2683	

TEST NUMBER: P904744

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US830-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3506.0	3506.0	3506.0	3506.0	3506.0
2.5°	3521.8	3506.0	3470.9	3503.0	3496.5
5°	3506.0	3490.1	3448.8	3477.3	3467.9
7.5°	3477.3	3458.5	3414.1	3426.5	3410.7
10°	3439.3	3417.1	3353.8	3344.0	3325.2
12.5°	3391.8	3363.3	3277.4	3258.6	3223.5
15°	3334.6	3299.7	3191.9	3131.6	3100.0
17.5°	3268.0	3217.2	3083.8	3014.2	2963.4
20°	3191.9	3128.3	2969.7	2890.6	2820.6
22.5°	3109.4	3036.4	2852.2	2744.5	2697.1
25°	3027.0	2925.3	2715.9	2586.0	2538.2
27.5°	2928.7	2820.6	2589.0	2439.9	2366.8
30°	2824.0	2703.1	2449.3	2287.7	2201.9
32.5°	2722.3	2576.2	2316.3	2125.8	2046.4
35°	2608.2	2446.3	2167.2	1967.3	1897.2
37.5°	2497.1	2322.4	2027.5	1808.4	1729.3
40°	2379.6	2189.4	1881.4	1656.2	1573.8
42.5°	2259.1	2056.2	1735.6	1500.7	1421.5
45°	2132.2	1919.5	1586.5	1360.9	1284.9
47.5°	2011.7	1786.5	1443.8	1218.2	1148.6
50°	1878.4	1653.1	1304.1	1085.0	1018.6
52.5°	1748.1	1510.1	1170.8	961.4	901.2
55°	1621.2	1373.8	1031.0	840.9	780.6
57.5°	1491.3	1237.5	907.6	729.8	679.0
60°	1357.9	1104.1	777.3	615.7	564.9
62.5°	1228.0	974.2	666.2	514.1	488.8
65°	1094.7	837.5	552.0	444.3	434.6
67.5°	967.8	710.6	444.3	390.1	380.7
70°	834.5	587.1	368.0	336.3	323.5
72.5°	707.6	472.6	307.6	282.4	276.1
75°	583.7	361.6	253.8	231.6	228.6
77.5°	460.1	256.8	199.9	187.2	180.8
80°	345.7	184.2	152.1	139.7	139.7
82.5°	241.0	123.9	104.7	98.3	98.3
85°	136.3	69.7	60.2	60.2	60.2
87.5°	50.8	25.3	25.3	22.2	22.2
90°	2.5	29.1	79.3	74.4	76.8
92.5°	50.1	68.0	70.4	72.8	72.8
95°	118.1	140.7	144.8	144.8	140.7
97.5°	196.5	217.5	226.5	226.5	226.5
100°	287.1	305.8	312.2	312.2	309.8
102.5°	382.6	396.3	405.2	407.6	405.2
105°	486.9	493.3	498.2	502.3	502.3
107.5°	590.4	600.1	600.1	601.7	590.4
110°	690.7	703.7	703.7	703.7	697.2

TEST NUMBER: P904744

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US830-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	799.1	812.8	810.4	804.0	799.1
115°	905.9	918.8	914.7	912.4	905.9
117.5°	1011.8	1029.6	1018.3	1011.8	1005.3
120°	1118.6	1136.3	1118.6	1118.6	1111.3
122.5°	1215.6	1238.3	1227.0	1220.5	1215.6
125°	1317.6	1337.8	1331.3	1324.0	1321.6
127.5°	1417.0	1442.1	1433.2	1423.5	1417.0
130°	1510.0	1539.2	1535.1	1530.2	1521.4
132.5°	1614.4	1637.0	1638.6	1627.3	1620.9
135°	1704.1	1729.2	1734.1	1731.6	1725.2
137.5°	1804.4	1824.7	1828.7	1827.1	1817.4
140°	1892.6	1912.8	1924.1	1924.1	1915.2
142.5°	1983.2	2003.4	2009.9	2012.3	2003.4
145°	2069.0	2085.1	2098.0	2100.5	2091.6
147.5°	2145.8	2166.0	2175.7	2179.7	2170.9
150°	2225.1	2238.8	2247.7	2254.9	2247.7
152.5°	2295.4	2309.1	2320.4	2329.4	2320.4
155°	2365.8	2372.2	2379.5	2390.9	2383.6
157.5°	2426.4	2431.3	2435.3	2451.5	2440.1
160°	2480.6	2485.5	2487.9	2501.6	2491.9
162.5°	2530.7	2530.7	2533.2	2548.5	2537.2
165°	2573.6	2571.2	2571.2	2587.4	2576.1
167.5°	2612.4	2605.2	2605.2	2621.3	2610.0
170°	2641.6	2635.1	2632.7	2648.8	2635.1
172.5°	2661.7	2655.3	2652.9	2669.1	2655.3
175°	2678.0	2671.4	2666.6	2682.9	2669.1
177.5°	2686.8	2680.4	2675.5	2689.3	2675.5
180°	2682.9	2682.9	2682.9	2682.9	2682.9

TEST NUMBER: P904744

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US830-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.61	11.43	11.58	12.41	13.70	6.58	7.41	7.55	8.39	9.67
	3H	12.29	13.02	13.27	14.01	15.32	7.77	8.51	8.75	9.50	10.81
	4H	12.89	13.59	13.89	14.58	15.90	8.22	8.92	9.22	9.91	11.23
	6H	13.31	13.95	14.32	14.95	16.28	8.54	9.18	9.55	10.18	11.51
	8H	13.44	14.05	14.45	15.06	16.39	8.63	9.24	9.65	10.26	11.59
	12H	13.50	14.08	14.52	15.09	16.44	8.68	9.26	9.70	10.27	11.62
4H	2H	10.63	11.32	11.63	12.32	13.63	7.18	7.87	8.18	8.87	10.18
	3H	12.45	13.03	13.47	14.06	15.39	8.53	9.10	9.54	10.13	11.46
	4H	13.15	13.67	14.17	14.69	16.05	9.08	9.60	10.09	10.62	11.97
	6H	13.66	14.11	14.69	15.15	16.51	9.50	9.95	10.53	10.99	12.34
	8H	13.84	14.26	14.87	15.29	16.66	9.62	10.05	10.66	11.08	12.45
	12H	13.93	14.31	14.98	15.36	16.73	9.69	10.07	10.74	11.12	12.49
8H	4H	13.11	13.54	14.14	14.57	15.94	9.35	9.78	10.39	10.81	12.18
	6H	13.68	14.03	14.73	15.10	16.47	9.87	10.22	10.93	11.30	12.66
	8H	13.90	14.20	14.96	15.26	16.65	10.07	10.37	11.13	11.43	12.82
	12H	14.03	14.30	15.10	15.36	16.78	10.19	10.46	11.25	11.51	12.93
12H	4H	13.07	13.45	14.11	14.49	15.87	9.36	9.74	10.41	10.79	12.16
	6H	13.65	13.96	14.72	15.02	16.40	9.92	10.23	10.99	11.29	12.67
	8H	13.88	14.15	14.94	15.20	16.62	10.13	10.41	11.20	11.46	12.88

END OF REPORT