

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904747

Luminaire Tested: DFN2DIP-TR4F0-090D100US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904747
REPORT IS A COMBINATION OF REPORTS P902007 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D100US830-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17729.2 lumens
Efficiency: N/A
Efficacy: 108.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 163.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904747

CATALOG NUMBER: DFN2DIP-TR4F0-090D100US830-FLLONL

Luminous Intensity Polar Plot

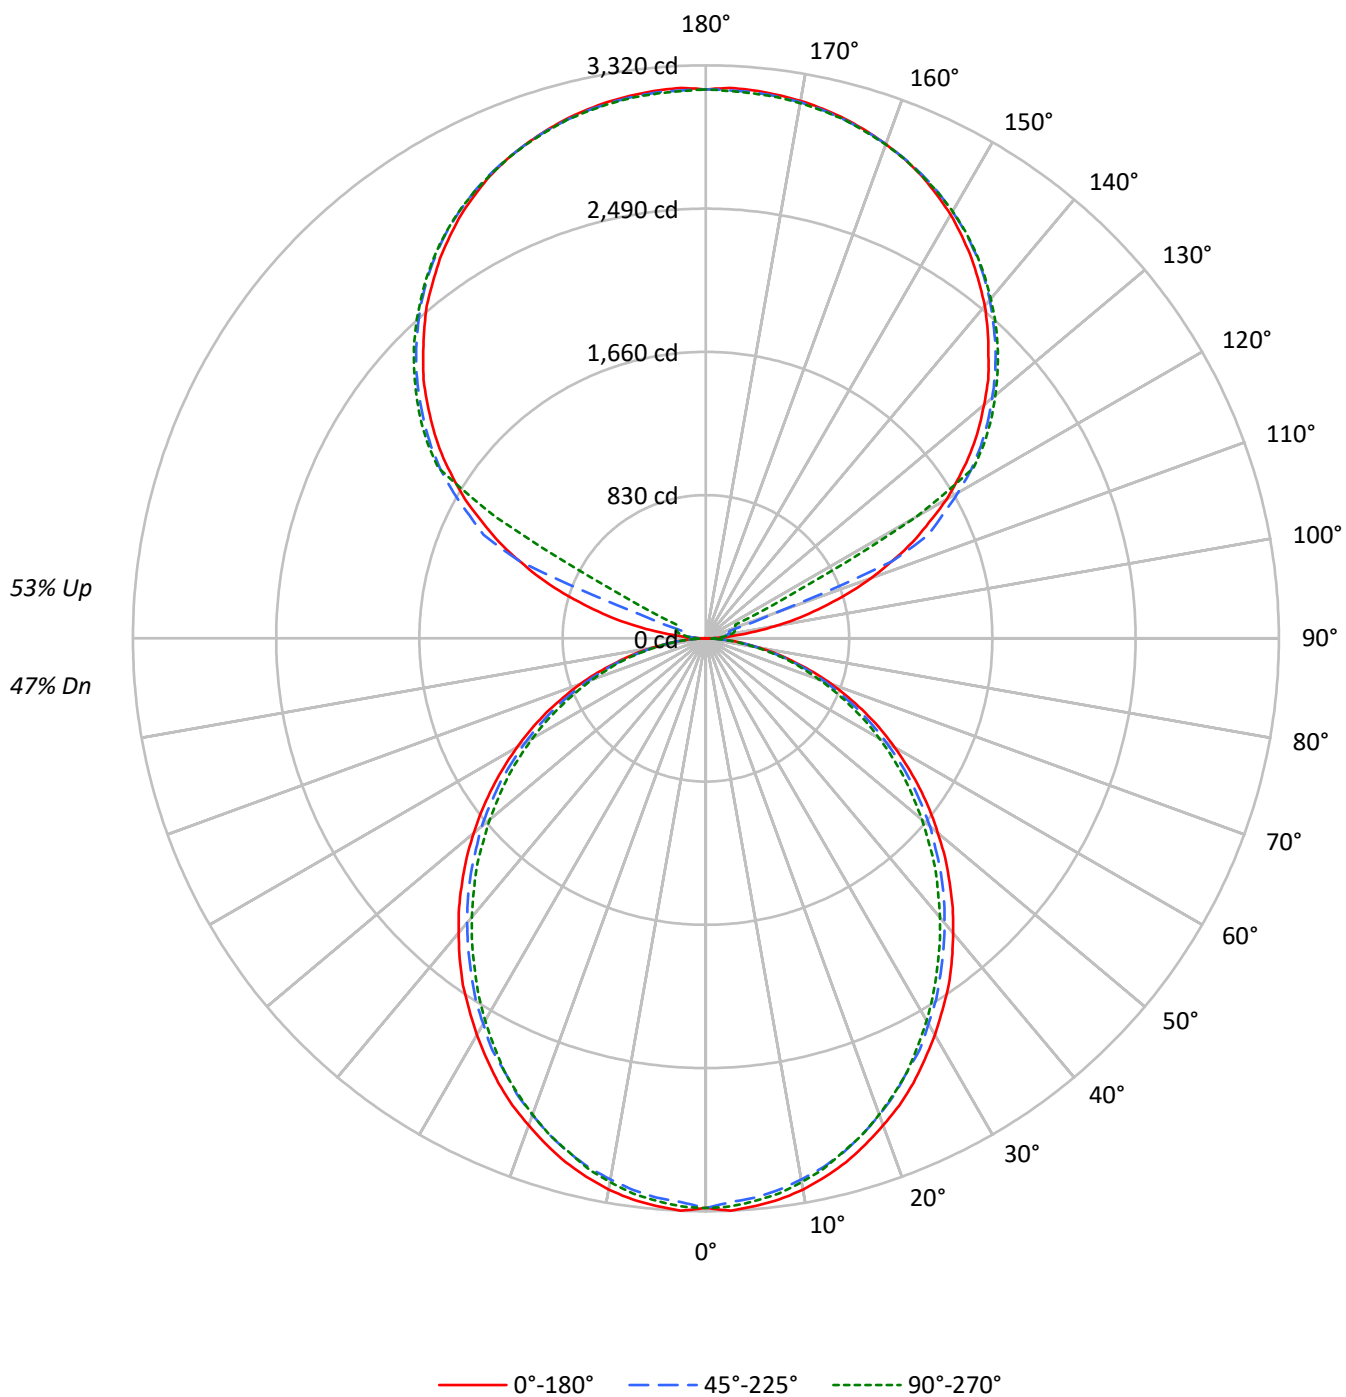

TEST NUMBER: P904747

CATALOG NUMBER: DFN2DIP-TR4F0-090D100US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	67	67	67	54	54	54
1	97	93	89	86	89	86	82	79	72	69	67	59	57	56	47	46	45
2	89	81	75	70	81	75	70	65	63	59	56	52	49	47	42	40	38
3	81	71	64	58	74	66	59	54	55	51	47	46	42	40	37	35	33
4	74	63	55	49	68	58	51	46	49	44	40	41	37	34	33	30	28
5	68	56	48	42	62	52	45	40	44	39	34	37	33	29	30	27	24
6	62	50	42	37	57	47	40	34	40	34	30	33	29	26	27	24	22
7	58	45	38	32	53	42	35	30	36	30	26	30	26	23	25	22	19
8	54	41	34	28	49	38	31	27	33	27	23	28	23	20	23	20	17
9	50	38	30	25	46	35	28	24	30	25	21	25	21	18	21	18	15
10	47	35	27	23	43	32	26	21	28	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2622	2622	2622
5°	2626	2586	2603
10°	2605	2551	2568
15°	2567	2509	2513
20°	2515	2450	2456
25°	2464	2381	2391
30°	2399	2316	2308
35°	2338	2239	2220
40°	2263	2162	2137
45°	2188	2084	2051
50°	2106	2003	1952
55°	2020	1908	1861
60°	1923	1797	1757
65°	1817	1681	1634
70°	1682	1540	1502
75°	1495	1371	1380
80°	1270	1155	1146
85°	919	784	759

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2188 cd/sqm

TEST NUMBER: P904747

CATALOG NUMBER: DFN2DIP-TR4F0-090D100US830-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	310.7	1.8
10°-20°	874.1	4.9
20°-30°	1284.6	7.2
30°-40°	1492.0	8.4
40°-50°	1490.1	8.4
50°-60°	1299.3	7.3
60°-70°	960.5	5.4
70°-80°	543.4	3.1
80°-90°	149.0	0.8
90°-100°	104.9	0.6
100°-110°	391.0	2.2
110°-120°	1037.0	5.8
120°-130°	1720.0	9.7
130°-140°	1827.0	10.3
140°-150°	1698.0	9.6
150°-160°	1365.2	7.7
160°-170°	879.7	5.0
170°-180°	302.8	1.7
0°-30°	2469.3	13.9
0°-40°	3961.3	22.3
0°-60°	6750.7	38.1
0°-90°	8403.7	47.4
90°-120°	1532.9	8.6
90°-150°	6778.0	38.2
90°-180°	9326.0	52.6
0°-180°	17729.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3301	3301	3301	3301	3301	
5°	3301	3288	3253	3278	3272	313
15°	3142	3123	3082	3095	3079	885
25°	2844	2818	2765	2771	2765	1309
35°	2454	2422	2371	2352	2336	1532
45°	1996	1974	1926	1892	1879	1541
55°	1511	1492	1454	1416	1400	1351
65°	1019	1000	968	940	924	1007
75°	533	527	511	492	498	569
85°	130	127	124	114	111	145
90°	2	28	46	58	62	16
95°	150	74	90	101	99	177
105°	700	769	140	166	175	748
115°	1323	1362	1420	354	189	1303
125°	1871	1901	1945	1961	1968	1669
135°	2316	2352	2373	2396	2392	1789
145°	2686	2684	2723	2739	2728	1680
155°	2958	2937	2965	2978	2960	1363
165°	3116	3103	3110	3126	3110	880
175°	3188	3172	3176	3192	3170	303
180°	3181	3181	3181	3181	3181	

TEST NUMBER: P904747

CATALOG NUMBER: DFN2DIP-TR4F0-090D100US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3300.7	3300.7	3300.7	3300.7	3300.7
2.5°	3319.9	3304.1	3269.1	3300.7	3294.7
5°	3300.7	3288.2	3253.3	3278.5	3272.4
7.5°	3278.5	3259.7	3224.6	3250.3	3243.9
10°	3243.9	3221.6	3183.5	3208.8	3199.4
12.5°	3196.0	3177.1	3139.1	3154.9	3148.6
15°	3142.2	3123.3	3081.8	3094.6	3078.8
17.5°	3075.4	3056.6	3015.2	3031.0	3015.2
20°	3002.4	2983.5	2939.0	2948.5	2936.0
22.5°	2929.6	2901.1	2859.6	2859.6	2853.2
25°	2843.7	2818.5	2764.7	2770.7	2764.7
27.5°	2748.5	2726.2	2685.2	2675.8	2659.9
30°	2653.5	2627.9	2580.4	2571.0	2558.2
32.5°	2551.8	2533.0	2482.1	2463.0	2450.1
35°	2453.5	2421.9	2371.0	2351.8	2336.0
37.5°	2342.4	2313.8	2262.9	2240.7	2224.9
40°	2228.2	2202.6	2151.7	2123.5	2110.7
42.5°	2117.0	2091.5	2041.0	2009.0	1990.2
45°	1996.5	1974.3	1926.5	1891.8	1879.1
47.5°	1879.1	1856.8	1805.9	1770.9	1752.1
50°	1755.1	1739.3	1694.8	1650.4	1634.6
52.5°	1634.6	1612.3	1571.2	1536.2	1514.0
55°	1511.0	1491.8	1453.7	1415.7	1399.9
57.5°	1387.0	1371.2	1329.8	1291.8	1278.9
60°	1263.1	1250.7	1206.2	1171.2	1161.8
62.5°	1142.5	1120.3	1088.6	1057.1	1044.2
65°	1019.0	999.8	968.1	939.5	923.7
67.5°	892.0	875.9	847.5	825.4	812.6
70°	774.5	761.7	733.1	710.9	698.4
72.5°	653.9	641.1	625.3	603.1	593.7
75°	533.1	527.0	510.9	492.0	498.4
77.5°	425.3	412.6	406.1	396.7	387.3
80°	317.5	314.1	307.7	298.3	292.0
82.5°	215.8	215.8	212.8	200.0	200.0
85°	130.0	127.0	123.9	114.1	111.1
87.5°	57.2	50.8	44.5	35.1	31.7
90°	2.2	27.6	45.9	57.7	62.0
92.5°	57.7	48.4	55.2	59.9	62.0
95°	149.5	73.5	89.6	101.4	99.0
97.5°	269.2	80.6	117.3	124.3	126.6
100°	407.6	92.1	131.2	149.5	154.2
102.5°	559.2	554.9	135.8	161.0	168.1
105°	699.7	768.8	140.5	165.6	174.9
107.5°	863.2	920.6	145.2	170.3	179.6
110°	1019.7	1067.9	402.8	172.8	181.7

TEST NUMBER: P904747

CATALOG NUMBER: DFN2DIP-TR4F0-090D100US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1167.1	1208.3	1169.3	177.1	184.3
115°	1323.4	1362.5	1420.2	354.5	188.9
117.5°	1459.2	1505.2	1544.5	1215.2	612.3
120°	1611.3	1645.7	1687.2	1714.9	1404.1
122.5°	1740.0	1776.9	1823.1	1836.7	1839.2
125°	1871.2	1901.3	1945.0	1961.1	1967.9
127.5°	1990.9	2023.2	2057.9	2080.9	2083.0
130°	2103.8	2140.7	2165.9	2191.2	2189.1
132.5°	2218.8	2248.9	2274.1	2294.8	2292.6
135°	2315.6	2352.5	2373.0	2396.2	2391.6
137.5°	2416.8	2444.4	2467.6	2490.6	2483.7
140°	2515.6	2534.3	2559.4	2580.2	2568.7
142.5°	2598.8	2614.9	2644.7	2663.0	2651.6
145°	2686.2	2683.8	2722.9	2739.0	2727.5
147.5°	2761.9	2755.1	2794.2	2805.7	2796.7
150°	2835.7	2819.6	2856.6	2870.2	2858.7
152.5°	2897.8	2879.5	2914.0	2927.8	2911.7
155°	2957.7	2937.2	2964.8	2978.4	2960.1
157.5°	3006.1	2987.8	3008.5	3024.6	3006.1
160°	3047.6	3033.7	3047.6	3061.3	3045.2
162.5°	3084.2	3070.5	3082.0	3098.1	3077.4
165°	3116.4	3102.8	3109.6	3125.8	3109.6
167.5°	3141.9	3127.9	3135.1	3151.2	3130.4
170°	3162.6	3148.8	3153.4	3169.5	3148.8
172.5°	3176.3	3162.6	3167.3	3183.4	3162.6
175°	3187.8	3171.7	3176.3	3192.5	3169.5
177.5°	3192.5	3176.3	3178.8	3194.9	3174.1
180°	3181.0	3181.0	3181.0	3181.0	3181.0

TEST NUMBER: P904747

CATALOG NUMBER: DFN2DIP-TR4F0-090D100US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.37	11.21	11.35	12.20	13.51	9.94	10.78	10.92	11.77	13.08
	3H	12.03	12.78	13.02	13.78	15.11	11.56	12.31	12.55	13.31	14.64
	4H	12.62	13.33	13.62	14.33	15.67	12.14	12.85	13.15	13.86	15.20
	6H	13.01	13.67	14.03	14.68	16.03	12.54	13.19	13.55	14.20	15.55
	8H	13.12	13.74	14.14	14.77	16.11	12.64	13.27	13.66	14.29	15.64
	12H	13.17	13.76	14.19	14.78	16.15	12.69	13.28	13.71	14.30	15.67
4H	2H	10.83	11.54	11.84	12.55	13.88	10.49	11.20	11.49	12.20	13.54
	3H	12.69	13.29	13.71	14.32	15.67	12.30	12.89	13.32	13.93	15.28
	4H	13.41	13.95	14.43	14.98	16.35	13.00	13.55	14.03	14.57	15.94
	6H	13.92	14.39	14.96	15.44	16.81	13.51	13.98	14.55	15.03	16.40
	8H	14.07	14.51	15.11	15.55	16.93	13.66	14.09	14.70	15.14	16.52
	12H	14.14	14.54	15.20	15.59	16.98	13.72	14.11	14.78	15.17	16.56
8H	4H	13.60	14.04	14.64	15.08	16.47	13.24	13.68	14.28	14.72	16.11
	6H	14.23	14.59	15.29	15.68	17.06	13.87	14.23	14.93	15.31	16.70
	8H	14.45	14.77	15.52	15.84	17.24	14.08	14.40	15.15	15.47	16.87
	12H	14.58	14.86	15.65	15.93	17.37	14.20	14.48	15.27	15.54	16.98
12H	4H	13.59	13.98	14.64	15.04	16.43	13.23	13.63	14.29	14.69	16.08
	6H	14.26	14.58	15.33	15.65	17.05	13.91	14.23	14.98	15.30	16.70
	8H	14.50	14.78	15.57	15.85	17.29	14.15	14.42	15.22	15.49	16.93

END OF REPORT