

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904762

Luminaire Tested: DFN2DIP-TR4F0-100D050US830-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904762
REPORT IS A COMBINATION OF REPORTS P900399 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D050US830-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13501.9 lumens
Efficiency: N/A
Efficacy: 97.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 138.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904762

CATALOG NUMBER: DFN2DIP-TR4F0-100D050US830-FLLFLL

Luminous Intensity Polar Plot

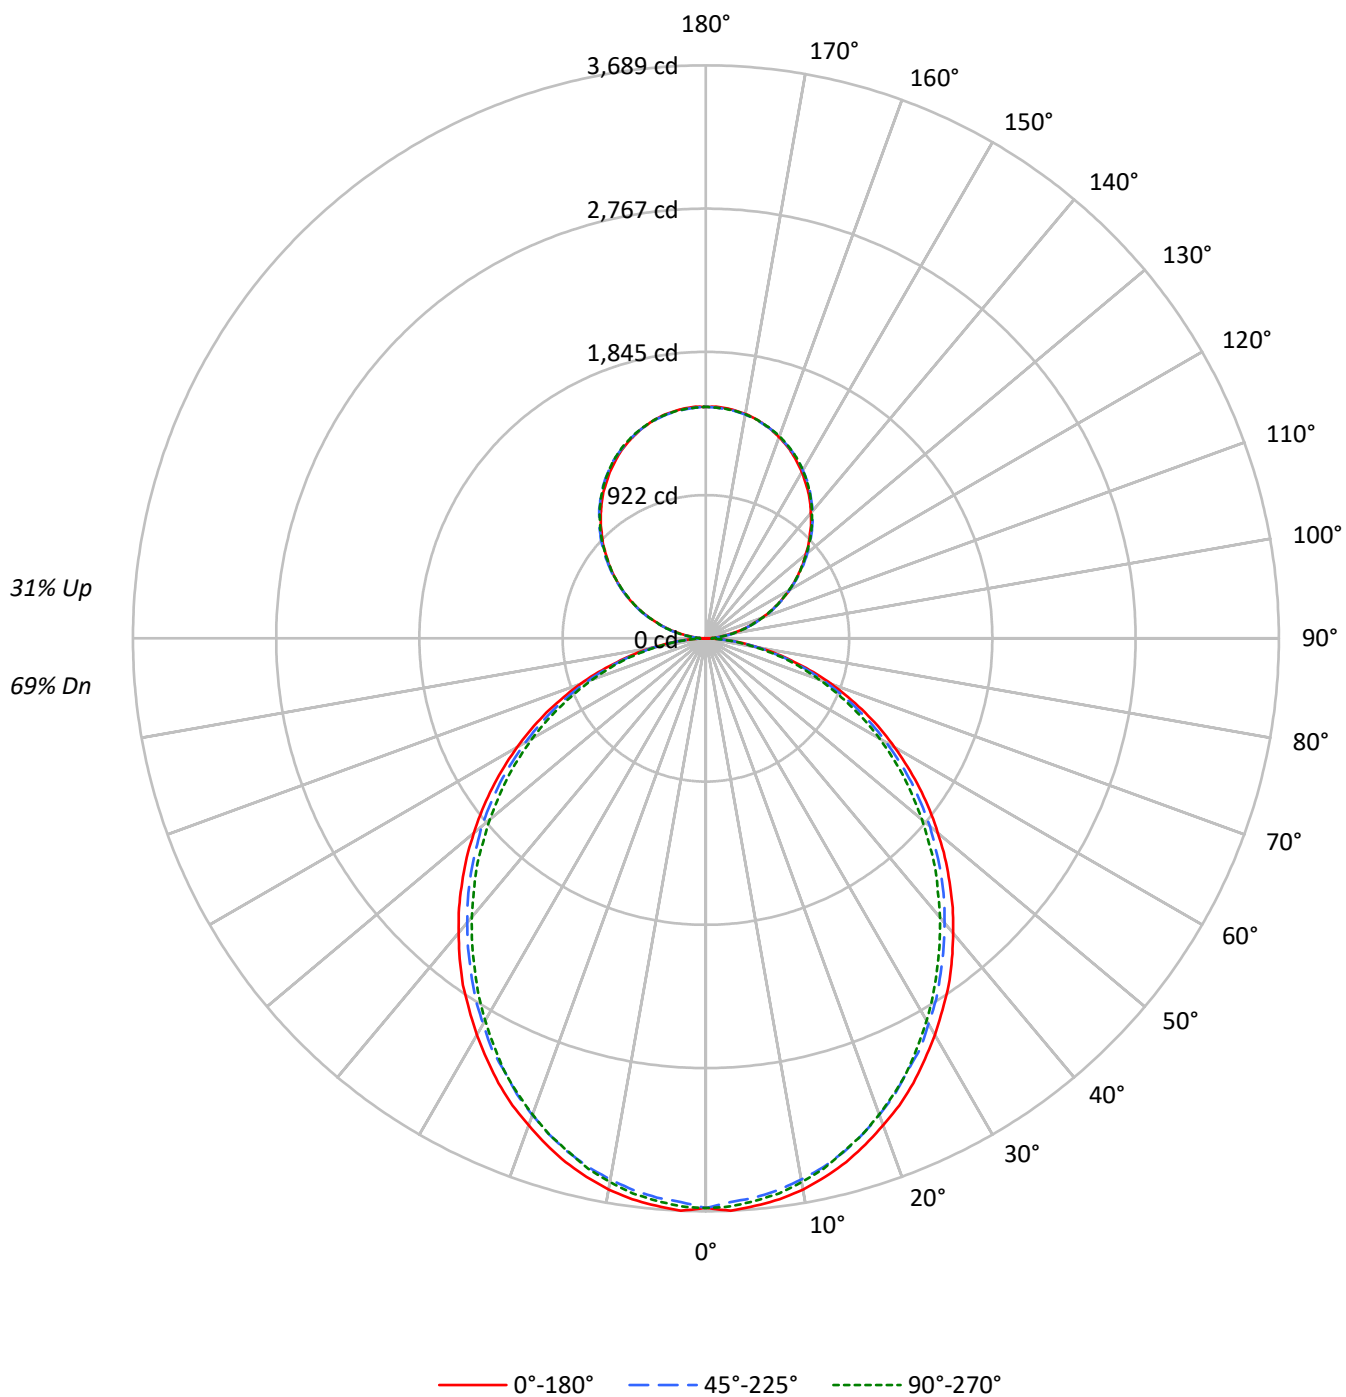

TEST NUMBER: P904762

CATALOG NUMBER: DFN2DIP-TR4F0-100D050US830-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	83	83	83	74	74	74
1	102	98	94	90	96	92	89	86	83	80	77	74	71	70	65	64	62
2	93	85	79	74	88	81	75	70	72	68	64	65	61	58	57	55	52
3	85	75	67	61	80	71	64	59	64	58	54	57	53	49	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	46	42	46	42	39
5	71	59	51	45	67	56	49	43	51	45	40	46	41	37	41	37	34
6	66	53	45	39	62	51	43	38	46	40	35	41	36	32	37	33	30
7	61	48	40	34	58	46	39	33	42	35	31	38	33	29	34	30	26
8	57	44	36	31	54	42	35	30	38	32	28	35	29	26	31	27	24
9	53	40	33	27	50	39	31	26	35	29	25	32	27	23	29	25	21
10	50	37	30	25	47	36	29	24	32	27	22	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2914	2914	2914
5°	2918	2873	2892
10°	2895	2834	2853
15°	2852	2788	2792
20°	2795	2723	2729
25°	2737	2645	2656
30°	2666	2573	2564
35°	2598	2488	2467
40°	2514	2402	2374
45°	2431	2316	2279
50°	2340	2225	2169
55°	2244	2120	2068
60°	2136	1996	1952
65°	2019	1868	1816
70°	1869	1711	1669
75°	1661	1523	1533
80°	1412	1284	1273
85°	1021	871	844

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2431 cd/sqm

TEST NUMBER: P904762

CATALOG NUMBER: DFN2DIP-TR4F0-100D050US830-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	345.2	2.6
10°-20°	971.2	7.2
20°-30°	1427.3	10.6
30°-40°	1657.7	12.3
40°-50°	1655.7	12.3
50°-60°	1443.7	10.7
60°-70°	1067.2	7.9
70°-80°	603.8	4.5
80°-90°	163.6	1.2
90°-100°	92.2	0.7
100°-110°	293.0	2.2
110°-120°	501.5	3.7
120°-130°	659.5	4.9
130°-140°	740.3	5.5
140°-150°	725.9	5.4
150°-160°	609.0	4.5
160°-170°	403.9	3.0
170°-180°	141.2	1.0
0°-30°	2743.7	20.3
0°-40°	4401.4	32.6
0°-60°	7500.8	55.6
0°-90°	9335.4	69.1
90°-120°	886.7	6.6
90°-150°	3012.5	22.3
90°-180°	4167.0	30.9
0°-180°	13501.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3668	3668	3668	3668	3668	
5°	3668	3654	3615	3643	3636	348
15°	3491	3470	3424	3438	3421	983
25°	3160	3132	3072	3078	3072	1454
35°	2726	2691	2634	2613	2596	1702
45°	2218	2194	2140	2102	2088	1712
55°	1679	1658	1615	1573	1555	1501
65°	1132	1111	1076	1044	1026	1119
75°	592	586	568	547	554	632
85°	144	141	138	127	124	161
90°	1	16	44	41	43	13
95°	66	78	80	80	78	73
105°	270	274	277	279	279	285
115°	503	510	508	507	503	498
125°	732	743	740	736	734	654
135°	947	961	963	962	958	732
145°	1149	1158	1166	1167	1162	718
155°	1314	1318	1322	1328	1324	605
165°	1430	1428	1428	1438	1431	403
175°	1488	1484	1482	1490	1483	141
180°	1490	1490	1490	1490	1490	

TEST NUMBER: P904762

CATALOG NUMBER: DFN2DIP-TR4F0-100D050US830-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3667.5	3667.5	3667.5	3667.5	3667.5
2.5°	3688.8	3671.2	3632.3	3667.5	3660.7
5°	3667.5	3653.7	3614.7	3642.8	3636.0
7.5°	3642.8	3621.8	3582.9	3611.4	3604.3
10°	3604.3	3579.6	3537.3	3565.4	3554.9
12.5°	3551.1	3530.2	3487.9	3505.5	3498.3
15°	3491.3	3470.3	3424.3	3438.5	3421.0
17.5°	3417.2	3396.3	3350.2	3367.8	3350.2
20°	3335.9	3315.0	3265.6	3276.1	3262.2
22.5°	3255.2	3223.4	3177.3	3177.3	3170.2
25°	3159.8	3131.7	3071.8	3078.5	3071.8
27.5°	3053.8	3029.1	2983.5	2973.1	2955.4
30°	2948.4	2919.9	2867.1	2856.7	2842.4
32.5°	2835.4	2814.4	2757.9	2736.6	2722.3
35°	2726.1	2691.0	2634.4	2613.1	2595.5
37.5°	2602.6	2570.8	2514.3	2489.6	2472.0
40°	2475.8	2447.3	2390.9	2359.5	2345.2
42.5°	2352.3	2323.8	2267.8	2232.2	2211.3
45°	2218.4	2193.7	2140.5	2102.0	2087.8
47.5°	2087.8	2063.1	2006.6	1967.7	1946.7
50°	1950.1	1932.5	1883.1	1833.7	1816.2
52.5°	1816.2	1791.5	1745.8	1706.9	1682.2
55°	1678.9	1657.6	1615.2	1572.9	1555.4
57.5°	1541.2	1523.5	1477.5	1435.3	1421.1
60°	1403.4	1389.6	1340.2	1301.3	1290.8
62.5°	1269.5	1244.8	1209.7	1174.5	1160.3
65°	1132.2	1110.9	1075.7	1043.9	1026.3
67.5°	991.2	973.2	941.8	917.1	902.9
70°	860.5	846.3	814.5	789.9	776.0
72.5°	726.6	712.4	694.8	670.1	659.6
75°	592.3	585.6	567.6	546.7	553.7
77.5°	472.6	458.4	451.2	440.7	430.3
80°	352.8	349.1	342.0	331.5	324.4
82.5°	239.9	239.9	236.5	222.3	222.3
85°	144.4	141.1	137.7	126.9	123.5
87.5°	63.6	56.5	49.4	38.9	35.2
90°	1.3	16.2	44.0	41.4	42.7
92.5°	27.9	37.7	39.1	40.4	40.4
95°	65.6	78.2	80.4	80.4	78.2
97.5°	109.1	120.8	125.8	125.8	125.8
100°	159.5	169.8	173.4	173.4	172.1
102.5°	212.5	220.2	225.1	226.5	225.1
105°	270.5	274.1	276.8	279.0	279.0
107.5°	328.0	333.4	333.4	334.3	328.0
110°	383.7	391.0	391.0	391.0	387.3



TEST NUMBER: P904762

CATALOG NUMBER: DFN2DIP-TR4F0-100D050US830-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	443.9	451.6	450.3	446.7	443.9
115°	503.2	510.5	508.2	506.9	503.2
117.5°	562.1	572.0	565.7	562.1	558.6
120°	621.4	631.3	621.4	621.4	617.4
122.5°	675.3	688.0	681.6	678.1	675.3
125°	732.0	743.2	739.6	735.6	734.2
127.5°	787.2	801.2	796.3	790.8	787.2
130°	839.0	855.1	852.8	850.2	845.2
132.5°	896.9	909.5	910.4	904.1	900.5
135°	946.8	960.6	963.4	962.1	958.5
137.5°	1002.5	1013.7	1016.0	1015.0	1009.7
140°	1051.4	1062.7	1068.9	1068.9	1064.0
142.5°	1101.7	1113.0	1116.6	1117.9	1113.0
145°	1149.4	1158.4	1165.5	1167.0	1162.0
147.5°	1192.1	1203.3	1208.7	1211.0	1206.0
150°	1236.1	1243.8	1248.7	1252.7	1248.7
152.5°	1275.3	1282.9	1289.1	1294.1	1289.1
155°	1314.3	1317.9	1321.9	1328.2	1324.2
157.5°	1348.0	1350.7	1352.9	1362.0	1355.7
160°	1378.1	1380.8	1382.1	1389.8	1384.4
162.5°	1406.0	1406.0	1407.3	1415.9	1409.6
165°	1429.8	1428.4	1428.4	1437.5	1431.2
167.5°	1451.3	1447.3	1447.3	1456.3	1450.0
170°	1467.5	1464.0	1462.6	1471.6	1464.0
172.5°	1478.8	1475.2	1473.9	1482.8	1475.2
175°	1487.8	1484.1	1481.5	1490.4	1482.8
177.5°	1492.7	1489.1	1486.4	1494.0	1486.4
180°	1490.4	1490.4	1490.4	1490.4	1490.4

TEST NUMBER: P904762

CATALOG NUMBER: DFN2DIP-TR4F0-100D050US830-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.58	13.65	13.36	14.44	15.41	12.15	13.22	12.93	14.01	14.98
	3H	14.26	15.22	15.05	16.02	17.02	13.79	14.74	14.57	15.55	16.55
	4H	14.86	15.76	15.66	16.57	17.58	14.38	15.29	15.19	16.10	17.11
	6H	15.27	16.10	16.08	16.92	17.95	14.79	15.62	15.61	16.45	17.47
	8H	15.38	16.17	16.20	17.01	18.04	14.90	15.70	15.73	16.54	17.56
	12H	15.43	16.19	16.26	17.02	18.07	14.95	15.71	15.78	16.54	17.59
4H	2H	13.07	13.97	13.88	14.79	15.80	12.73	13.63	13.53	14.44	15.45
	3H	14.95	15.71	15.77	16.56	17.58	14.56	15.32	15.38	16.16	17.19
	4H	15.68	16.36	16.51	17.21	18.26	15.27	15.96	16.11	16.80	17.86
	6H	16.20	16.80	17.05	17.67	18.73	15.79	16.39	16.64	17.26	18.32
	8H	16.36	16.91	17.21	17.78	18.85	15.95	16.50	16.80	17.37	18.44
	12H	16.44	16.94	17.31	17.83	18.90	16.02	16.52	16.89	17.41	18.48
8H	4H	15.89	16.45	16.74	17.31	18.38	15.53	16.09	16.38	16.95	18.02
	6H	16.53	16.99	17.41	17.90	18.97	16.17	16.63	17.05	17.53	18.61
	8H	16.75	17.16	17.64	18.06	19.15	16.38	16.79	17.28	17.69	18.78
	12H	16.89	17.25	17.79	18.15	19.29	16.51	16.87	17.40	17.76	18.90
12H	4H	15.89	16.39	16.76	17.27	18.35	15.53	16.03	16.41	16.92	18.00
	6H	16.56	16.97	17.45	17.87	18.96	16.21	16.62	17.10	17.52	18.61
	8H	16.81	17.17	17.71	18.07	19.21	16.46	16.82	17.35	17.71	18.85

END OF REPORT