

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904784

Luminaire Tested: DFN2DIP-TR4F0-100D100US830-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904784
REPORT IS A COMBINATION OF REPORTS P900490 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D100US830-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16353.1 lumens
Efficiency: N/A
Efficacy: 92.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 177.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904784

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US830-RLLFLL

Luminous Intensity Polar Plot

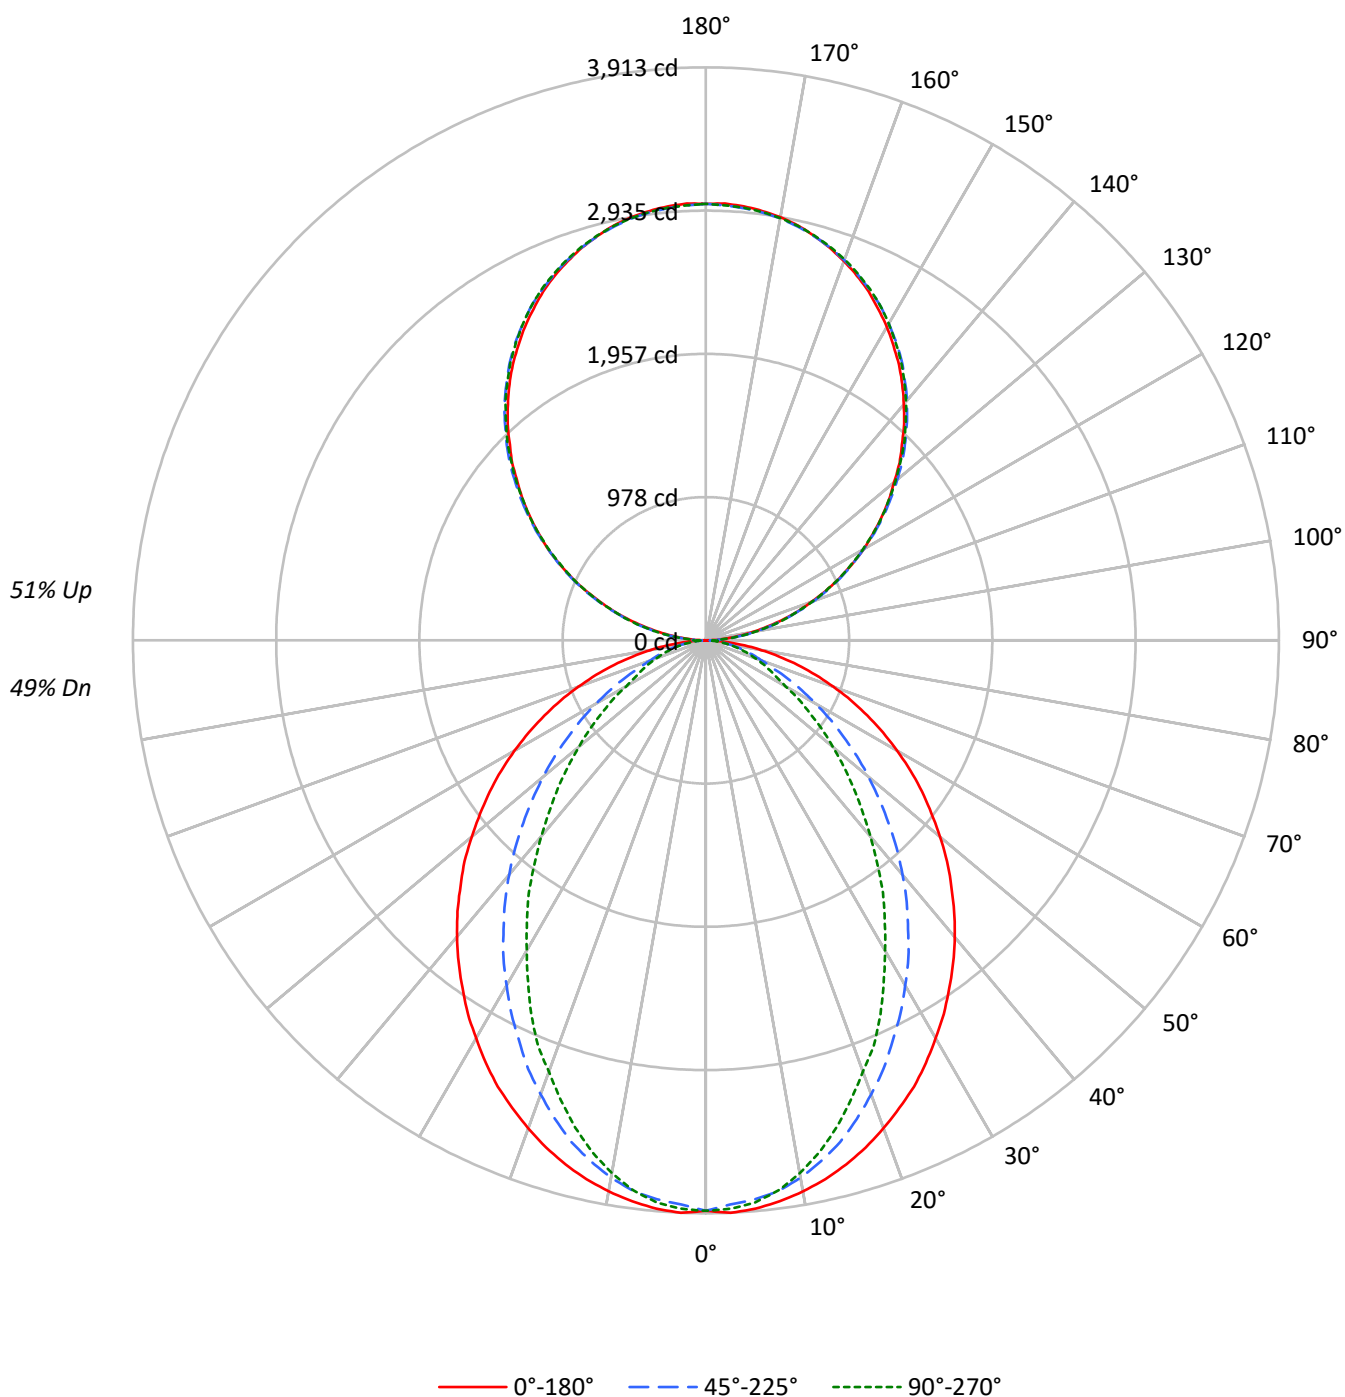

TEST NUMBER: P904784

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US830-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3095	3095	3095
5°	3100	3046	3065
10°	3069	2986	2965
15°	3027	2887	2811
20°	2971	2751	2622
25°	2914	2598	2439
30°	2837	2442	2207
35°	2762	2274	2003
40°	2685	2100	1770
45°	2596	1907	1559
50°	2504	1712	1352
55°	2408	1504	1153
60°	2297	1286	949
65°	2169	1065	854
70°	2014	859	773
75°	1819	757	703
80°	1537	635	609
85°	1071	423	457

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2596 cd/sqm

TEST NUMBER: P904784

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US830-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	365.1	2.2
10°-20°	1002.2	6.1
20°-30°	1407.1	8.6
30°-40°	1533.9	9.4
40°-50°	1409.8	8.6
50°-60°	1107.2	6.8
60°-70°	720.7	4.4
70°-80°	371.0	2.3
80°-90°	103.2	0.6
90°-100°	184.5	1.1
100°-110°	586.1	3.6
110°-120°	1003.0	6.1
120°-130°	1319.1	8.1
130°-140°	1480.6	9.1
140°-150°	1451.9	8.9
150°-160°	1217.9	7.4
160°-170°	807.7	4.9
170°-180°	282.3	1.7
0°-30°	2774.5	17.0
0°-40°	4308.3	26.3
0°-60°	6825.3	41.7
0°-90°	8020.0	49.0
90°-120°	1773.5	10.8
90°-150°	6025.1	36.8
90°-180°	8333.0	51.0
0°-180°	16353.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3896	3896	3896	3896	3896	
5°	3896	3878	3832	3864	3853	369
15°	3705	3666	3546	3480	3444	1044
25°	3363	3250	3018	2873	2820	1547
35°	2898	2718	2408	2186	2108	1814
45°	2369	2133	1763	1512	1428	1830
55°	1801	1526	1146	934	867	1610
65°	1216	931	613	494	483	1206
75°	649	402	282	257	254	686
85°	152	77	67	67	67	174
90°	3	32	88	83	85	16
95°	131	156	161	161	156	146
105°	541	548	554	558	558	571
115°	1006	1021	1016	1014	1006	996
125°	1464	1486	1479	1471	1468	1308
135°	1894	1921	1927	1924	1917	1464
145°	2299	2317	2331	2334	2324	1436
155°	2629	2636	2644	2656	2648	1210
165°	2860	2857	2857	2875	2862	807
175°	2976	2968	2963	2981	2966	283
180°	2981	2981	2981	2981	2981	

TEST NUMBER: P904784

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US830-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3895.5	3895.5	3895.5	3895.5	3895.5
2.5°	3913.1	3895.5	3856.6	3892.1	3885.1
5°	3895.5	3877.9	3831.9	3863.8	3853.2
7.5°	3863.8	3842.7	3793.4	3807.2	3789.7
10°	3821.4	3796.7	3726.4	3715.6	3694.7
12.5°	3768.8	3736.9	3641.5	3620.6	3581.7
15°	3705.1	3666.2	3546.5	3479.6	3444.4
17.5°	3631.0	3574.6	3426.5	3349.0	3292.6
20°	3546.5	3475.8	3299.7	3211.8	3134.0
22.5°	3454.9	3373.7	3169.1	3049.5	2996.7
25°	3363.3	3250.4	3017.6	2873.2	2820.2
27.5°	3254.0	3134.0	2876.6	2710.9	2629.8
30°	3137.7	3003.4	2721.4	2541.9	2446.6
32.5°	3024.8	2862.4	2573.7	2362.0	2273.7
35°	2897.9	2718.1	2408.0	2185.8	2108.0
37.5°	2774.6	2580.4	2252.8	2009.3	1921.4
40°	2644.0	2432.7	2090.5	1840.2	1748.6
42.5°	2510.1	2284.5	1928.5	1667.5	1579.5
45°	2369.1	2132.7	1762.8	1512.2	1427.7
47.5°	2235.2	1985.0	1604.2	1353.6	1276.2
50°	2087.1	1836.8	1449.0	1205.5	1131.8
52.5°	1942.3	1677.9	1300.9	1068.2	1001.3
55°	1801.3	1526.4	1145.7	934.3	867.3
57.5°	1657.0	1374.9	1008.4	810.9	754.4
60°	1508.8	1226.8	863.7	684.1	627.6
62.5°	1364.4	1082.4	740.2	571.2	543.1
65°	1216.4	930.6	613.4	493.7	482.9
67.5°	1075.3	789.6	493.7	433.5	423.0
70°	927.2	652.3	408.8	373.6	359.5
72.5°	786.2	525.1	341.9	313.8	306.7
75°	648.6	401.7	282.0	257.3	253.9
77.5°	511.3	285.4	222.2	207.9	200.9
80°	384.1	204.6	169.1	155.2	155.2
82.5°	267.8	137.6	116.3	109.2	109.2
85°	151.5	77.4	66.9	66.9	66.9
87.5°	56.5	28.1	28.1	24.7	24.7
90°	2.7	32.3	88.0	82.7	85.4
92.5°	55.7	75.5	78.2	80.9	80.9
95°	131.2	156.4	160.9	160.9	156.4
97.5°	218.4	241.8	251.7	251.7	251.7
100°	319.1	339.7	346.9	346.9	344.2
102.5°	425.1	440.4	450.3	452.9	450.3
105°	541.0	548.2	553.6	558.1	558.1
107.5°	656.0	666.8	666.8	668.6	656.0
110°	767.5	781.8	781.8	781.8	774.7

TEST NUMBER: P904784

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US830-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	887.9	903.1	900.5	893.2	887.9
115°	1006.5	1020.9	1016.4	1013.7	1006.5
117.5°	1124.3	1144.1	1131.4	1124.3	1117.0
120°	1242.8	1262.6	1242.8	1242.8	1234.8
122.5°	1350.7	1375.8	1363.3	1356.1	1350.7
125°	1464.0	1486.4	1479.2	1471.1	1468.5
127.5°	1574.5	1602.3	1592.4	1581.7	1574.5
130°	1677.8	1710.1	1705.7	1700.3	1690.4
132.5°	1793.8	1818.9	1820.7	1808.2	1800.9
135°	1893.5	1921.4	1926.7	1924.1	1916.8
137.5°	2005.0	2027.4	2031.9	2030.1	2019.3
140°	2102.9	2125.3	2138.0	2138.0	2128.1
142.5°	2203.6	2226.0	2233.2	2235.9	2226.0
145°	2298.8	2316.8	2331.2	2333.8	2323.9
147.5°	2384.2	2406.7	2417.4	2422.0	2412.1
150°	2472.3	2487.6	2497.5	2505.5	2497.5
152.5°	2550.4	2565.7	2578.3	2588.2	2578.3
155°	2628.7	2635.8	2643.9	2656.5	2648.4
157.5°	2696.0	2701.4	2705.9	2723.9	2711.3
160°	2756.3	2761.6	2764.3	2779.6	2768.8
162.5°	2812.0	2812.0	2814.6	2831.7	2819.1
165°	2859.6	2856.8	2856.8	2874.8	2862.3
167.5°	2902.7	2894.6	2894.6	2912.6	2900.0
170°	2935.1	2927.9	2925.2	2943.2	2927.9
172.5°	2957.5	2950.3	2947.6	2965.6	2950.3
175°	2975.5	2968.3	2963.0	2980.9	2965.6
177.5°	2985.4	2978.2	2972.8	2988.0	2972.8
180°	2980.9	2980.9	2980.9	2980.9	2980.9

TEST NUMBER: P904784

CATALOG NUMBER: DFN2DIP-TR4F0-100D100US830-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.97	11.80	11.95	12.78	14.07	6.95	7.77	7.92	8.75	10.04
	3H	12.65	13.39	13.63	14.38	15.69	8.14	8.87	9.12	9.86	11.17
	4H	13.26	13.96	14.26	14.95	16.27	8.59	9.28	9.58	10.28	11.60
	6H	13.68	14.32	14.69	15.32	16.65	8.91	9.55	9.92	10.55	11.88
	8H	13.81	14.42	14.82	15.43	16.76	9.00	9.61	10.01	10.62	11.95
	12H	13.87	14.45	14.89	15.46	16.81	9.04	9.62	10.06	10.63	11.98
4H	2H	10.99	11.69	11.99	12.68	14.00	7.54	8.24	8.55	9.23	10.55
	3H	12.82	13.40	13.83	14.42	15.75	8.89	9.47	9.90	10.49	11.83
	4H	13.51	14.04	14.53	15.06	16.41	9.44	9.97	10.46	10.99	12.34
	6H	14.03	14.48	15.06	15.52	16.87	9.86	10.31	10.89	11.35	12.71
	8H	14.20	14.63	15.23	15.66	17.02	9.99	10.41	11.02	11.45	12.81
	12H	14.30	14.68	15.34	15.73	17.10	10.06	10.44	11.10	11.48	12.86
8H	4H	13.48	13.90	14.51	14.94	16.30	9.72	10.14	10.75	11.18	12.54
	6H	14.05	14.40	15.10	15.47	16.83	10.24	10.59	11.29	11.66	13.03
	8H	14.26	14.57	15.32	15.63	17.01	10.43	10.74	11.49	11.80	13.18
	12H	14.40	14.67	15.46	15.72	17.15	10.55	10.82	11.62	11.88	13.30
12H	4H	13.43	13.81	14.48	14.86	16.23	9.73	10.11	10.77	11.15	12.53
	6H	14.02	14.33	15.08	15.39	16.77	10.29	10.60	11.35	11.66	13.04
	8H	14.24	14.51	15.31	15.57	16.99	10.50	10.77	11.56	11.82	13.25