

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P904807

Luminaire Tested: DFN2DIP-TR4F0-110D070US830-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P904807
REPORT IS A COMBINATION OF REPORTS P901957 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-110D070US830-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16796.0 lumens
Efficiency: N/A
Efficacy: 101.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 164.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9613
Total Harmonic Distortion (THDi): 0.083
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P904807

CATALOG NUMBER: DFN2DIP-TR4F0-110D070US830-FLLONL

Luminous Intensity Polar Plot

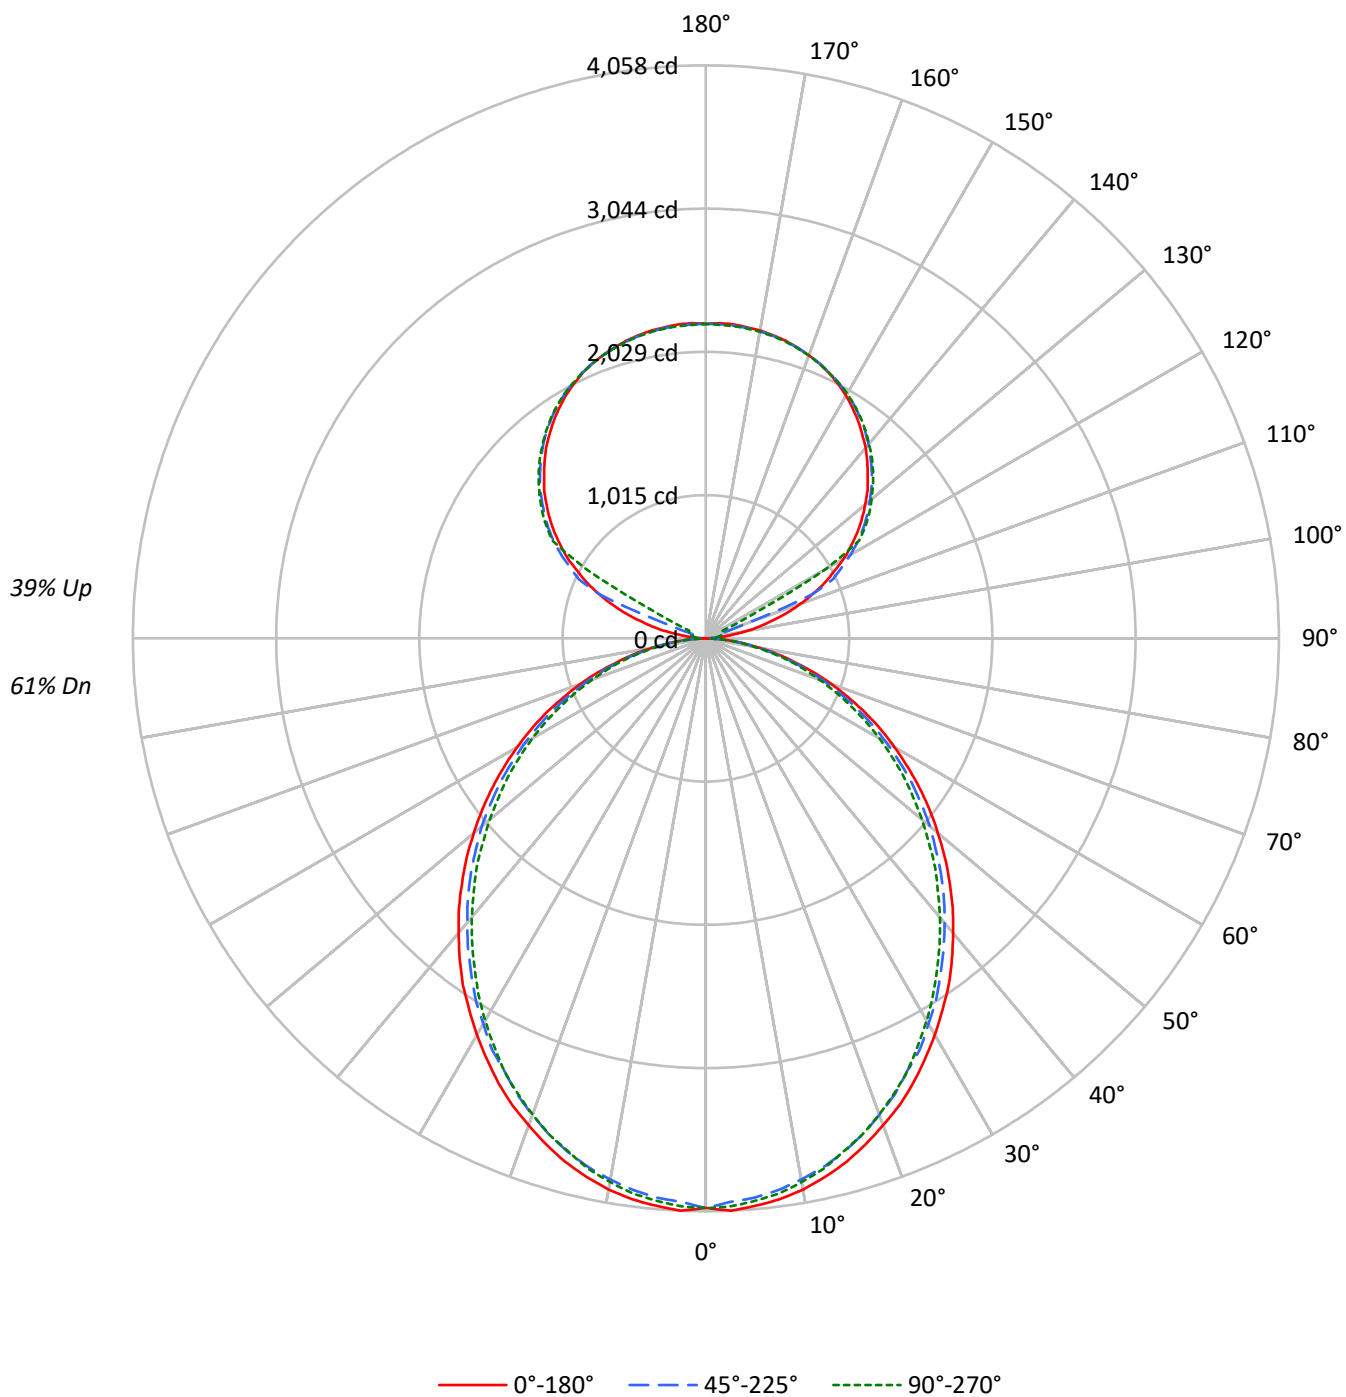

TEST NUMBER: P904807

CATALOG NUMBER: DFN2DIP-TR4F0-110D070US830-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	90	90	90	77	77	77	66	66	66
1	100	96	92	88	94	90	86	83	79	76	74	68	66	65	59	57	56
2	91	84	77	72	85	79	73	68	69	65	61	60	57	54	52	49	47
3	83	74	66	60	78	69	63	57	61	56	51	53	49	46	46	43	40
4	76	65	57	51	71	61	54	49	54	48	44	47	43	39	41	38	35
5	70	58	50	44	65	55	47	42	48	42	38	42	38	34	37	33	30
6	65	52	44	38	60	49	42	36	44	38	33	38	34	30	34	30	27
7	60	47	39	33	56	45	37	32	40	34	29	35	30	26	31	27	24
8	56	43	35	30	52	41	33	28	36	30	26	32	27	24	28	24	21
9	52	39	32	27	48	37	30	25	33	27	23	30	25	21	26	22	19
10	48	36	29	24	45	34	28	23	31	25	21	27	23	19	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3205	3205	3205
5°	3210	3160	3182
10°	3184	3118	3138
15°	3137	3066	3071
20°	3074	2995	3002
25°	3011	2910	2922
30°	2932	2830	2821
35°	2858	2737	2713
40°	2766	2642	2611
45°	2674	2547	2507
50°	2574	2448	2386
55°	2469	2333	2275
60°	2350	2196	2147
65°	2221	2055	1997
70°	2056	1882	1836
75°	1827	1675	1686
80°	1553	1413	1401
85°	1124	959	928

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2674 cd/sqm

TEST NUMBER: P904807

CATALOG NUMBER: DFN2DIP-TR4F0-110D070US830-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	379.7	2.3
10°-20°	1068.3	6.4
20°-30°	1570.0	9.3
30°-40°	1823.5	10.9
40°-50°	1821.2	10.8
50°-60°	1588.0	9.5
60°-70°	1173.9	7.0
70°-80°	664.2	4.0
80°-90°	179.2	1.1
90°-100°	73.4	0.4
100°-110°	273.7	1.6
110°-120°	725.9	4.3
120°-130°	1204.0	7.2
130°-140°	1278.9	7.6
140°-150°	1188.6	7.1
150°-160°	955.6	5.7
160°-170°	615.8	3.7
170°-180°	211.9	1.3
0°-30°	3018.1	18.0
0°-40°	4841.6	28.8
0°-60°	8250.9	49.1
0°-90°	10268.2	61.1
90°-120°	1073.0	6.4
90°-150°	4744.6	28.2
90°-180°	6528.0	38.9
0°-180°	16796.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4034	4034	4034	4034	4034	
5°	4034	4019	3976	4007	4000	383
15°	3840	3817	3767	3782	3763	1082
25°	3476	3445	3379	3386	3379	1599
35°	2999	2960	2898	2874	2855	1873
45°	2440	2413	2355	2312	2297	1883
55°	1847	1823	1777	1730	1711	1651
65°	1245	1222	1183	1148	1129	1231
75°	652	644	624	601	609	696
85°	159	155	152	140	136	177
90°	2	19	32	40	44	16
95°	105	52	63	71	69	124
105°	490	538	98	116	122	523
115°	926	954	994	248	132	912
125°	1310	1331	1362	1373	1378	1168
135°	1621	1647	1661	1677	1674	1252
145°	1880	1879	1906	1917	1909	1176
155°	2070	2056	2075	2085	2072	954
165°	2182	2172	2177	2188	2177	616
175°	2232	2220	2224	2235	2219	212
180°	2227	2227	2227	2227	2227	

TEST NUMBER: P904807

CATALOG NUMBER: DFN2DIP-TR4F0-110D070US830-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4034.3	4034.3	4034.3	4034.3	4034.3
2.5°	4057.6	4038.3	3995.5	4034.3	4026.8
5°	4034.3	4019.0	3976.2	4007.0	3999.7
7.5°	4007.0	3984.0	3941.2	3972.5	3964.7
10°	3964.7	3937.5	3891.0	3921.8	3910.3
12.5°	3906.3	3883.2	3836.7	3856.0	3848.2
15°	3840.4	3817.3	3766.7	3782.3	3763.0
17.5°	3758.9	3735.9	3685.2	3704.6	3685.2
20°	3669.6	3646.5	3592.2	3603.7	3588.5
22.5°	3580.7	3545.7	3495.0	3495.0	3487.2
25°	3475.7	3444.9	3379.0	3386.5	3379.0
27.5°	3359.2	3332.1	3281.8	3270.3	3251.0
30°	3243.2	3211.9	3153.8	3142.3	3126.7
32.5°	3118.9	3095.9	3033.7	3010.2	2994.6
35°	2998.7	2960.1	2897.8	2874.4	2855.1
37.5°	2862.9	2827.9	2765.8	2738.6	2719.2
40°	2723.4	2692.1	2630.0	2595.4	2579.7
42.5°	2587.6	2556.3	2494.5	2455.4	2432.4
45°	2440.2	2413.0	2354.6	2312.2	2296.6
47.5°	2296.6	2269.5	2207.2	2164.5	2141.4
50°	2145.1	2125.8	2071.4	2017.1	1997.8
52.5°	1997.8	1970.6	1920.4	1877.5	1850.4
55°	1846.7	1823.3	1776.8	1730.2	1710.9
57.5°	1695.3	1675.9	1625.3	1578.8	1563.1
60°	1543.8	1528.6	1474.2	1431.4	1419.9
62.5°	1396.5	1369.3	1330.6	1291.9	1276.3
65°	1245.4	1221.9	1183.3	1148.3	1129.0
67.5°	1090.2	1070.5	1035.9	1008.8	993.2
70°	946.6	930.9	896.0	868.8	853.6
72.5°	799.3	783.6	764.3	737.2	725.6
75°	651.5	644.1	624.3	601.3	609.2
77.5°	519.8	504.2	496.3	484.8	473.3
80°	388.1	384.0	376.2	364.7	356.8
82.5°	263.8	263.8	260.1	244.5	244.5
85°	158.9	155.1	151.5	139.5	135.8
87.5°	69.9	62.1	54.3	42.8	38.6
90°	1.5	19.3	32.1	40.3	43.5
92.5°	40.3	33.8	38.6	41.9	43.5
95°	104.6	51.5	62.8	71.0	69.3
97.5°	188.4	56.5	82.1	87.1	88.6
100°	285.3	64.5	91.8	104.6	107.9
102.5°	391.4	388.4	95.1	112.7	117.6
105°	489.8	538.2	98.3	115.9	122.4
107.5°	604.2	644.4	101.6	119.2	125.7
110°	713.9	747.5	282.0	120.9	127.2

TEST NUMBER: P904807

CATALOG NUMBER: DFN2DIP-TR4F0-110D070US830-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	817.0	845.8	818.5	123.9	128.9
115°	926.4	953.8	994.1	248.2	132.2
117.5°	1021.5	1053.7	1081.2	850.6	428.6
120°	1127.8	1152.0	1181.1	1200.4	982.9
122.5°	1218.0	1243.8	1276.2	1285.7	1287.4
125°	1309.9	1330.9	1361.5	1372.8	1377.5
127.5°	1393.6	1416.2	1440.5	1456.6	1458.1
130°	1472.6	1498.5	1516.1	1533.9	1532.4
132.5°	1553.2	1574.2	1591.9	1606.4	1604.9
135°	1620.9	1646.7	1661.1	1677.3	1674.1
137.5°	1691.7	1711.1	1727.3	1743.4	1738.6
140°	1761.0	1774.0	1791.6	1806.1	1798.1
142.5°	1819.1	1830.4	1851.2	1864.1	1856.1
145°	1880.4	1878.7	1906.0	1917.3	1909.3
147.5°	1933.3	1928.6	1956.0	1964.0	1957.7
150°	1985.0	1973.8	1999.6	2009.1	2001.1
152.5°	2028.4	2015.6	2039.8	2049.5	2038.2
155°	2070.4	2056.0	2075.3	2084.9	2072.1
157.5°	2104.2	2091.4	2105.9	2117.2	2104.2
160°	2133.4	2123.5	2133.4	2142.9	2131.6
162.5°	2159.0	2149.4	2157.4	2168.7	2154.2
165°	2181.5	2172.0	2176.7	2188.0	2176.7
167.5°	2199.3	2189.5	2194.5	2205.8	2191.3
170°	2213.8	2204.1	2207.3	2218.7	2204.1
172.5°	2223.5	2213.8	2217.1	2228.4	2213.8
175°	2231.5	2220.2	2223.5	2234.7	2218.7
177.5°	2234.7	2223.5	2225.2	2236.5	2221.9
180°	2226.7	2226.7	2226.7	2226.7	2226.7

TEST NUMBER: P904807

CATALOG NUMBER: DFN2DIP-TR4F0-110D070US830-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.28	13.25	13.14	14.13	15.23	11.85	12.82	12.71	13.70	14.80
	3H	13.95	14.82	14.82	15.71	16.84	13.48	14.35	14.35	15.24	16.36
	4H	14.54	15.37	15.43	16.26	17.40	14.07	14.89	14.95	15.79	16.93
	6H	14.95	15.71	15.84	16.61	17.76	14.47	15.23	15.37	16.13	17.28
	8H	15.06	15.78	15.96	16.70	17.85	14.58	15.30	15.48	16.22	17.37
	12H	15.11	15.80	16.02	16.71	17.89	14.63	15.32	15.54	16.23	17.41
4H	2H	12.76	13.58	13.65	14.47	15.61	12.41	13.24	13.30	14.13	15.27
	3H	14.63	15.32	15.53	16.24	17.40	14.24	14.93	15.14	15.85	17.01
	4H	15.35	15.98	16.26	16.90	18.08	14.95	15.57	15.86	16.49	17.67
	6H	15.87	16.41	16.80	17.36	18.54	15.46	16.00	16.39	16.95	18.13
	8H	16.02	16.53	16.95	17.47	18.66	15.61	16.12	16.54	17.06	18.25
	12H	16.10	16.56	17.05	17.52	18.72	15.68	16.14	16.63	17.09	18.29
8H	4H	15.56	16.06	16.48	17.00	18.20	15.20	15.70	16.12	16.64	17.84
	6H	16.19	16.61	17.15	17.59	18.79	15.83	16.25	16.78	17.23	18.42
	8H	16.41	16.78	17.38	17.75	18.97	16.05	16.42	17.01	17.39	18.60
	12H	16.55	16.88	17.52	17.84	19.10	16.17	16.49	17.13	17.46	18.72
12H	4H	15.55	16.00	16.49	16.96	18.16	15.20	15.65	16.14	16.61	17.81
	6H	16.22	16.59	17.19	17.56	18.78	15.87	16.24	16.84	17.21	18.43
	8H	16.47	16.80	17.44	17.76	19.02	16.11	16.44	17.08	17.40	18.66

END OF REPORT