

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907315

Luminaire Tested: DFN2DIP-TR4F0-050D060US835-FLONL

Issue Date: 11/21/2024

**Test Information**


Test Method: LM-79-2019  
Report Number: P907315  
REPORT IS A COMBINATION OF REPORTS P901927 AND P898849  
Test Lab: INNOVATION CENTER  
Issue Date: 11/21/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: NEO-RAY  
Catalog Number: DFN2DIP-TR4F0-050D060US835-FLLONL  
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 10890.0 lumens  
Efficiency: N/A  
Efficacy: 125.6 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29  
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')  
CIE Type: General Diffuse  
  
Input Watts (W): 86.7  
Input Voltage (V):  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: 0.996  
Total Harmonic Distortion (THDi): 0.064  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P907315  
CATALOG NUMBER: DFN2DIP-TR4F0-050D060US835-FLLONL

### Luminous Intensity Polar Plot

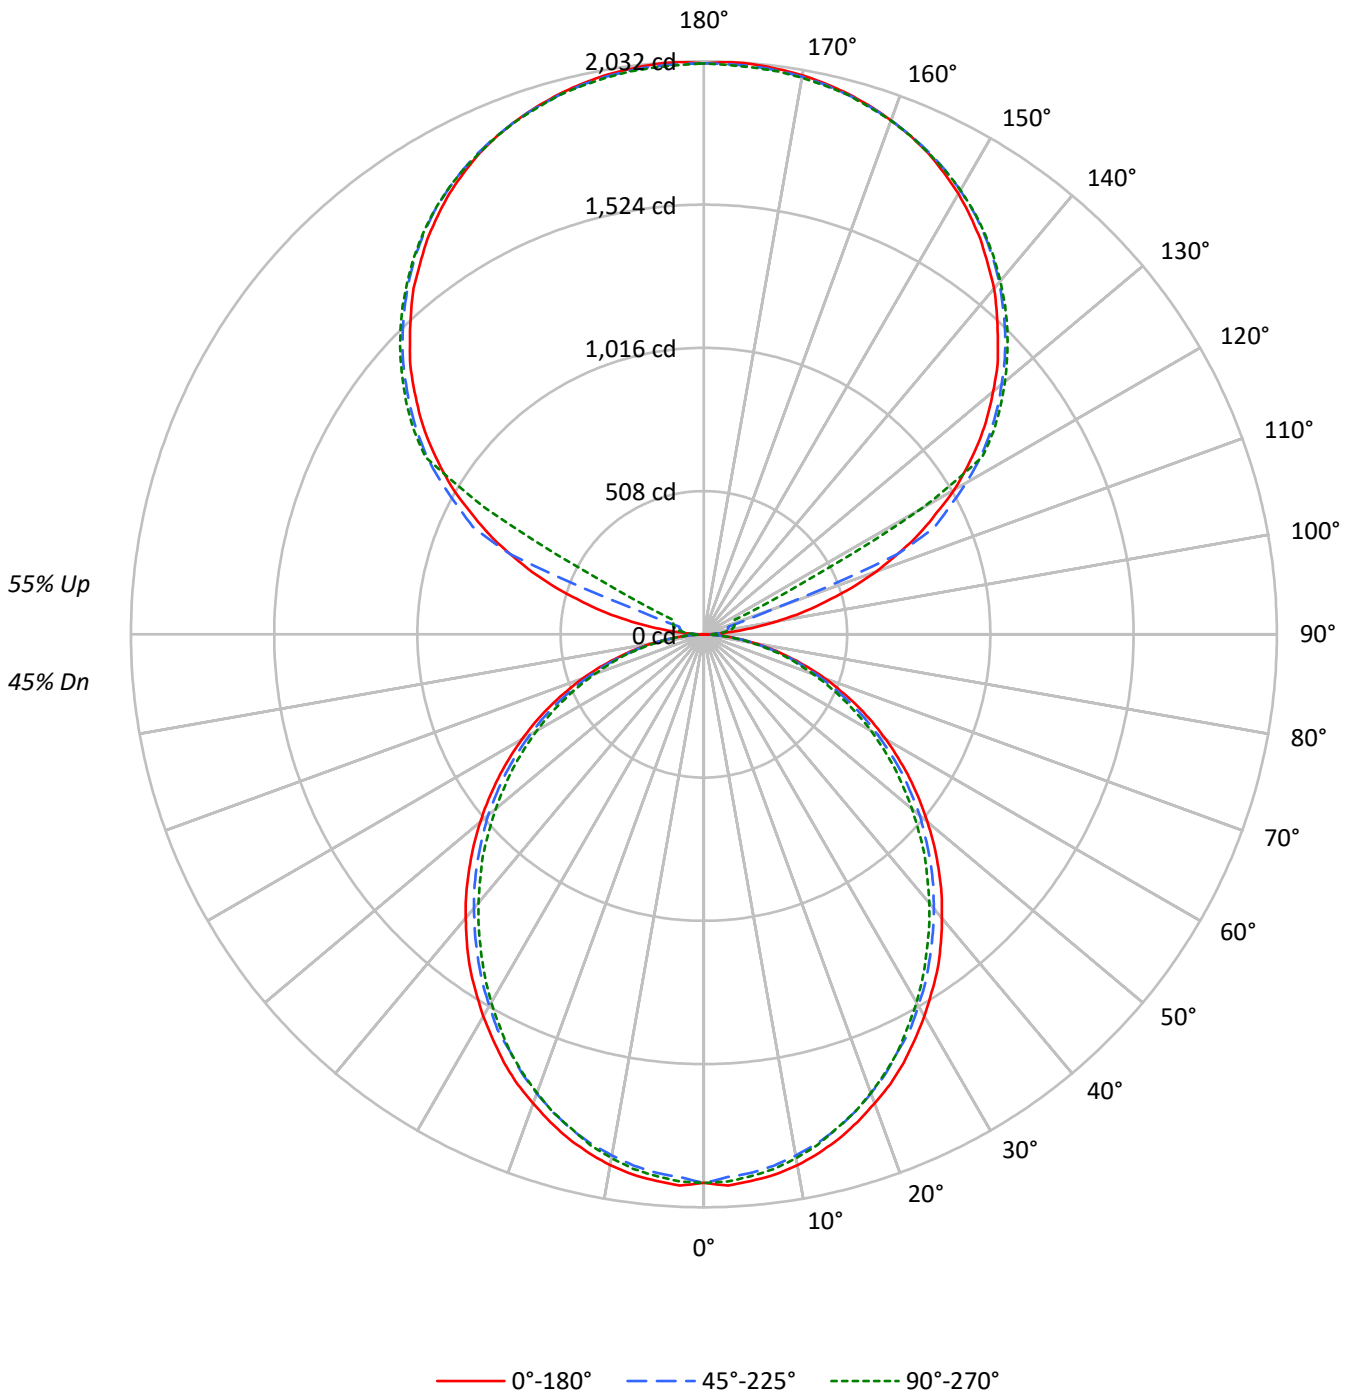



TEST NUMBER: P907315  
 CATALOG NUMBER: DFN2DIP-TR4F0-050D060US835-FLLONL

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52	45	45	45	45
1	97	92	89	85	89	85	82	79	71	68	66	58	56	55	46	45	44	38	38	38	38
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	40	39	37	32	32	32	32
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	33	31	27	27	27	27
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27	23	23	23	23
5	67	56	48	42	62	52	45	39	43	38	34	36	32	29	29	26	24	20	20	20	20
6	62	50	42	36	57	46	39	34	39	34	30	32	28	25	26	23	21	18	18	18	18
7	57	45	37	32	53	42	35	30	35	30	26	30	25	22	24	21	18	16	16	16	16
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17	14	14	14	14
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15	13	13	13	13
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14	12	12	12	12

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	1546	1546	1546
5°	1548	1524	1534
10°	1536	1504	1513
15°	1513	1479	1481
20°	1482	1444	1448
25°	1452	1403	1409
30°	1414	1365	1360
35°	1378	1320	1309
40°	1334	1274	1259
45°	1290	1228	1209
50°	1241	1180	1151
55°	1191	1125	1097
60°	1133	1059	1036
65°	1071	991	963
70°	991	908	885
75°	881	808	813
80°	749	681	676
85°	542	462	448

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 1290 cd/sqm



TEST NUMBER: P907315

CATALOG NUMBER: DFN2DIP-TR4F0-050D060US835-FLLONL

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	183.1	1.7
10°-20°	515.2	4.7
20°-30°	757.2	7.0
30°-40°	879.4	8.1
40°-50°	878.3	8.1
50°-60°	765.8	7.0
60°-70°	566.1	5.2
70°-80°	320.3	2.9
80°-90°	88.1	0.8
90°-100°	66.8	0.6
100°-110°	248.9	2.3
110°-120°	660.2	6.1
120°-130°	1094.9	10.1
130°-140°	1163.0	10.7
140°-150°	1080.9	9.9
150°-160°	869.0	8.0
160°-170°	560.0	5.1
170°-180°	192.7	1.8
0°-30°	1455.5	13.4
0°-40°	2334.9	21.4
0°-60°	3979.0	36.5
0°-90°	4953.6	45.5
90°-120°	975.8	9.0
90°-150°	4314.7	39.6
90°-180°	5936.0	54.5
0°-180°	10890.0	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	1946	1946	1946	1946	1946	
5°	1946	1938	1918	1932	1929	185
15°	1852	1841	1816	1824	1815	522
25°	1676	1661	1630	1633	1630	771
35°	1446	1428	1398	1386	1377	903
45°	1177	1164	1136	1115	1108	908
55°	891	879	857	834	825	796
65°	601	589	571	554	544	594
75°	314	311	301	290	294	335
85°	77	75	73	67	66	85
90°	1	18	29	37	40	10
95°	95	47	57	65	63	113
105°	445	489	89	105	111	476
115°	842	867	904	226	120	829
125°	1191	1210	1238	1248	1253	1062
135°	1474	1498	1511	1525	1522	1139
145°	1710	1708	1733	1744	1736	1069
155°	1883	1870	1887	1896	1884	868
165°	1984	1975	1980	1990	1980	560
175°	2029	2019	2022	2032	2018	193
180°	2025	2025	2025	2025	2025	



TEST NUMBER: P907315

CATALOG NUMBER: DFN2DIP-TR4F0-050D060US835-FLLONL

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	1945.5	1945.5	1945.5	1945.5	1945.5
2.5°	1956.8	1947.5	1926.9	1945.5	1942.0
5°	1945.5	1938.2	1917.5	1932.4	1928.9
7.5°	1932.4	1921.3	1900.7	1915.8	1912.0
10°	1912.0	1898.9	1876.5	1891.3	1885.8
12.5°	1883.8	1872.7	1850.3	1859.6	1855.8
15°	1852.0	1840.9	1816.5	1824.1	1814.7
17.5°	1812.7	1801.6	1777.2	1786.5	1777.2
20°	1769.7	1758.6	1732.4	1737.9	1730.6
22.5°	1726.8	1709.9	1685.5	1685.5	1681.7
25°	1676.2	1661.3	1629.5	1633.1	1629.5
27.5°	1620.0	1606.9	1582.7	1577.1	1567.8
30°	1564.0	1549.0	1521.0	1515.4	1507.9
32.5°	1504.1	1493.0	1463.0	1451.7	1444.2
35°	1446.1	1427.5	1397.5	1386.2	1376.9
37.5°	1380.6	1363.8	1333.8	1320.7	1311.4
40°	1313.4	1298.3	1268.3	1251.6	1244.1
42.5°	1247.9	1232.8	1203.0	1184.1	1173.0
45°	1176.8	1163.7	1135.5	1115.1	1107.5
47.5°	1107.5	1094.4	1064.5	1043.8	1032.7
50°	1034.5	1025.2	999.0	972.8	963.4
52.5°	963.4	950.3	926.1	905.5	892.4
55°	890.6	879.3	856.8	834.4	825.1
57.5°	817.5	808.2	783.8	761.4	753.8
60°	744.5	737.2	711.0	690.3	684.8
62.5°	673.5	660.4	641.7	623.0	615.5
65°	600.6	589.3	570.6	553.8	544.4
67.5°	525.8	516.3	499.6	486.5	478.9
70°	456.5	449.0	432.1	419.0	411.7
72.5°	385.5	377.9	368.6	355.5	349.9
75°	314.2	310.6	301.1	290.0	293.8
77.5°	250.7	243.1	239.4	233.8	228.3
80°	187.2	185.2	181.4	175.9	172.1
82.5°	127.2	127.2	125.4	117.9	117.9
85°	76.6	74.8	73.0	67.3	65.5
87.5°	33.7	30.0	26.2	20.6	18.7
90°	1.4	17.6	29.2	36.7	39.5
92.5°	36.7	30.8	35.1	38.1	39.5
95°	95.2	46.8	57.1	64.6	63.0
97.5°	171.4	51.3	74.6	79.2	80.6
100°	259.4	58.6	83.5	95.2	98.1
102.5°	356.0	353.2	86.5	102.5	107.0
105°	445.4	489.4	89.4	105.4	111.4
107.5°	549.5	586.0	92.4	108.4	114.3
110°	649.2	679.8	256.5	110.0	115.7



TEST NUMBER: P907315

CATALOG NUMBER: DFN2DIP-TR4F0-050D060US835-FLLONL

**CANDELA DISTRIBUTION (continued):**

	0°	22.5°	45°	67.5°	90°
112.5°	742.9	769.2	744.3	112.7	117.3
115°	842.5	867.4	904.1	225.7	120.2
117.5°	928.9	958.2	983.2	773.6	389.7
120°	1025.7	1047.6	1074.1	1091.6	893.8
122.5°	1107.6	1131.1	1160.5	1169.2	1170.8
125°	1191.2	1210.3	1238.1	1248.4	1252.7
127.5°	1267.4	1287.9	1310.0	1324.6	1326.0
130°	1339.2	1362.7	1378.7	1394.9	1393.5
132.5°	1412.5	1431.6	1447.6	1460.8	1459.4
135°	1474.1	1497.6	1510.6	1525.4	1522.4
137.5°	1538.4	1556.0	1570.8	1585.4	1581.1
140°	1601.4	1613.3	1629.3	1642.5	1635.2
142.5°	1654.3	1664.6	1683.6	1695.2	1687.9
145°	1710.0	1708.4	1733.3	1743.6	1736.3
147.5°	1758.2	1753.8	1778.7	1786.0	1780.3
150°	1805.2	1794.9	1818.4	1827.1	1819.8
152.5°	1844.7	1833.0	1854.9	1863.8	1853.5
155°	1882.8	1869.7	1887.3	1896.0	1884.3
157.5°	1913.6	1901.9	1915.1	1925.4	1913.6
160°	1940.0	1931.1	1940.0	1948.7	1938.5
162.5°	1963.3	1954.6	1961.9	1972.2	1959.0
165°	1983.9	1975.2	1979.5	1989.8	1979.5
167.5°	2000.0	1991.2	1995.7	2006.0	1992.7
170°	2013.3	2004.4	2007.4	2017.6	2004.4
172.5°	2022.0	2013.3	2016.2	2026.5	2013.3
175°	2029.3	2019.0	2022.0	2032.2	2017.6
177.5°	2032.2	2022.0	2023.5	2033.8	2020.6
180°	2024.9	2024.9	2024.9	2024.9	2024.9



TEST NUMBER: P907315  
 CATALOG NUMBER: DFN2DIP-TR4F0-050D060US835-FLLONL

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.35	9.17	9.34	10.18	11.51	7.92	8.74	8.91	9.74	11.08
	3H	10.00	10.74	11.01	11.76	13.11	9.53	10.27	10.54	11.28	12.64
	4H	10.59	11.29	11.61	12.31	13.67	10.12	10.82	11.14	11.83	13.20
	6H	10.99	11.63	12.02	12.65	14.03	10.51	11.16	11.54	12.18	13.55
	8H	11.09	11.70	12.13	12.74	14.11	10.62	11.23	11.65	12.27	13.64
	12H	11.14	11.72	12.18	12.75	14.15	10.66	11.24	11.70	12.27	13.67
4H	2H	8.80	9.50	9.83	10.52	11.88	8.46	9.16	9.48	10.18	11.54
	3H	10.67	11.25	11.70	12.30	13.67	10.27	10.86	11.31	11.90	13.28
	4H	11.38	11.91	12.42	12.95	14.35	10.97	11.51	12.01	12.55	13.94
	6H	11.89	12.35	12.94	13.41	14.81	11.48	11.94	12.53	13.00	14.40
	8H	12.04	12.47	13.09	13.52	14.93	11.63	12.06	12.68	13.11	14.52
	12H	12.11	12.50	13.18	13.57	14.98	11.69	12.08	12.76	13.15	14.56
8H	4H	11.57	12.00	12.62	13.06	14.47	11.21	11.64	12.26	12.70	14.11
	6H	12.20	12.56	13.28	13.65	15.06	11.84	12.19	12.91	13.29	14.70
	8H	12.42	12.73	13.50	13.81	15.24	12.05	12.37	13.14	13.45	14.87
	12H	12.55	12.83	13.64	13.90	15.37	12.17	12.44	13.25	13.52	14.98
12H	4H	11.56	11.94	12.63	13.01	14.43	11.20	11.59	12.27	12.66	14.08
	6H	12.23	12.54	13.31	13.62	15.05	11.88	12.19	12.96	13.27	14.70
	8H	12.47	12.75	13.56	13.82	15.29	12.12	12.39	13.20	13.46	14.93