

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907352

Luminaire Tested: DFN2DIP-TR4F0-060D060US835-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907352
REPORT IS A COMBINATION OF REPORTS P900410 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D060US835-RLLFLL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10410.0 lumens
Efficiency: N/A
Efficacy: 106.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 98.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907352

CATALOG NUMBER: DFN2DIP-TR4F0-060D060US835-RLLFLL

Luminous Intensity Polar Plot

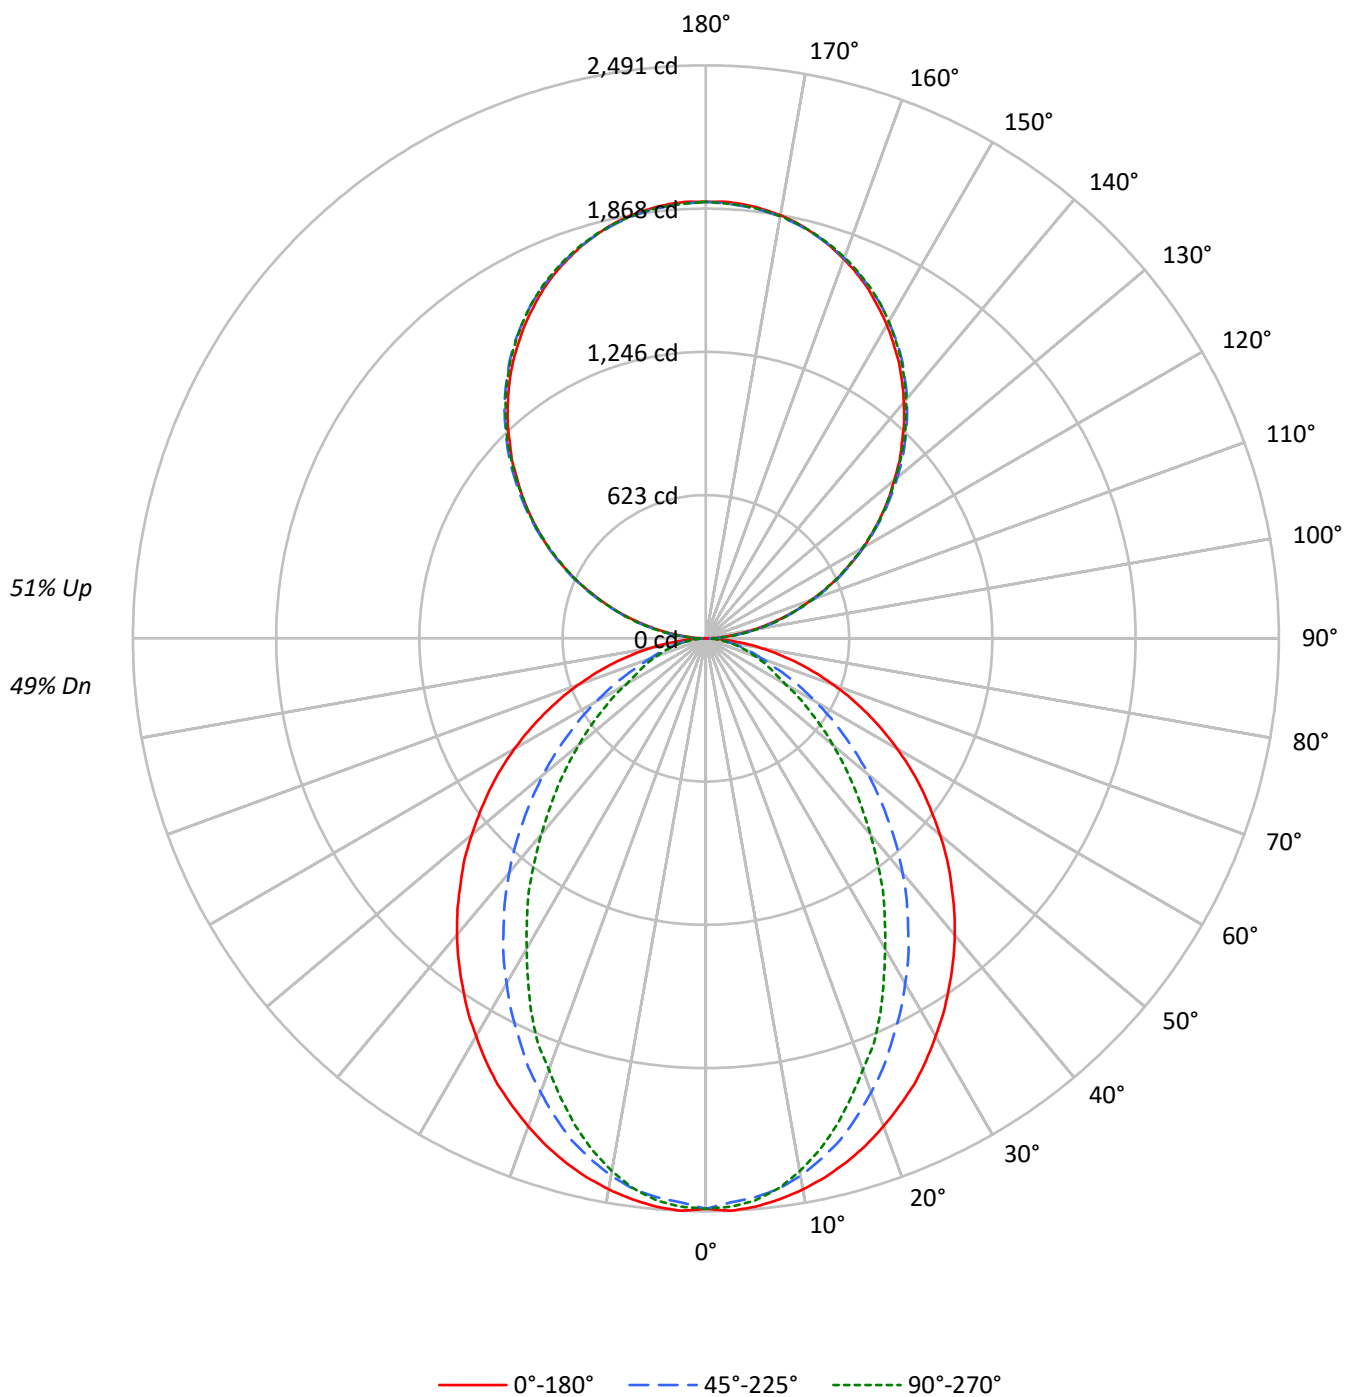

TEST NUMBER: P907352

CATALOG NUMBER: DFN2DIP-TR4F0-060D060US835-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1970	1970	1970
5°	1973	1939	1951
10°	1954	1901	1888
15°	1927	1838	1789
20°	1891	1751	1669
25°	1855	1654	1553
30°	1806	1555	1405
35°	1758	1448	1275
40°	1709	1337	1127
45°	1653	1214	992
50°	1594	1090	861
55°	1533	957	734
60°	1462	819	604
65°	1381	678	544
70°	1282	547	492
75°	1158	482	448
80°	978	404	388
85°	682	270	291

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1653 cd/sqm

TEST NUMBER: P907352

CATALOG NUMBER: DFN2DIP-TR4F0-060D060US835-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	232.4	2.2
10°-20°	638.0	6.1
20°-30°	895.7	8.6
30°-40°	976.4	9.4
40°-50°	897.4	8.6
50°-60°	704.8	6.8
60°-70°	458.8	4.4
70°-80°	236.1	2.3
80°-90°	65.7	0.6
90°-100°	117.4	1.1
100°-110°	373.1	3.6
110°-120°	638.5	6.1
120°-130°	839.7	8.1
130°-140°	942.5	9.1
140°-150°	924.2	8.9
150°-160°	775.3	7.4
160°-170°	514.2	4.9
170°-180°	179.7	1.7
0°-30°	1766.2	17.0
0°-40°	2742.6	26.3
0°-60°	4344.8	41.7
0°-90°	5105.4	49.0
90°-120°	1129.0	10.8
90°-150°	3835.4	36.8
90°-180°	5305.0	51.0
0°-180°	10410.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2480	2480	2480	2480	2480	
5°	2480	2469	2439	2460	2453	235
15°	2359	2334	2258	2215	2193	665
25°	2141	2069	1921	1829	1795	985
35°	1845	1730	1533	1391	1342	1155
45°	1508	1358	1122	963	909	1165
55°	1147	972	729	595	552	1025
65°	774	592	390	314	307	768
75°	413	256	180	164	162	437
85°	96	49	43	43	43	111
90°	2	21	56	53	54	10
95°	84	100	102	102	100	93
105°	344	349	352	355	355	363
115°	641	650	647	645	641	634
125°	932	946	942	936	935	833
135°	1205	1223	1226	1225	1220	932
145°	1463	1475	1484	1486	1479	914
155°	1673	1678	1683	1691	1686	770
165°	1820	1819	1819	1830	1822	514
175°	1894	1890	1886	1898	1888	180
180°	1898	1898	1898	1898	1898	

TEST NUMBER: P907352

CATALOG NUMBER: DFN2DIP-TR4F0-060D060US835-RLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2479.8	2479.8	2479.8	2479.8	2479.8
2.5°	2491.0	2479.8	2455.0	2477.6	2473.1
5°	2479.8	2468.6	2439.3	2459.6	2452.9
7.5°	2459.6	2446.2	2414.8	2423.6	2412.4
10°	2432.6	2416.9	2372.2	2365.3	2351.9
12.5°	2399.1	2378.8	2318.1	2304.8	2280.0
15°	2358.6	2333.8	2257.6	2215.0	2192.6
17.5°	2311.5	2275.5	2181.2	2131.9	2096.0
20°	2257.6	2212.6	2100.5	2044.5	1995.0
22.5°	2199.3	2147.6	2017.4	1941.2	1907.6
25°	2141.0	2069.1	1921.0	1829.1	1795.3
27.5°	2071.5	1995.0	1831.2	1725.7	1674.1
30°	1997.4	1911.9	1732.4	1618.1	1557.4
32.5°	1925.5	1822.2	1638.4	1503.6	1447.4
35°	1844.8	1730.3	1532.9	1391.4	1341.9
37.5°	1766.2	1642.6	1434.1	1279.1	1223.1
40°	1683.1	1548.6	1330.7	1171.4	1113.1
42.5°	1597.9	1454.3	1227.6	1061.4	1005.5
45°	1508.1	1357.6	1122.2	962.6	908.8
47.5°	1422.9	1263.6	1021.2	861.7	812.4
50°	1328.6	1169.3	922.4	767.4	720.5
52.5°	1236.4	1068.1	828.1	680.0	637.4
55°	1146.7	971.7	729.3	594.8	552.1
57.5°	1054.8	875.2	641.9	516.2	480.2
60°	960.5	781.0	549.8	435.5	399.5
62.5°	868.6	689.1	471.2	363.6	345.7
65°	774.3	592.4	390.5	314.3	307.4
67.5°	684.5	502.6	314.3	276.0	269.3
70°	590.2	415.2	260.2	237.9	228.8
72.5°	500.5	334.3	217.6	199.8	195.2
75°	412.9	255.7	179.5	163.8	161.7
77.5°	325.5	181.7	141.4	132.4	127.9
80°	244.5	130.2	107.6	98.8	98.8
82.5°	170.5	87.6	74.0	69.5	69.5
85°	96.4	49.3	42.6	42.6	42.6
87.5°	36.0	17.9	17.9	15.7	15.7
90°	1.7	20.6	56.1	52.6	54.3
92.5°	35.5	48.1	49.8	51.5	51.5
95°	83.5	99.5	102.4	102.4	99.5
97.5°	139.0	153.9	160.2	160.2	160.2
100°	203.1	216.2	220.8	220.8	219.1
102.5°	270.6	280.3	286.6	288.3	286.6
105°	344.4	349.0	352.4	355.3	355.3
107.5°	417.6	424.5	424.5	425.6	417.6
110°	488.6	497.7	497.7	497.7	493.1

TEST NUMBER: P907352

CATALOG NUMBER: DFN2DIP-TR4F0-060D060US835-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	565.2	574.9	573.2	568.6	565.2
115°	640.7	649.9	647.0	645.3	640.7
117.5°	715.7	728.3	720.2	715.7	711.1
120°	791.2	803.8	791.2	791.2	786.0
122.5°	859.8	875.8	867.8	863.3	859.8
125°	931.9	946.2	941.6	936.5	934.8
127.5°	1002.3	1020.0	1013.7	1006.9	1002.3
130°	1068.1	1088.7	1085.8	1082.4	1076.1
132.5°	1141.9	1157.9	1159.0	1151.0	1146.4
135°	1205.4	1223.1	1226.5	1224.8	1220.2
137.5°	1276.3	1290.6	1293.5	1292.3	1285.5
140°	1338.7	1353.0	1361.0	1361.0	1354.7
142.5°	1402.7	1417.0	1421.6	1423.3	1417.0
145°	1463.4	1474.8	1484.0	1485.7	1479.4
147.5°	1517.7	1532.0	1538.9	1541.7	1535.4
150°	1573.8	1583.5	1589.8	1594.9	1589.8
152.5°	1623.5	1633.3	1641.3	1647.6	1641.3
155°	1673.3	1677.9	1683.0	1691.1	1685.9
157.5°	1716.2	1719.7	1722.5	1734.0	1726.0
160°	1754.6	1758.0	1759.7	1769.4	1762.6
162.5°	1790.0	1790.0	1791.7	1802.6	1794.6
165°	1820.3	1818.6	1818.6	1830.1	1822.1
167.5°	1847.8	1842.7	1842.7	1854.1	1846.1
170°	1868.4	1863.8	1862.1	1873.5	1863.8
172.5°	1882.7	1878.1	1876.4	1887.8	1878.1
175°	1894.1	1889.6	1886.1	1897.6	1887.8
177.5°	1900.4	1895.9	1892.4	1902.1	1892.4
180°	1897.6	1897.6	1897.6	1897.6	1897.6

TEST NUMBER: P907352

CATALOG NUMBER: DFN2DIP-TR4F0-060D060US835-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.41	10.23	10.38	11.21	12.50	5.38	6.20	6.35	7.18	8.47
	3H	11.08	11.82	12.07	12.81	14.12	6.57	7.30	7.55	8.29	9.60
	4H	11.69	12.39	12.69	13.38	14.70	7.02	7.71	8.02	8.71	10.03
	6H	12.11	12.75	13.12	13.75	15.08	7.34	7.98	8.35	8.98	10.31
	8H	12.24	12.85	13.25	13.86	15.19	7.43	8.04	8.44	9.06	10.38
	12H	12.30	12.88	13.32	13.89	15.24	7.48	8.05	8.49	9.06	10.41
4H	2H	9.42	10.12	10.43	11.11	12.43	5.97	6.67	6.98	7.66	8.98
	3H	11.25	11.83	12.26	12.85	14.18	7.32	7.90	8.34	8.93	10.26
	4H	11.94	12.47	12.96	13.49	14.84	7.87	8.40	8.89	9.42	10.77
	6H	12.46	12.91	13.49	13.95	15.30	8.29	8.75	9.32	9.79	11.14
	8H	12.63	13.06	13.66	14.09	15.45	8.42	8.85	9.45	9.88	11.24
	12H	12.73	13.11	13.78	14.16	15.53	8.49	8.87	9.54	9.92	11.29
8H	4H	11.91	12.33	12.94	13.37	14.73	8.15	8.58	9.18	9.61	10.97
	6H	12.48	12.83	13.53	13.90	15.26	8.67	9.02	9.73	10.09	11.46
	8H	12.69	13.00	13.75	14.06	15.44	8.86	9.17	9.92	10.23	11.61
	12H	12.83	13.10	13.90	14.15	15.58	8.98	9.25	10.05	10.31	11.73
12H	4H	11.86	12.24	12.91	13.29	14.66	8.16	8.54	9.20	9.59	10.96
	6H	12.45	12.76	13.51	13.82	15.20	8.72	9.03	9.78	10.09	11.47
	8H	12.67	12.94	13.74	14.00	15.42	8.93	9.20	10.00	10.26	11.68

END OF REPORT