

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907358

Luminaire Tested: DFN2DIP-TR4F0-060D080US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907358
REPORT IS A COMBINATION OF REPORTS P900445 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D080US835-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 13020.0 lumens
Efficiency: N/A
Efficacy: 115.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 112.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907358
CATALOG NUMBER: DFN2DIP-TR4F0-060D080US835-FLLFLL

Luminous Intensity Polar Plot

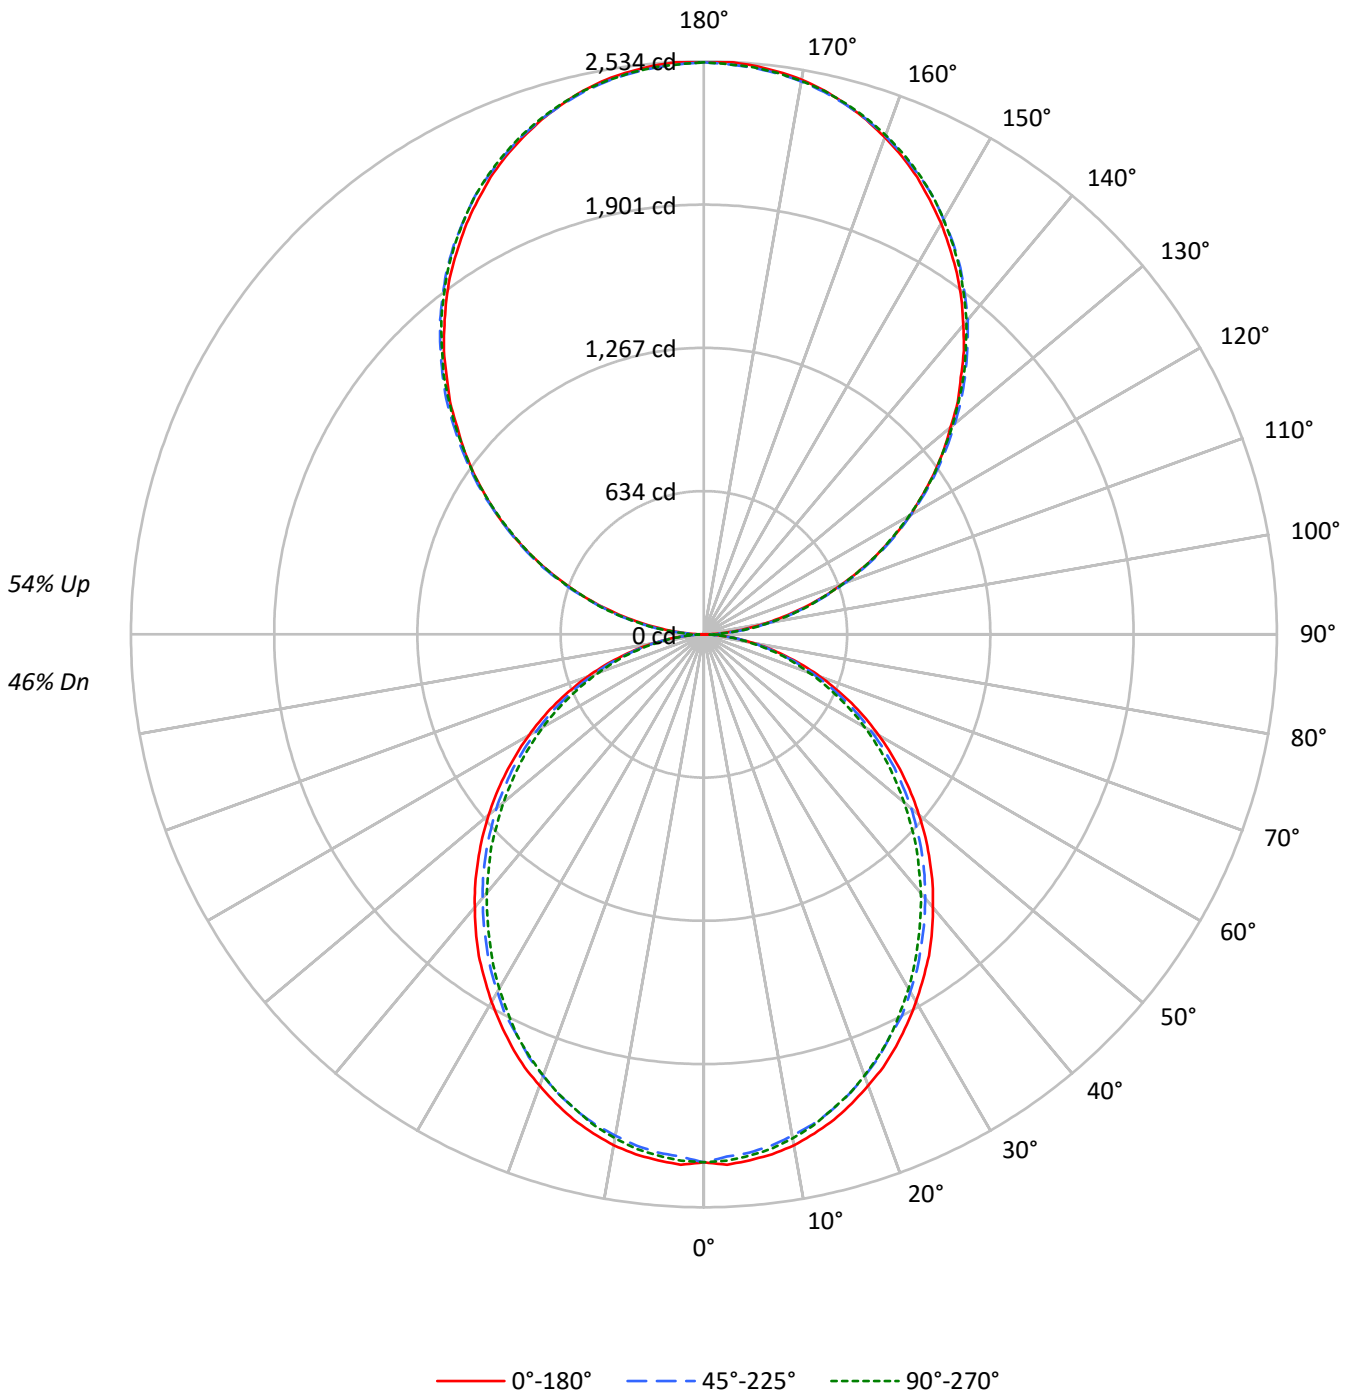



TEST NUMBER: P907358

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US835-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52	46	46	46	46
1	97	93	89	85	89	85	82	79	71	69	66	58	56	55	46	45	44	38	38	38	38
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	41	39	37	32	32	32	32
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	34	32	27	27	27	27
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27	23	23	23	23
5	67	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24	20	20	20	20
6	62	50	42	36	57	46	39	34	39	34	30	33	28	25	26	23	21	18	18	18	18
7	57	45	37	32	53	42	35	30	36	30	26	30	25	22	24	21	19	16	16	16	16
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17	14	14	14	14
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15	13	13	13	13
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14	12	12	12	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1855	1855	1855
5°	1858	1829	1841
10°	1843	1804	1816
15°	1816	1774	1777
20°	1779	1733	1737
25°	1743	1684	1691
30°	1697	1638	1632
35°	1654	1584	1570
40°	1600	1529	1511
45°	1547	1474	1451
50°	1489	1417	1381
55°	1429	1350	1316
60°	1360	1271	1243
65°	1285	1189	1156
70°	1190	1089	1062
75°	1057	970	976
80°	899	817	811
85°	650	554	537

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°
 Vertical Angle: 90°
 Luminance: 1973 cd/sqm



TEST NUMBER: P907358

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	219.7	1.7
10°-20°	618.3	4.7
20°-30°	908.6	7.0
30°-40°	1055.3	8.1
40°-50°	1054.0	8.1
50°-60°	919.0	7.1
60°-70°	679.4	5.2
70°-80°	384.4	3.0
80°-90°	108.6	0.8
90°-100°	156.6	1.2
100°-110°	497.5	3.8
110°-120°	851.3	6.5
120°-130°	1119.6	8.6
130°-140°	1256.7	9.7
140°-150°	1232.3	9.5
150°-160°	1033.7	7.9
160°-170°	685.6	5.3
170°-180°	239.6	1.8
0°-30°	1746.6	13.4
0°-40°	2801.8	21.5
0°-60°	4774.8	36.7
0°-90°	5947.2	45.7
90°-120°	1505.3	11.6
90°-150°	5113.9	39.3
90°-180°	7073.0	54.3
0°-180°	13020.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2335	2335	2335	2335	2335	
5°	2335	2326	2301	2319	2315	222
15°	2222	2209	2180	2189	2178	626
25°	2011	1994	1955	1960	1955	926
35°	1735	1713	1677	1663	1652	1084
45°	1412	1396	1363	1338	1329	1090
55°	1069	1055	1028	1001	990	955
65°	721	707	685	664	653	713
75°	377	373	361	348	352	402
85°	92	90	88	81	79	103
90°	2	28	75	70	72	13
95°	111	133	136	136	133	124
105°	459	465	470	474	474	485
115°	854	866	863	860	854	845
125°	1242	1262	1256	1249	1246	1110
135°	1607	1631	1635	1633	1627	1242
145°	1951	1966	1979	1981	1972	1219
155°	2231	2237	2244	2255	2248	1027
165°	2427	2425	2425	2440	2429	685
175°	2526	2519	2515	2530	2517	240
180°	2530	2530	2530	2530	2530	



TEST NUMBER: P907358

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US835-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2334.6	2334.6	2334.6	2334.6	2334.6
2.5°	2348.2	2337.0	2312.2	2334.6	2330.3
5°	2334.6	2325.8	2301.0	2318.9	2314.6
7.5°	2318.9	2305.6	2280.8	2298.9	2294.4
10°	2294.4	2278.7	2251.7	2269.6	2262.9
12.5°	2260.6	2247.2	2220.3	2231.5	2227.0
15°	2222.4	2209.1	2179.8	2188.9	2177.7
17.5°	2175.3	2162.0	2132.7	2143.8	2132.7
20°	2123.6	2110.3	2078.8	2085.5	2076.7
22.5°	2072.2	2051.9	2022.6	2022.6	2018.1
25°	2011.4	1993.6	1955.4	1959.7	1955.4
27.5°	1944.0	1928.3	1899.2	1892.6	1881.4
30°	1876.9	1858.7	1825.2	1818.5	1809.4
32.5°	1804.9	1791.6	1755.6	1742.0	1733.0
35°	1735.4	1713.0	1677.0	1663.4	1652.2
37.5°	1656.8	1636.5	1600.6	1584.8	1573.6
40°	1576.0	1557.9	1522.0	1502.0	1492.9
42.5°	1497.4	1479.3	1443.6	1421.0	1407.6
45°	1412.2	1396.4	1362.6	1338.1	1329.0
47.5°	1329.0	1313.3	1277.4	1252.6	1239.2
50°	1241.4	1230.2	1198.8	1167.3	1156.1
52.5°	1156.1	1140.4	1111.3	1086.6	1070.9
55°	1068.7	1055.1	1028.2	1001.3	990.1
57.5°	981.1	969.9	940.6	913.7	904.6
60°	893.4	884.6	853.2	828.4	821.7
62.5°	808.1	792.4	770.0	747.6	738.6
65°	720.7	707.2	684.8	664.5	653.3
67.5°	630.9	619.5	599.5	583.8	574.7
70°	547.8	538.8	518.5	502.8	494.0
72.5°	462.5	453.5	442.3	426.6	419.9
75°	377.0	372.8	361.3	348.0	352.5
77.5°	300.8	291.8	287.2	280.6	273.9
80°	224.6	222.2	217.7	211.0	206.5
82.5°	152.7	152.7	150.5	141.5	141.5
85°	91.9	89.8	87.6	80.7	78.6
87.5°	40.5	36.0	31.4	24.8	22.4
90°	2.3	27.5	74.8	70.2	72.5
92.5°	47.3	64.1	66.4	68.6	68.6
95°	111.4	132.7	136.5	136.5	132.7
97.5°	185.4	205.2	213.6	213.6	213.6
100°	270.8	288.3	294.4	294.4	292.1
102.5°	360.8	373.8	382.1	384.4	382.1
105°	459.2	465.3	469.9	473.7	473.7
107.5°	556.8	566.0	566.0	567.5	556.8
110°	651.4	663.6	663.6	663.6	657.5



TEST NUMBER: P907358

CATALOG NUMBER: DFN2DIP-TR4F0-060D080US835-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	753.6	766.6	764.3	758.2	753.6
115°	854.3	866.5	862.7	860.4	854.3
117.5°	954.2	971.0	960.3	954.2	948.1
120°	1054.9	1071.7	1054.9	1054.9	1048.0
122.5°	1146.4	1167.8	1157.1	1151.0	1146.4
125°	1242.5	1261.6	1255.5	1248.6	1246.4
127.5°	1336.4	1360.0	1351.6	1342.5	1336.4
130°	1424.1	1451.5	1447.7	1443.2	1434.8
132.5°	1522.5	1543.8	1545.4	1534.7	1528.6
135°	1607.1	1630.8	1635.4	1633.1	1627.0
137.5°	1701.7	1720.8	1724.6	1723.1	1713.9
140°	1784.9	1803.9	1814.6	1814.6	1806.2
142.5°	1870.3	1889.4	1895.5	1897.8	1889.4
145°	1951.2	1966.4	1978.6	1980.9	1972.5
147.5°	2023.6	2042.7	2051.8	2055.7	2047.3
150°	2098.4	2111.3	2119.7	2126.6	2119.7
152.5°	2164.7	2177.7	2188.4	2196.8	2188.4
155°	2231.1	2237.2	2244.1	2254.7	2247.9
157.5°	2288.3	2292.9	2296.7	2311.9	2301.3
160°	2339.4	2344.0	2346.3	2359.2	2350.1
162.5°	2386.7	2386.7	2389.0	2403.5	2392.8
165°	2427.1	2424.8	2424.8	2440.1	2429.4
167.5°	2463.7	2456.9	2456.9	2472.1	2461.4
170°	2491.2	2485.1	2482.8	2498.1	2485.1
172.5°	2510.3	2504.2	2501.9	2517.1	2504.2
175°	2525.5	2519.4	2514.8	2530.1	2517.1
177.5°	2533.9	2527.8	2523.2	2536.2	2523.2
180°	2530.1	2530.1	2530.1	2530.1	2530.1



TEST NUMBER: P907358
 CATALOG NUMBER: DFN2DIP-TR4F0-060D080US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.00	9.82	9.99	10.83	12.16	8.57	9.39	9.56	10.40	11.73
	3H	10.66	11.39	11.66	12.41	13.76	10.18	10.92	11.19	11.94	13.29
	4H	11.24	11.94	12.26	12.96	14.32	10.77	11.47	11.78	12.48	13.84
	6H	11.64	12.28	12.67	13.30	14.68	11.16	11.81	12.19	12.83	14.20
	8H	11.74	12.36	12.77	13.39	14.76	11.27	11.88	12.30	12.92	14.29
	12H	11.79	12.37	12.83	13.40	14.80	11.31	11.89	12.35	12.92	14.32
4H	2H	9.46	10.15	10.48	11.17	12.53	9.11	9.81	10.13	10.83	12.19
	3H	11.32	11.90	12.35	12.95	14.32	10.92	11.51	11.96	12.55	13.93
	4H	12.03	12.56	13.07	13.60	15.00	11.62	12.16	12.66	13.20	14.59
	6H	12.54	13.00	13.59	14.06	15.46	12.13	12.59	13.18	13.65	15.05
	8H	12.69	13.12	13.74	14.17	15.58	12.28	12.71	13.33	13.76	15.17
	12H	12.76	13.15	13.83	14.22	15.63	12.34	12.73	13.41	13.80	15.21
8H	4H	12.22	12.65	13.27	13.71	15.11	11.86	12.29	12.91	13.35	14.75
	6H	12.85	13.21	13.93	14.30	15.71	12.49	12.85	13.56	13.94	15.35
	8H	13.07	13.39	14.15	14.46	15.89	12.70	13.02	13.79	14.10	15.52
	12H	13.20	13.48	14.29	14.55	16.02	12.82	13.09	13.90	14.17	15.63
12H	4H	12.21	12.60	13.28	13.66	15.08	11.86	12.24	12.92	13.31	14.72
	6H	12.88	13.20	13.96	14.27	15.70	12.53	12.84	13.61	13.92	15.35
	8H	13.12	13.40	14.21	14.47	15.94	12.77	13.04	13.85	14.12	15.58