

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907399

Luminaire Tested: DFN2DIP-TR4F0-070D090US835-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907399
REPORT IS A COMBINATION OF REPORTS P901985 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D090US835-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15840.0 lumens
Efficiency: N/A
Efficacy: 118.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 133.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907399

CATALOG NUMBER: DFN2DIP-TR4F0-070D090US835-FLLONL

Luminous Intensity Polar Plot

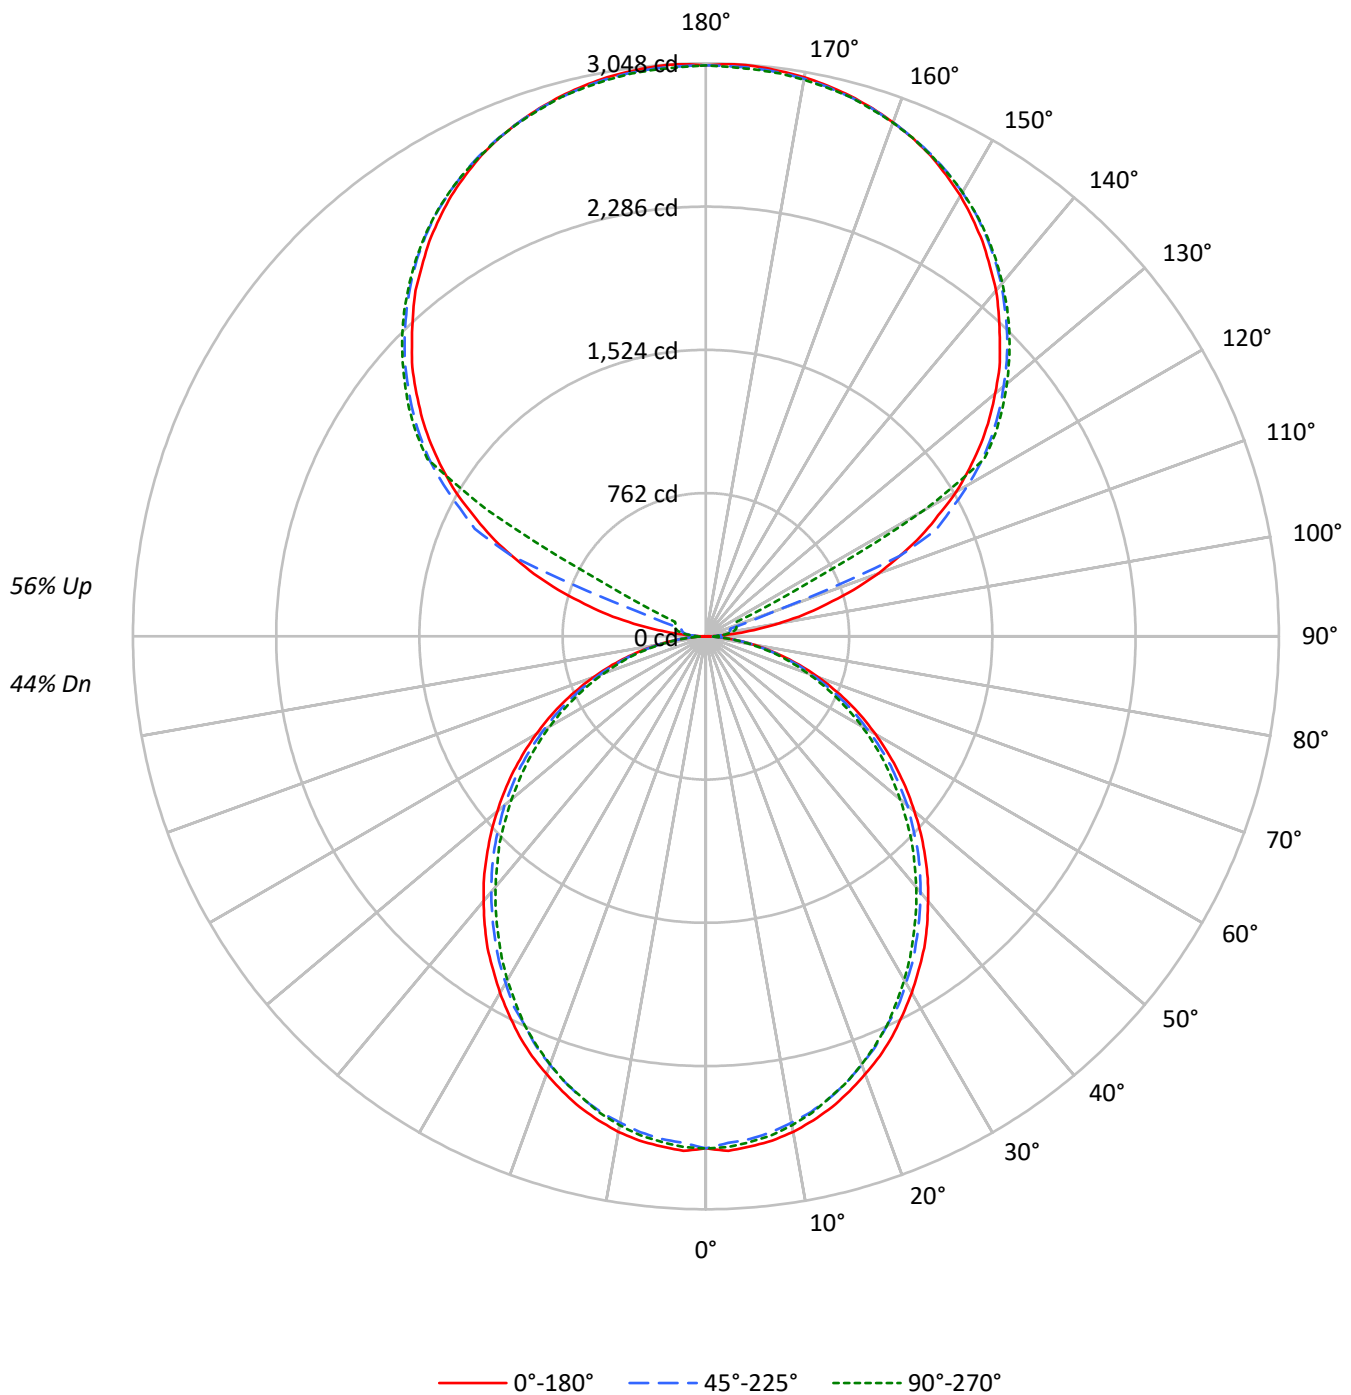

TEST NUMBER: P907399

CATALOG NUMBER: DFN2DIP-TR4F0-070D090US835-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	50	50	50
1	96	92	88	85	88	84	81	78	70	68	66	57	55	54	45	44	43
2	88	80	74	69	80	74	69	64	61	58	54	50	47	45	39	37	36
3	80	71	63	58	73	65	59	54	54	49	46	44	41	38	35	32	31
4	73	63	55	49	67	58	51	45	48	43	39	39	35	32	31	28	26
5	67	56	48	42	61	51	44	39	43	38	33	35	31	28	28	25	23
6	62	50	42	36	56	46	39	34	39	33	29	32	28	25	25	22	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	48	38	31	26	32	27	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	20	17	14
10	46	34	27	22	42	32	25	21	27	22	18	22	18	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2164	2164	2164
5°	2167	2134	2148
10°	2150	2105	2119
15°	2118	2070	2073
20°	2075	2022	2027
25°	2033	1964	1973
30°	1980	1911	1904
35°	1929	1848	1832
40°	1867	1784	1763
45°	1805	1720	1693
50°	1738	1653	1611
55°	1667	1575	1536
60°	1587	1483	1450
65°	1499	1387	1348
70°	1388	1271	1239
75°	1234	1131	1138
80°	1048	954	946
85°	759	647	627

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1805 cd/sqm

TEST NUMBER: P907399

CATALOG NUMBER: DFN2DIP-TR4F0-070D090US835-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	256.4	1.6
10°-20°	721.3	4.6
20°-30°	1060.0	6.7
30°-40°	1231.1	7.8
40°-50°	1229.6	7.8
50°-60°	1072.2	6.8
60°-70°	792.6	5.0
70°-80°	448.4	2.8
80°-90°	123.7	0.8
90°-100°	100.2	0.6
100°-110°	373.4	2.4
110°-120°	990.2	6.3
120°-130°	1642.4	10.4
130°-140°	1744.6	11.0
140°-150°	1621.4	10.2
150°-160°	1303.5	8.2
160°-170°	840.0	5.3
170°-180°	289.1	1.8
0°-30°	2037.7	12.9
0°-40°	3268.8	20.6
0°-60°	5570.6	35.2
0°-90°	6935.4	43.8
90°-120°	1463.7	9.2
90°-150°	6472.0	40.9
90°-180°	8905.0	56.2
0°-180°	15840.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2724	2724	2724	2724	2724	
5°	2724	2714	2685	2705	2700	259
15°	2593	2577	2543	2554	2541	730
25°	2347	2326	2281	2286	2281	1080
35°	2025	1998	1956	1941	1928	1264
45°	1648	1629	1590	1561	1550	1271
55°	1247	1231	1200	1168	1155	1115
65°	841	825	799	775	762	831
75°	440	435	422	406	411	470
85°	107	105	102	94	92	120
90°	2	26	44	55	59	15
95°	143	70	86	97	94	169
105°	668	734	134	158	167	714
115°	1264	1301	1356	338	180	1244
125°	1787	1815	1857	1873	1879	1594
135°	2211	2246	2266	2288	2284	1708
145°	2565	2563	2600	2615	2604	1604
155°	2824	2805	2831	2844	2826	1301
165°	2976	2963	2969	2985	2969	841
175°	3044	3028	3033	3048	3026	290
180°	3037	3037	3037	3037	3037	

TEST NUMBER: P907399

CATALOG NUMBER: DFN2DIP-TR4F0-070D090US835-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2723.7	2723.7	2723.7	2723.7	2723.7
2.5°	2739.6	2726.5	2697.6	2723.7	2718.7
5°	2723.7	2713.5	2684.6	2705.4	2700.4
7.5°	2705.4	2689.8	2660.9	2682.1	2676.8
10°	2676.8	2658.4	2627.0	2647.9	2640.1
12.5°	2637.3	2621.8	2590.4	2603.4	2598.1
15°	2592.9	2577.3	2543.1	2553.7	2540.6
17.5°	2537.8	2522.3	2488.1	2501.2	2488.1
20°	2477.5	2462.0	2425.3	2433.1	2422.8
22.5°	2417.5	2393.9	2359.7	2359.7	2354.4
25°	2346.7	2325.8	2281.4	2286.4	2281.4
27.5°	2268.0	2249.7	2215.8	2208.0	2194.9
30°	2189.7	2168.5	2129.4	2121.6	2111.0
32.5°	2105.7	2090.2	2048.2	2032.4	2021.8
35°	2024.6	1998.5	1956.5	1940.7	1927.6
37.5°	1932.9	1909.3	1867.3	1849.0	1835.9
40°	1838.7	1817.6	1775.6	1752.3	1741.7
42.5°	1747.0	1725.9	1684.2	1657.8	1642.2
45°	1647.5	1629.2	1589.7	1561.1	1550.5
47.5°	1550.5	1532.2	1490.2	1461.3	1445.8
50°	1448.3	1435.2	1398.5	1361.9	1348.8
52.5°	1348.8	1330.5	1296.6	1267.7	1249.3
55°	1246.8	1231.0	1199.6	1168.2	1155.1
57.5°	1144.6	1131.5	1097.3	1065.9	1055.4
60°	1042.3	1032.0	995.4	966.5	958.7
62.5°	942.8	924.5	898.4	872.3	861.7
65°	840.9	825.0	798.9	775.3	762.2
67.5°	736.1	722.8	699.4	681.1	670.5
70°	639.1	628.6	604.9	586.6	576.3
72.5°	539.6	529.1	516.0	497.7	489.9
75°	439.9	434.9	421.5	406.0	411.3
77.5°	351.0	340.4	335.1	327.3	319.6
80°	262.0	259.3	254.0	246.2	240.9
82.5°	178.1	178.1	175.6	165.1	165.1
85°	107.3	104.8	102.3	94.2	91.7
87.5°	47.2	42.0	36.7	28.9	26.1
90°	2.1	26.4	43.8	55.1	59.2
92.5°	55.1	46.2	52.7	57.2	59.2
95°	142.8	70.2	85.6	96.8	94.5
97.5°	257.1	77.0	112.0	118.7	120.8
100°	389.1	88.0	125.3	142.8	147.2
102.5°	534.0	529.8	129.7	153.7	160.5
105°	668.1	734.2	134.1	158.2	167.0
107.5°	824.2	879.0	138.6	162.6	171.5
110°	973.7	1019.7	384.7	164.9	173.6

TEST NUMBER: P907399

CATALOG NUMBER: DFN2DIP-TR4F0-070D090US835-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1114.4	1153.8	1116.5	169.1	175.9
115°	1263.7	1301.0	1356.1	338.5	180.3
117.5°	1393.4	1437.3	1474.8	1160.4	584.6
120°	1538.5	1571.4	1611.1	1637.4	1340.7
122.5°	1661.5	1696.7	1740.8	1753.8	1756.2
125°	1786.7	1815.4	1857.2	1872.6	1879.1
127.5°	1901.0	1931.8	1965.0	1986.9	1989.0
130°	2008.8	2044.1	2068.1	2092.3	2090.3
132.5°	2118.7	2147.4	2171.4	2191.3	2189.2
135°	2211.1	2246.3	2265.9	2288.1	2283.7
137.5°	2307.7	2334.0	2356.2	2378.1	2371.6
140°	2402.1	2419.9	2443.9	2463.7	2452.8
142.5°	2481.5	2496.9	2525.3	2542.8	2531.9
145°	2565.0	2562.6	2600.0	2615.4	2604.4
147.5°	2637.3	2630.8	2668.1	2679.1	2670.4
150°	2707.8	2692.4	2727.6	2740.6	2729.7
152.5°	2767.0	2749.5	2782.4	2795.7	2780.3
155°	2824.2	2804.6	2830.9	2844.0	2826.5
157.5°	2870.4	2852.9	2872.7	2888.1	2870.4
160°	2910.0	2896.7	2910.0	2923.1	2907.7
162.5°	2945.0	2931.9	2942.9	2958.3	2938.5
165°	2975.8	2962.7	2969.3	2984.7	2969.3
167.5°	3000.1	2986.8	2993.5	3008.9	2989.1
170°	3019.9	3006.6	3011.0	3026.4	3006.6
172.5°	3033.0	3019.9	3024.3	3039.7	3019.9
175°	3043.9	3028.5	3033.0	3048.3	3026.4
177.5°	3048.3	3033.0	3035.3	3050.7	3030.9
180°	3037.4	3037.4	3037.4	3037.4	3037.4

TEST NUMBER: P907399

CATALOG NUMBER: DFN2DIP-TR4F0-070D090US835-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.35	10.15	10.35	11.17	12.53	8.91	9.72	9.92	10.74	12.10
	3H	11.00	11.73	12.02	12.75	14.13	10.53	11.25	11.55	12.28	13.66
	4H	11.59	12.27	12.62	13.30	14.69	11.11	11.80	12.14	12.83	14.22
	6H	11.98	12.62	13.03	13.65	15.05	11.51	12.14	12.55	13.17	14.57
	8H	12.09	12.69	13.13	13.74	15.13	11.61	12.21	12.66	13.26	14.66
	12H	12.13	12.70	13.18	13.75	15.17	11.65	12.22	12.70	13.27	14.69
4H	2H	9.80	10.49	10.84	11.52	12.90	9.46	10.14	10.49	11.17	12.56
	3H	11.66	12.23	12.71	13.29	14.69	11.27	11.84	12.32	12.90	14.30
	4H	12.37	12.90	13.43	13.95	15.37	11.97	12.49	13.02	13.54	14.96
	6H	12.89	13.34	13.95	14.41	15.83	12.48	12.93	13.54	14.00	15.42
	8H	13.03	13.46	14.10	14.52	15.95	12.62	13.04	13.69	14.11	15.54
	12H	13.10	13.49	14.19	14.57	16.00	12.68	13.06	13.76	14.14	15.58
8H	4H	12.57	12.99	13.63	14.05	15.48	12.21	12.63	13.27	13.69	15.12
	6H	13.20	13.54	14.28	14.65	16.08	12.83	13.18	13.92	14.29	15.72
	8H	13.42	13.72	14.51	14.81	16.26	13.05	13.35	14.14	14.44	15.89
	12H	13.54	13.81	14.64	14.90	16.39	13.16	13.43	14.26	14.52	16.00
12H	4H	12.55	12.93	13.63	14.01	15.45	12.20	12.58	13.28	13.66	15.09
	6H	13.22	13.53	14.32	14.62	16.07	12.87	13.18	13.97	14.27	15.72
	8H	13.46	13.73	14.56	14.82	16.31	13.11	13.38	14.20	14.46	15.95