

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907457

Luminaire Tested: DFN2DIP-TR4F0-090D050US835-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907457
REPORT IS A COMBINATION OF REPORTS P901918 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D050US835-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12600.0 lumens
Efficiency: N/A
Efficacy: 100.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 125.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907457

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US835-RLLONL

Luminous Intensity Polar Plot

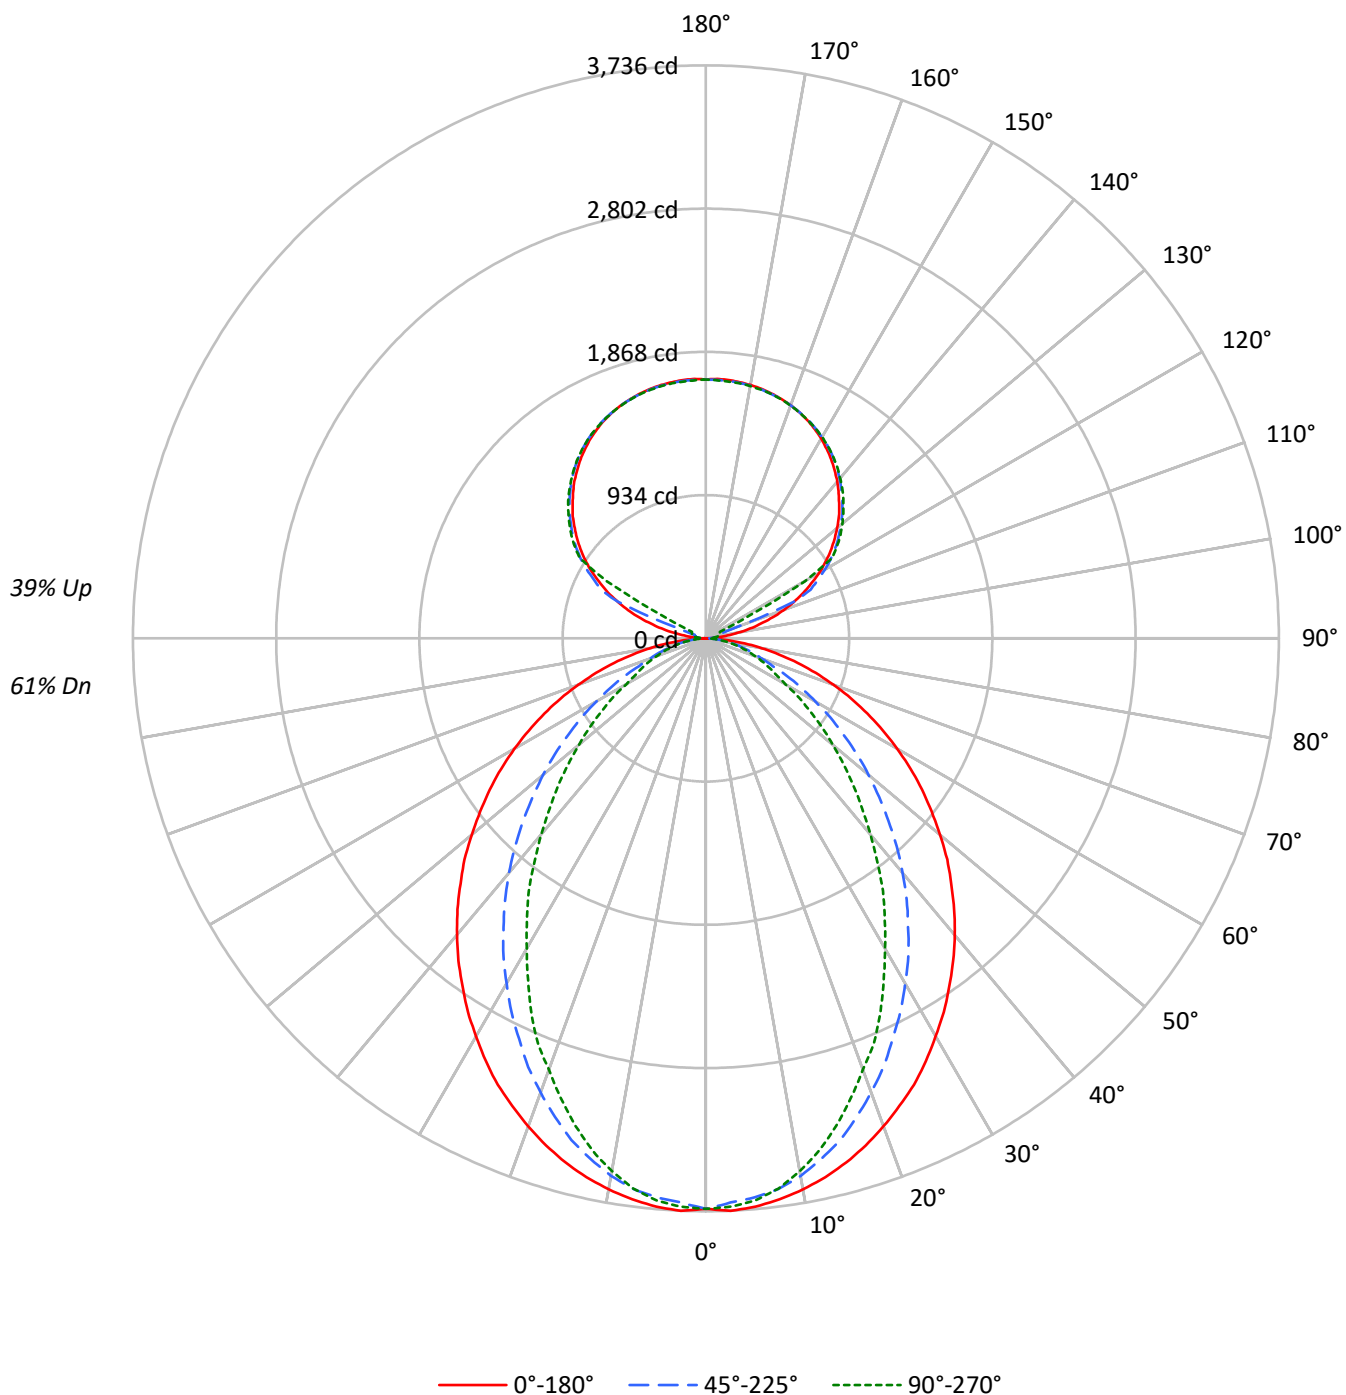

TEST NUMBER: P907457

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US835-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	103	103	103	103	89	89	89	77	77	77	66	66	66
1	101	97	93	90	94	91	87	84	79	77	75	69	67	65	59	58	57
2	92	85	79	74	86	80	75	70	70	66	63	61	58	56	53	51	49
3	85	75	68	62	79	71	65	59	62	58	53	55	51	48	47	45	42
4	78	67	59	53	73	63	56	51	56	50	46	49	45	41	43	40	37
5	72	60	52	46	67	57	50	44	50	45	40	44	40	36	39	35	33
6	66	54	46	41	62	51	44	39	46	40	35	40	36	32	35	32	29
7	61	49	41	36	57	47	39	34	42	36	32	37	32	29	33	29	26
8	57	45	37	32	53	43	36	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	30	26	31	27	23	28	24	21
10	50	38	31	26	47	36	30	25	33	27	23	29	25	21	26	22	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2955	2955	2955
5°	2960	2908	2927
10°	2931	2851	2831
15°	2890	2757	2684
20°	2837	2627	2503
25°	2782	2481	2329
30°	2709	2332	2107
35°	2637	2171	1913
40°	2564	2005	1690
45°	2479	1821	1488
50°	2391	1635	1291
55°	2299	1436	1101
60°	2193	1228	906
65°	2071	1017	816
70°	1923	820	738
75°	1737	723	671
80°	1468	606	582
85°	1023	404	437

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2479 cd/sqm

TEST NUMBER: P907457

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US835-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	348.6	2.8
10°-20°	957.0	7.6
20°-30°	1343.6	10.7
30°-40°	1464.6	11.6
40°-50°	1346.2	10.7
50°-60°	1057.2	8.4
60°-70°	688.1	5.5
70°-80°	354.2	2.8
80°-90°	93.4	0.7
90°-100°	55.7	0.4
100°-110°	207.4	1.6
110°-120°	550.1	4.4
120°-130°	912.4	7.2
130°-140°	969.2	7.7
140°-150°	900.8	7.1
150°-160°	724.2	5.7
160°-170°	466.6	3.7
170°-180°	160.6	1.3
0°-30°	2649.2	21.0
0°-40°	4113.9	32.6
0°-60°	6517.2	51.7
0°-90°	7653.0	60.7
90°-120°	813.2	6.5
90°-150°	3595.6	28.5
90°-180°	4947.0	39.3
0°-180°	12600.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3720	3720	3720	3720	3720	
5°	3720	3703	3659	3689	3679	353
15°	3538	3501	3386	3322	3289	997
25°	3212	3104	2882	2744	2693	1477
35°	2767	2595	2299	2087	2013	1732
45°	2262	2036	1683	1444	1363	1747
55°	1720	1458	1094	892	828	1537
65°	1161	889	586	471	461	1151
75°	619	384	269	246	242	655
85°	145	74	64	64	64	166
90°	1	15	24	31	33	12
95°	79	39	48	54	52	94
105°	371	408	74	88	93	397
115°	702	723	753	188	100	691
125°	993	1009	1032	1040	1044	885
135°	1228	1248	1259	1271	1269	949
145°	1425	1424	1444	1453	1447	891
155°	1569	1558	1573	1580	1570	723
165°	1653	1646	1650	1658	1650	467
175°	1691	1682	1685	1694	1681	161
180°	1687	1687	1687	1687	1687	

TEST NUMBER: P907457

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US835-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3719.7	3719.7	3719.7	3719.7	3719.7
2.5°	3736.5	3719.7	3682.5	3716.5	3709.7
5°	3719.7	3702.9	3659.0	3689.3	3679.3
7.5°	3689.3	3669.3	3622.2	3635.4	3618.6
10°	3649.0	3625.4	3558.3	3547.9	3527.9
12.5°	3598.6	3568.3	3477.2	3457.2	3420.0
15°	3537.9	3500.8	3386.5	3322.5	3289.0
17.5°	3467.2	3413.3	3271.8	3197.9	3144.0
20°	3386.5	3319.0	3150.7	3066.8	2992.5
22.5°	3299.0	3221.5	3026.1	2911.8	2861.5
25°	3211.5	3103.6	2881.5	2743.6	2692.9
27.5°	3107.2	2992.5	2746.8	2588.6	2511.1
30°	2996.1	2867.9	2598.6	2427.2	2336.1
32.5°	2888.2	2733.2	2457.5	2255.4	2171.1
35°	2767.2	2595.4	2299.3	2087.2	2012.9
37.5°	2649.3	2464.0	2151.1	1918.6	1834.7
40°	2524.7	2322.9	1996.1	1757.2	1669.7
42.5°	2396.8	2181.5	1841.4	1592.2	1508.2
45°	2262.2	2036.5	1683.2	1443.9	1363.2
47.5°	2134.3	1895.4	1531.8	1292.5	1218.6
50°	1992.9	1753.9	1383.6	1151.1	1080.7
52.5°	1854.7	1602.2	1242.2	1020.0	956.1
55°	1720.0	1457.5	1093.9	892.2	828.2
57.5°	1582.2	1312.9	962.9	774.3	720.4
60°	1440.7	1171.4	824.7	653.2	599.3
62.5°	1302.9	1033.6	706.8	545.4	518.6
65°	1161.4	888.6	585.7	471.4	461.1
67.5°	1026.8	753.9	471.4	413.9	403.9
70°	885.4	622.9	390.4	356.8	343.2
72.5°	750.7	501.4	326.4	299.6	292.9
75°	619.3	383.6	269.3	245.7	242.5
77.5°	488.2	272.5	212.1	198.6	191.8
80°	366.8	195.4	161.4	148.2	148.2
82.5°	255.7	131.4	111.1	104.3	104.3
85°	144.6	73.9	63.9	63.9	63.9
87.5°	53.9	26.8	26.8	23.6	23.6
90°	1.2	14.6	24.4	30.6	32.9
92.5°	30.6	25.7	29.3	31.8	32.9
95°	79.3	39.0	47.6	53.8	52.5
97.5°	142.8	42.8	62.2	66.0	67.1
100°	216.2	48.9	69.6	79.3	81.8
102.5°	296.7	294.3	72.1	85.4	89.2
105°	371.2	407.9	74.5	87.9	92.8
107.5°	457.9	488.3	77.0	90.3	95.3
110°	541.0	566.5	213.7	91.6	96.4



TEST NUMBER: P907457

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US835-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	619.1	641.0	620.3	94.0	97.7
115°	702.1	722.8	753.4	188.1	100.2
117.5°	774.1	798.5	819.4	644.6	324.8
120°	854.7	873.0	895.0	909.7	744.8
122.5°	923.0	942.6	967.1	974.4	975.7
125°	992.6	1008.6	1031.8	1040.3	1044.0
127.5°	1056.1	1073.2	1091.7	1103.8	1105.0
130°	1116.0	1135.6	1148.9	1162.4	1161.3
132.5°	1177.1	1193.0	1206.3	1217.4	1216.2
135°	1228.4	1248.0	1258.8	1271.2	1268.7
137.5°	1282.0	1296.7	1309.0	1321.2	1317.6
140°	1334.5	1344.4	1357.7	1368.7	1362.7
142.5°	1378.6	1387.2	1403.0	1412.7	1406.6
145°	1425.0	1423.7	1444.4	1453.0	1446.9
147.5°	1465.2	1461.5	1482.3	1488.4	1483.6
150°	1504.3	1495.8	1515.3	1522.6	1516.5
152.5°	1537.2	1527.5	1545.8	1553.2	1544.6
155°	1569.0	1558.1	1572.7	1580.0	1570.3
157.5°	1594.6	1584.9	1595.9	1604.5	1594.6
160°	1616.7	1609.3	1616.7	1623.9	1615.4
162.5°	1636.1	1628.9	1634.9	1643.5	1632.5
165°	1653.2	1646.0	1649.6	1658.1	1649.6
167.5°	1666.7	1659.3	1663.1	1671.6	1660.6
170°	1677.7	1670.3	1672.8	1681.3	1670.3
172.5°	1685.0	1677.7	1680.2	1688.7	1677.7
175°	1691.1	1682.5	1685.0	1693.5	1681.3
177.5°	1693.5	1685.0	1686.3	1694.8	1683.8
180°	1687.4	1687.4	1687.4	1687.4	1687.4

TEST NUMBER: P907457

CATALOG NUMBER: DFN2DIP-TR4F0-090D050US835-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.85	12.78	12.72	13.66	14.77	7.83	8.75	8.69	9.64	10.75
	3H	13.54	14.37	14.42	15.26	16.40	9.02	9.85	9.90	10.74	11.88
	4H	14.15	14.93	15.05	15.83	16.98	9.48	10.26	10.37	11.16	12.31
	6H	14.58	15.30	15.48	16.20	17.36	9.81	10.53	10.71	11.43	12.59
	8H	14.71	15.39	15.62	16.31	17.47	9.90	10.58	10.81	11.51	12.67
	12H	14.77	15.42	15.69	16.34	17.52	9.95	10.60	10.87	11.51	12.70
4H	2H	11.88	12.67	12.78	13.56	14.71	8.43	9.22	9.33	10.11	11.26
	3H	13.72	14.37	14.63	15.30	16.46	9.79	10.44	10.70	11.37	12.54
	4H	14.42	15.01	15.34	15.93	17.12	10.35	10.94	11.27	11.86	13.05
	6H	14.94	15.45	15.87	16.40	17.59	10.77	11.28	11.71	12.23	13.42
	8H	15.11	15.59	16.05	16.53	17.74	10.90	11.38	11.84	12.32	13.53
	12H	15.21	15.64	16.17	16.60	17.81	10.97	11.40	11.93	12.36	13.57
8H	4H	14.39	14.87	15.33	15.81	17.01	10.63	11.11	11.57	12.05	13.26
	6H	14.96	15.35	15.93	16.34	17.54	11.16	11.55	12.12	12.53	13.74
	8H	15.18	15.53	16.15	16.50	17.72	11.35	11.70	12.32	12.67	13.89
	12H	15.32	15.63	16.30	16.59	17.86	11.47	11.78	12.45	12.75	14.02
12H	4H	14.35	14.78	15.31	15.74	16.95	10.64	11.07	11.60	12.03	13.24
	6H	14.94	15.29	15.91	16.26	17.48	11.21	11.55	12.18	12.53	13.75
	8H	15.16	15.47	16.14	16.44	17.71	11.42	11.73	12.40	12.70	13.96

END OF REPORT