

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P907474

Luminaire Tested: DFN2DIP-TR4F0-090D100US835-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P907474
REPORT IS A COMBINATION OF REPORTS P900487 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D100US835-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17760.0 lumens
Efficiency: N/A
Efficacy: 108.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 163.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P907474

CATALOG NUMBER: DFN2DIP-TR4F0-090D100US835-FLLFLL

Luminous Intensity Polar Plot

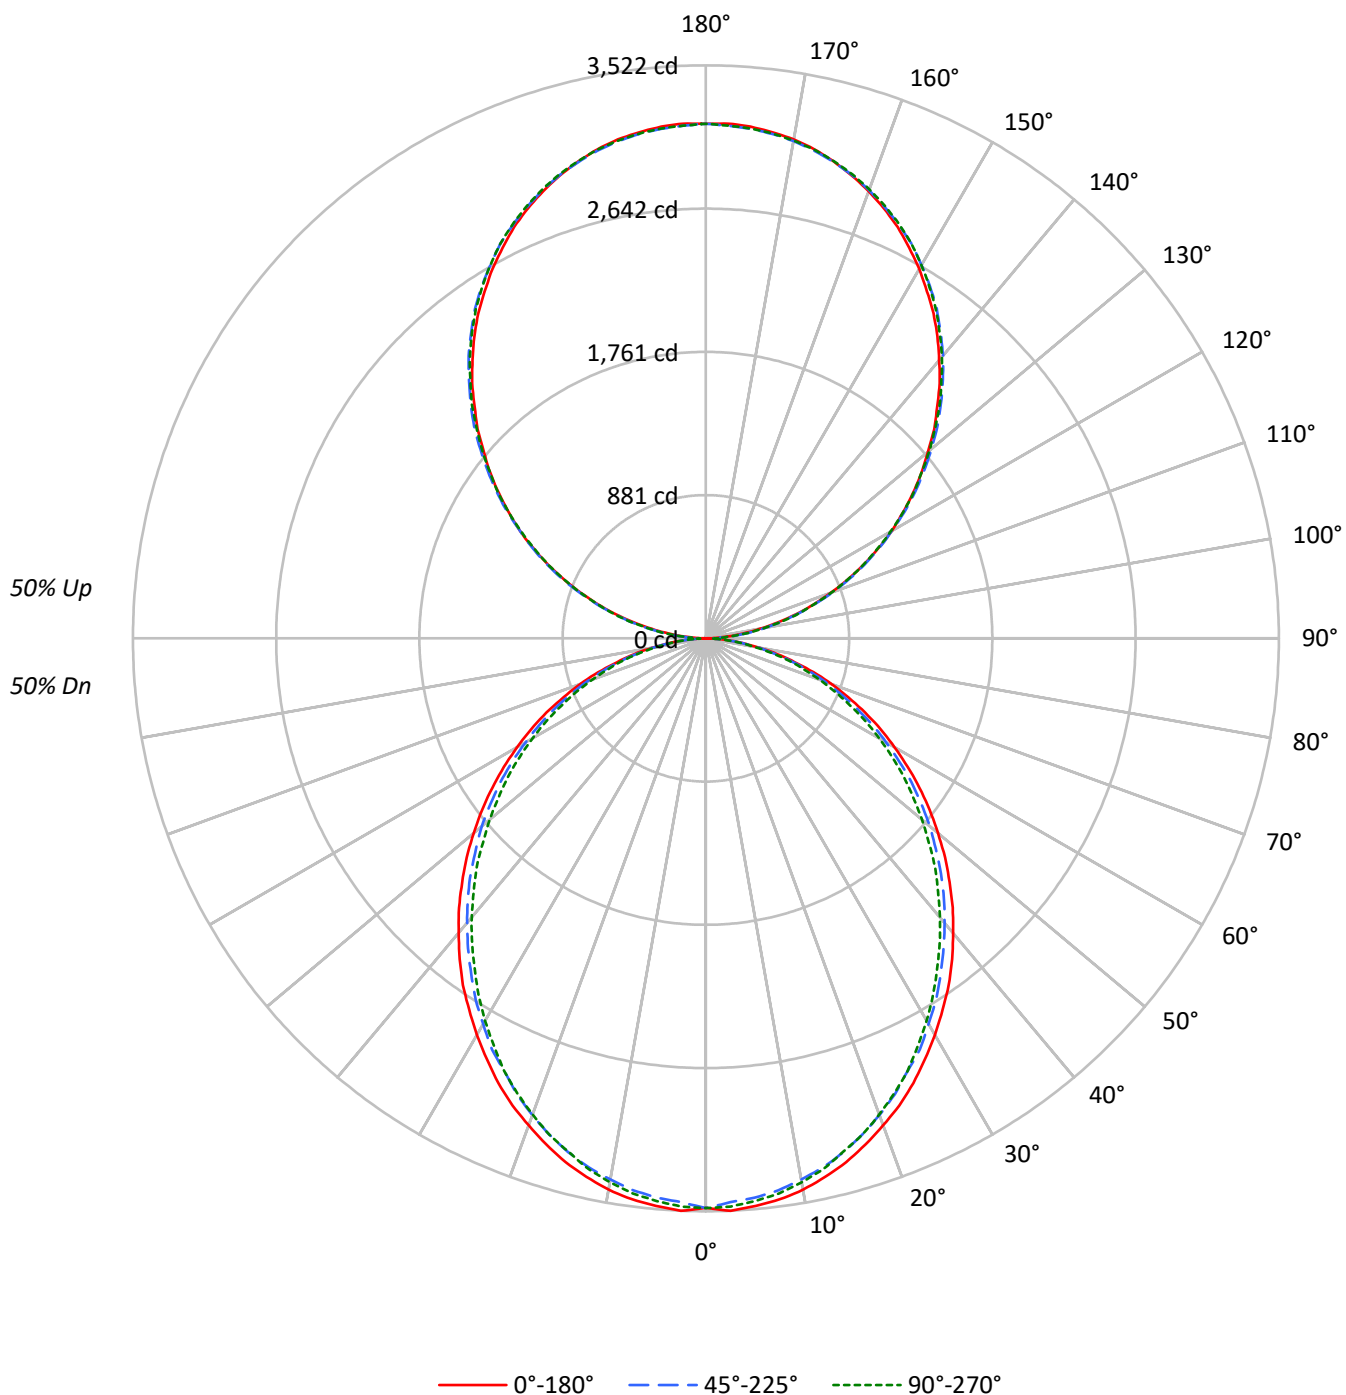

TEST NUMBER: P907474

CATALOG NUMBER: DFN2DIP-TR4F0-090D100US835-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	69	61	59	58	50	49	48
2	89	82	76	70	82	76	70	66	64	60	57	54	51	48	44	42	40
3	81	72	64	59	75	67	60	55	57	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	41	35	31	34	30	27	28	25	23
7	58	46	38	32	54	43	36	31	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	34	28	24	29	24	21	24	20	18
9	50	38	31	25	46	36	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2782	2782	2782
5°	2786	2743	2762
10°	2764	2706	2724
15°	2723	2662	2666
20°	2668	2600	2606
25°	2614	2526	2537
30°	2545	2457	2449
35°	2481	2376	2355
40°	2401	2293	2267
45°	2321	2211	2176
50°	2234	2125	2071
55°	2143	2025	1975
60°	2040	1906	1864
65°	1928	1783	1734
70°	1785	1634	1593
75°	1586	1455	1464
80°	1348	1226	1216
85°	975	832	806

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2466 cd/sqm

TEST NUMBER: P907474

CATALOG NUMBER: DFN2DIP-TR4F0-090D100US835-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	329.6	1.9
10°-20°	927.4	5.2
20°-30°	1362.9	7.7
30°-40°	1582.9	8.9
40°-50°	1580.9	8.9
50°-60°	1378.5	7.8
60°-70°	1019.0	5.7
70°-80°	576.6	3.2
80°-90°	161.2	0.9
90°-100°	195.7	1.1
100°-110°	621.8	3.5
110°-120°	1064.1	6.0
120°-130°	1399.5	7.9
130°-140°	1570.9	8.8
140°-150°	1540.4	8.7
150°-160°	1292.2	7.3
160°-170°	856.9	4.8
170°-180°	299.5	1.7
0°-30°	2619.9	14.8
0°-40°	4202.8	23.7
0°-60°	7162.3	40.3
0°-90°	8919.0	50.2
90°-120°	1881.6	10.6
90°-150°	6392.4	36.0
90°-180°	8841.0	49.8
0°-180°	17760.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3502	3502	3502	3502	3502	
5°	3502	3489	3452	3478	3472	332
15°	3334	3314	3270	3283	3266	939
25°	3017	2990	2933	2940	2933	1388
35°	2603	2570	2516	2495	2478	1626
45°	2118	2095	2044	2007	1994	1635
55°	1603	1583	1542	1502	1485	1433
65°	1081	1061	1027	997	980	1069
75°	566	559	542	522	529	604
85°	138	135	132	121	118	154
90°	3	34	93	88	91	17
95°	139	166	171	171	166	155
105°	574	582	587	592	592	606
115°	1068	1083	1078	1076	1068	1056
125°	1553	1577	1569	1561	1558	1388
135°	2009	2038	2044	2041	2034	1553
145°	2439	2458	2473	2476	2466	1524
155°	2789	2796	2805	2818	2810	1284
165°	3034	3031	3031	3050	3037	856
175°	3157	3149	3144	3163	3146	300
180°	3163	3163	3163	3163	3163	

TEST NUMBER: P907474

CATALOG NUMBER: DFN2DIP-TR4F0-090D100US835-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3501.9	3501.9	3501.9	3501.9	3501.9
2.5°	3522.3	3505.5	3468.4	3501.9	3495.5
5°	3501.9	3488.7	3451.6	3478.4	3471.9
7.5°	3478.4	3458.4	3421.2	3448.4	3441.6
10°	3441.6	3418.0	3377.6	3404.4	3394.4
12.5°	3390.8	3370.8	3330.5	3347.2	3340.5
15°	3333.7	3313.7	3269.7	3283.3	3266.5
17.5°	3262.9	3242.9	3199.0	3215.8	3199.0
20°	3185.4	3165.4	3118.2	3128.2	3115.0
22.5°	3108.2	3077.9	3033.9	3033.9	3027.1
25°	3017.1	2990.3	2933.2	2939.6	2933.2
27.5°	2916.0	2892.4	2848.9	2838.9	2822.1
30°	2815.3	2788.1	2737.7	2727.7	2714.2
32.5°	2707.4	2687.4	2633.4	2613.1	2599.5
35°	2603.1	2569.5	2515.5	2495.2	2478.4
37.5°	2485.2	2454.8	2400.8	2377.3	2360.5
40°	2364.0	2336.9	2282.9	2252.9	2239.4
42.5°	2246.1	2219.0	2165.4	2131.5	2111.5
45°	2118.2	2094.7	2043.9	2007.1	1993.6
47.5°	1993.6	1970.0	1916.0	1878.9	1858.9
50°	1862.1	1845.3	1798.1	1751.0	1734.2
52.5°	1734.2	1710.6	1667.0	1629.9	1606.3
55°	1603.1	1582.7	1542.3	1502.0	1485.2
57.5°	1471.6	1454.8	1410.9	1370.5	1356.9
60°	1340.1	1326.9	1279.7	1242.6	1232.6
62.5°	1212.2	1188.6	1155.0	1121.5	1107.9
65°	1081.1	1060.7	1027.1	996.8	980.0
67.5°	946.4	929.3	899.2	875.7	862.1
70°	821.7	808.1	777.8	754.2	741.0
72.5°	693.8	680.2	663.4	639.9	629.9
75°	565.6	559.1	542.0	522.0	528.8
77.5°	451.2	437.7	430.9	420.9	410.9
80°	336.9	333.3	326.5	316.5	309.8
82.5°	229.0	229.0	225.8	212.2	212.2
85°	137.9	134.7	131.5	121.1	117.9
87.5°	60.7	53.9	47.2	37.2	33.6
90°	2.9	34.3	93.4	87.7	90.6
92.5°	59.1	80.1	83.0	85.8	85.8
95°	139.2	165.9	170.7	170.7	165.9
97.5°	231.7	256.5	267.0	267.0	267.0
100°	338.5	360.4	368.0	368.0	365.2
102.5°	451.0	467.2	477.7	480.5	477.7
105°	574.0	581.6	587.3	592.1	592.1
107.5°	696.0	707.5	707.5	709.4	696.0
110°	814.3	829.5	829.5	829.5	821.9

TEST NUMBER: P907474

CATALOG NUMBER: DFN2DIP-TR4F0-090D100US835-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	942.0	958.2	955.4	947.7	942.0
115°	1067.9	1083.1	1078.4	1075.5	1067.9
117.5°	1192.8	1213.8	1200.4	1192.8	1185.1
120°	1318.6	1339.6	1318.6	1318.6	1310.1
122.5°	1433.0	1459.7	1446.4	1438.8	1433.0
125°	1553.2	1577.0	1569.4	1560.8	1558.0
127.5°	1670.5	1700.0	1689.5	1678.1	1670.5
130°	1780.1	1814.4	1809.7	1803.9	1793.5
132.5°	1903.1	1929.8	1931.7	1918.4	1910.7
135°	2008.9	2038.5	2044.2	2041.4	2033.7
137.5°	2127.2	2151.0	2155.8	2153.9	2142.4
140°	2231.1	2254.9	2268.3	2268.3	2257.8
142.5°	2337.9	2361.7	2369.3	2372.2	2361.7
145°	2438.9	2458.0	2473.3	2476.1	2465.6
147.5°	2529.5	2553.4	2564.8	2569.6	2559.1
150°	2623.0	2639.2	2649.7	2658.2	2649.7
152.5°	2705.9	2722.1	2735.5	2746.0	2735.5
155°	2788.9	2796.5	2805.1	2818.4	2809.8
157.5°	2860.4	2866.1	2870.9	2889.9	2876.6
160°	2924.3	2930.0	2932.8	2949.0	2937.6
162.5°	2983.4	2983.4	2986.2	3004.3	2991.0
165°	3033.9	3031.0	3031.0	3050.1	3036.8
167.5°	3079.7	3071.1	3071.1	3090.2	3076.8
170°	3114.0	3106.4	3103.5	3122.6	3106.4
172.5°	3137.8	3130.2	3127.3	3146.4	3130.2
175°	3156.9	3149.3	3143.6	3162.6	3146.4
177.5°	3167.4	3159.8	3154.0	3170.2	3154.0
180°	3162.6	3162.6	3162.6	3162.6	3162.6

TEST NUMBER: P907474

CATALOG NUMBER: DFN2DIP-TR4F0-090D100US835-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.84	11.70	11.80	12.67	13.94	10.41	11.27	11.36	12.24	13.51
	3H	12.50	13.28	13.47	14.26	15.55	12.03	12.80	12.99	13.78	15.07
	4H	13.09	13.82	14.07	14.81	16.10	12.62	13.35	13.60	14.33	15.63
	6H	13.49	14.16	14.48	15.15	16.46	13.01	13.69	14.00	14.68	15.99
	8H	13.59	14.24	14.59	15.24	16.55	13.12	13.76	14.12	14.77	16.08
	12H	13.64	14.25	14.64	15.25	16.59	13.16	13.77	14.16	14.77	16.11
4H	2H	11.30	12.04	12.29	13.02	14.32	10.96	11.69	11.94	12.67	13.97
	3H	13.17	13.78	14.16	14.79	16.11	12.78	13.39	13.77	14.40	15.71
	4H	13.88	14.44	14.89	15.45	16.78	13.48	14.04	14.48	15.04	16.38
	6H	14.40	14.88	15.41	15.91	17.24	13.99	14.47	15.00	15.50	16.83
	8H	14.55	15.00	15.56	16.02	17.37	14.14	14.59	15.15	15.61	16.96
	12H	14.62	15.03	15.66	16.07	17.42	14.20	14.61	15.23	15.64	17.00
8H	4H	14.08	14.53	15.10	15.55	16.90	13.72	14.17	14.74	15.19	16.54
	6H	14.71	15.08	15.75	16.15	17.49	14.35	14.72	15.39	15.79	17.13
	8H	14.93	15.26	15.98	16.31	17.67	14.56	14.89	15.61	15.94	17.31
	12H	15.06	15.35	16.12	16.40	17.80	14.68	14.97	15.73	16.01	17.42
12H	4H	14.07	14.47	15.10	15.51	16.86	13.71	14.12	14.75	15.16	16.51
	6H	14.74	15.07	15.79	16.12	17.48	14.39	14.72	15.44	15.77	17.13
	8H	14.98	15.27	16.04	16.32	17.72	14.63	14.91	15.68	15.96	17.37