

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910007

Luminaire Tested: DFN2DIP-TR4F0-040D060US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910007
REPORT IS A COMBINATION OF REPORTS P901925 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-040D060US840-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9997.6 lumens
Efficiency: N/A
Efficacy: 130.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 76.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910007

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US840-FLLONL

Luminous Intensity Polar Plot

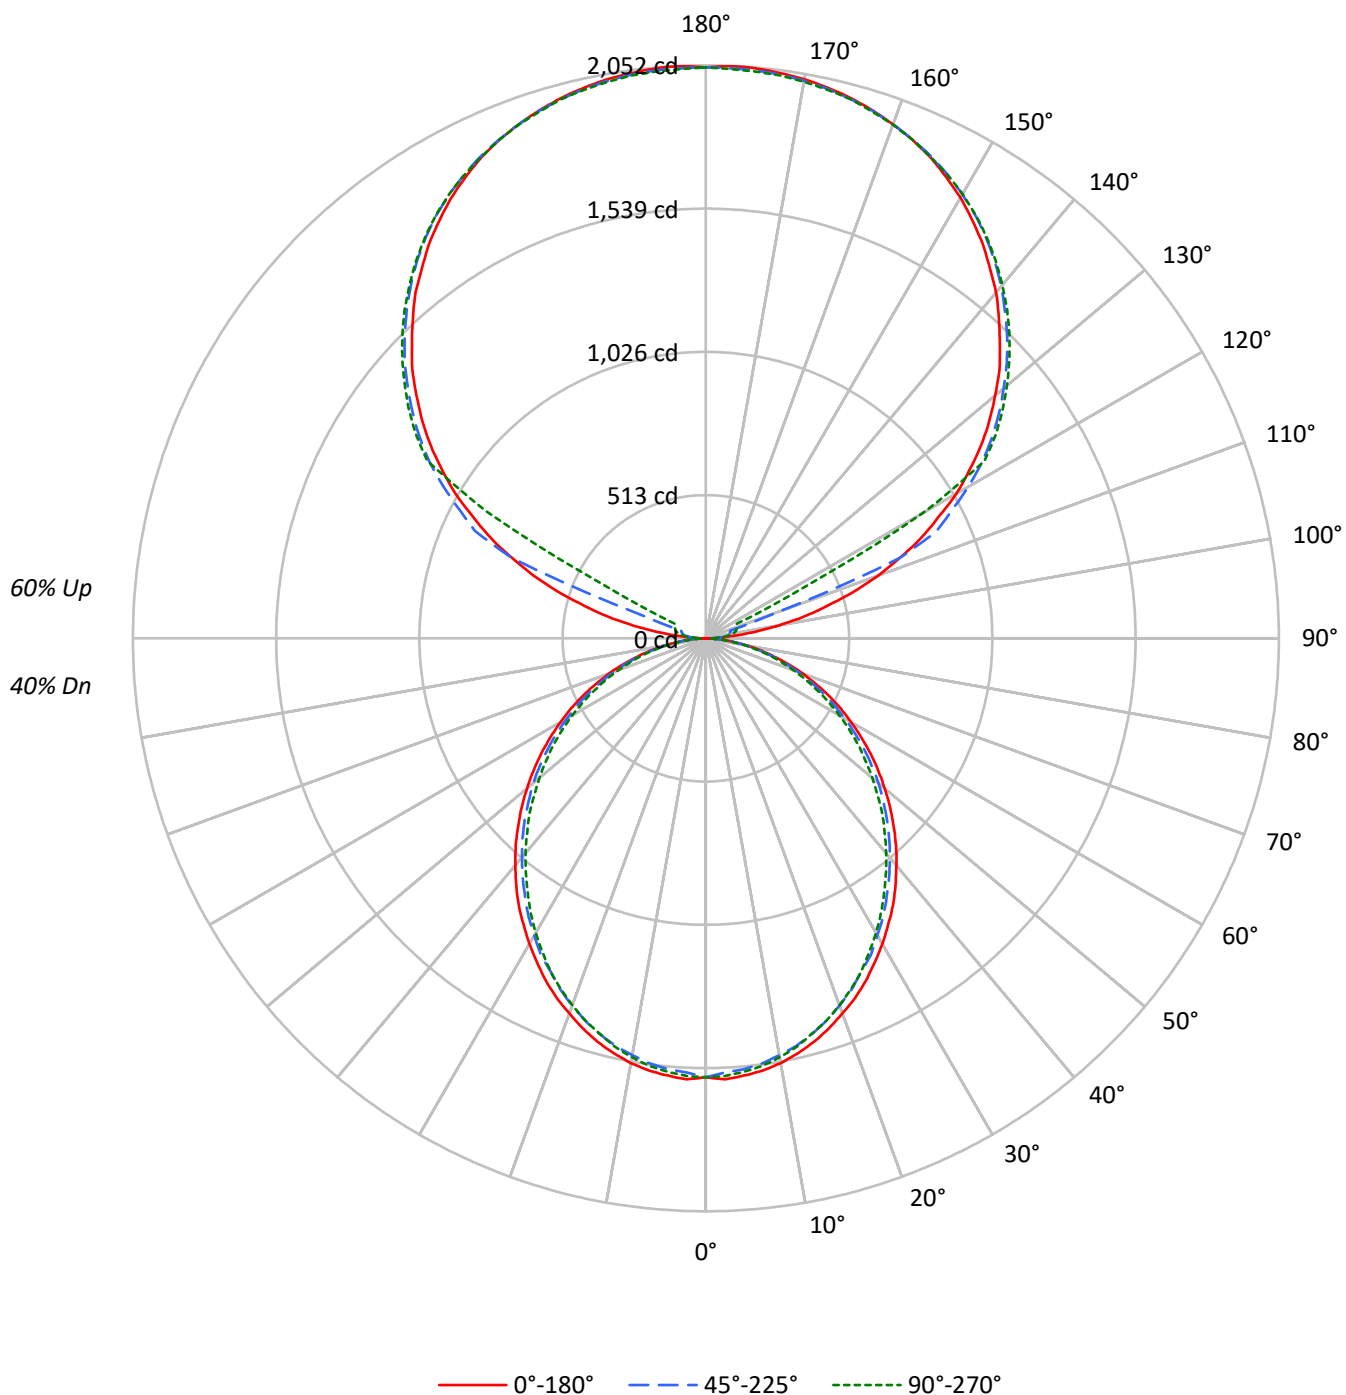

TEST NUMBER: P910007

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47
1	96	91	87	84	87	83	80	77	68	66	64	54	53	51	41	41	40
2	87	80	74	69	79	73	68	63	60	56	53	48	45	43	37	35	33
3	79	70	63	57	72	64	58	53	53	48	44	42	39	36	32	30	28
4	73	62	54	48	66	57	50	45	47	42	38	37	34	31	29	26	24
5	67	55	47	41	60	50	44	38	42	37	33	34	30	27	26	23	21
6	61	49	41	36	56	45	38	33	38	32	28	30	26	23	24	21	19
7	57	45	37	31	51	41	34	29	34	29	25	28	24	21	22	19	17
8	52	40	33	27	48	37	30	26	31	26	22	25	21	18	20	17	15
9	49	37	29	24	44	34	27	23	28	23	20	23	19	17	18	15	13
10	46	34	27	22	41	31	25	20	26	21	18	21	18	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1249	1249	1249
5°	1251	1231	1240
10°	1241	1215	1223
15°	1222	1195	1196
20°	1198	1167	1170
25°	1173	1134	1138
30°	1142	1103	1099
35°	1113	1066	1057
40°	1078	1029	1017
45°	1042	992	977
50°	1003	954	930
55°	962	909	886
60°	916	856	837
65°	865	800	778
70°	801	733	715
75°	712	653	657
80°	605	550	546
85°	438	373	362

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1086 cd/sqm

TEST NUMBER: P910007

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.9	1.5
10°-20°	416.2	4.2
20°-30°	611.7	6.1
30°-40°	710.5	7.1
40°-50°	709.6	7.1
50°-60°	618.7	6.2
60°-70°	457.4	4.6
70°-80°	258.8	2.6
80°-90°	71.9	0.7
90°-100°	67.4	0.7
100°-110°	251.4	2.5
110°-120°	666.7	6.7
120°-130°	1105.7	11.1
130°-140°	1174.5	11.7
140°-150°	1091.6	10.9
150°-160°	877.6	8.8
160°-170°	565.5	5.7
170°-180°	194.6	1.9
0°-30°	1175.9	11.8
0°-40°	1886.3	18.9
0°-60°	3214.6	32.2
0°-90°	4002.6	40.0
90°-120°	985.5	9.9
90°-150°	4357.2	43.6
90°-180°	5995.0	60.0
0°-180°	9997.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1572	1572	1572	1572	1572	
5°	1572	1566	1549	1561	1558	149
15°	1496	1487	1468	1474	1466	421
25°	1354	1342	1316	1319	1316	623
35°	1168	1153	1129	1120	1112	730
45°	951	940	917	901	895	734
55°	720	710	692	674	667	643
65°	485	476	461	447	440	480
75°	254	251	243	234	237	271
85°	62	60	59	54	53	69
90°	1	18	30	37	40	9
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P910007

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1571.8	1571.8	1571.8	1571.8	1571.8
2.5°	1580.9	1573.4	1556.7	1571.8	1568.9
5°	1571.8	1565.8	1549.1	1561.2	1558.3
7.5°	1561.2	1552.2	1535.5	1547.7	1544.7
10°	1544.7	1534.1	1516.0	1528.0	1523.5
12.5°	1521.9	1512.9	1494.8	1502.4	1499.2
15°	1496.2	1487.2	1467.5	1473.6	1466.1
17.5°	1464.5	1455.5	1435.8	1443.3	1435.8
20°	1429.7	1420.7	1399.6	1404.0	1398.2
22.5°	1395.0	1381.4	1361.7	1361.7	1358.7
25°	1354.1	1342.1	1316.5	1319.4	1316.5
27.5°	1308.8	1298.2	1278.7	1274.1	1266.7
30°	1263.5	1251.4	1228.8	1224.3	1218.2
32.5°	1215.2	1206.2	1181.9	1172.9	1166.7
35°	1168.3	1153.3	1129.0	1119.9	1112.4
37.5°	1115.4	1101.8	1077.5	1067.0	1059.4
40°	1061.1	1048.8	1024.6	1011.2	1005.1
42.5°	1008.1	995.9	971.9	956.6	947.7
45°	950.7	940.2	917.4	900.9	894.7
47.5°	894.7	884.1	860.0	843.3	834.4
50°	835.8	828.2	807.1	785.9	778.3
52.5°	778.3	767.8	748.2	731.5	720.9
55°	719.5	710.3	692.3	674.1	666.6
57.5°	660.5	653.0	633.2	615.1	609.0
60°	601.5	595.5	574.4	557.7	553.2
62.5°	544.1	533.5	518.5	503.3	497.3
65°	485.2	476.1	461.0	447.4	439.9
67.5°	424.7	417.1	403.6	393.0	387.0
70°	368.8	362.7	349.1	338.5	332.5
72.5°	311.4	305.3	297.8	287.2	282.7
75°	253.9	251.0	243.3	234.3	237.3
77.5°	202.5	196.4	193.4	188.8	184.4
80°	151.2	149.6	146.5	142.1	139.1
82.5°	102.8	102.8	101.4	95.2	95.2
85°	61.9	60.5	59.0	54.3	52.9
87.5°	27.3	24.2	21.2	16.7	15.0
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8

TEST NUMBER: P910007

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P910007

CATALOG NUMBER: DFN2DIP-TR4F0-040D060US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.04	7.82	8.08	8.86	10.27	6.61	7.39	7.65	8.43	9.84
	3H	8.70	9.39	9.74	10.45	11.87	8.22	8.92	9.27	9.97	11.40
	4H	9.28	9.94	10.34	11.00	12.43	8.81	9.47	9.87	10.52	11.95
	6H	9.67	10.28	10.74	11.34	12.79	9.20	9.81	10.27	10.87	12.31
	8H	9.78	10.36	10.85	11.43	12.87	9.30	9.88	10.38	10.96	12.40
	12H	9.82	10.37	10.90	11.44	12.91	9.34	9.89	10.42	10.96	12.42
4H	2H	7.49	8.15	8.56	9.21	10.64	7.15	7.81	8.21	8.86	10.30
	3H	9.35	9.90	10.43	10.99	12.43	8.96	9.51	10.03	10.59	12.04
	4H	10.06	10.57	11.14	11.64	13.11	9.66	10.16	10.74	11.24	12.70
	6H	10.57	11.01	11.66	12.10	13.56	10.16	10.60	11.25	11.69	13.16
	8H	10.72	11.13	11.81	12.21	13.69	10.31	10.71	11.40	11.80	13.28
	12H	10.79	11.16	11.89	12.26	13.74	10.37	10.73	11.47	11.84	13.32
8H	4H	10.25	10.66	11.34	11.75	13.22	9.89	10.30	10.98	11.39	12.86
	6H	10.88	11.21	11.99	12.35	13.82	10.52	10.85	11.63	11.98	13.46
	8H	11.10	11.39	12.22	12.51	14.00	10.73	11.02	11.85	12.14	13.63
	12H	11.23	11.49	12.35	12.59	14.13	10.84	11.10	11.96	12.21	13.74
12H	4H	10.23	10.60	11.34	11.70	13.19	9.88	10.25	10.99	11.35	12.83
	6H	10.91	11.20	12.03	12.32	13.81	10.56	10.85	11.67	11.96	13.46
	8H	11.15	11.41	12.27	12.51	14.05	10.79	11.05	11.91	12.16	13.69