

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910015

Luminaire Tested: DFN2DIP-TR4F0-040D080US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910015
REPORT IS A COMBINATION OF REPORTS P901961 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-040D080US840-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11997.2 lumens
Efficiency: N/A
Efficacy: 131.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 91.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910015

CATALOG NUMBER: DFN2DIP-TR4F0-040D080US840-FLLONL

Luminous Intensity Polar Plot

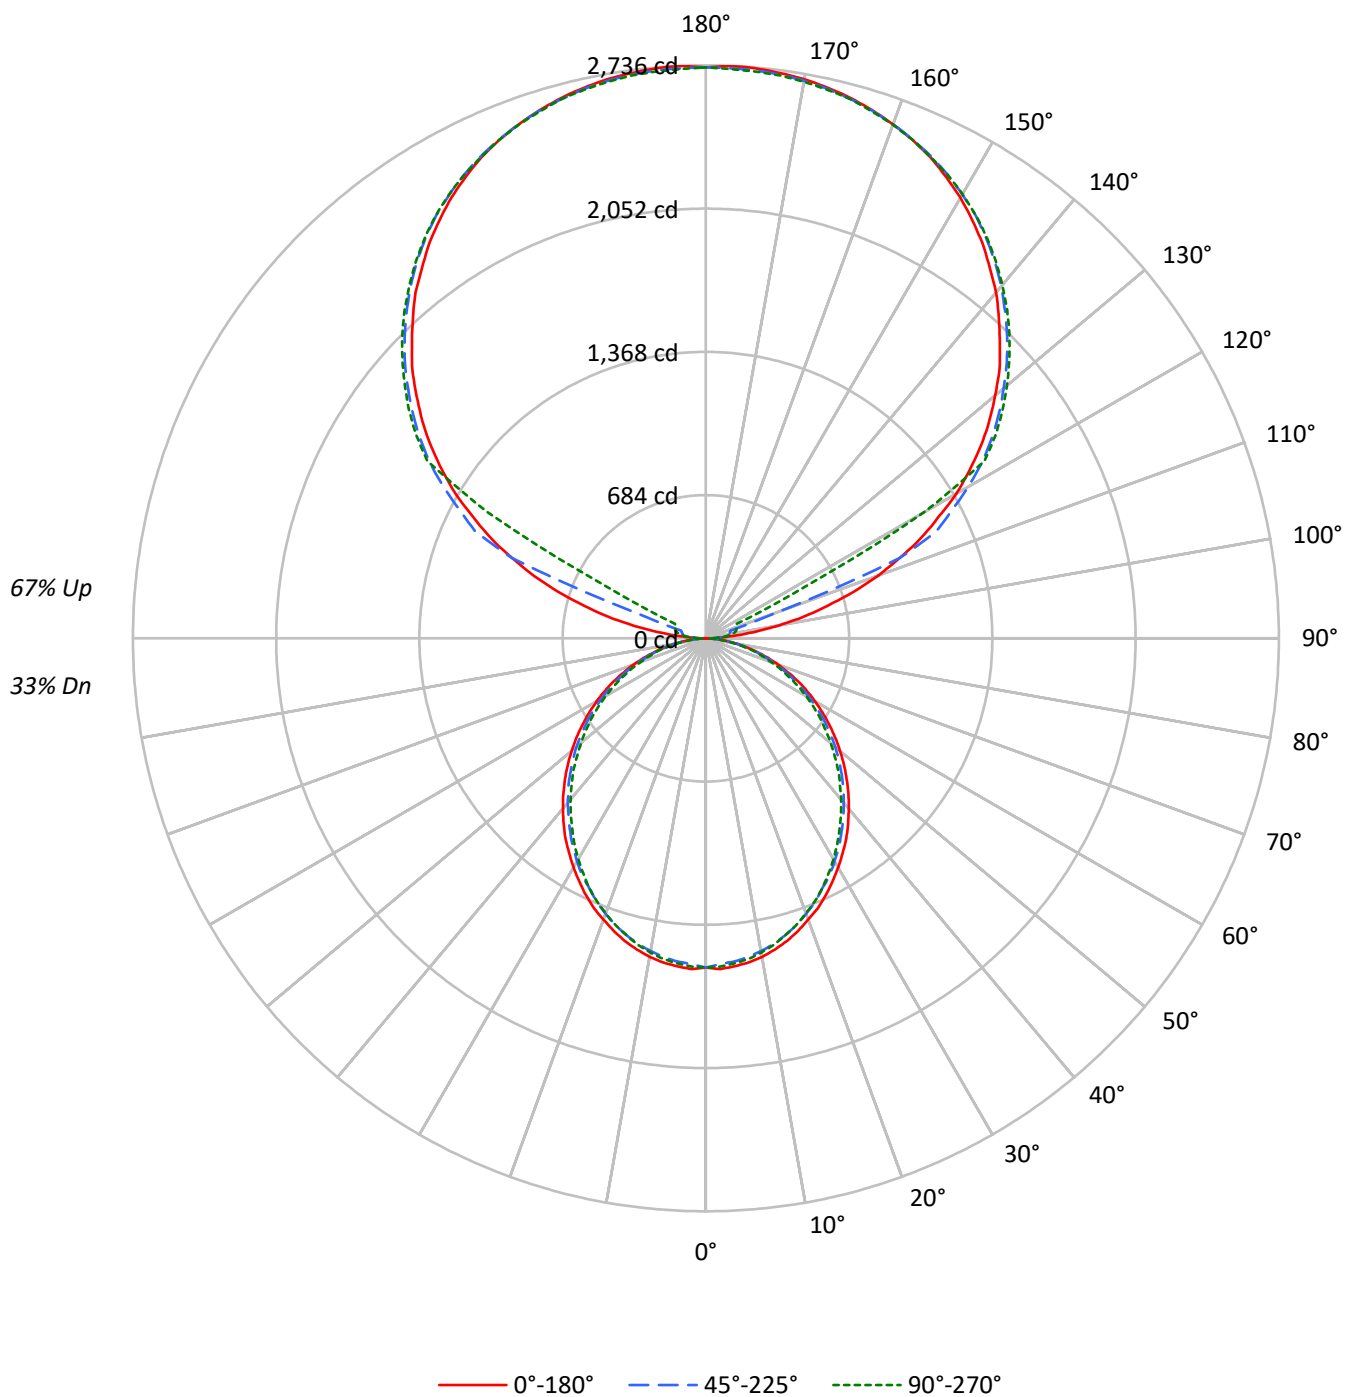

TEST NUMBER: P910015

CATALOG NUMBER: DFN2DIP-TR4F0-040D080US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1249	1249	1249
5°	1251	1231	1240
10°	1241	1215	1223
15°	1222	1195	1196
20°	1198	1167	1170
25°	1173	1134	1138
30°	1142	1103	1099
35°	1113	1066	1057
40°	1078	1029	1017
45°	1042	992	977
50°	1003	954	930
55°	962	909	886
60°	916	856	837
65°	865	800	778
70°	801	733	715
75°	712	653	657
80°	605	550	546
85°	438	373	362

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1448 cd/sqm

TEST NUMBER: P910015

CATALOG NUMBER: DFN2DIP-TR4F0-040D080US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.9	1.2
10°-20°	416.2	3.5
20°-30°	611.7	5.1
30°-40°	710.5	5.9
40°-50°	709.6	5.9
50°-60°	618.7	5.2
60°-70°	457.4	3.8
70°-80°	258.8	2.2
80°-90°	73.1	0.6
90°-100°	89.9	0.7
100°-110°	335.1	2.8
110°-120°	888.9	7.4
120°-130°	1474.3	12.3
130°-140°	1566.0	13.1
140°-150°	1455.4	12.1
150°-160°	1170.1	9.8
160°-170°	754.0	6.3
170°-180°	259.5	2.2
0°-30°	1175.9	9.8
0°-40°	1886.3	15.7
0°-60°	3214.6	26.8
0°-90°	4003.8	33.4
90°-120°	1314.0	11.0
90°-150°	5809.7	48.4
90°-180°	7993.0	66.6
0°-180°	11997.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1572	1572	1572	1572	1572	
5°	1572	1566	1549	1561	1558	149
15°	1496	1487	1468	1474	1466	421
25°	1354	1342	1316	1319	1316	623
35°	1168	1153	1129	1120	1112	730
45°	951	940	917	901	895	734
55°	720	710	692	674	667	643
65°	485	476	461	447	440	480
75°	254	251	243	234	237	271
85°	62	60	59	54	53	69
90°	2	24	39	49	53	11
95°	128	63	77	87	85	152
105°	600	659	120	142	150	641
115°	1134	1168	1217	304	162	1117
125°	1604	1630	1667	1681	1687	1430
135°	1985	2016	2034	2054	2050	1533
145°	2302	2300	2334	2348	2338	1440
155°	2535	2518	2541	2553	2537	1168
165°	2671	2660	2665	2679	2665	755
175°	2732	2719	2723	2736	2717	260
180°	2726	2726	2726	2726	2726	

TEST NUMBER: P910015

CATALOG NUMBER: DFN2DIP-TR4F0-040D080US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1571.8	1571.8	1571.8	1571.8	1571.8
2.5°	1580.9	1573.4	1556.7	1571.8	1568.9
5°	1571.8	1565.8	1549.1	1561.2	1558.3
7.5°	1561.2	1552.2	1535.5	1547.7	1544.7
10°	1544.7	1534.1	1516.0	1528.0	1523.5
12.5°	1521.9	1512.9	1494.8	1502.4	1499.2
15°	1496.2	1487.2	1467.5	1473.6	1466.1
17.5°	1464.5	1455.5	1435.8	1443.3	1435.8
20°	1429.7	1420.7	1399.6	1404.0	1398.2
22.5°	1395.0	1381.4	1361.7	1361.7	1358.7
25°	1354.1	1342.1	1316.5	1319.4	1316.5
27.5°	1308.8	1298.2	1278.7	1274.1	1266.7
30°	1263.5	1251.4	1228.8	1224.3	1218.2
32.5°	1215.2	1206.2	1181.9	1172.9	1166.7
35°	1168.3	1153.3	1129.0	1119.9	1112.4
37.5°	1115.4	1101.8	1077.5	1067.0	1059.4
40°	1061.1	1048.8	1024.6	1011.2	1005.1
42.5°	1008.1	995.9	971.9	956.6	947.7
45°	950.7	940.2	917.4	900.9	894.7
47.5°	894.7	884.1	860.0	843.3	834.4
50°	835.8	828.2	807.1	785.9	778.3
52.5°	778.3	767.8	748.2	731.5	720.9
55°	719.5	710.3	692.3	674.1	666.6
57.5°	660.5	653.0	633.2	615.1	609.0
60°	601.5	595.5	574.4	557.7	553.2
62.5°	544.1	533.5	518.5	503.3	497.3
65°	485.2	476.1	461.0	447.4	439.9
67.5°	424.7	417.1	403.6	393.0	387.0
70°	368.8	362.7	349.1	338.5	332.5
72.5°	311.4	305.3	297.8	287.2	282.7
75°	253.9	251.0	243.3	234.3	237.3
77.5°	202.5	196.4	193.4	188.8	184.4
80°	151.2	149.6	146.5	142.1	139.1
82.5°	102.8	102.8	101.4	95.2	95.2
85°	61.9	60.5	59.0	54.3	52.9
87.5°	27.3	24.2	21.2	16.7	15.0
90°	1.9	23.6	39.4	49.4	53.2
92.5°	49.4	41.5	47.4	51.3	53.2
95°	128.2	63.0	76.9	86.9	84.8
97.5°	230.8	69.1	100.5	106.6	108.5
100°	349.3	79.0	112.5	128.2	132.1
102.5°	479.4	475.5	116.4	137.9	144.1
105°	599.8	659.0	120.4	142.0	150.0
107.5°	739.8	789.0	124.4	145.9	153.9
110°	874.1	915.3	345.4	148.0	155.8

TEST NUMBER: P910015

CATALOG NUMBER: DFN2DIP-TR4F0-040D080US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1000.4	1035.7	1002.3	151.8	157.9
115°	1134.4	1167.9	1217.3	303.9	161.9
117.5°	1250.8	1290.2	1323.9	1041.6	524.8
120°	1381.1	1410.6	1446.2	1469.9	1203.5
122.5°	1491.4	1523.1	1562.7	1574.4	1576.5
125°	1603.9	1629.6	1667.1	1680.9	1686.8
127.5°	1706.5	1734.1	1763.9	1783.5	1785.4
130°	1803.2	1834.8	1856.4	1878.2	1876.3
132.5°	1901.9	1927.6	1949.2	1967.0	1965.1
135°	1984.8	2016.4	2034.0	2054.0	2049.9
137.5°	2071.5	2095.2	2115.1	2134.8	2128.9
140°	2156.3	2172.2	2193.8	2211.6	2201.7
142.5°	2227.6	2241.3	2266.8	2282.6	2272.7
145°	2302.5	2300.4	2333.9	2347.7	2337.8
147.5°	2367.4	2361.6	2395.0	2404.9	2397.1
150°	2430.6	2416.8	2448.4	2460.1	2450.3
152.5°	2483.9	2468.1	2497.6	2509.6	2495.8
155°	2535.2	2517.6	2541.2	2552.9	2537.3
157.5°	2576.6	2560.9	2578.7	2592.5	2576.6
160°	2612.2	2600.3	2612.2	2623.9	2610.1
162.5°	2643.6	2631.9	2641.7	2655.5	2637.8
165°	2671.3	2659.6	2665.4	2679.2	2665.4
167.5°	2693.0	2681.1	2687.2	2701.0	2683.2
170°	2710.9	2698.9	2702.9	2716.7	2698.9
172.5°	2722.6	2710.9	2714.8	2728.7	2710.9
175°	2732.4	2718.6	2722.6	2736.3	2716.7
177.5°	2736.3	2722.6	2724.6	2738.5	2720.7
180°	2726.5	2726.5	2726.5	2726.5	2726.5

TEST NUMBER: P910015

CATALOG NUMBER: DFN2DIP-TR4F0-040D080US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.27	7.00	7.35	8.08	9.57	5.83	6.56	6.92	7.65	9.14
	3H	7.92	8.57	9.01	9.66	11.17	7.44	8.10	8.54	9.19	10.70
	4H	8.50	9.12	9.60	10.21	11.73	8.02	8.64	9.13	9.74	11.25
	6H	8.89	9.46	10.01	10.56	12.09	8.41	8.99	9.53	10.08	11.61
	8H	8.99	9.53	10.11	10.65	12.17	8.52	9.06	9.64	10.17	11.69
	12H	9.03	9.55	10.16	10.66	12.20	8.55	9.07	9.68	10.18	11.72
4H	2H	6.71	7.33	7.83	8.43	9.94	6.37	6.99	7.48	8.08	9.60
	3H	8.56	9.08	9.69	10.21	11.73	8.17	8.69	9.29	9.81	11.34
	4H	9.27	9.75	10.40	10.86	12.41	8.87	9.34	9.99	10.46	12.00
	6H	9.78	10.19	10.91	11.32	12.86	9.37	9.78	10.50	10.91	12.45
	8H	9.93	10.31	11.06	11.44	12.99	9.52	9.90	10.65	11.02	12.58
	12H	9.99	10.34	11.14	11.48	13.04	9.57	9.92	10.72	11.06	12.62
8H	4H	9.46	9.84	10.59	10.97	12.52	9.10	9.48	10.23	10.61	12.16
	6H	10.08	10.40	11.24	11.57	13.12	9.72	10.04	10.87	11.21	12.76
	8H	10.30	10.58	11.46	11.73	13.30	9.94	10.21	11.09	11.36	12.93
	12H	10.43	10.67	11.59	11.82	13.42	10.05	10.29	11.21	11.43	13.04
12H	4H	9.44	9.78	10.59	10.92	12.48	9.09	9.43	10.23	10.57	12.13
	6H	10.11	10.39	11.27	11.54	13.11	9.76	10.04	10.92	11.19	12.76
	8H	10.35	10.59	11.51	11.74	13.34	9.99	10.23	11.15	11.38	12.99

END OF REPORT