

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910018

Luminaire Tested: DFN2DIP-TR4F0-040D090US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910018
REPORT IS A COMBINATION OF REPORTS P900459 AND P897293
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-040D090US840-FLLFLL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12042.6 lumens
Efficiency: N/A
Efficacy: 120.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 99.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910018

CATALOG NUMBER: DFN2DIP-TR4F0-040D090US840-FLLFLL

Luminous Intensity Polar Plot

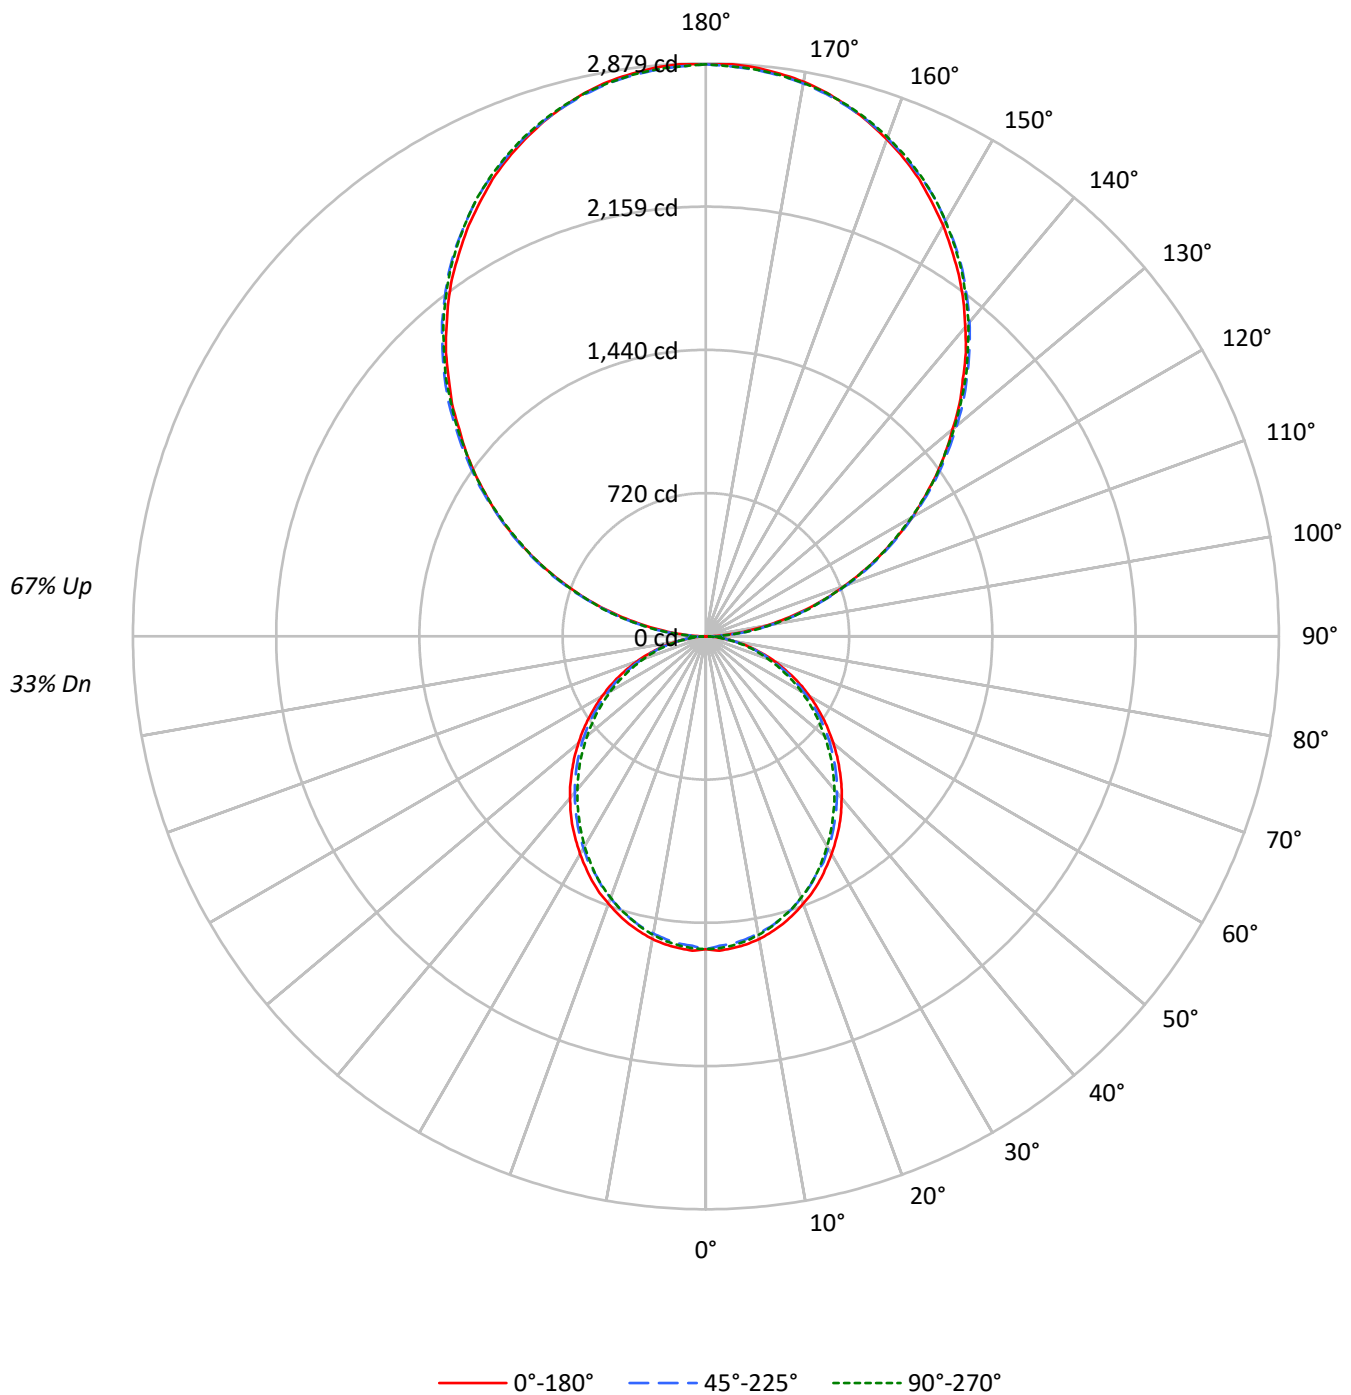

TEST NUMBER: P910018

CATALOG NUMBER: DFN2DIP-TR4F0-040D090US840-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	18	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1249	1249	1249
5°	1251	1231	1240
10°	1241	1215	1223
15°	1222	1195	1196
20°	1198	1167	1170
25°	1173	1134	1138
30°	1142	1103	1099
35°	1113	1066	1057
40°	1078	1029	1017
45°	1042	992	977
50°	1003	954	930
55°	962	909	886
60°	916	856	837
65°	865	800	778
70°	801	733	715
75°	712	653	657
80°	605	550	546
85°	438	373	362

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2240 cd/sqm

TEST NUMBER: P910018

CATALOG NUMBER: DFN2DIP-TR4F0-040D090US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.9	1.2
10°-20°	416.2	3.5
20°-30°	611.7	5.1
30°-40°	710.5	5.9
40°-50°	709.6	5.9
50°-60°	618.7	5.1
60°-70°	457.4	3.8
70°-80°	258.8	2.1
80°-90°	76.5	0.6
90°-100°	177.9	1.5
100°-110°	565.2	4.7
110°-120°	967.2	8.0
120°-130°	1272.0	10.6
130°-140°	1427.7	11.9
140°-150°	1400.0	11.6
150°-160°	1174.4	9.8
160°-170°	778.9	6.5
170°-180°	272.2	2.3
0°-30°	1175.9	9.8
0°-40°	1886.3	15.7
0°-60°	3214.6	26.7
0°-90°	4007.2	33.3
90°-120°	1710.2	14.2
90°-150°	5809.9	48.2
90°-180°	8035.0	66.7
0°-180°	12042.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1572	1572	1572	1572	1572	
5°	1572	1566	1549	1561	1558	149
15°	1496	1487	1468	1474	1466	421
25°	1354	1342	1316	1319	1316	623
35°	1168	1153	1129	1120	1112	730
45°	951	940	917	901	895	734
55°	720	710	692	674	667	643
65°	485	476	461	447	440	480
75°	254	251	243	234	237	271
85°	62	60	59	54	53	69
90°	3	31	85	80	82	12
95°	126	151	155	155	151	141
105°	522	529	534	538	538	551
115°	971	984	980	978	971	960
125°	1412	1433	1426	1419	1416	1261
135°	1826	1853	1858	1855	1848	1411
145°	2217	2234	2248	2250	2241	1385
155°	2535	2542	2550	2562	2554	1167
165°	2757	2755	2755	2772	2760	778
175°	2869	2862	2857	2874	2860	273
180°	2874	2874	2874	2874	2874	

TEST NUMBER: P910018

CATALOG NUMBER: DFN2DIP-TR4F0-040D090US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1571.8	1571.8	1571.8	1571.8	1571.8
2.5°	1580.9	1573.4	1556.7	1571.8	1568.9
5°	1571.8	1565.8	1549.1	1561.2	1558.3
7.5°	1561.2	1552.2	1535.5	1547.7	1544.7
10°	1544.7	1534.1	1516.0	1528.0	1523.5
12.5°	1521.9	1512.9	1494.8	1502.4	1499.2
15°	1496.2	1487.2	1467.5	1473.6	1466.1
17.5°	1464.5	1455.5	1435.8	1443.3	1435.8
20°	1429.7	1420.7	1399.6	1404.0	1398.2
22.5°	1395.0	1381.4	1361.7	1361.7	1358.7
25°	1354.1	1342.1	1316.5	1319.4	1316.5
27.5°	1308.8	1298.2	1278.7	1274.1	1266.7
30°	1263.5	1251.4	1228.8	1224.3	1218.2
32.5°	1215.2	1206.2	1181.9	1172.9	1166.7
35°	1168.3	1153.3	1129.0	1119.9	1112.4
37.5°	1115.4	1101.8	1077.5	1067.0	1059.4
40°	1061.1	1048.8	1024.6	1011.2	1005.1
42.5°	1008.1	995.9	971.9	956.6	947.7
45°	950.7	940.2	917.4	900.9	894.7
47.5°	894.7	884.1	860.0	843.3	834.4
50°	835.8	828.2	807.1	785.9	778.3
52.5°	778.3	767.8	748.2	731.5	720.9
55°	719.5	710.3	692.3	674.1	666.6
57.5°	660.5	653.0	633.2	615.1	609.0
60°	601.5	595.5	574.4	557.7	553.2
62.5°	544.1	533.5	518.5	503.3	497.3
65°	485.2	476.1	461.0	447.4	439.9
67.5°	424.7	417.1	403.6	393.0	387.0
70°	368.8	362.7	349.1	338.5	332.5
72.5°	311.4	305.3	297.8	287.2	282.7
75°	253.9	251.0	243.3	234.3	237.3
77.5°	202.5	196.4	193.4	188.8	184.4
80°	151.2	149.6	146.5	142.1	139.1
82.5°	102.8	102.8	101.4	95.2	95.2
85°	61.9	60.5	59.0	54.3	52.9
87.5°	27.3	24.2	21.2	16.7	15.0
90°	2.6	31.2	84.9	79.7	82.3
92.5°	53.7	72.8	75.4	78.0	78.0
95°	126.5	150.8	155.1	155.1	150.8
97.5°	210.6	233.1	242.7	242.7	242.7
100°	307.6	327.6	334.5	334.5	331.9
102.5°	409.9	424.6	434.1	436.8	434.1
105°	521.7	528.6	533.8	538.2	538.2
107.5°	632.6	643.0	643.0	644.7	632.6
110°	740.0	754.0	754.0	754.0	747.0

TEST NUMBER: P910018

CATALOG NUMBER: DFN2DIP-TR4F0-040D090US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	856.2	870.9	868.3	861.4	856.2
115°	970.6	984.4	980.1	977.5	970.6
117.5°	1084.1	1103.2	1091.1	1084.1	1077.1
120°	1198.5	1217.5	1198.5	1198.5	1190.6
122.5°	1302.4	1326.8	1314.6	1307.7	1302.4
125°	1411.7	1433.3	1426.4	1418.6	1416.0
127.5°	1518.2	1545.1	1535.6	1525.2	1518.2
130°	1617.9	1649.1	1644.8	1639.5	1630.0
132.5°	1729.7	1753.9	1755.7	1743.5	1736.7
135°	1825.8	1852.7	1858.0	1855.3	1848.5
137.5°	1933.3	1955.0	1959.3	1957.6	1947.2
140°	2027.8	2049.4	2061.5	2061.5	2052.0
142.5°	2124.9	2146.5	2153.4	2156.1	2146.5
145°	2216.8	2234.0	2247.9	2250.5	2241.0
147.5°	2299.1	2320.7	2331.1	2335.4	2325.9
150°	2384.0	2398.7	2408.2	2416.0	2408.2
152.5°	2459.3	2474.1	2486.2	2495.8	2486.2
155°	2534.8	2541.6	2549.5	2561.6	2553.8
157.5°	2599.7	2604.9	2609.3	2626.6	2614.4
160°	2657.8	2663.0	2665.6	2680.3	2669.9
162.5°	2711.5	2711.5	2714.1	2730.6	2718.5
165°	2757.4	2754.8	2754.8	2772.2	2760.1
167.5°	2799.0	2791.3	2791.3	2808.5	2796.4
170°	2830.2	2823.3	2820.8	2838.0	2823.3
172.5°	2851.9	2845.0	2842.4	2859.7	2845.0
175°	2869.2	2862.3	2857.1	2874.5	2859.7
177.5°	2878.7	2871.9	2866.6	2881.3	2866.6
180°	2874.5	2874.5	2874.5	2874.5	2874.5

TEST NUMBER: P910018

CATALOG NUMBER: DFN2DIP-TR4F0-040D090US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.25	6.98	7.34	8.07	9.56	5.82	6.55	6.91	7.63	9.13
	3H	7.90	8.55	9.00	9.65	11.16	7.43	8.08	8.52	9.18	10.69
	4H	8.48	9.10	9.59	10.20	11.71	8.01	8.63	9.12	9.73	11.24
	6H	8.87	9.44	9.99	10.54	12.07	8.40	8.97	9.52	10.07	11.60
	8H	8.97	9.52	10.10	10.63	12.15	8.50	9.04	9.62	10.16	11.68
	12H	9.02	9.53	10.14	10.64	12.19	8.54	9.05	9.66	10.16	11.71
4H	2H	6.70	7.32	7.81	8.41	9.93	6.35	6.97	7.47	8.07	9.58
	3H	8.55	9.07	9.67	10.19	11.72	8.16	8.67	9.28	9.80	11.32
	4H	9.26	9.73	10.38	10.85	12.39	8.85	9.33	9.98	10.44	11.99
	6H	9.77	10.17	10.90	11.31	12.85	9.36	9.76	10.49	10.90	12.44
	8H	9.91	10.29	11.04	11.42	12.98	9.50	9.88	10.63	11.01	12.56
	12H	9.98	10.32	11.13	11.46	13.02	9.56	9.90	10.70	11.04	12.60
8H	4H	9.44	9.82	10.58	10.95	12.51	9.08	9.46	10.22	10.59	12.15
	6H	10.07	10.38	11.22	11.55	13.11	9.71	10.02	10.86	11.19	12.74
	8H	10.29	10.56	11.45	11.71	13.29	9.92	10.19	11.08	11.34	12.92
	12H	10.41	10.66	11.58	11.80	13.41	10.03	10.27	11.19	11.42	13.02
12H	4H	9.42	9.77	10.57	10.91	12.47	9.07	9.42	10.22	10.56	12.12
	6H	10.10	10.37	11.26	11.52	13.10	9.75	10.02	10.91	11.17	12.74
	8H	10.33	10.58	11.50	11.72	13.33	9.98	10.22	11.14	11.36	12.97

END OF REPORT