

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910031

Luminaire Tested: DFN2DIP-TR4F0-040D120US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910031
REPORT IS A COMBINATION OF REPORTS P902033 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-040D120US840-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15996.2 lumens
Efficiency: N/A
Efficacy: 129.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 123.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9952
Total Harmonic Distortion (THDi): 0.069
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910031

CATALOG NUMBER: DFN2DIP-TR4F0-040D120US840-FLLONL

Luminous Intensity Polar Plot

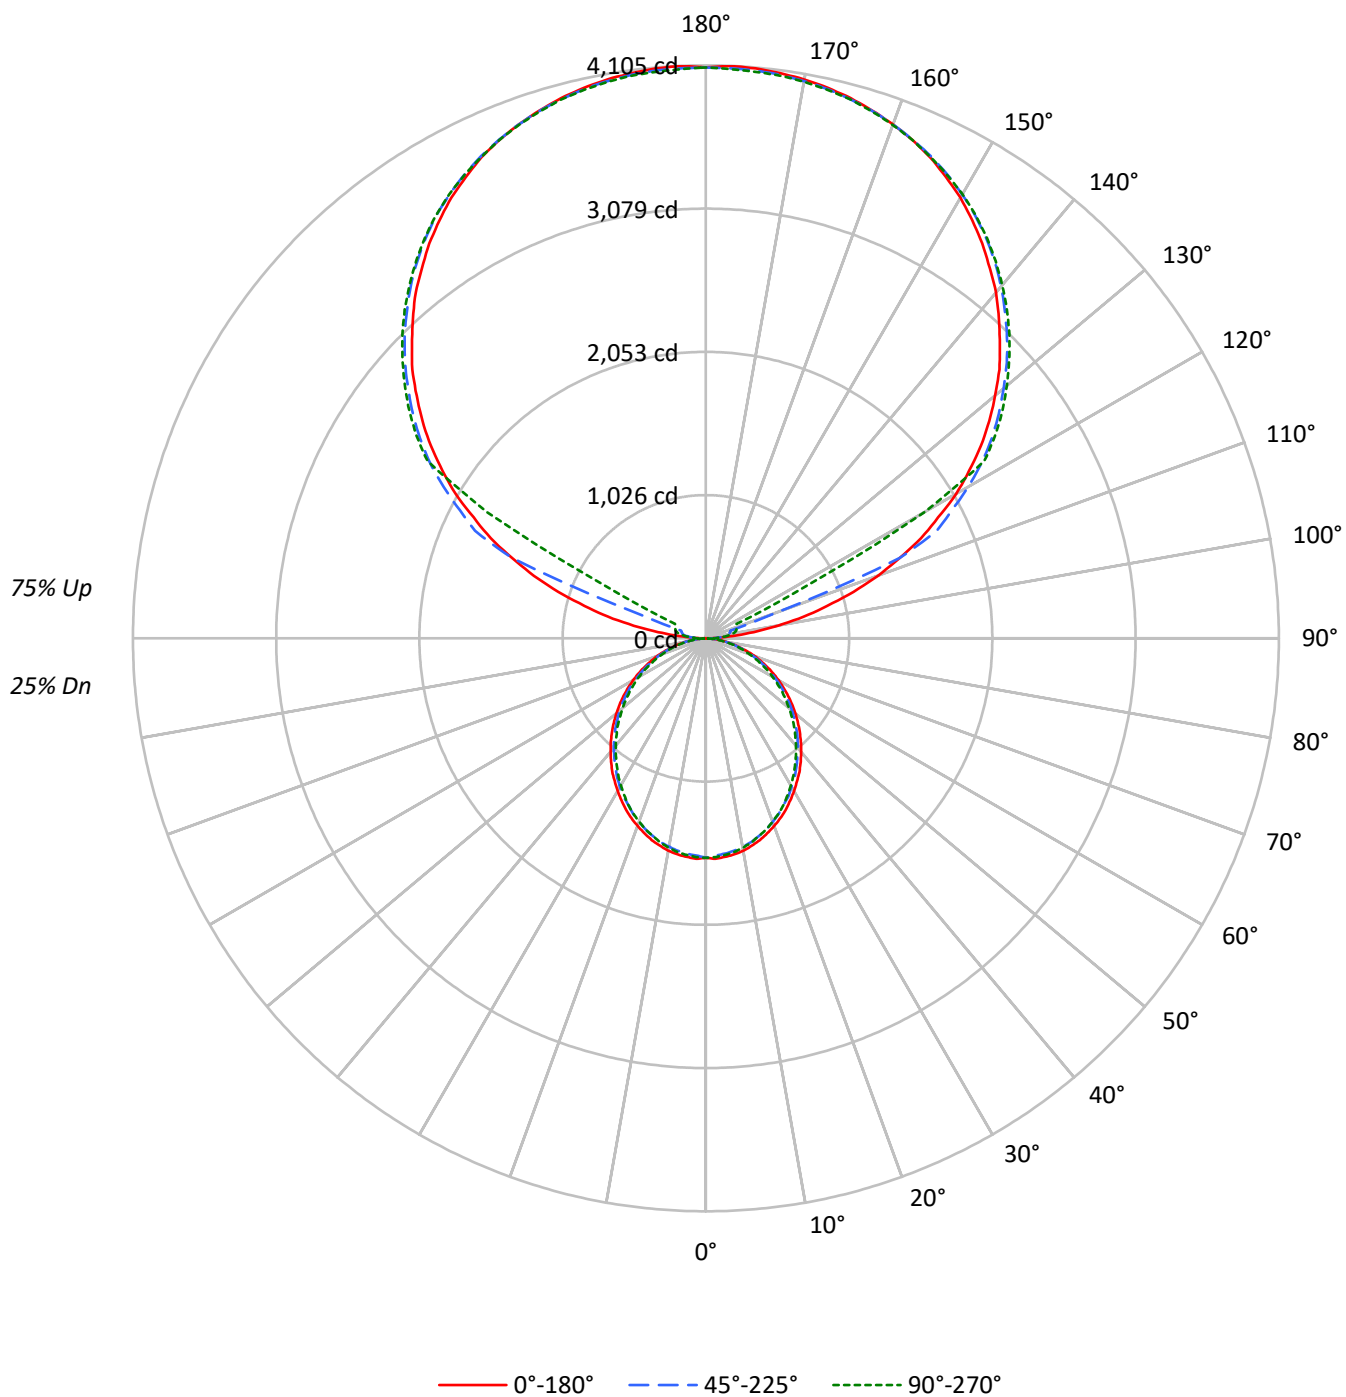

TEST NUMBER: P910031

CATALOG NUMBER: DFN2DIP-TR4F0-040D120US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	101	101	101	101	90	90	90	90	69	69	69	51	51	51	33	33	33
1	92	88	84	81	82	79	75	73	61	59	57	44	43	42	29	29	28
2	84	77	71	66	74	69	64	59	53	50	47	39	37	35	26	25	24
3	76	67	60	55	68	60	54	50	47	43	39	34	32	30	23	21	20
4	70	60	52	46	62	53	47	42	42	37	33	31	28	25	20	19	17
5	64	53	45	39	57	47	41	36	37	32	29	27	24	22	18	16	15
6	59	47	40	34	52	42	36	31	33	28	25	25	21	19	17	15	13
7	54	43	35	30	48	38	32	27	30	25	22	22	19	17	15	13	12
8	50	38	31	26	45	35	28	24	27	23	19	20	17	15	14	12	10
9	47	35	28	23	41	31	25	21	25	20	17	19	15	13	13	11	9
10	43	32	25	20	39	29	23	19	23	18	15	17	14	12	12	10	8

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1249	1249	1249
5°	1251	1231	1240
10°	1241	1215	1223
15°	1222	1195	1196
20°	1198	1167	1170
25°	1173	1134	1138
30°	1142	1103	1099
35°	1113	1066	1057
40°	1078	1029	1017
45°	1042	992	977
50°	1003	954	930
55°	962	909	886
60°	916	856	837
65°	865	800	778
70°	801	733	715
75°	712	653	657
80°	605	550	546
85°	438	373	362

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2172 cd/sqm

TEST NUMBER: P910031

CATALOG NUMBER: DFN2DIP-TR4F0-040D120US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	147.9	0.9
10°-20°	416.2	2.6
20°-30°	611.7	3.8
30°-40°	710.5	4.4
40°-50°	709.6	4.4
50°-60°	618.7	3.9
60°-70°	457.4	2.9
70°-80°	258.8	1.6
80°-90°	75.5	0.5
90°-100°	134.9	0.8
100°-110°	502.7	3.1
110°-120°	1333.3	8.3
120°-130°	2211.4	13.8
130°-140°	2349.0	14.7
140°-150°	2183.2	13.6
150°-160°	1755.2	11.0
160°-170°	1131.0	7.1
170°-180°	389.3	2.4
0°-30°	1175.9	7.4
0°-40°	1886.3	11.8
0°-60°	3214.6	20.1
0°-90°	4006.2	25.0
90°-120°	1970.9	12.3
90°-150°	8714.5	54.5
90°-180°	11990.0	75.0
0°-180°	15996.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1572	1572	1572	1572	1572	
5°	1572	1566	1549	1561	1558	149
15°	1496	1487	1468	1474	1466	421
25°	1354	1342	1316	1319	1316	623
35°	1168	1153	1129	1120	1112	730
45°	951	940	917	901	895	734
55°	720	710	692	674	667	643
65°	485	476	461	447	440	480
75°	254	251	243	234	237	271
85°	62	60	59	54	53	69
90°	3	35	59	74	80	15
95°	192	94	115	130	127	228
105°	900	989	181	213	225	961
115°	1702	1752	1826	456	243	1675
125°	2406	2444	2501	2521	2530	2146
135°	2977	3025	3051	3081	3075	2300
145°	3454	3451	3501	3522	3507	2160
155°	3803	3776	3812	3829	3806	1752
165°	4007	3989	3998	4019	3998	1132
175°	4098	4078	4084	4105	4075	390
180°	4090	4090	4090	4090	4090	

TEST NUMBER: P910031

CATALOG NUMBER: DFN2DIP-TR4F0-040D120US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1571.8	1571.8	1571.8	1571.8	1571.8
2.5°	1580.9	1573.4	1556.7	1571.8	1568.9
5°	1571.8	1565.8	1549.1	1561.2	1558.3
7.5°	1561.2	1552.2	1535.5	1547.7	1544.7
10°	1544.7	1534.1	1516.0	1528.0	1523.5
12.5°	1521.9	1512.9	1494.8	1502.4	1499.2
15°	1496.2	1487.2	1467.5	1473.6	1466.1
17.5°	1464.5	1455.5	1435.8	1443.3	1435.8
20°	1429.7	1420.7	1399.6	1404.0	1398.2
22.5°	1395.0	1381.4	1361.7	1361.7	1358.7
25°	1354.1	1342.1	1316.5	1319.4	1316.5
27.5°	1308.8	1298.2	1278.7	1274.1	1266.7
30°	1263.5	1251.4	1228.8	1224.3	1218.2
32.5°	1215.2	1206.2	1181.9	1172.9	1166.7
35°	1168.3	1153.3	1129.0	1119.9	1112.4
37.5°	1115.4	1101.8	1077.5	1067.0	1059.4
40°	1061.1	1048.8	1024.6	1011.2	1005.1
42.5°	1008.1	995.9	971.9	956.6	947.7
45°	950.7	940.2	917.4	900.9	894.7
47.5°	894.7	884.1	860.0	843.3	834.4
50°	835.8	828.2	807.1	785.9	778.3
52.5°	778.3	767.8	748.2	731.5	720.9
55°	719.5	710.3	692.3	674.1	666.6
57.5°	660.5	653.0	633.2	615.1	609.0
60°	601.5	595.5	574.4	557.7	553.2
62.5°	544.1	533.5	518.5	503.3	497.3
65°	485.2	476.1	461.0	447.4	439.9
67.5°	424.7	417.1	403.6	393.0	387.0
70°	368.8	362.7	349.1	338.5	332.5
72.5°	311.4	305.3	297.8	287.2	282.7
75°	253.9	251.0	243.3	234.3	237.3
77.5°	202.5	196.4	193.4	188.8	184.4
80°	151.2	149.6	146.5	142.1	139.1
82.5°	102.8	102.8	101.4	95.2	95.2
85°	61.9	60.5	59.0	54.3	52.9
87.5°	27.3	24.2	21.2	16.7	15.0
90°	2.8	35.4	59.1	74.1	79.8
92.5°	74.1	62.2	71.0	77.0	79.8
95°	192.2	94.5	115.2	130.4	127.2
97.5°	346.2	103.7	150.8	159.9	162.7
100°	523.9	118.5	168.6	192.2	198.2
102.5°	719.0	713.4	174.6	207.0	216.1
105°	899.6	988.6	180.7	213.0	224.9
107.5°	1109.7	1183.6	186.6	218.9	230.9
110°	1311.1	1373.0	518.0	222.1	233.7

TEST NUMBER: P910031

CATALOG NUMBER: DFN2DIP-TR4F0-040D120US840-FLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1500.6	1553.6	1503.4	227.7	236.8
115°	1701.5	1751.8	1825.9	455.8	242.9
117.5°	1876.2	1935.3	1985.9	1562.4	787.2
120°	2071.6	2115.9	2169.3	2204.8	1805.2
122.5°	2237.2	2284.6	2344.0	2361.6	2364.7
125°	2405.8	2444.5	2500.7	2521.4	2530.2
127.5°	2559.7	2601.2	2645.8	2675.3	2678.2
130°	2704.8	2752.3	2784.6	2817.3	2814.5
132.5°	2852.8	2891.4	2923.8	2950.5	2947.7
135°	2977.2	3024.6	3051.0	3080.9	3074.9
137.5°	3107.3	3142.7	3172.6	3202.1	3193.3
140°	3234.5	3258.3	3290.6	3317.4	3302.7
142.5°	3341.2	3362.0	3400.3	3423.8	3409.1
145°	3453.7	3450.6	3500.8	3521.6	3506.8
147.5°	3551.1	3542.3	3592.6	3607.3	3595.7
150°	3645.9	3625.2	3672.7	3690.3	3675.5
152.5°	3725.7	3702.2	3746.5	3764.4	3743.7
155°	3802.6	3776.3	3811.8	3829.4	3805.9
157.5°	3864.9	3841.3	3868.1	3888.8	3864.9
160°	3918.3	3900.4	3918.3	3935.8	3915.1
162.5°	3965.4	3947.9	3962.6	3983.3	3956.7
165°	4006.8	3989.3	3998.1	4018.9	3998.1
167.5°	4039.6	4021.6	4030.8	4051.5	4024.8
170°	4066.2	4048.3	4054.3	4075.0	4048.3
172.5°	4083.8	4066.2	4072.3	4093.0	4066.2
175°	4098.5	4077.8	4083.8	4104.6	4075.0
177.5°	4104.6	4083.8	4087.0	4107.7	4081.1
180°	4089.9	4089.9	4089.9	4089.9	4089.9

TEST NUMBER: P910031

CATALOG NUMBER: DFN2DIP-TR4F0-040D120US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.10	5.77	6.24	6.90	8.49	4.66	5.34	5.81	6.47	8.06
	3H	6.74	7.35	7.90	8.49	10.09	6.27	6.87	7.42	8.02	9.62
	4H	7.32	7.89	8.48	9.04	10.65	6.85	7.42	8.01	8.56	10.17
	6H	7.71	8.24	8.88	9.38	11.00	7.23	7.76	8.40	8.91	10.53
	8H	7.81	8.31	8.98	9.47	11.08	7.33	7.84	8.51	9.00	10.61
	12H	7.85	8.33	9.03	9.48	11.12	7.37	7.85	8.55	9.00	10.63
4H	2H	5.53	6.11	6.70	7.25	8.86	5.19	5.76	6.36	6.91	8.51
	3H	7.38	7.86	8.56	9.03	10.65	6.99	7.47	8.16	8.64	10.26
	4H	8.09	8.53	9.27	9.69	11.33	7.68	8.13	8.86	9.28	10.92
	6H	8.59	8.97	9.77	10.15	11.78	8.18	8.56	9.37	9.74	11.37
	8H	8.74	9.09	9.92	10.26	11.91	8.33	8.68	9.51	9.85	11.50
	12H	8.80	9.12	10.00	10.30	11.95	8.38	8.70	9.58	9.88	11.53
8H	4H	8.27	8.62	9.45	9.79	11.44	7.91	8.26	9.09	9.43	11.08
	6H	8.89	9.18	10.09	10.40	12.04	8.53	8.82	9.73	10.04	11.68
	8H	9.11	9.37	10.32	10.56	12.22	8.74	9.00	9.95	10.19	11.85
	12H	9.24	9.46	10.44	10.65	12.34	8.85	9.07	10.06	10.26	11.96
12H	4H	8.25	8.57	9.44	9.75	11.40	7.90	8.22	9.09	9.40	11.05
	6H	8.92	9.18	10.13	10.37	12.03	8.57	8.82	9.78	10.01	11.68
	8H	9.16	9.38	10.36	10.57	12.26	8.80	9.02	10.01	10.21	11.90

END OF REPORT