

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910085

Luminaire Tested: DFN2DIP-TR4F0-060D070US840-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910085
REPORT IS A COMBINATION OF REPORTS P901948 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D070US840-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12148.7 lumens
Efficiency: N/A
Efficacy: 115.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 105.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910085

CATALOG NUMBER: DFN2DIP-TR4F0-060D070US840-RLLONL

Luminous Intensity Polar Plot

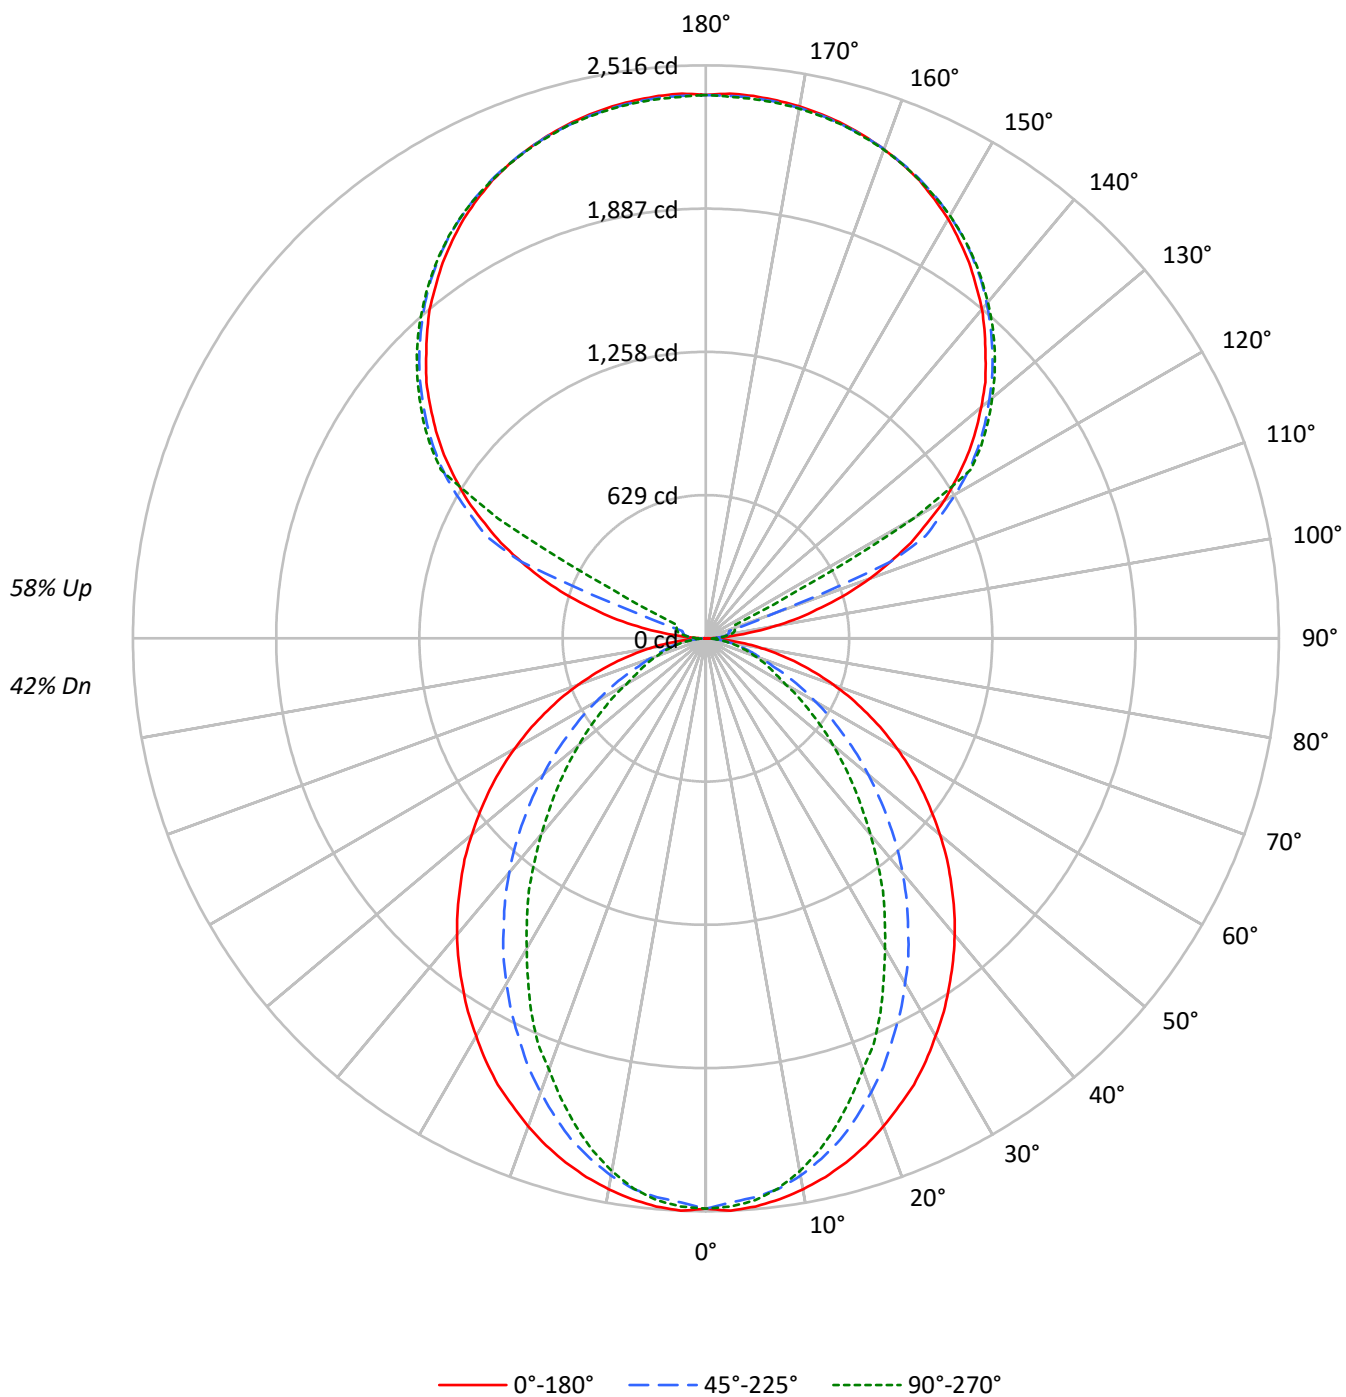

TEST NUMBER: P910085

CATALOG NUMBER: DFN2DIP-TR4F0-060D070US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	89	85	88	85	81	79	70	68	66	56	55	54	44	43	42
2	88	81	75	70	80	74	69	65	62	58	55	50	48	45	39	38	36
3	81	72	65	59	74	66	60	55	55	50	47	45	42	39	35	33	31
4	74	64	56	50	67	59	52	47	49	44	40	40	36	34	32	29	27
5	68	57	49	43	62	52	46	40	44	39	35	36	32	29	29	26	24
6	63	51	43	38	57	47	40	35	40	34	31	33	29	26	26	23	21
7	58	46	39	33	53	43	36	31	36	31	27	30	26	23	24	21	19
8	54	42	35	29	49	39	32	28	33	28	24	27	24	21	22	19	17
9	50	38	31	26	46	36	29	25	30	25	22	25	21	19	21	18	16
10	47	35	28	24	43	33	26	22	28	23	20	23	20	17	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1989	1989	1989
5°	1993	1958	1970
10°	1973	1919	1906
15°	1946	1856	1807
20°	1910	1769	1685
25°	1873	1671	1568
30°	1824	1570	1419
35°	1775	1462	1288
40°	1726	1350	1138
45°	1669	1226	1002
50°	1610	1101	869
55°	1548	967	741
60°	1477	827	610
65°	1394	685	549
70°	1294	552	497
75°	1170	487	452
80°	988	408	392
85°	689	272	294

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1669 cd/sqm

TEST NUMBER: P910085

CATALOG NUMBER: DFN2DIP-TR4F0-060D070US840-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	234.7	1.9
10°-20°	644.3	5.3
20°-30°	904.6	7.4
30°-40°	986.1	8.1
40°-50°	906.3	7.5
50°-60°	711.7	5.9
60°-70°	463.3	3.8
70°-80°	238.5	2.0
80°-90°	65.1	0.5
90°-100°	78.7	0.6
100°-110°	293.3	2.4
110°-120°	777.8	6.4
120°-130°	1290.0	10.6
130°-140°	1370.3	11.3
140°-150°	1273.5	10.5
150°-160°	1023.9	8.4
160°-170°	659.7	5.4
170°-180°	227.1	1.9
0°-30°	1783.6	14.7
0°-40°	2769.6	22.8
0°-60°	4387.7	36.1
0°-90°	5154.5	42.4
90°-120°	1149.7	9.5
90°-150°	5083.5	41.8
90°-180°	6994.0	57.6
0°-180°	12148.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2504	2504	2504	2504	2504	
5°	2504	2493	2463	2484	2477	237
15°	2382	2357	2280	2237	2214	671
25°	2162	2090	1940	1847	1813	994
35°	1863	1747	1548	1405	1355	1166
45°	1523	1371	1133	972	918	1176
55°	1158	981	736	601	558	1035
65°	782	598	394	317	310	775
75°	417	258	181	165	163	441
85°	97	50	43	43	43	112
90°	2	21	34	43	47	11
95°	112	55	67	76	74	133
105°	525	577	105	124	131	561
115°	993	1022	1065	266	142	977
125°	1403	1426	1459	1471	1476	1252
135°	1737	1764	1780	1797	1794	1342
145°	2015	2013	2042	2054	2046	1260
155°	2218	2203	2224	2234	2220	1022
165°	2337	2327	2332	2344	2332	660
175°	2391	2379	2382	2394	2377	228
180°	2386	2386	2386	2386	2386	

TEST NUMBER: P910085

CATALOG NUMBER: DFN2DIP-TR4F0-060D070US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2504.3	2504.3	2504.3	2504.3	2504.3
2.5°	2515.6	2504.3	2479.2	2502.0	2497.5
5°	2504.3	2493.0	2463.4	2483.9	2477.1
7.5°	2483.9	2470.3	2438.6	2447.5	2436.2
10°	2456.6	2440.7	2395.6	2388.6	2375.1
12.5°	2422.8	2402.3	2341.0	2327.5	2302.5
15°	2381.9	2356.8	2279.9	2236.9	2214.2
17.5°	2334.3	2297.9	2202.7	2152.9	2116.7
20°	2279.9	2234.4	2121.2	2064.7	2014.7
22.5°	2221.0	2168.8	2037.3	1960.4	1926.4
25°	2162.1	2089.5	1940.0	1847.1	1813.0
27.5°	2091.9	2014.7	1849.3	1742.7	1690.6
30°	2017.1	1930.8	1749.5	1634.1	1572.8
32.5°	1944.5	1840.2	1654.6	1518.4	1461.7
35°	1863.0	1747.4	1548.0	1405.1	1355.1
37.5°	1783.6	1658.8	1448.2	1291.7	1235.2
40°	1699.7	1563.9	1343.8	1183.0	1124.1
42.5°	1613.7	1468.6	1239.7	1071.9	1015.4
45°	1523.0	1371.0	1133.3	972.1	917.8
47.5°	1436.9	1276.1	1031.3	870.2	820.4
50°	1341.7	1180.8	931.5	775.0	727.6
52.5°	1248.6	1078.6	836.3	686.7	643.7
55°	1158.0	981.3	736.5	600.7	557.5
57.5°	1065.2	883.8	648.2	521.3	484.9
60°	970.0	788.7	555.2	439.8	403.4
62.5°	877.2	695.9	475.8	367.2	349.1
65°	781.9	598.2	394.4	317.4	310.4
67.5°	691.3	507.6	317.4	278.7	272.0
70°	596.0	419.3	262.8	240.2	231.1
72.5°	505.4	337.6	219.7	201.8	197.1
75°	417.0	258.2	181.3	165.4	163.3
77.5°	328.7	183.5	142.8	133.7	129.2
80°	246.9	131.5	108.7	99.8	99.8
82.5°	172.2	88.5	74.7	70.2	70.2
85°	97.4	49.8	43.0	43.0	43.0
87.5°	36.4	18.1	18.1	15.9	15.9
90°	1.6	20.7	34.4	43.2	46.6
92.5°	43.2	36.3	41.4	44.9	46.6
95°	112.1	55.1	67.3	76.0	74.2
97.5°	201.9	60.5	88.0	93.3	94.9
100°	305.7	69.1	98.4	112.1	115.6
102.5°	419.4	416.2	101.9	120.8	126.0
105°	524.8	576.6	105.3	124.2	131.2
107.5°	647.3	690.4	108.9	127.7	134.7
110°	764.9	800.9	302.2	129.6	136.3

TEST NUMBER: P910085

CATALOG NUMBER: DFN2DIP-TR4F0-060D070US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	875.4	906.3	877.0	132.8	138.1
115°	992.6	1021.9	1065.1	265.9	141.7
117.5°	1094.5	1128.9	1158.4	911.4	459.2
120°	1208.4	1234.3	1265.5	1286.2	1053.1
122.5°	1304.9	1332.6	1367.4	1377.6	1379.4
125°	1403.4	1425.9	1458.8	1470.9	1475.9
127.5°	1493.2	1517.3	1543.4	1560.6	1562.3
130°	1577.8	1605.5	1624.4	1643.5	1641.8
132.5°	1664.2	1686.7	1705.6	1721.1	1719.5
135°	1736.7	1764.3	1779.8	1797.2	1793.7
137.5°	1812.5	1833.3	1850.7	1867.9	1862.8
140°	1886.7	1900.7	1919.6	1935.1	1926.5
142.5°	1949.0	1961.2	1983.5	1997.2	1988.6
145°	2014.7	2012.9	2042.2	2054.3	2045.7
147.5°	2071.4	2066.4	2095.7	2104.3	2097.5
150°	2126.8	2114.8	2142.4	2152.6	2144.0
152.5°	2173.3	2159.6	2185.5	2195.9	2183.8
155°	2218.3	2202.8	2223.5	2233.8	2220.1
157.5°	2254.5	2240.8	2256.3	2268.5	2254.5
160°	2285.7	2275.2	2285.7	2295.9	2283.8
162.5°	2313.2	2302.9	2311.5	2323.6	2308.0
165°	2337.3	2327.1	2332.2	2344.3	2332.2
167.5°	2356.4	2345.9	2351.3	2363.4	2347.8
170°	2372.0	2361.6	2365.0	2377.1	2361.6
172.5°	2382.3	2372.0	2375.5	2387.5	2372.0
175°	2390.9	2378.7	2382.3	2394.3	2377.1
177.5°	2394.3	2382.3	2384.1	2396.2	2380.6
180°	2385.7	2385.7	2385.7	2385.7	2385.7

TEST NUMBER: P910085

CATALOG NUMBER: DFN2DIP-TR4F0-060D070US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.78	9.55	9.81	10.58	11.96	4.75	5.53	5.78	6.56	7.93
	3H	10.45	11.14	11.49	12.18	13.58	5.94	6.63	6.98	7.67	9.07
	4H	11.06	11.71	12.11	12.75	14.16	6.39	7.04	7.44	8.08	9.49
	6H	11.48	12.08	12.54	13.12	14.54	6.71	7.31	7.77	8.35	9.77
	8H	11.60	12.17	12.67	13.24	14.65	6.80	7.37	7.86	8.43	9.84
	12H	11.66	12.21	12.73	13.26	14.70	6.84	7.38	7.91	8.44	9.87
4H	2H	8.79	9.45	9.85	10.49	11.89	5.34	6.00	6.40	7.04	8.44
	3H	10.62	11.16	11.68	12.23	13.65	6.69	7.23	7.75	8.30	9.72
	4H	11.31	11.80	12.37	12.86	14.30	7.24	7.73	8.30	8.79	10.23
	6H	11.82	12.24	12.89	13.33	14.76	7.65	8.08	8.73	9.16	10.60
	8H	11.99	12.39	13.07	13.47	14.92	7.78	8.18	8.86	9.25	10.70
	12H	12.08	12.44	13.18	13.53	14.99	7.84	8.20	8.94	9.29	10.75
8H	4H	11.27	11.67	12.35	12.74	14.19	7.51	7.91	8.59	8.98	10.43
	6H	11.83	12.16	12.93	13.28	14.73	8.03	8.36	9.13	9.47	10.92
	8H	12.05	12.34	13.16	13.44	14.90	8.22	8.51	9.33	9.61	11.08
	12H	12.19	12.44	13.30	13.53	15.04	8.34	8.59	9.45	9.69	11.19
12H	4H	11.22	11.58	12.31	12.67	14.12	7.51	7.87	8.61	8.96	10.42
	6H	11.81	12.10	12.92	13.20	14.66	8.08	8.37	9.18	9.47	10.93
	8H	12.03	12.28	13.14	13.38	14.88	8.29	8.54	9.40	9.64	11.14