

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910099

Luminaire Tested: DFN2DIP-TR4F0-060D110US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910099
REPORT IS A COMBINATION OF REPORTS P902019 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-060D110US840-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16996.0 lumens
Efficiency: N/A
Efficacy: 123.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 138.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9781
Total Harmonic Distortion (THDi): 0.075
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910099

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US840-FLLONL

Luminous Intensity Polar Plot

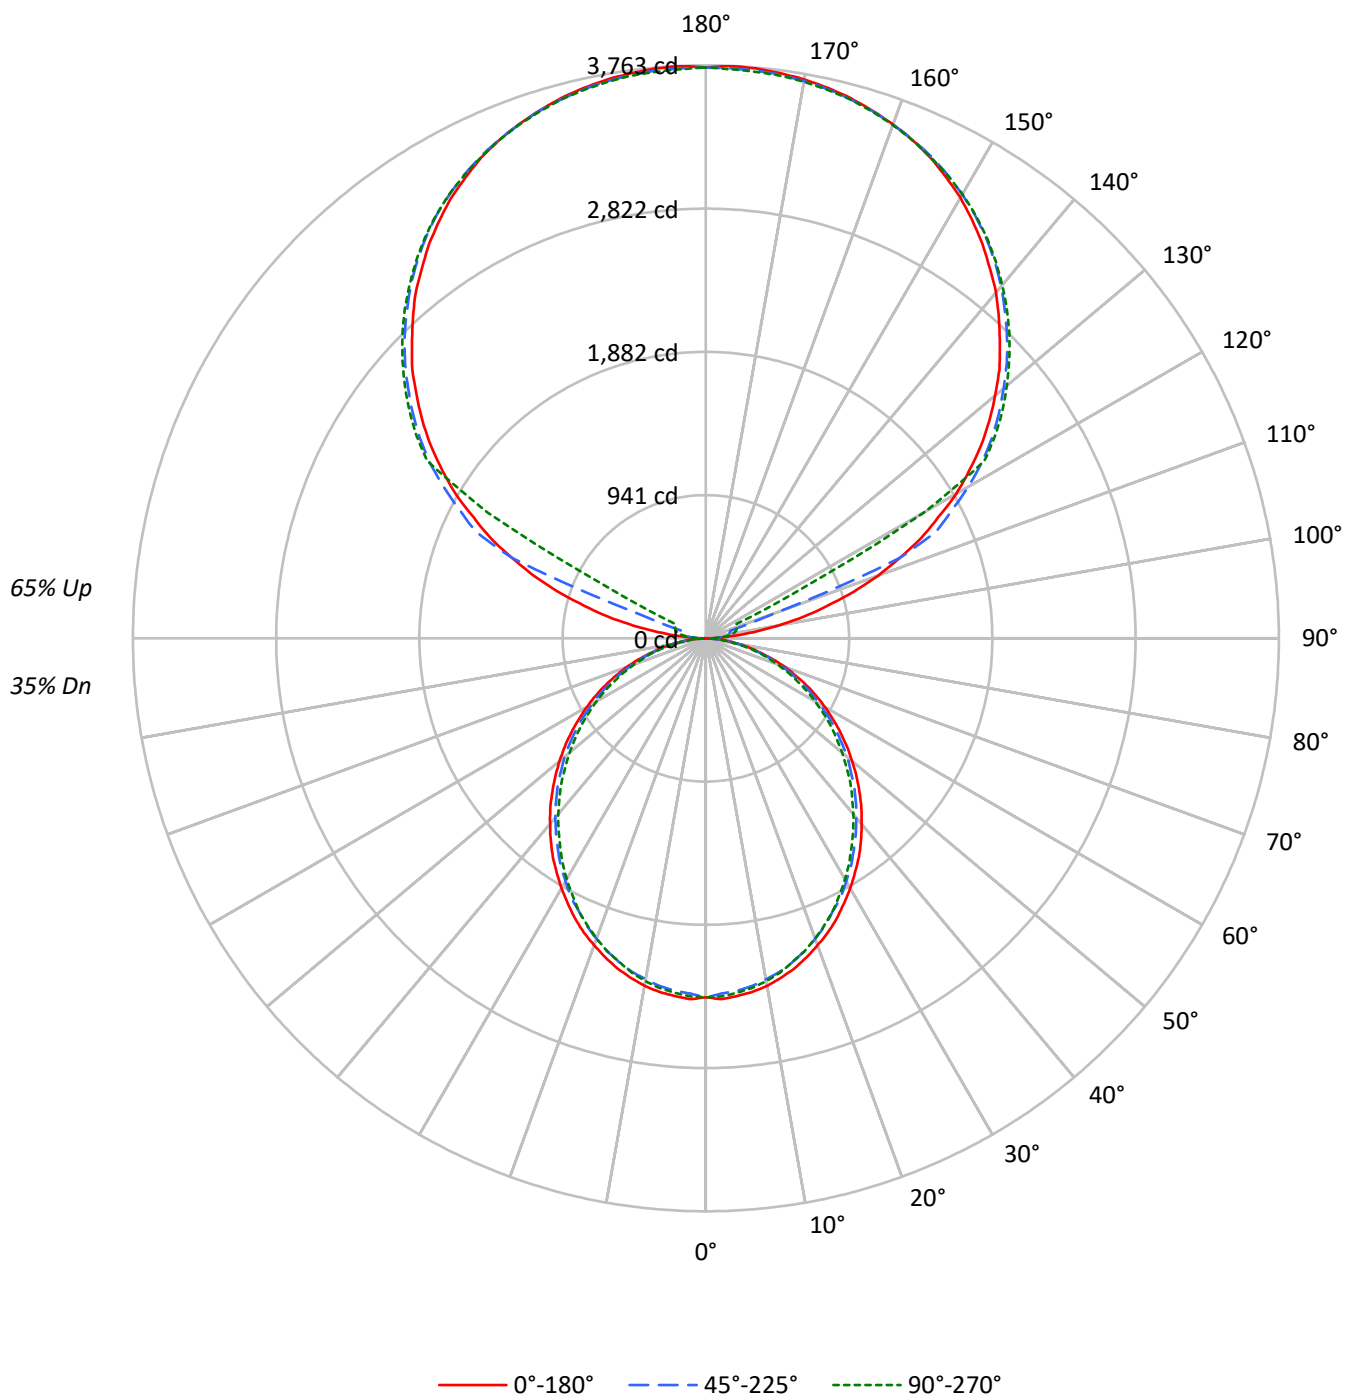

TEST NUMBER: P910099

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	75	75	75	58	58	58	43	43	43
1	95	90	86	83	85	82	79	76	66	64	62	51	50	48	38	37	36
2	86	79	73	68	78	71	66	62	58	54	51	45	43	40	33	32	30
3	78	69	62	56	71	63	57	52	51	46	43	40	37	34	29	27	26
4	72	61	53	48	65	56	49	44	45	40	36	35	32	29	26	24	22
5	66	54	46	41	59	50	43	38	40	35	31	32	28	25	24	21	19
6	60	49	41	35	54	44	37	32	36	31	27	29	25	22	21	19	17
7	56	44	36	31	50	40	33	28	33	28	24	26	22	19	20	17	15
8	52	40	32	27	47	36	30	25	30	25	21	24	20	17	18	15	13
9	48	36	29	24	43	33	27	22	27	22	19	22	18	15	17	14	12
10	45	33	26	21	41	30	24	20	25	20	17	20	16	14	15	13	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1873	1873	1873
5°	1876	1847	1859
10°	1861	1822	1834
15°	1833	1792	1795
20°	1797	1750	1754
25°	1760	1700	1708
30°	1714	1654	1648
35°	1670	1599	1586
40°	1616	1544	1526
45°	1563	1489	1465
50°	1504	1431	1394
55°	1443	1363	1329
60°	1373	1283	1255
65°	1298	1201	1167
70°	1201	1100	1073
75°	1068	979	985
80°	907	825	818
85°	656	560	543

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1989 cd/sqm

TEST NUMBER: P910099

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	221.9	1.3
10°-20°	624.4	3.7
20°-30°	917.5	5.4
30°-40°	1065.7	6.3
40°-50°	1064.4	6.3
50°-60°	928.1	5.5
60°-70°	686.1	4.0
70°-80°	388.2	2.3
80°-90°	109.0	0.6
90°-100°	123.6	0.7
100°-110°	460.8	2.7
110°-120°	1222.2	7.2
120°-130°	2027.1	11.9
130°-140°	2153.3	12.7
140°-150°	2001.2	11.8
150°-160°	1608.9	9.5
160°-170°	1036.7	6.1
170°-180°	356.8	2.1
0°-30°	1763.8	10.4
0°-40°	2829.5	16.6
0°-60°	4821.9	28.4
0°-90°	6005.2	35.3
90°-120°	1806.7	10.6
90°-150°	7988.3	47.0
90°-180°	10991.0	64.7
0°-180°	16996.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2358	2358	2358	2358	2358	
5°	2358	2349	2324	2342	2337	224
15°	2244	2231	2201	2210	2199	632
25°	2031	2013	1975	1979	1975	935
35°	1752	1730	1694	1680	1668	1094
45°	1426	1410	1376	1351	1342	1101
55°	1079	1066	1038	1011	1000	965
65°	728	714	692	671	660	720
75°	381	376	365	351	356	406
85°	93	91	88	82	79	104
90°	3	32	54	68	73	16
95°	176	87	106	120	117	209
105°	825	906	166	195	206	881
115°	1560	1606	1674	418	223	1536
125°	2205	2241	2292	2311	2319	1967
135°	2729	2773	2797	2824	2819	2108
145°	3166	3163	3209	3228	3215	1980
155°	3486	3462	3494	3510	3489	1606
165°	3673	3657	3665	3684	3665	1038
175°	3757	3738	3744	3763	3736	358
180°	3749	3749	3749	3749	3749	

TEST NUMBER: P910099

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2357.6	2357.6	2357.6	2357.6	2357.6
2.5°	2371.4	2360.1	2335.0	2357.6	2353.3
5°	2357.6	2348.7	2323.7	2341.8	2337.4
7.5°	2341.8	2328.3	2303.3	2321.6	2317.0
10°	2317.0	2301.2	2273.9	2292.0	2285.2
12.5°	2282.9	2269.4	2242.2	2253.5	2249.0
15°	2244.3	2230.9	2201.3	2210.5	2199.2
17.5°	2196.8	2183.3	2153.7	2164.9	2153.7
20°	2144.6	2131.1	2099.3	2106.1	2097.2
22.5°	2092.6	2072.1	2042.6	2042.6	2038.0
25°	2031.2	2013.3	1974.7	1979.0	1974.7
27.5°	1963.2	1947.3	1917.9	1911.3	1900.0
30°	1895.4	1877.0	1843.2	1836.4	1827.3
32.5°	1822.7	1809.3	1772.9	1759.2	1750.1
35°	1752.5	1729.9	1693.5	1679.8	1668.5
37.5°	1673.1	1652.6	1616.4	1600.4	1589.1
40°	1591.5	1573.3	1537.0	1516.8	1507.6
42.5°	1512.2	1493.9	1457.8	1435.0	1421.5
45°	1426.1	1410.2	1376.0	1351.3	1342.1
47.5°	1342.1	1326.3	1290.0	1265.0	1251.4
50°	1253.6	1242.3	1210.6	1178.8	1167.5
52.5°	1167.5	1151.7	1122.3	1097.3	1081.5
55°	1079.2	1065.5	1038.3	1011.2	999.9
57.5°	990.8	979.5	949.9	922.7	913.5
60°	902.2	893.3	861.6	836.6	829.8
62.5°	816.1	800.2	777.6	755.0	745.9
65°	727.8	714.2	691.6	671.1	659.7
67.5°	637.1	625.6	605.4	589.6	580.4
70°	553.2	544.1	523.6	507.8	498.9
72.5°	467.1	458.0	446.7	430.8	424.0
75°	380.7	376.5	364.9	351.4	356.0
77.5°	303.8	294.7	290.0	283.4	276.6
80°	226.8	224.4	219.8	213.1	208.5
82.5°	154.2	154.2	152.0	142.9	142.9
85°	92.8	90.7	88.5	81.5	79.4
87.5°	40.9	36.4	31.7	25.0	22.6
90°	2.6	32.5	54.1	68.0	73.1
92.5°	68.0	57.1	65.0	70.6	73.1
95°	176.2	86.6	105.6	119.5	116.6
97.5°	317.3	95.0	138.1	146.5	149.2
100°	480.3	108.6	154.6	176.2	181.7
102.5°	659.0	653.9	160.1	189.8	198.1
105°	824.7	906.2	165.6	195.2	206.2
107.5°	1017.3	1084.9	171.1	200.7	211.7
110°	1201.8	1258.6	474.8	203.6	214.2

TEST NUMBER: P910099

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1375.5	1424.1	1378.1	208.7	217.1
115°	1559.7	1605.8	1673.9	417.8	222.6
117.5°	1719.9	1774.0	1820.4	1432.2	721.5
120°	1899.0	1939.5	1988.5	2021.0	1654.8
122.5°	2050.7	2094.2	2148.6	2164.7	2167.7
125°	2205.3	2240.8	2292.3	2311.3	2319.4
127.5°	2346.4	2384.4	2425.3	2452.4	2455.0
130°	2479.4	2522.9	2552.5	2582.5	2580.0
132.5°	2615.0	2650.5	2680.2	2704.6	2702.1
135°	2729.2	2772.6	2796.7	2824.2	2818.6
137.5°	2848.3	2880.8	2908.2	2935.3	2927.2
140°	2965.0	2986.8	3016.5	3040.9	3027.4
142.5°	3062.8	3081.8	3116.9	3138.6	3125.0
145°	3165.9	3163.0	3209.0	3228.1	3214.6
147.5°	3255.2	3247.1	3293.2	3306.7	3296.1
150°	3342.2	3323.2	3366.6	3382.7	3369.2
152.5°	3415.3	3393.7	3434.2	3450.7	3431.7
155°	3485.9	3461.6	3494.1	3510.3	3488.7
157.5°	3542.8	3521.2	3545.7	3564.7	3542.8
160°	3591.8	3575.3	3591.8	3607.8	3588.9
162.5°	3634.9	3618.9	3632.4	3651.4	3626.9
165°	3673.0	3656.8	3664.9	3683.9	3664.9
167.5°	3702.9	3686.5	3694.9	3713.9	3689.4
170°	3727.4	3711.0	3716.4	3735.5	3711.0
172.5°	3743.5	3727.4	3732.9	3751.9	3727.4
175°	3757.0	3738.0	3743.5	3762.6	3735.5
177.5°	3762.6	3743.5	3746.4	3765.4	3740.9
180°	3749.0	3749.0	3749.0	3749.0	3749.0

TEST NUMBER: P910099

CATALOG NUMBER: DFN2DIP-TR4F0-060D110US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.91	8.66	8.99	9.73	11.20	7.48	8.23	8.56	9.30	10.77
	3H	9.57	10.23	10.65	11.31	12.80	9.09	9.76	10.18	10.84	12.33
	4H	10.15	10.78	11.24	11.86	13.35	9.67	10.31	10.77	11.39	12.88
	6H	10.54	11.12	11.64	12.21	13.71	10.07	10.65	11.17	11.74	13.24
	8H	10.64	11.20	11.75	12.30	13.80	10.17	10.72	11.27	11.82	13.32
	12H	10.69	11.21	11.80	12.31	13.83	10.21	10.73	11.32	11.83	13.35
4H	2H	8.36	8.99	9.46	10.08	11.57	8.02	8.65	9.12	9.73	11.22
	3H	10.22	10.74	11.32	11.86	13.36	9.82	10.35	10.93	11.46	12.97
	4H	10.93	11.41	12.04	12.51	14.04	10.52	11.00	11.63	12.11	13.63
	6H	11.43	11.85	12.55	12.97	14.49	11.02	11.44	12.14	12.56	14.08
	8H	11.58	11.97	12.70	13.09	14.62	11.17	11.56	12.29	12.67	14.21
	12H	11.65	12.00	12.78	13.13	14.67	11.23	11.58	12.36	12.71	14.24
8H	4H	11.11	11.50	12.23	12.62	14.15	10.75	11.14	11.87	12.26	13.79
	6H	11.74	12.06	12.88	13.22	14.75	11.38	11.70	12.52	12.86	14.38
	8H	11.96	12.24	13.11	13.38	14.93	11.59	11.87	12.74	13.01	14.56
	12H	12.08	12.33	13.24	13.47	15.05	11.70	11.95	12.85	13.08	14.67
12H	4H	11.09	11.44	12.23	12.57	14.11	10.74	11.09	11.88	12.22	13.76
	6H	11.77	12.05	12.91	13.19	14.74	11.42	11.70	12.56	12.84	14.38
	8H	12.00	12.25	13.15	13.39	14.97	11.65	11.89	12.80	13.03	14.61