

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910109

Luminaire Tested: DFN2DIP-TR4F0-070D040US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910109
REPORT IS A COMBINATION OF REPORTS P901896 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D040US840-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10007.7 lumens
Efficiency: N/A
Efficacy: 104.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 95.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910109

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US840-RLLONL

Luminous Intensity Polar Plot

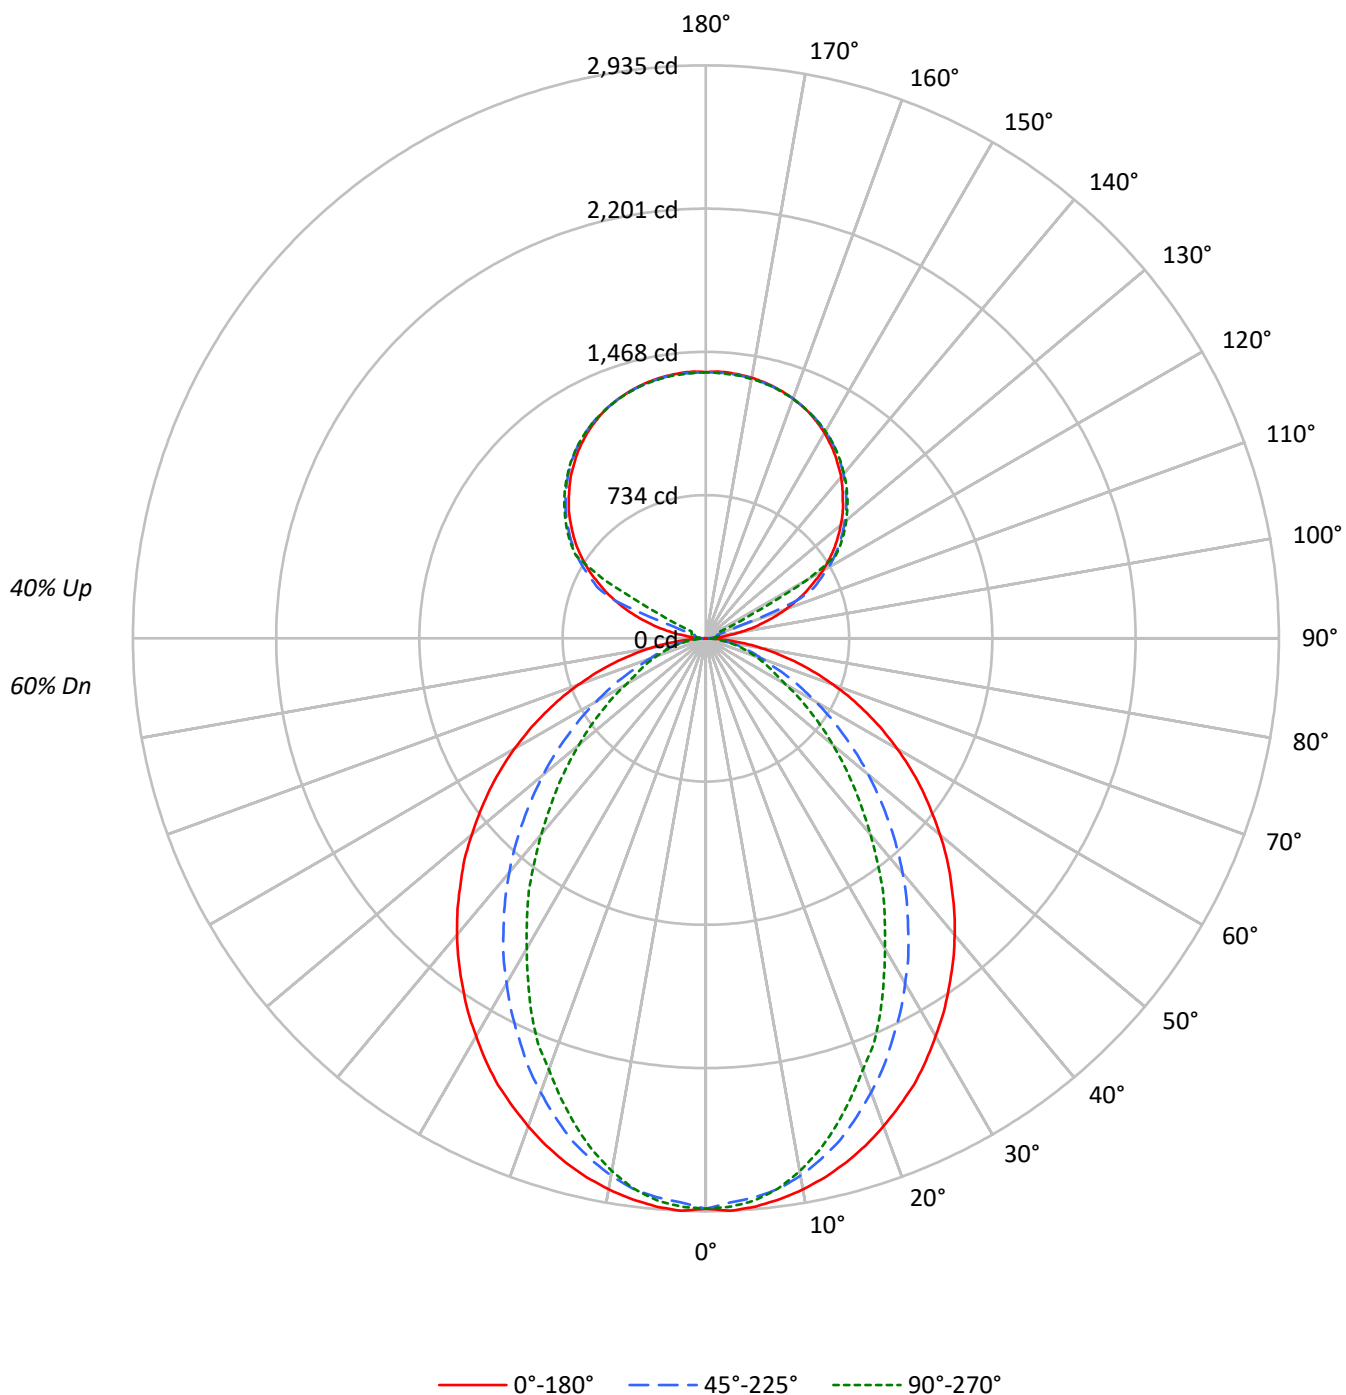

TEST NUMBER: P910109

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89	77	77	77	65	65	65
1	101	96	93	89	94	90	87	84	79	77	74	68	67	65	59	57	56
2	92	85	79	74	86	80	74	70	70	66	62	61	58	55	52	50	48
3	84	75	68	62	79	71	64	59	62	57	53	54	51	47	47	44	42
4	78	67	59	53	72	63	56	51	56	50	46	49	45	41	42	39	37
5	71	60	52	46	67	57	49	44	50	44	40	44	40	36	38	35	32
6	66	54	46	40	62	51	44	39	45	40	35	40	35	32	35	32	29
7	61	49	41	36	57	46	39	34	41	36	31	37	32	29	32	29	26
8	57	45	37	32	53	42	35	31	38	32	28	34	29	26	30	26	23
9	53	41	34	29	50	39	32	28	35	29	25	31	27	23	28	24	21
10	50	38	31	26	47	36	29	25	32	27	23	29	24	21	26	22	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2321	2321	2321
5°	2325	2284	2299
10°	2302	2239	2224
15°	2270	2165	2108
20°	2228	2063	1966
25°	2185	1949	1829
30°	2128	1832	1655
35°	2071	1706	1503
40°	2014	1575	1327
45°	1947	1430	1169
50°	1878	1284	1014
55°	1806	1128	865
60°	1723	965	712
65°	1627	799	641
70°	1510	644	580
75°	1365	568	527
80°	1153	476	457
85°	803	318	343

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1947 cd/sqm

TEST NUMBER: P910109

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	273.8	2.7
10°-20°	751.7	7.5
20°-30°	1055.3	10.5
30°-40°	1150.4	11.5
40°-50°	1057.3	10.6
50°-60°	830.4	8.3
60°-70°	540.5	5.4
70°-80°	278.2	2.8
80°-90°	73.4	0.7
90°-100°	44.9	0.4
100°-110°	167.6	1.7
110°-120°	444.4	4.4
120°-130°	737.1	7.4
130°-140°	783.0	7.8
140°-150°	727.7	7.3
150°-160°	585.1	5.8
160°-170°	377.0	3.8
170°-180°	129.8	1.3
0°-30°	2080.9	20.8
0°-40°	3231.2	32.3
0°-60°	5118.9	51.2
0°-90°	6011.0	60.1
90°-120°	656.9	6.6
90°-150°	2904.8	29.0
90°-180°	3997.0	39.9
0°-180°	10007.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2922	2922	2922	2922	2922	
5°	2922	2908	2874	2898	2890	277
15°	2779	2750	2660	2610	2583	783
25°	2522	2438	2263	2155	2115	1160
35°	2173	2038	1806	1639	1581	1360
45°	1777	1600	1322	1134	1071	1372
55°	1351	1145	859	701	651	1207
65°	912	698	460	370	362	904
75°	486	301	212	193	190	515
85°	114	58	50	50	50	130
90°	1	12	20	25	27	9
95°	64	32	38	43	42	76
105°	300	330	60	71	75	320
115°	567	584	609	152	81	558
125°	802	815	834	840	843	715
135°	992	1008	1017	1027	1025	767
145°	1151	1150	1167	1174	1169	720
155°	1268	1259	1271	1276	1269	584
165°	1336	1330	1333	1340	1333	377
175°	1366	1359	1361	1368	1358	130
180°	1363	1363	1363	1363	1363	

TEST NUMBER: P910109

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2921.6	2921.6	2921.6	2921.6	2921.6
2.5°	2934.8	2921.6	2892.5	2919.1	2913.8
5°	2921.6	2908.4	2874.0	2897.8	2889.9
7.5°	2897.8	2882.1	2845.1	2855.4	2842.3
10°	2866.1	2847.6	2794.8	2786.7	2771.0
12.5°	2826.5	2802.7	2731.2	2715.4	2686.2
15°	2778.8	2749.7	2659.9	2609.7	2583.3
17.5°	2723.3	2681.0	2569.9	2511.7	2469.4
20°	2659.9	2606.9	2474.8	2408.8	2350.5
22.5°	2591.2	2530.3	2376.8	2287.0	2247.6
25°	2522.4	2437.7	2263.2	2155.0	2115.2
27.5°	2440.5	2350.5	2157.5	2033.3	1972.4
30°	2353.3	2252.6	2041.0	1906.4	1834.9
32.5°	2268.6	2146.9	1930.3	1771.5	1705.3
35°	2173.4	2038.5	1806.0	1639.4	1581.0
37.5°	2080.9	1935.3	1689.6	1506.9	1441.1
40°	1983.0	1824.5	1567.8	1380.2	1311.4
42.5°	1882.6	1713.4	1446.3	1250.5	1184.7
45°	1776.9	1599.5	1322.1	1134.2	1070.8
47.5°	1676.4	1488.7	1203.2	1015.2	957.2
50°	1565.3	1377.7	1086.7	904.1	848.9
52.5°	1456.7	1258.4	975.6	801.1	750.9
55°	1351.0	1144.8	859.2	700.7	650.6
57.5°	1242.7	1031.2	756.3	608.1	565.8
60°	1131.7	920.1	647.7	513.1	470.7
62.5°	1023.3	811.8	555.1	428.4	407.3
65°	912.2	697.9	460.1	370.3	362.1
67.5°	806.5	592.2	370.3	325.1	317.3
70°	695.4	489.2	306.6	280.2	269.5
72.5°	589.7	393.8	256.4	235.4	230.0
75°	486.5	301.2	211.5	193.0	190.5
77.5°	383.4	214.0	166.6	155.9	150.7
80°	288.1	153.4	126.8	116.4	116.4
82.5°	200.9	103.2	87.3	81.9	81.9
85°	113.6	58.1	50.2	50.2	50.2
87.5°	42.3	21.0	21.0	18.5	18.5
90°	0.9	11.8	19.7	24.7	26.6
92.5°	24.7	20.7	23.6	25.7	26.6
95°	64.0	31.5	38.4	43.4	42.4
97.5°	115.4	34.5	50.3	53.3	54.2
100°	174.6	39.5	56.2	64.0	66.0
102.5°	239.6	237.8	58.2	69.0	72.0
105°	299.8	329.5	60.2	71.0	74.9
107.5°	369.9	394.6	62.2	73.0	77.0
110°	437.1	457.7	172.7	74.0	77.9

TEST NUMBER: P910109

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	500.2	517.9	501.1	75.9	79.0
115°	567.1	583.9	608.6	151.9	81.0
117.5°	625.4	645.1	662.0	520.8	262.4
120°	690.5	705.3	723.1	735.0	601.8
122.5°	745.7	761.5	781.3	787.2	788.2
125°	801.9	814.9	833.5	840.5	843.4
127.5°	853.2	867.1	881.9	891.8	892.7
130°	901.6	917.5	928.2	939.1	938.2
132.5°	950.9	963.8	974.6	983.5	982.6
135°	992.4	1008.2	1017.0	1026.9	1025.0
137.5°	1035.7	1047.5	1057.5	1067.3	1064.4
140°	1078.1	1086.1	1096.9	1105.8	1100.9
142.5°	1113.8	1120.6	1133.5	1141.2	1136.4
145°	1151.2	1150.2	1166.9	1173.9	1168.9
147.5°	1183.7	1180.7	1197.5	1202.4	1198.6
150°	1215.3	1208.4	1224.3	1230.1	1225.2
152.5°	1241.9	1234.1	1248.8	1254.8	1247.9
155°	1267.6	1258.8	1270.6	1276.5	1268.6
157.5°	1288.3	1280.4	1289.4	1296.3	1288.3
160°	1306.1	1300.1	1306.1	1311.9	1305.0
162.5°	1321.8	1316.0	1320.9	1327.8	1318.9
165°	1335.6	1329.8	1332.7	1339.6	1332.7
167.5°	1346.6	1340.5	1343.6	1350.5	1341.6
170°	1355.4	1349.5	1351.4	1358.4	1349.5
172.5°	1361.3	1355.4	1357.5	1364.3	1355.4
175°	1366.1	1359.3	1361.3	1368.2	1358.4
177.5°	1368.2	1361.3	1362.3	1369.3	1360.4
180°	1363.3	1363.3	1363.3	1363.3	1363.3

TEST NUMBER: P910109

CATALOG NUMBER: DFN2DIP-TR4F0-070D040US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.96	11.88	11.83	12.77	13.89	6.93	7.85	7.80	8.74	9.86
	3H	12.64	13.47	13.53	14.36	15.51	8.13	8.95	9.01	9.85	11.00
	4H	13.26	14.03	14.16	14.94	16.09	8.58	9.36	9.48	10.26	11.42
	6H	13.68	14.40	14.59	15.31	16.48	8.91	9.62	9.82	10.54	11.71
	8H	13.81	14.49	14.73	15.42	16.59	9.00	9.68	9.92	10.61	11.78
	12H	13.87	14.52	14.80	15.44	16.64	9.05	9.70	9.98	10.62	11.81
4H	2H	10.99	11.76	11.89	12.67	13.83	7.54	8.31	8.44	9.22	10.38
	3H	12.83	13.47	13.74	14.41	15.58	8.90	9.54	9.81	10.48	11.65
	4H	13.52	14.11	14.45	15.04	16.24	9.45	10.04	10.38	10.97	12.17
	6H	14.04	14.55	14.98	15.50	16.70	9.87	10.38	10.82	11.33	12.54
	8H	14.22	14.69	15.16	15.64	16.85	10.01	10.48	10.95	11.43	12.64
	12H	14.32	14.74	15.28	15.71	16.93	10.08	10.50	11.04	11.47	12.69
8H	4H	13.49	13.97	14.44	14.92	16.13	9.74	10.21	10.68	11.16	12.37
	6H	14.06	14.45	15.03	15.44	16.66	10.26	10.65	11.23	11.64	12.85
	8H	14.28	14.63	15.26	15.61	16.84	10.45	10.80	11.43	11.78	13.01
	12H	14.42	14.73	15.40	15.70	16.98	10.57	10.88	11.56	11.85	13.13
12H	4H	13.45	13.88	14.41	14.84	16.06	9.74	10.17	10.71	11.14	12.35
	6H	14.04	14.38	15.02	15.36	16.60	10.31	10.65	11.29	11.63	12.86
	8H	14.26	14.57	15.24	15.54	16.82	10.52	10.83	11.50	11.80	13.08

END OF REPORT