

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910135

Luminaire Tested: DFN2DIP-TR4F0-070D110US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910135
REPORT IS A COMBINATION OF REPORTS P902021 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-070D110US840-FLLONL
Description: 4 foot, Triangle Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17995.8 lumens
Efficiency: N/A
Efficacy: 119.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 150.3
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9977
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910135

CATALOG NUMBER: DFN2DIP-TR4F0-070D110US840-FLLONL

Luminous Intensity Polar Plot

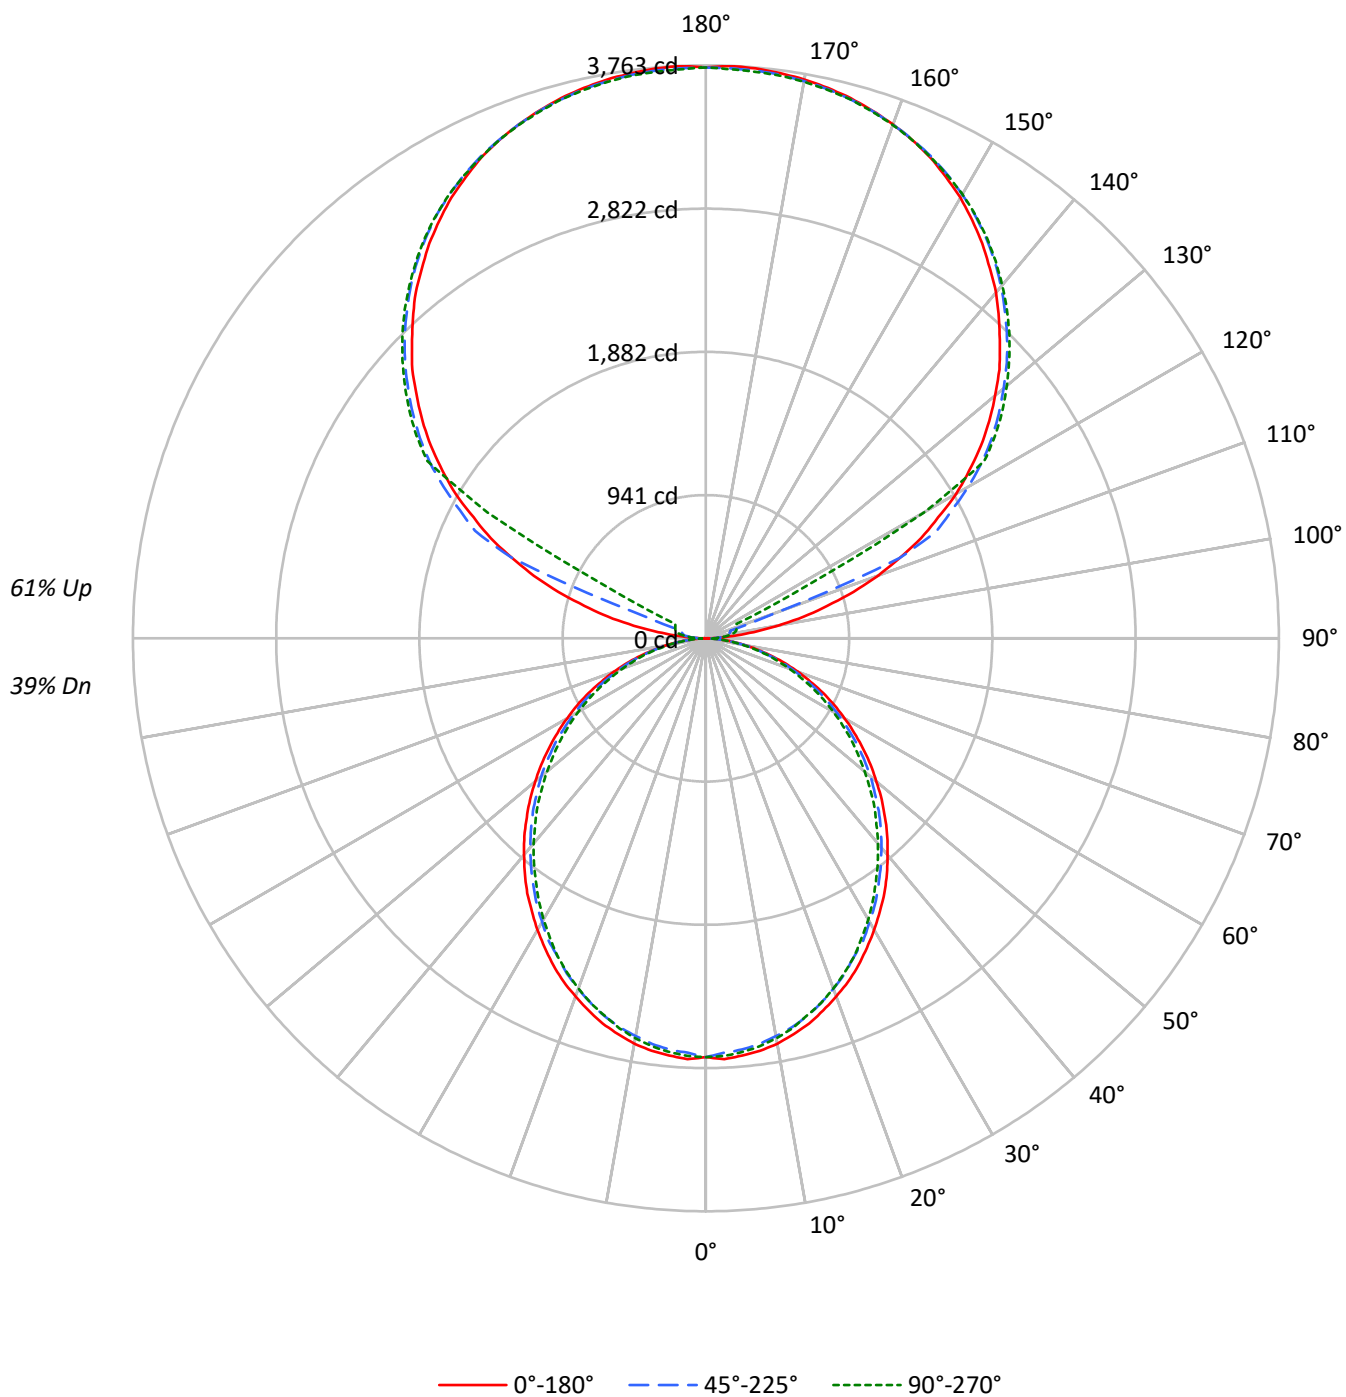

TEST NUMBER: P910135

CATALOG NUMBER: DFN2DIP-TR4F0-070D110US840-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	95	91	87	84	86	83	80	77	68	65	63	54	52	51	41	40	39
2	87	79	73	68	79	72	67	63	59	56	52	47	44	42	36	34	33
3	79	70	63	57	72	64	58	53	52	48	44	42	38	36	32	30	28
4	72	62	54	48	65	56	50	44	46	41	37	37	33	31	28	26	24
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	23	21
6	61	49	41	36	55	45	38	33	37	32	28	30	26	23	23	20	18
7	56	44	37	31	51	41	34	29	34	28	25	27	23	20	21	18	16
8	52	40	33	27	47	37	30	26	31	26	22	25	21	18	19	17	15
9	49	37	29	24	44	34	27	23	28	23	19	23	19	16	18	15	13
10	45	34	26	22	41	31	25	20	26	21	17	21	17	15	17	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2185	2185	2185
5°	2189	2155	2169
10°	2171	2126	2140
15°	2139	2091	2094
20°	2096	2042	2047
25°	2053	1984	1992
30°	1999	1930	1923
35°	1948	1866	1850
40°	1886	1801	1780
45°	1823	1737	1709
50°	1755	1669	1627
55°	1683	1590	1551
60°	1602	1497	1464
65°	1514	1401	1362
70°	1402	1283	1251
75°	1246	1142	1150
80°	1059	963	955
85°	767	654	633

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1989 cd/sqm

TEST NUMBER: P910135

CATALOG NUMBER: DFN2DIP-TR4F0-070D110US840-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	258.9	1.4
10°-20°	728.4	4.0
20°-30°	1070.5	5.9
30°-40°	1243.3	6.9
40°-50°	1241.7	6.9
50°-60°	1082.8	6.0
60°-70°	800.4	4.4
70°-80°	452.9	2.5
80°-90°	126.1	0.7
90°-100°	123.6	0.7
100°-110°	460.8	2.6
110°-120°	1222.2	6.8
120°-130°	2027.1	11.3
130°-140°	2153.3	12.0
140°-150°	2001.2	11.1
150°-160°	1608.9	8.9
160°-170°	1036.7	5.8
170°-180°	356.8	2.0
0°-30°	2057.8	11.4
0°-40°	3301.1	18.3
0°-60°	5625.6	31.3
0°-90°	7005.0	38.9
90°-120°	1806.7	10.0
90°-150°	7988.3	44.4
90°-180°	10991.0	61.1
0°-180°	17995.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2751	2751	2751	2751	2751	
5°	2751	2740	2711	2732	2727	261
15°	2618	2603	2568	2579	2566	737
25°	2370	2349	2304	2309	2304	1090
35°	2045	2018	1976	1960	1947	1277
45°	1664	1645	1605	1576	1566	1284
55°	1259	1243	1211	1180	1166	1126
65°	849	833	807	783	770	840
75°	444	439	426	410	415	474
85°	108	106	103	95	93	121
90°	3	32	54	68	73	17
95°	176	87	106	120	117	209
105°	825	906	166	195	206	881
115°	1560	1606	1674	418	223	1536
125°	2205	2241	2292	2311	2319	1967
135°	2729	2773	2797	2824	2819	2108
145°	3166	3163	3209	3228	3215	1980
155°	3486	3462	3494	3510	3489	1606
165°	3673	3657	3665	3684	3665	1038
175°	3757	3738	3744	3763	3736	358
180°	3749	3749	3749	3749	3749	

TEST NUMBER: P910135

CATALOG NUMBER: DFN2DIP-TR4F0-070D110US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2750.6	2750.6	2750.6	2750.6	2750.6
2.5°	2766.6	2753.4	2724.2	2750.6	2745.5
5°	2750.6	2740.3	2711.1	2732.1	2727.0
7.5°	2732.1	2716.3	2687.2	2708.6	2703.2
10°	2703.2	2684.6	2652.9	2674.0	2666.1
12.5°	2663.3	2647.7	2616.0	2629.1	2623.7
15°	2618.5	2602.7	2568.2	2578.9	2565.7
17.5°	2562.8	2547.2	2512.6	2525.9	2512.6
20°	2501.9	2486.3	2449.2	2457.1	2446.7
22.5°	2441.3	2417.5	2383.0	2383.0	2377.6
25°	2369.9	2348.7	2303.9	2309.0	2303.9
27.5°	2290.4	2271.9	2237.7	2229.8	2216.6
30°	2211.3	2189.9	2150.4	2142.5	2131.8
32.5°	2126.5	2110.8	2068.4	2052.5	2041.7
35°	2044.6	2018.2	1975.8	1959.8	1946.6
37.5°	1952.0	1928.1	1885.7	1867.2	1854.0
40°	1856.8	1835.5	1793.1	1769.6	1758.9
42.5°	1764.2	1742.9	1700.8	1674.2	1658.4
45°	1663.8	1645.3	1605.4	1576.5	1565.8
47.5°	1565.8	1547.3	1504.9	1475.7	1460.1
50°	1462.6	1449.4	1412.3	1375.3	1362.1
52.5°	1362.1	1343.6	1309.4	1280.2	1261.6
55°	1259.1	1243.1	1211.4	1179.7	1166.5
57.5°	1155.9	1142.7	1108.1	1076.4	1065.8
60°	1052.6	1042.2	1005.2	976.0	968.2
62.5°	952.1	933.6	907.3	880.9	870.2
65°	849.2	833.1	806.8	782.9	769.7
67.5°	743.4	729.9	706.3	687.8	677.1
70°	645.4	634.8	610.9	592.4	582.0
72.5°	544.9	534.3	521.1	502.6	494.7
75°	444.2	439.2	425.7	410.0	415.4
77.5°	354.5	343.8	338.4	330.5	322.8
80°	264.6	261.9	256.5	248.6	243.3
82.5°	179.9	179.9	177.3	166.7	166.7
85°	108.4	105.8	103.3	95.1	92.6
87.5°	47.7	42.4	37.1	29.2	26.4
90°	2.6	32.5	54.1	68.0	73.1
92.5°	68.0	57.1	65.0	70.6	73.1
95°	176.2	86.6	105.6	119.5	116.6
97.5°	317.3	95.0	138.1	146.5	149.2
100°	480.3	108.6	154.6	176.2	181.7
102.5°	659.0	653.9	160.1	189.8	198.1
105°	824.7	906.2	165.6	195.2	206.2
107.5°	1017.3	1084.9	171.1	200.7	211.7
110°	1201.8	1258.6	474.8	203.6	214.2

TEST NUMBER: P910135

CATALOG NUMBER: DFN2DIP-TR4F0-070D110US840-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1375.5	1424.1	1378.1	208.7	217.1
115°	1559.7	1605.8	1673.9	417.8	222.6
117.5°	1719.9	1774.0	1820.4	1432.2	721.5
120°	1899.0	1939.5	1988.5	2021.0	1654.8
122.5°	2050.7	2094.2	2148.6	2164.7	2167.7
125°	2205.3	2240.8	2292.3	2311.3	2319.4
127.5°	2346.4	2384.4	2425.3	2452.4	2455.0
130°	2479.4	2522.9	2552.5	2582.5	2580.0
132.5°	2615.0	2650.5	2680.2	2704.6	2702.1
135°	2729.2	2772.6	2796.7	2824.2	2818.6
137.5°	2848.3	2880.8	2908.2	2935.3	2927.2
140°	2965.0	2986.8	3016.5	3040.9	3027.4
142.5°	3062.8	3081.8	3116.9	3138.6	3125.0
145°	3165.9	3163.0	3209.0	3228.1	3214.6
147.5°	3255.2	3247.1	3293.2	3306.7	3296.1
150°	3342.2	3323.2	3366.6	3382.7	3369.2
152.5°	3415.3	3393.7	3434.2	3450.7	3431.7
155°	3485.9	3461.6	3494.1	3510.3	3488.7
157.5°	3542.8	3521.2	3545.7	3564.7	3542.8
160°	3591.8	3575.3	3591.8	3607.8	3588.9
162.5°	3634.9	3618.9	3632.4	3651.4	3626.9
165°	3673.0	3656.8	3664.9	3683.9	3664.9
167.5°	3702.9	3686.5	3694.9	3713.9	3689.4
170°	3727.4	3711.0	3716.4	3735.5	3711.0
172.5°	3743.5	3727.4	3732.9	3751.9	3727.4
175°	3757.0	3738.0	3743.5	3762.6	3735.5
177.5°	3762.6	3743.5	3746.4	3765.4	3740.9
180°	3749.0	3749.0	3749.0	3749.0	3749.0

TEST NUMBER: P910135

CATALOG NUMBER: DFN2DIP-TR4F0-070D110US840-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.86	9.63	9.91	10.69	12.11	8.43	9.20	9.48	10.25	11.67
	3H	10.52	11.21	11.57	12.27	13.71	10.04	10.73	11.10	11.79	13.23
	4H	11.10	11.75	12.17	12.82	14.26	10.63	11.28	11.69	12.34	13.79
	6H	11.49	12.10	12.57	13.16	14.62	11.02	11.62	12.10	12.69	14.15
	8H	11.60	12.17	12.68	13.25	14.71	11.12	11.70	12.20	12.78	14.23
	12H	11.64	12.19	12.73	13.26	14.74	11.16	11.71	12.25	12.78	14.26
4H	2H	9.31	9.97	10.39	11.03	12.48	8.97	9.62	10.04	10.69	12.13
	3H	11.17	11.72	12.25	12.81	14.27	10.78	11.32	11.86	12.41	13.87
	4H	11.88	12.38	12.97	13.46	14.94	11.48	11.98	12.56	13.06	14.54
	6H	12.39	12.82	13.49	13.93	15.40	11.98	12.41	13.08	13.52	14.99
	8H	12.54	12.94	13.64	14.04	15.53	12.13	12.53	13.22	13.62	15.11
	12H	12.61	12.97	13.72	14.08	15.58	12.19	12.55	13.30	13.66	15.15
8H	4H	12.07	12.47	13.17	13.57	15.06	11.71	12.11	12.81	13.21	14.70
	6H	12.70	13.03	13.82	14.17	15.66	12.34	12.67	13.45	13.81	15.29
	8H	12.92	13.21	14.04	14.33	15.84	12.55	12.84	13.67	13.96	15.47
	12H	13.05	13.30	14.17	14.42	15.96	12.66	12.92	13.79	14.03	15.58
12H	4H	12.05	12.42	13.17	13.52	15.02	11.70	12.06	12.81	13.17	14.67
	6H	12.73	13.02	13.85	14.14	15.65	12.38	12.67	13.50	13.79	15.29
	8H	12.97	13.22	14.09	14.34	15.88	12.61	12.86	13.74	13.98	15.52

END OF REPORT