

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910201

Luminaire Tested: DFN2DIP-TR4F0-090D090US840-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910201
REPORT IS A COMBINATION OF REPORTS P901990 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-090D090US840-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16723.4 lumens
Efficiency: N/A
Efficacy: 107.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 155.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.099
Total Harmonic Distortion (THDi): 0.979
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910201

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US840-RLLONL

Luminous Intensity Polar Plot

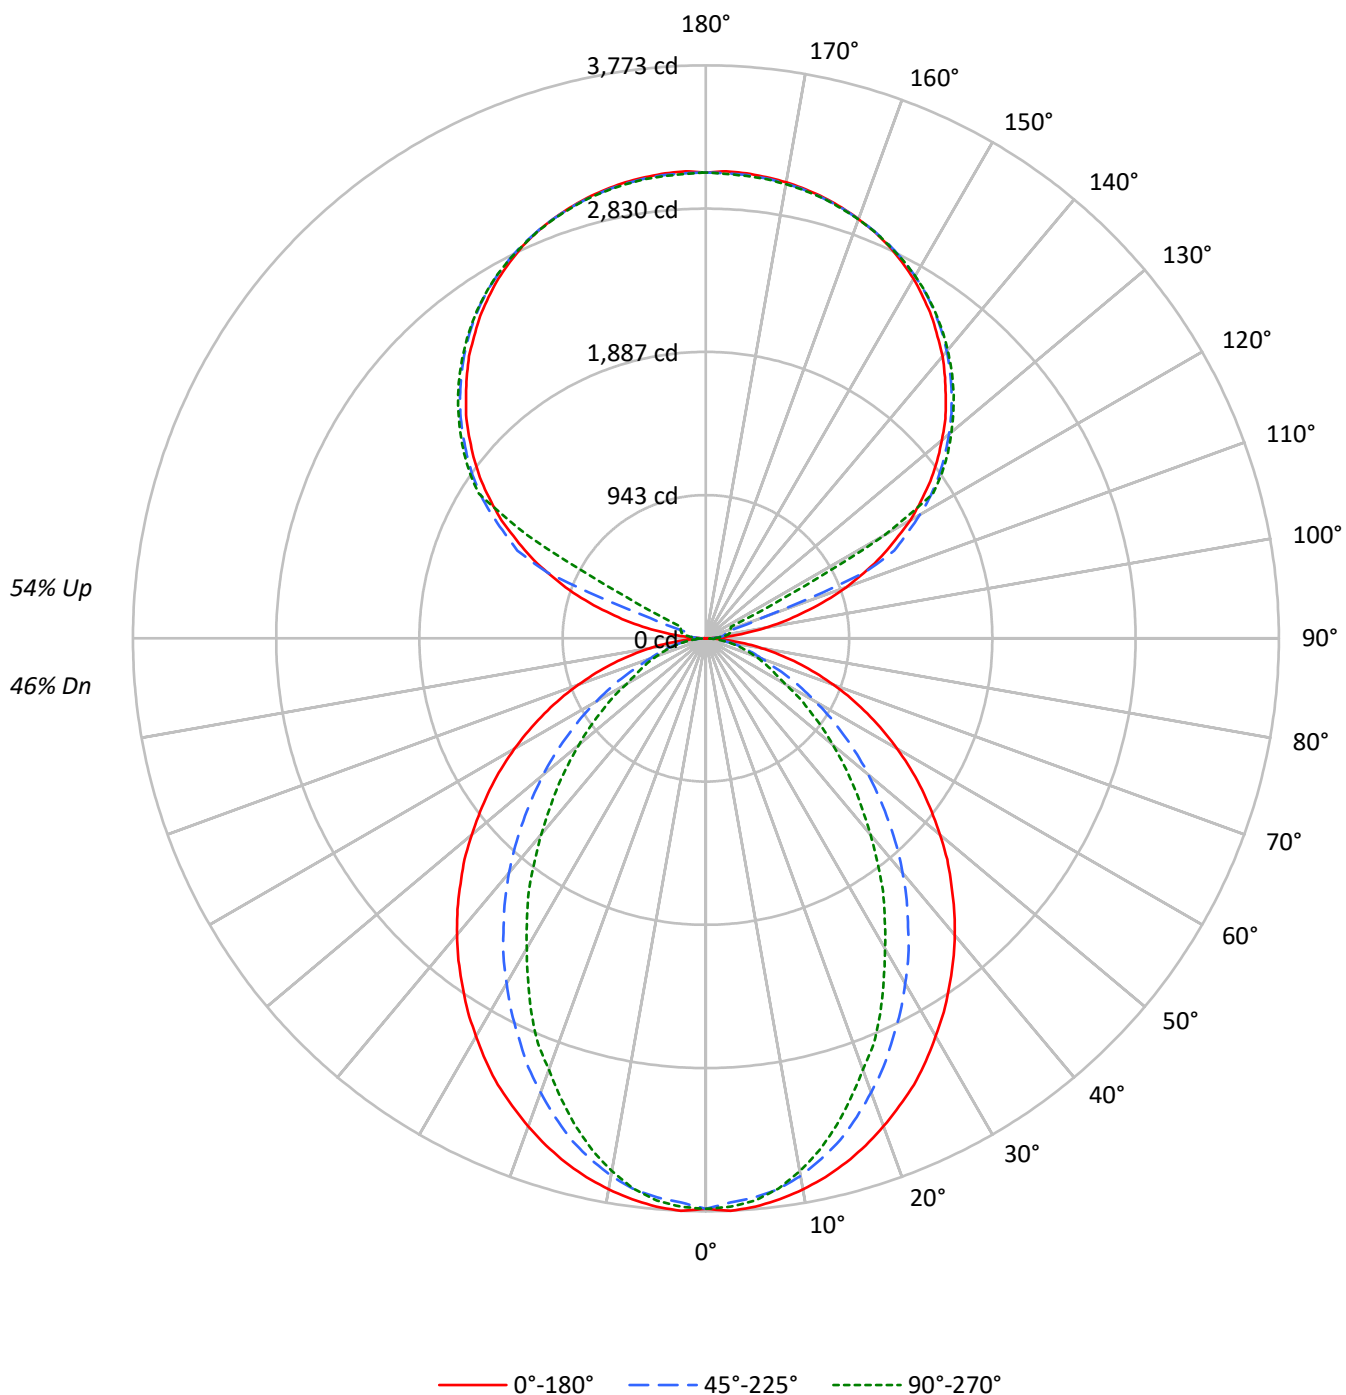

TEST NUMBER: P910201

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2984	2984	2984
5°	2989	2937	2956
10°	2959	2879	2859
15°	2919	2784	2711
20°	2865	2653	2528
25°	2810	2506	2352
30°	2736	2355	2128
35°	2663	2193	1932
40°	2589	2025	1707
45°	2503	1839	1503
50°	2415	1651	1304
55°	2322	1450	1112
60°	2215	1240	915
65°	2091	1027	824
70°	1942	828	745
75°	1754	730	678
80°	1482	612	588
85°	1032	408	441

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2503 cd/sqm

TEST NUMBER: P910201

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US840-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	352.1	2.1
10°-20°	966.5	5.8
20°-30°	1356.9	8.1
30°-40°	1479.1	8.8
40°-50°	1359.4	8.1
50°-60°	1067.6	6.4
60°-70°	694.9	4.2
70°-80°	357.7	2.1
80°-90°	96.7	0.6
90°-100°	101.2	0.6
100°-110°	377.0	2.3
110°-120°	1000.0	6.0
120°-130°	1658.6	9.9
130°-140°	1761.8	10.5
140°-150°	1637.4	9.8
150°-160°	1316.4	7.9
160°-170°	848.2	5.1
170°-180°	292.0	1.7
0°-30°	2675.4	16.0
0°-40°	4154.5	24.8
0°-60°	6581.5	39.4
0°-90°	7730.9	46.2
90°-120°	1478.2	8.8
90°-150°	6535.9	39.1
90°-180°	8992.0	53.8
0°-180°	16723.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3756	3756	3756	3756	3756	
5°	3756	3739	3695	3726	3716	356
15°	3573	3535	3420	3355	3321	1007
25°	3243	3134	2910	2771	2720	1492
35°	2794	2621	2322	2108	2033	1749
45°	2284	2057	1700	1458	1377	1764
55°	1737	1472	1105	901	836	1552
65°	1173	897	592	476	466	1163
75°	625	387	272	248	245	661
85°	146	75	64	64	64	168
90°	2	27	44	56	60	16
95°	144	71	86	98	95	171
105°	675	741	135	160	169	721
115°	1276	1314	1370	342	182	1256
125°	1804	1833	1876	1891	1898	1609
135°	2233	2268	2288	2311	2306	1725
145°	2590	2588	2626	2641	2630	1620
155°	2852	2832	2859	2872	2854	1314
165°	3005	2992	2999	3014	2999	849
175°	3074	3058	3063	3078	3056	293
180°	3067	3067	3067	3067	3067	



TEST NUMBER: P910201

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3756.4	3756.4	3756.4	3756.4	3756.4
2.5°	3773.4	3756.4	3718.8	3753.2	3746.3
5°	3756.4	3739.4	3695.1	3725.7	3715.6
7.5°	3725.7	3705.5	3657.9	3671.3	3654.3
10°	3685.0	3661.2	3593.4	3582.9	3562.7
12.5°	3634.1	3603.5	3511.5	3491.3	3453.7
15°	3572.8	3535.3	3419.9	3355.3	3321.4
17.5°	3501.4	3447.0	3304.1	3229.4	3175.0
20°	3419.9	3351.7	3181.8	3097.1	3022.0
22.5°	3331.5	3253.3	3056.0	2940.5	2889.7
25°	3243.2	3134.2	2909.9	2770.7	2719.5
27.5°	3137.9	3022.0	2773.9	2614.1	2535.9
30°	3025.7	2896.2	2624.2	2451.1	2359.1
32.5°	2916.7	2760.2	2481.7	2277.7	2192.5
35°	2794.5	2621.0	2322.0	2107.8	2032.8
37.5°	2675.4	2488.3	2172.3	1937.5	1852.8
40°	2549.6	2345.8	2015.8	1774.5	1686.2
42.5°	2420.4	2203.0	1859.6	1607.9	1523.1
45°	2284.5	2056.6	1699.8	1458.1	1376.6
47.5°	2155.4	1914.1	1546.9	1305.3	1230.6
50°	2012.6	1771.2	1397.2	1162.5	1091.4
52.5°	1873.0	1618.0	1254.5	1030.1	965.5
55°	1737.0	1471.9	1104.7	901.0	836.4
57.5°	1597.8	1325.9	972.4	781.9	727.5
60°	1454.9	1183.0	832.8	659.6	605.2
62.5°	1315.8	1043.8	713.8	550.8	523.7
65°	1172.9	897.4	591.5	476.1	465.6
67.5°	1036.9	761.3	476.1	418.0	407.9
70°	894.1	629.0	394.3	360.3	346.6
72.5°	758.1	506.3	329.6	302.6	295.8
75°	625.4	387.4	272.0	248.1	244.9
77.5°	493.0	275.2	214.2	200.6	193.7
80°	370.4	197.3	163.0	149.7	149.7
82.5°	258.2	132.7	112.2	105.3	105.3
85°	146.0	74.6	64.5	64.5	64.5
87.5°	54.4	27.1	27.1	23.8	23.8
90°	2.1	26.7	44.2	55.6	59.8
92.5°	55.6	46.7	53.2	57.8	59.8
95°	144.2	70.9	86.4	97.8	95.4
97.5°	259.6	77.8	113.1	119.9	122.0
100°	392.9	88.9	126.5	144.2	148.7
102.5°	539.3	535.0	131.0	155.2	162.1
105°	674.7	741.4	135.4	159.8	168.6
107.5°	832.3	887.7	140.0	164.2	173.2
110°	983.3	1029.8	388.5	166.5	175.3



TEST NUMBER: P910201

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1125.4	1165.2	1127.5	170.8	177.6
115°	1276.2	1313.8	1369.5	341.8	182.1
117.5°	1407.1	1451.5	1489.3	1171.8	590.4
120°	1553.7	1586.9	1627.0	1653.6	1353.9
122.5°	1677.9	1713.4	1758.0	1771.1	1773.5
125°	1804.3	1833.3	1875.5	1891.1	1897.6
127.5°	1919.8	1950.9	1984.4	2006.5	2008.6
130°	2028.6	2064.3	2088.5	2112.9	2110.9
132.5°	2139.6	2168.6	2192.8	2212.9	2210.8
135°	2232.9	2268.5	2288.3	2310.7	2306.2
137.5°	2330.5	2357.0	2379.4	2401.6	2395.0
140°	2425.8	2443.8	2468.0	2488.0	2477.0
142.5°	2506.0	2521.5	2550.2	2567.9	2556.9
145°	2590.3	2587.9	2625.7	2641.2	2630.1
147.5°	2663.3	2656.8	2694.4	2705.5	2696.7
150°	2734.5	2719.0	2754.5	2767.6	2756.6
152.5°	2794.3	2776.6	2809.8	2823.3	2807.7
155°	2852.1	2832.3	2858.8	2872.1	2854.4
157.5°	2898.7	2881.0	2901.0	2916.6	2898.7
160°	2938.7	2925.3	2938.7	2951.9	2936.4
162.5°	2974.1	2960.8	2971.9	2987.5	2967.5
165°	3005.2	2991.9	2998.6	3014.1	2998.6
167.5°	3029.7	3016.3	3023.0	3038.6	3018.6
170°	3049.7	3036.3	3040.7	3056.3	3036.3
172.5°	3062.9	3049.7	3054.1	3069.7	3049.7
175°	3073.9	3058.4	3062.9	3078.4	3056.3
177.5°	3078.4	3062.9	3065.2	3080.8	3060.8
180°	3067.4	3067.4	3067.4	3067.4	3067.4

TEST NUMBER: P910201

CATALOG NUMBER: DFN2DIP-TR4F0-090D090US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.58	11.38	11.57	12.38	13.71	6.55	7.35	7.55	8.35	9.68
	3H	12.25	12.97	13.26	13.98	15.33	7.74	8.45	8.74	9.46	10.81
	4H	12.86	13.54	13.88	14.55	15.91	8.19	8.86	9.21	9.88	11.23
	6H	13.28	13.90	14.31	14.92	16.29	8.51	9.13	9.54	10.15	11.52
	8H	13.40	14.00	14.44	15.03	16.40	8.60	9.19	9.63	10.23	11.59
	12H	13.47	14.03	14.50	15.06	16.44	8.64	9.20	9.68	10.23	11.62
4H	2H	10.59	11.27	11.62	12.28	13.64	7.14	7.82	8.17	8.83	10.19
	3H	12.42	12.98	13.45	14.02	15.39	8.49	9.05	9.52	10.10	11.47
	4H	13.11	13.62	14.15	14.66	16.05	9.04	9.55	10.08	10.59	11.98
	6H	13.62	14.06	14.67	15.12	16.51	9.46	9.90	10.51	10.96	12.34
	8H	13.80	14.21	14.85	15.26	16.66	9.59	10.00	10.64	11.05	12.45
	12H	13.89	14.26	14.96	15.33	16.74	9.65	10.02	10.72	11.09	12.50
8H	4H	13.08	13.49	14.13	14.54	15.94	9.32	9.73	10.37	10.78	12.18
	6H	13.64	13.98	14.71	15.07	16.47	9.83	10.18	10.91	11.27	12.67
	8H	13.86	14.16	14.94	15.23	16.65	10.03	10.33	11.11	11.40	12.82
	12H	13.99	14.26	15.08	15.33	16.79	10.14	10.41	11.23	11.48	12.94
12H	4H	13.03	13.40	14.09	14.46	15.87	9.32	9.69	10.39	10.76	12.16
	6H	13.62	13.91	14.70	14.99	16.41	9.88	10.18	10.97	11.26	12.68
	8H	13.83	14.10	14.92	15.17	16.63	10.09	10.36	11.18	11.43	12.89

END OF REPORT