

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P910245

Luminaire Tested: DFN2DIP-TR4F0-100D110US840-RLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P910245
REPORT IS A COMBINATION OF REPORTS P902028 AND P898849
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-TR4F0-100D110US840-RLLONL
Description: 4 foot, Triangle Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19581.2 lumens
Efficiency: N/A
Efficacy: 105.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.43' x L: 3.96' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 185.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9972
Total Harmonic Distortion (THDi): 0.128
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P910245

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US840-RLLONL

Luminous Intensity Polar Plot

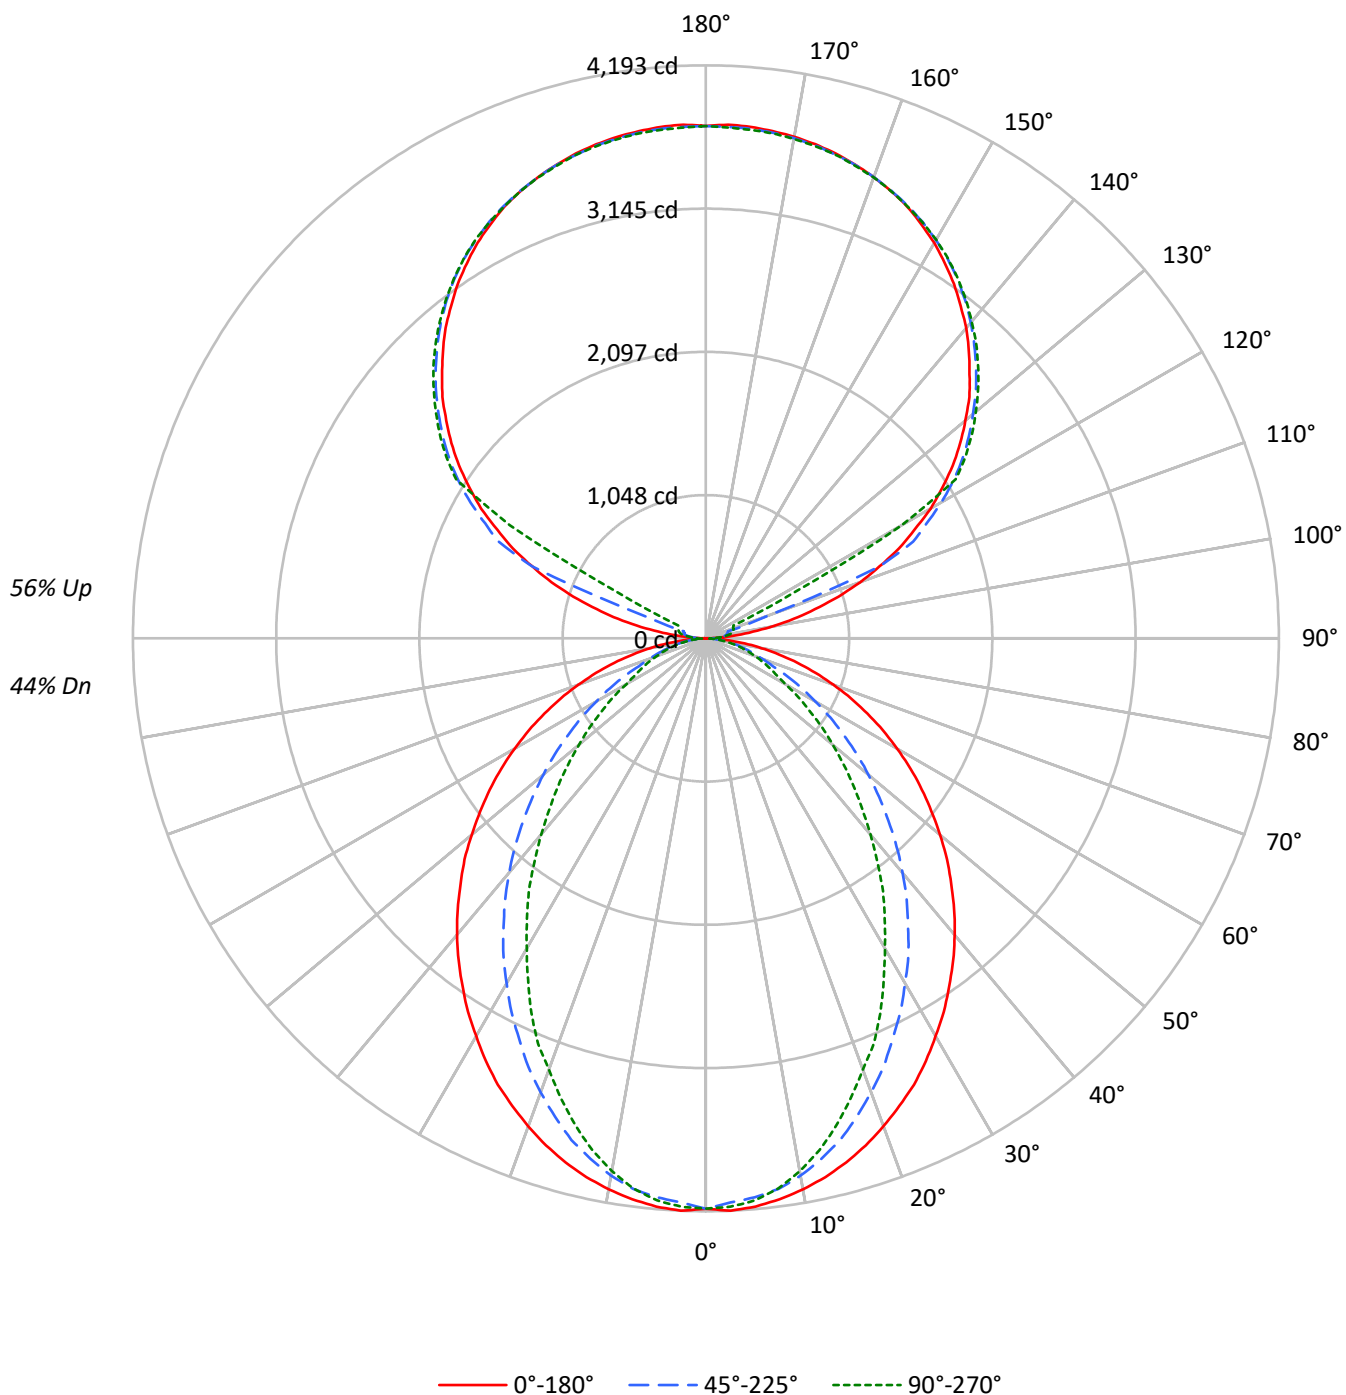

TEST NUMBER: P910245

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	50	50	50
1	97	93	89	86	89	85	82	79	71	68	66	57	56	55	45	44	43
2	89	81	76	71	81	75	70	66	62	59	56	51	48	46	40	39	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	40	36	34	32
4	74	64	56	51	68	59	52	47	49	45	41	41	37	34	33	30	28
5	68	57	49	44	62	53	46	41	44	39	35	37	33	30	30	27	25
6	63	51	44	38	58	47	41	36	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	37	31	27	30	26	24	25	22	20
8	54	42	35	30	50	39	33	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	26	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3316	3316	3316
5°	3321	3263	3284
10°	3288	3199	3177
15°	3243	3093	3012
20°	3183	2947	2809
25°	3122	2784	2613
30°	3040	2617	2365
35°	2959	2436	2147
40°	2877	2250	1896
45°	2781	2043	1670
50°	2683	1835	1448
55°	2580	1612	1236
60°	2461	1378	1017
65°	2324	1141	915
70°	2158	920	828
75°	1949	811	753
80°	1646	680	653
85°	1148	454	490

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2781 cd/sqm

TEST NUMBER: P910245

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	391.2	2.0
10°-20°	1073.8	5.5
20°-30°	1507.6	7.7
30°-40°	1643.4	8.4
40°-50°	1510.5	7.7
50°-60°	1186.3	6.1
60°-70°	772.1	3.9
70°-80°	397.5	2.0
80°-90°	108.1	0.6
90°-100°	123.6	0.6
100°-110°	460.8	2.4
110°-120°	1222.2	6.2
120°-130°	2027.1	10.4
130°-140°	2153.3	11.0
140°-150°	2001.2	10.2
150°-160°	1608.9	8.2
160°-170°	1036.7	5.3
170°-180°	356.8	1.8
0°-30°	2972.6	15.2
0°-40°	4616.1	23.6
0°-60°	7312.8	37.3
0°-90°	8590.4	43.9
90°-120°	1806.7	9.2
90°-150°	7988.3	40.8
90°-180°	10991.0	56.1
0°-180°	19581.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4174	4174	4174	4174	4174	
5°	4174	4155	4106	4140	4128	396
15°	3970	3928	3800	3728	3690	1119
25°	3604	3482	3233	3078	3022	1657
35°	3105	2912	2580	2342	2259	1943
45°	2538	2285	1889	1620	1530	1960
55°	1930	1636	1228	1001	929	1725
65°	1303	997	657	529	517	1292
75°	695	430	302	276	272	735
85°	162	83	72	72	72	186
90°	3	32	54	68	73	18
95°	176	87	106	120	117	209
105°	825	906	166	195	206	881
115°	1560	1606	1674	418	223	1536
125°	2205	2241	2292	2311	2319	1967
135°	2729	2773	2797	2824	2819	2108
145°	3166	3163	3209	3228	3215	1980
155°	3486	3462	3494	3510	3489	1606
165°	3673	3657	3665	3684	3665	1038
175°	3757	3738	3744	3763	3736	358
180°	3749	3749	3749	3749	3749	

TEST NUMBER: P910245

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4173.8	4173.8	4173.8	4173.8	4173.8
2.5°	4192.6	4173.8	4132.1	4170.1	4162.6
5°	4173.8	4154.9	4105.6	4139.7	4128.4
7.5°	4139.7	4117.2	4064.3	4079.1	4060.4
10°	4094.4	4067.9	3992.6	3981.0	3958.6
12.5°	4037.9	4003.8	3901.6	3879.2	3837.5
15°	3969.8	3928.1	3799.8	3728.1	3690.5
17.5°	3890.4	3829.9	3671.3	3588.3	3527.8
20°	3799.8	3724.1	3535.3	3441.2	3357.8
22.5°	3701.7	3614.7	3395.5	3267.3	3210.8
25°	3603.5	3482.5	3233.2	3078.5	3021.6
27.5°	3486.5	3357.8	3082.1	2904.6	2817.6
30°	3361.8	3217.9	2915.8	2723.5	2621.3
32.5°	3240.9	3066.9	2757.5	2530.7	2436.1
35°	3104.9	2912.3	2580.0	2342.0	2258.6
37.5°	2972.7	2764.7	2413.7	2152.8	2058.6
40°	2832.9	2606.5	2239.8	1971.7	1873.5
42.5°	2689.4	2447.7	2066.3	1786.6	1692.3
45°	2538.3	2285.0	1888.8	1620.2	1529.6
47.5°	2394.9	2126.8	1718.8	1450.3	1367.4
50°	2236.1	1968.0	1552.5	1291.6	1212.6
52.5°	2081.0	1797.8	1393.8	1144.5	1072.8
55°	1930.0	1635.5	1227.5	1001.1	929.3
57.5°	1775.3	1473.1	1080.5	868.8	808.3
60°	1616.6	1314.4	925.3	733.0	672.5
62.5°	1461.9	1159.7	793.0	612.0	581.9
65°	1303.2	997.0	657.2	529.0	517.4
67.5°	1152.2	846.0	529.0	464.4	453.2
70°	993.4	698.9	438.0	400.3	385.2
72.5°	842.3	562.6	366.3	336.2	328.6
75°	694.9	430.4	302.2	275.7	272.1
77.5°	547.9	305.8	238.0	222.8	215.2
80°	411.5	219.2	181.2	166.3	166.3
82.5°	286.9	147.4	124.6	117.0	117.0
85°	162.3	82.9	71.7	71.7	71.7
87.5°	60.5	30.1	30.1	26.5	26.5
90°	2.6	32.5	54.1	68.0	73.1
92.5°	68.0	57.1	65.0	70.6	73.1
95°	176.2	86.6	105.6	119.5	116.6
97.5°	317.3	95.0	138.1	146.5	149.2
100°	480.3	108.6	154.6	176.2	181.7
102.5°	659.0	653.9	160.1	189.8	198.1
105°	824.7	906.2	165.6	195.2	206.2
107.5°	1017.3	1084.9	171.1	200.7	211.7
110°	1201.8	1258.6	474.8	203.6	214.2



TEST NUMBER: P910245

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1375.5	1424.1	1378.1	208.7	217.1
115°	1559.7	1605.8	1673.9	417.8	222.6
117.5°	1719.9	1774.0	1820.4	1432.2	721.5
120°	1899.0	1939.5	1988.5	2021.0	1654.8
122.5°	2050.7	2094.2	2148.6	2164.7	2167.7
125°	2205.3	2240.8	2292.3	2311.3	2319.4
127.5°	2346.4	2384.4	2425.3	2452.4	2455.0
130°	2479.4	2522.9	2552.5	2582.5	2580.0
132.5°	2615.0	2650.5	2680.2	2704.6	2702.1
135°	2729.2	2772.6	2796.7	2824.2	2818.6
137.5°	2848.3	2880.8	2908.2	2935.3	2927.2
140°	2965.0	2986.8	3016.5	3040.9	3027.4
142.5°	3062.8	3081.8	3116.9	3138.6	3125.0
145°	3165.9	3163.0	3209.0	3228.1	3214.6
147.5°	3255.2	3247.1	3293.2	3306.7	3296.1
150°	3342.2	3323.2	3366.6	3382.7	3369.2
152.5°	3415.3	3393.7	3434.2	3450.7	3431.7
155°	3485.9	3461.6	3494.1	3510.3	3488.7
157.5°	3542.8	3521.2	3545.7	3564.7	3542.8
160°	3591.8	3575.3	3591.8	3607.8	3588.9
162.5°	3634.9	3618.9	3632.4	3651.4	3626.9
165°	3673.0	3656.8	3664.9	3683.9	3664.9
167.5°	3702.9	3686.5	3694.9	3713.9	3689.4
170°	3727.4	3711.0	3716.4	3735.5	3711.0
172.5°	3743.5	3727.4	3732.9	3751.9	3727.4
175°	3757.0	3738.0	3743.5	3762.6	3735.5
177.5°	3762.6	3743.5	3746.4	3765.4	3740.9
180°	3749.0	3749.0	3749.0	3749.0	3749.0

TEST NUMBER: P910245

CATALOG NUMBER: DFN2DIP-TR4F0-100D110US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.71	11.49	11.72	12.51	13.87	6.68	7.46	7.69	8.48	9.84
	3H	12.38	13.08	13.40	14.11	15.49	7.87	8.56	8.89	9.59	10.97
	4H	12.99	13.65	14.02	14.68	16.07	8.31	8.98	9.35	10.01	11.39
	6H	13.40	14.01	14.45	15.05	16.45	8.63	9.24	9.68	10.28	11.68
	8H	13.53	14.11	14.58	15.16	16.55	8.72	9.30	9.78	10.35	11.75
	12H	13.59	14.14	14.65	15.19	16.60	8.77	9.32	9.82	10.36	11.78
4H	2H	10.72	11.38	11.76	12.41	13.80	7.27	7.93	8.31	8.96	10.35
	3H	12.54	13.09	13.59	14.15	15.55	8.62	9.17	9.67	10.23	11.62
	4H	13.23	13.74	14.29	14.79	16.21	9.16	9.67	10.22	10.72	12.14
	6H	13.75	14.18	14.81	15.25	16.67	9.58	10.01	10.65	11.09	12.50
	8H	13.92	14.32	14.99	15.39	16.82	9.71	10.11	10.78	11.18	12.61
	12H	14.01	14.38	15.10	15.46	16.89	9.77	10.14	10.86	11.22	12.65
8H	4H	13.20	13.60	14.27	14.67	16.10	9.44	9.84	10.51	10.91	12.34
	6H	13.76	14.10	14.85	15.20	16.63	9.96	10.29	11.05	11.40	12.83
	8H	13.98	14.27	15.08	15.36	16.81	10.15	10.44	11.25	11.53	12.98
	12H	14.11	14.37	15.21	15.46	16.95	10.27	10.52	11.37	11.61	13.10
12H	4H	13.15	13.51	14.23	14.59	16.03	9.44	9.81	10.53	10.89	12.32
	6H	13.74	14.03	14.83	15.12	16.57	10.01	10.30	11.10	11.39	12.84
	8H	13.96	14.21	15.06	15.30	16.79	10.22	10.47	11.32	11.56	13.05

END OF REPORT